


# PARK PATHWAY LIGHTING SCHEMATIC

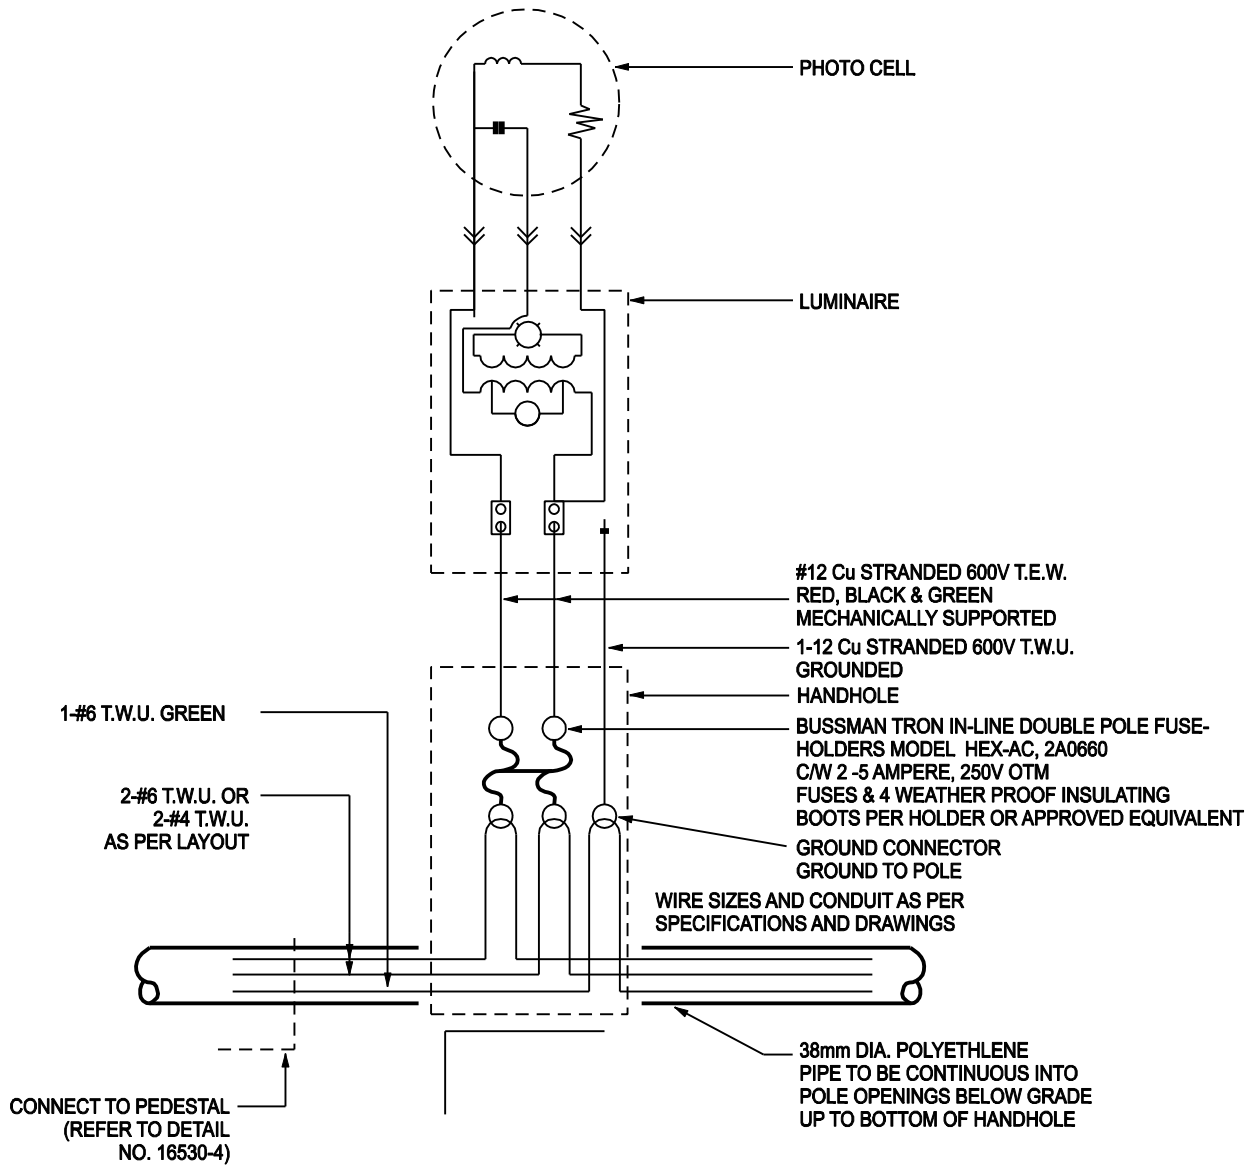

**NOTES:**

1. DESIGNED AS PER LOAD REQUIREMENTS BY CERTIFIED ELECTIRCAL ENGINEER
2. WIRING/CONDUIT TO HAVE 150mm WIDE YELLOW PLASTIC CAUTION TAPE LAID 300mm ABOVE DURING BACKFILLING.
3. ARRANGE INSPECTIONS OF WORK PER SPECIFICATION.

NO.	REVISION	DATE
2.	21JULY05 - REVISED/ADD DOUBLE POLE FUSE-HOLDER	
1.	29MAR04 - ADD CAUTION TAPE AND INSPECTION NOTE	



SCALE: N.T.S.  
 DATE: 24 MAY 2002  
 DRAWN BY: P & H  
 NUMBER: 16530-2