METRIC

ALL DIMENSIONS IN MILLIMETRES

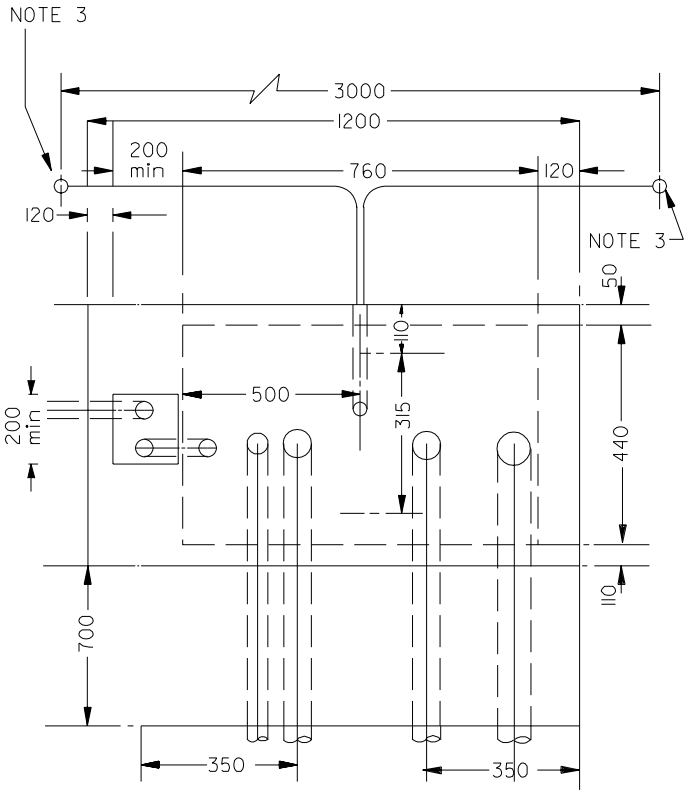


## NOTES

1. ALL ANCHOR BOLTS 19 mm X 450 mm WITH 90° BEND (2 REQUIRED).
2. 100 mm RIGID PVC CONDUIT. CONTINUOUS TO FIELD HANDWELLS AS PER STD DWG 2060.130
3. 19 mm X 3000 LONG GROUND ROD (SPEC. ONTARIO HYDRO ELECTRICAL SAFETY CODE, LATEST EDITION).
4. 30.0 MPa CONCRETE
5. ALL DIMENSIONS IN mm.
6. CONCRETE BASE SHALL BE LEVEL.
7. 50 mm RIGID PVC CONDUIT FOR POWER SERVICE.
8. 25 mm RIGID PVC COND. FOR WIRE CONNECTION TO GROUND ROD.
9. 32 mm FLEXIBLE PVC CONDUIT FOR BELL LINES
10. 75 mm RIGID PVC CONDUIT SPARE

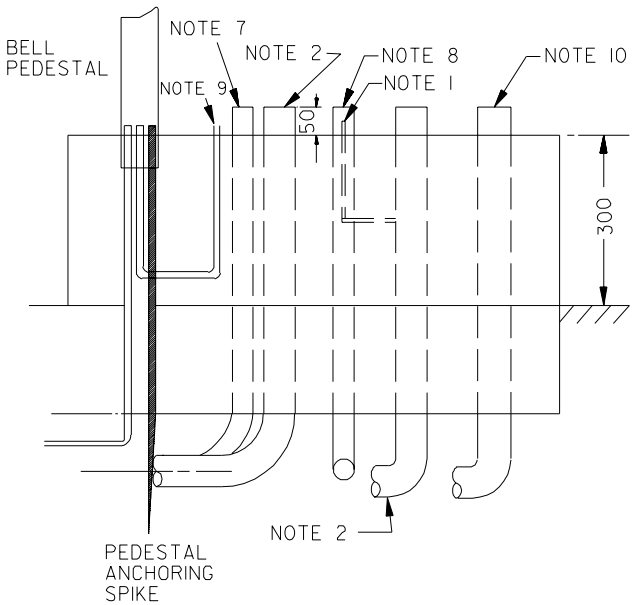


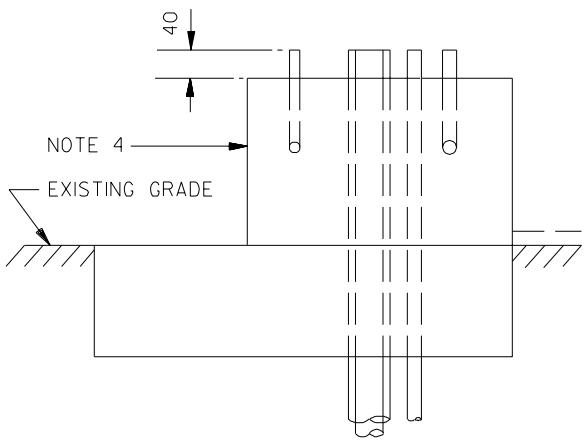


MISSISSAUGA Transportation and Works

# STANDARD

# CONCRETE BASE FOR CONTROLLER CABINET

| | | | |
|---|---|---|---|
| EFF. DATE | 2002-01-01 | SCALE | N.T.S. |
| REV. | | STANDARD No. | 2600.041 |