


**METRIC**  
ALL DIMENSIONS IN METRES

**NOTES**

1. HYDRO, GAS, TELECOMMUNICATIONS AND SL CORRIDOR TO HAVE A MINIMUM COVER OF 0.965m.
2. WATERMAIN TO HAVE A MINIMUM COVER OF 1.7m.
3. IF UTILITIES CANNOT BE INSTALLED ACCORDING TO THIS STANDARD THEY ARE TO BE INSTALLED AS CLOSE AS POSSIBLE TO THE PRESCRIBED LOCATION SUBJECT TO THE APPROVAL OF THE TRANSPORTATION AND WORKS DEPARTMENT OF THE CITY OF MISSISSAUGA.
4. A 0.4m - 0.6m CLEARANCE MUST BE MAINTAINED BETWEEN CABLES AND HYDRANTS.
5. A 0.3m CLEARANCE MUST BE MAINTAINED BETWEEN WATERMAINS AND UTILITY POLES.
6. SIDEWALKS REQUIRED ON ONE SIDE ONLY ON STREETS OTHER THAN CUL-DE-SACS.
7. SIDEWALKS REQUIRED ON ONE SIDE ONLY ON CUL-DE-SACS SERVICING DEVELOPMENTS OTHER THAN SINGLE FAMILY OR SEMI-DETACHED DWELLINGS OR WHERE SIDEWALKS WILL FORM PART OF A WALKWAY SYSTEM.
8. SIDEWALKS WILL NOT BE REQUIRED ON CUL-DE-SACS SERVICING SINGLE FAMILY OR SEMI-DETACHED DWELLINGS.
9. ROAD WIDTH IS MEASURED FROM FACE OF CURB TO FACE OF CURB AS DEFINED ON OPSD STD. 600.040 CURB & GUTTER. PAVEMENT WIDTH IS MEASURED FROM EDGE OF PAVEMENT (EP) TO EDGE OF PAVEMENT (EP).
10. FOR LOCATION OF GAS MAIN WITHIN UTILITY CORRIDOR REFER TO STD. 2211.280

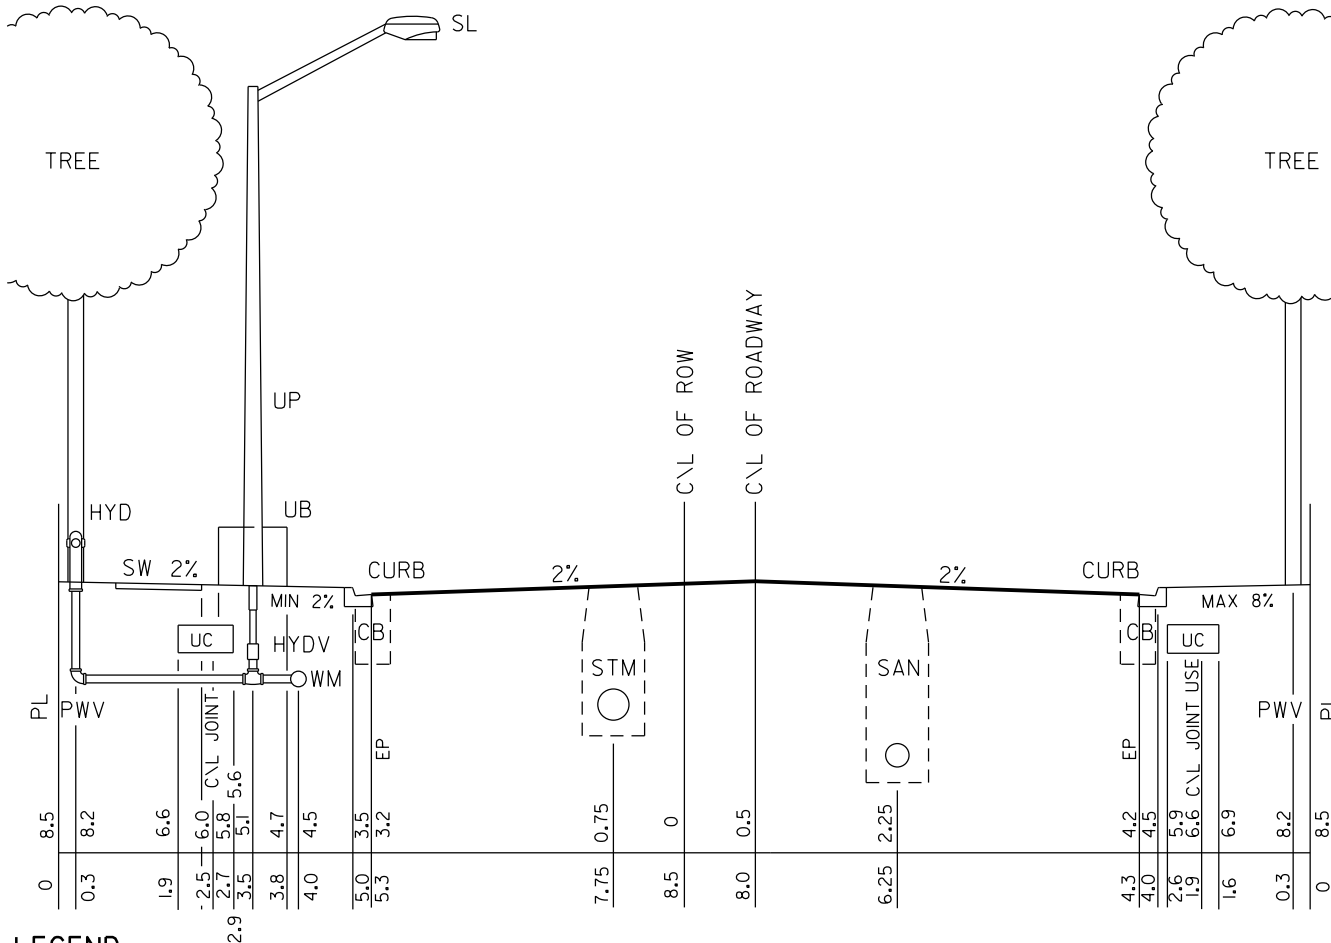


**LEGEND**

- EP - EDGE OF PAVEMENT
- CB - CATCH BASIN
- CURB - CURB OR CURB AND GUTTER
- C/L - CENTRELINE
- GAS - GAS MAIN
- HYD - FIRE HYDRANT
- HYDV - FIRE HYDRANT VALVE
- PWV - PRIVATE WATER VALVE
- PL - PROPERTY LINE
- SL - STREETLIGHT
- SW - SIDEWALK
- SAN - SANITARY SEWER
- STM - STORM SEWER
- UB - UTILITY BOX (HYDRO, TELECOMMUNICATIONS)
- UC - UTILITY CORRIDOR (HYDRO, TELECOMMUNICATIONS, SL, GAS)
- UP - UTILITY POLE
- WM - WATERMAIN

DISTANCE FROM  
C/L OF ROW

DISTANCE FROM  
PROPERTY LINE



**MISSISSAUGA**

---

**STANDARD**

**MINOR LOCAL RESIDENTIAL ROAD**

**8.0m ROAD ON 17m ROW**

EFF. DATE	2002-01-01	SCALE	N.T.S.
REV.	8	2015-06-04	STANDARD No. 2211.060