


TYPE 'A'

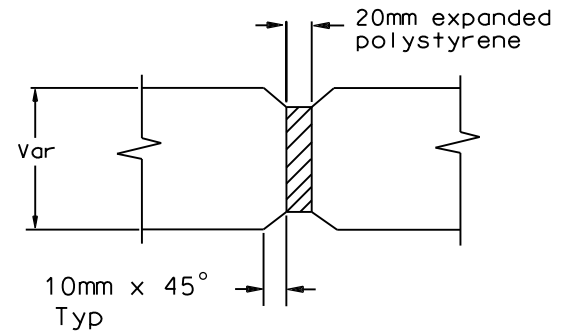

CONTRACTION JOINT
IN CONCRETE TOE WALLS

NOTES :

- 1. ALL EXCAVATION FOR TOE WALLS TO BE BACKFILLED WITH GRANULAR 'A' MATERIAL.
- 2. SIDEWALK AND EXPANSION JOINT AS OPSD-303.03.
- A A CONTRACTION JOINT IS TO BE PROVIDED EVERY 3.0 METRES.
- B A CLASS OF CONCRETE: 32 MPa.
- C ALL DIMENSIONS ARE IN MILLIMETRES UNLESS OTHERWISE SHOWN.



MINI CONCRETE TOE WALLS

EFF. DATE 2017-07-18 SCALE N.T.S.

STANDARD No. 2230.040