


METRIC
ALL DIMENSIONS IN MILLIMETRES



PLAN

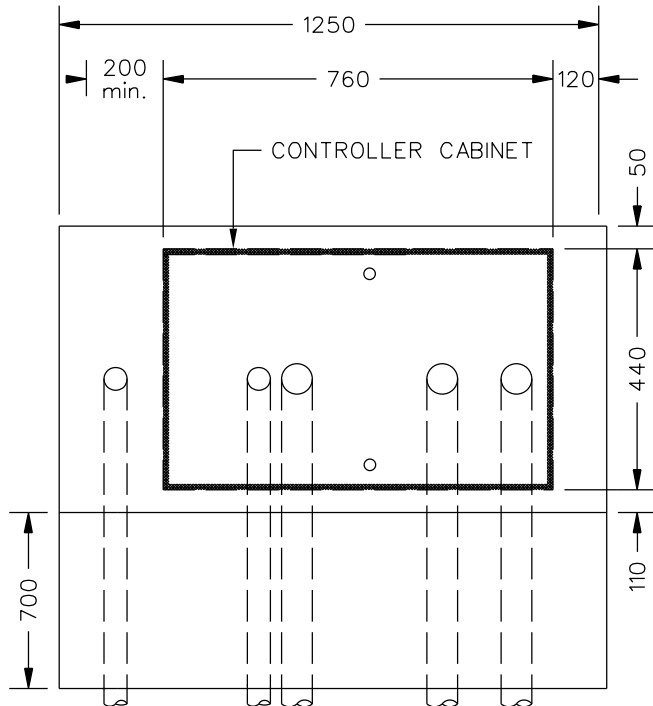

NOTES:

1. ALL ANCHOR BOLTS 19 mm X 450 mm WITH 90° BEND (2 REQUIRED)
2. 100mm RIGID PVC CONDUIT CONTINUOUS TO FIELD HANDWELLS AS PER STD DWG'S
3. CONCRETE TO ATTAIN A COMPRESSIVE STRENGTH OF AT 28 DAYS, AIR CONTENT TO BE 7%, ±1.5% 30.0 MPa CONCRETE
4. CONCRETE BASE SHALL BE LEVEL
5. 50 mm RIGID PVC CONDUIT FOR POWER SERVICE
6. 50 mm RIGID PVC CONDUIT FOR COMMUNICATIONS (AS PER DESIGN DRAWING, OR FIELD LAYOUT)
7. ALL CONCRETE SHALL BE THOROUGHLY COMPACTED SHALL CONSOLIDATE THE FULL DEPTH AND WIDTH BY MEANS OF APPROVED VIBRATORS. THE VIBRATOR OF THE CONCRETE TO A UNIFORM MASS WITHOUT SEGREGATION AND FREE FROM EXCESSIVE SURFACE MORTAR AT A SINGLE PASSAGE OF THE VIBRATING MACHINE
8. FINISHED GRADE TO BE A MINIMUM OF 50mm BELOW TOP OF CONCRETE BASE
9. CONTROLLER PAD TO BE EXTENDED TO EXISTING SIDEWALK

SIDE ELEVATION

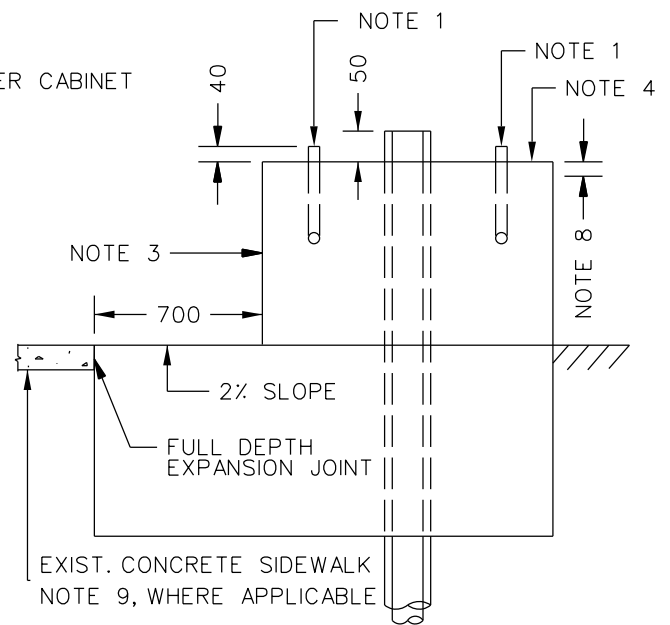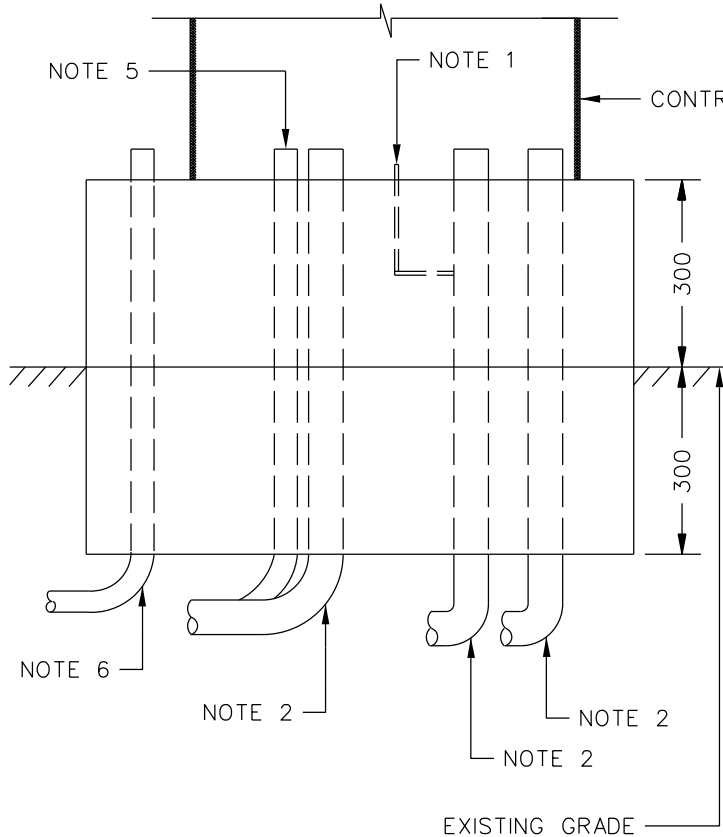

FRONT ELEVATION



STANDARD CONCRETE BASE
 FOR CONTROLLER CABINET

EFF. DATE	SCALE	N.T.S.
REV. 6	2020-07-07	STANDARD No. 2600.041