


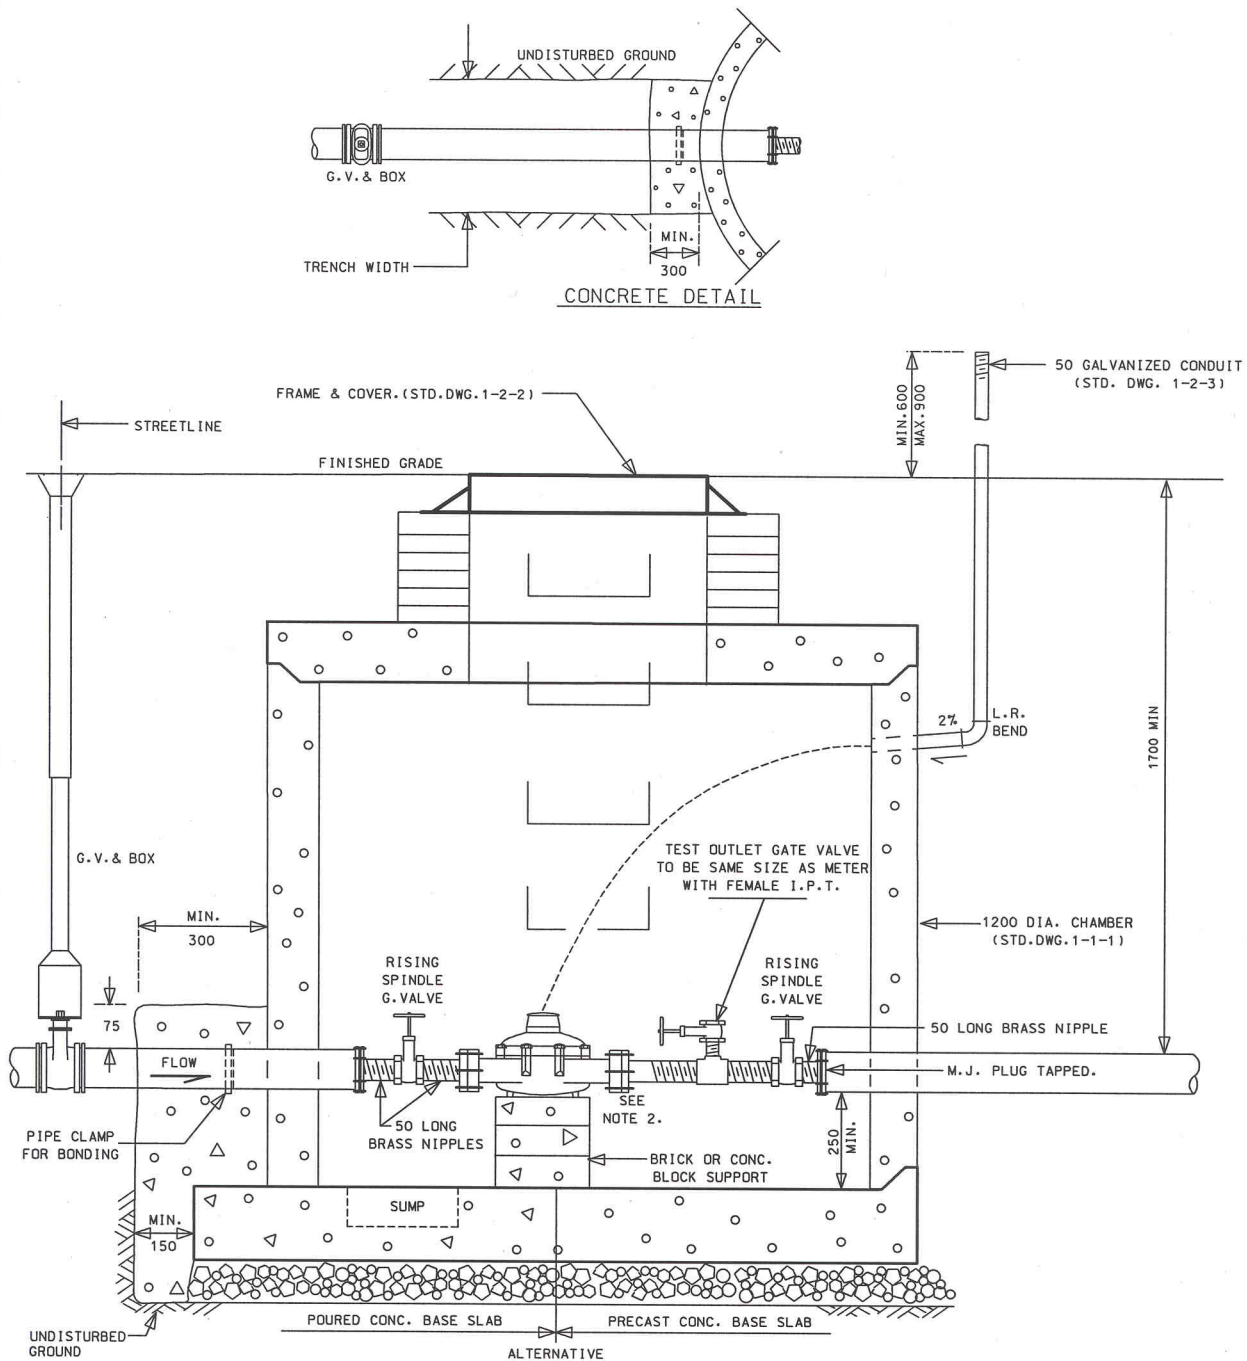

NOTE

1. 50mm GALVANIZED CONDUIT TO BE INSTALLED FROM INSIDE CHAMBER WALL TO A SUITABLE LOCATION 2000mm MIN. OUTSIDE TRAFFIC AREA, AS PER STD. DWG. 1-2-3.
2. IF OPTIONAL BYPASS IS NOT INSTALLED, THEN SHUTDOWN OF SERVICE WILL OCCUR FOR MAINTENANCE AND REPAIR DURING NORMAL BUSINESS HOURS.
3. NO EXTRUDED COPPER (SOLDERED) OR GALVANIZED FITTINGS TO BE USED. ALL FITTINGS TO BE BRASS.
4. TEST VALVE MUST BE LOCATED BETWEEN THE OUTLET SIDE OF THE METER AND THE OUTLET SIDE ISOLATION VALVE.

Region of Peel
Working for you

PUBLIC WORKS
STANDARD DRAWING

REV. DATE: MARCH 1998

APPROVED BY

DRAWN BY

B.N./I.F.

38 AND 50 T-10 METER CHAMBER
INSTALLATION ON D.I. OR P.V.C. WATERMAIN

STD. DWG. 1-4-6

SCALE
N.T.S.