


15430-1

Water Service Yard Hydrant

NOTE:

TO BE USED AS A GUIDELINE ONLY.
NOT TO SCALE. REMOVE CITY TITLE BLOCK
AND REDRAW TO REPRESENT SITE SPECIFIC
CONDITIONS. ALL SITE SPECIFIC CONDITIONS
ARE TO BE CONFIRMED BY THE PROJECT
CONSULTANT.

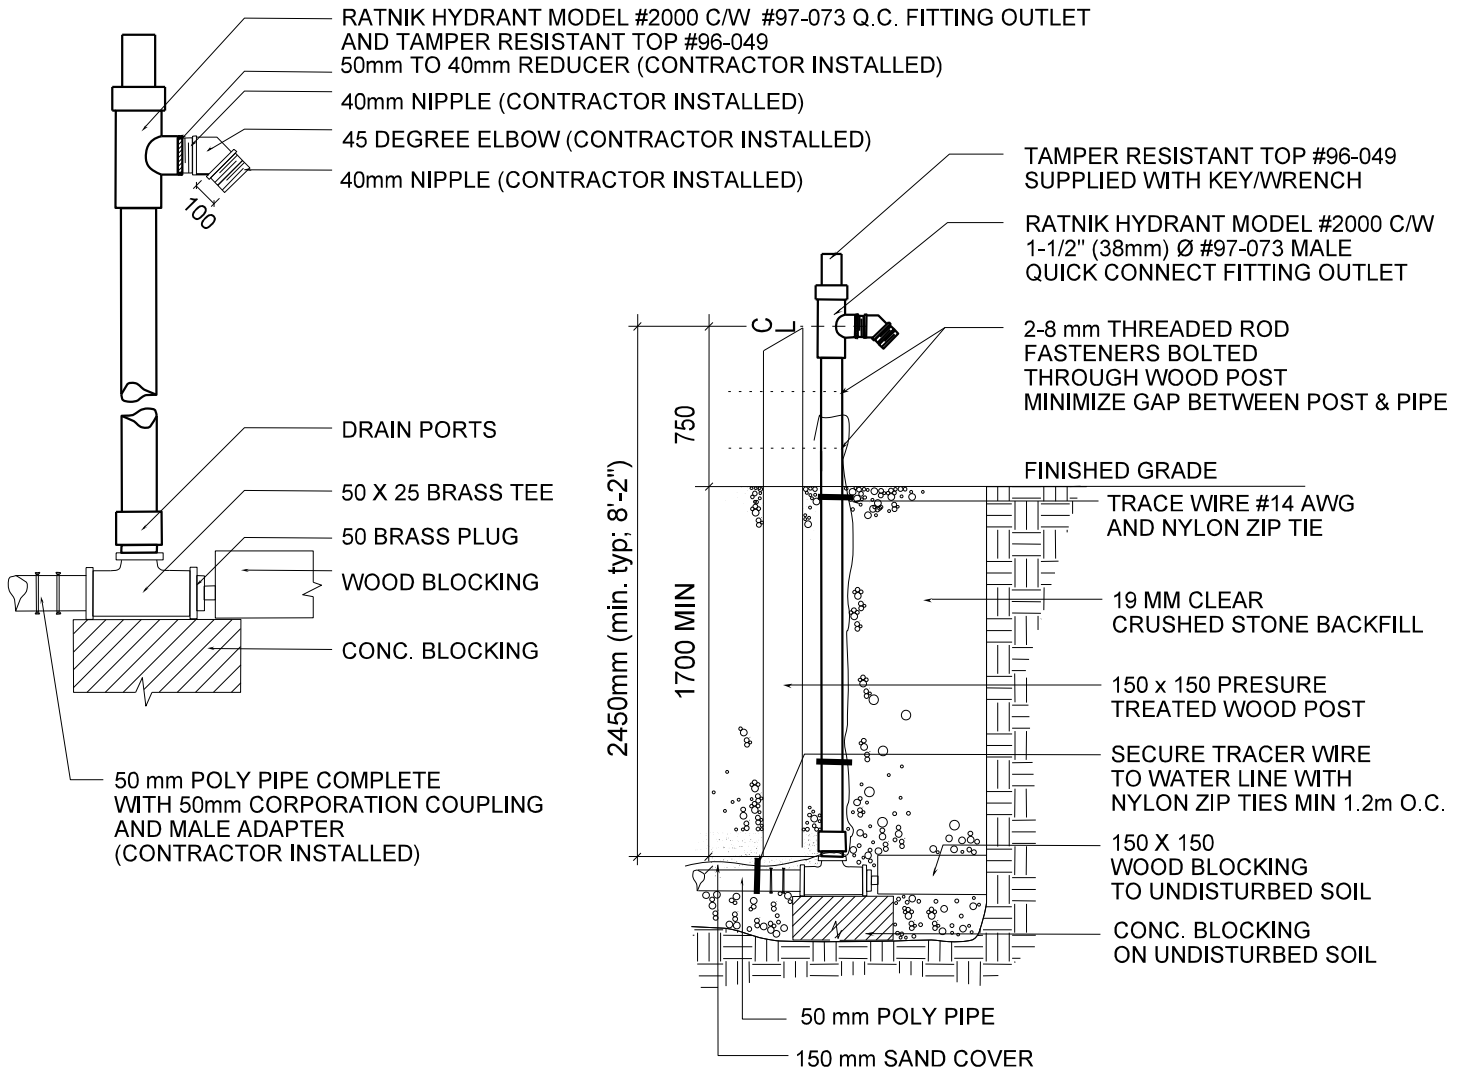

NOTES:

1. CONTRACTOR TO SUPPLY AND INSTALL MODIFICATIONS TO RATNIK HYDRANT TO PERMIT CONNECTIONS (REDUCER, NIPPLES, AND ELBOW AS NOTED.)
2. ALL BLOCKING AND WOOD POST SHALL REST ON UNDISTURBED SOIL.
3. HYDRANT TO BE SUPPLIED BY RATNIK INDUSTRIES OR APPROVED EQUAL (SEE SPECIFICATIONS).
4. ALL DIMENSIONS ARE IN MILLIMETRES.
5. REMOVEABLE RATNIK HYDRANT WRENCH (OR 'KEY') TO BE PROVIDED TO COMMUNITY SERVICES AFTER DEMONSTRATION OF HYDRANT FUNCTIONING, PRIOR TO ISSUANCE OF SUBSTANTIAL PERFORMANCE.

N.T.S.