


ELECTRICAL POWER PEDESTAL - SCHEMATIC

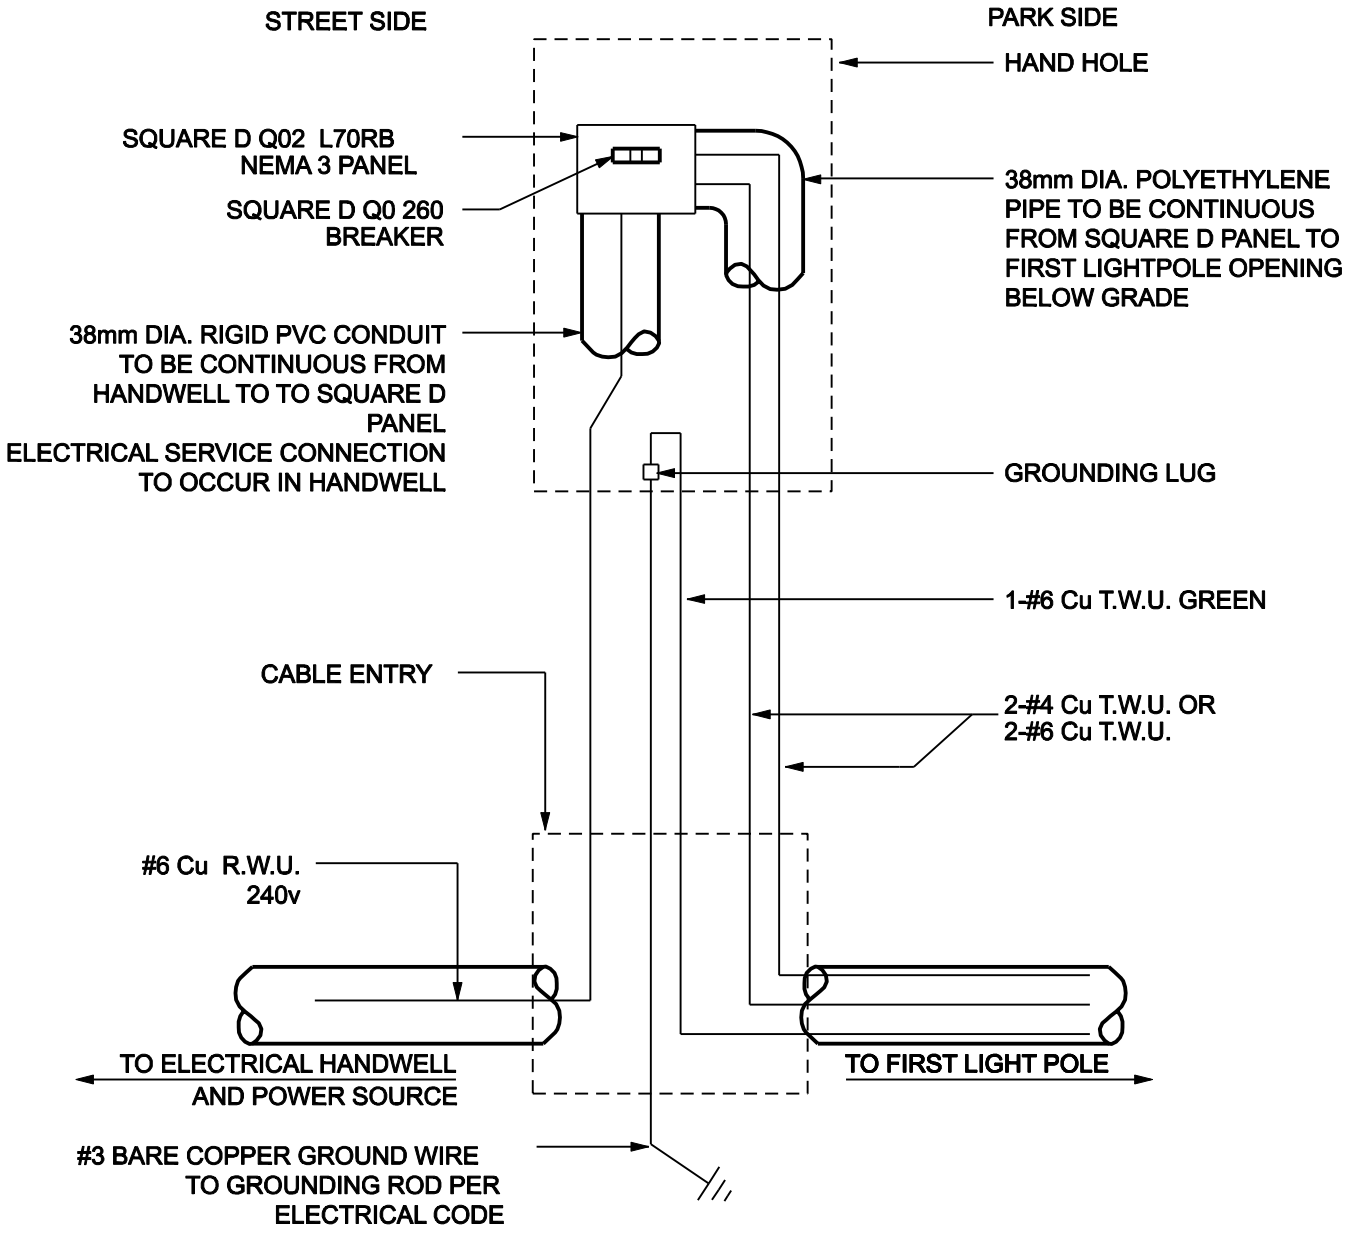

NOTES:

1. REFER TO DETAIL NO. 16530-3 FOR LOCATION OF POWER PEDESTAL AND ELECTRICAL HANDWELL.
2. ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED.
3. ELECTRICAL CONNECTION TO BE MADE IN HANDWELL PARK ELECTRICAL CONTRACTOR.
4. WIRING/CONDUIT TO HAVE 150mm WIDE CONTINUOUS YELLOW PLASTIC CAUTION TAPE LAID 300mm ABOVE DURING BACKFILLING.
5. ARRANGE INSPECTIONS OF WORK PER SPECIFICATION.

NO. REVISION DATE

1. 22APR04 - HANDWELL, CONNECTION REFERENCE, CAUTION TAPE & INSPECTION
2. 16JUN04 - TERMINAL BLOCK TO HANDWELL, CONDUIT & PANEL CHANGE
3. 13FEB05 - INCOMING SERVICE PER ENERSOURCE



SCALE: N.T.S.
 DATE: JANUARY 2001
 DRAWN BY: P & H
 NUMBER: 16530-5