


# 16530-13

## Lighting and Electrical In Ground Direct Buried Power Pedestal

**NOTE:**  
TO BE USED AS A GUIDELINE ONLY.  
NOT TO SCALE. REMOVE CITY TITLE BLOCK  
AND REDRAW TO REPRESENT SITE SPECIFIC  
CONDITIONS. ALL SITE SPECIFIC CONDITIONS  
ARE TO BE CONFIRMED BY THE PROJECT  
CONSULTANT.

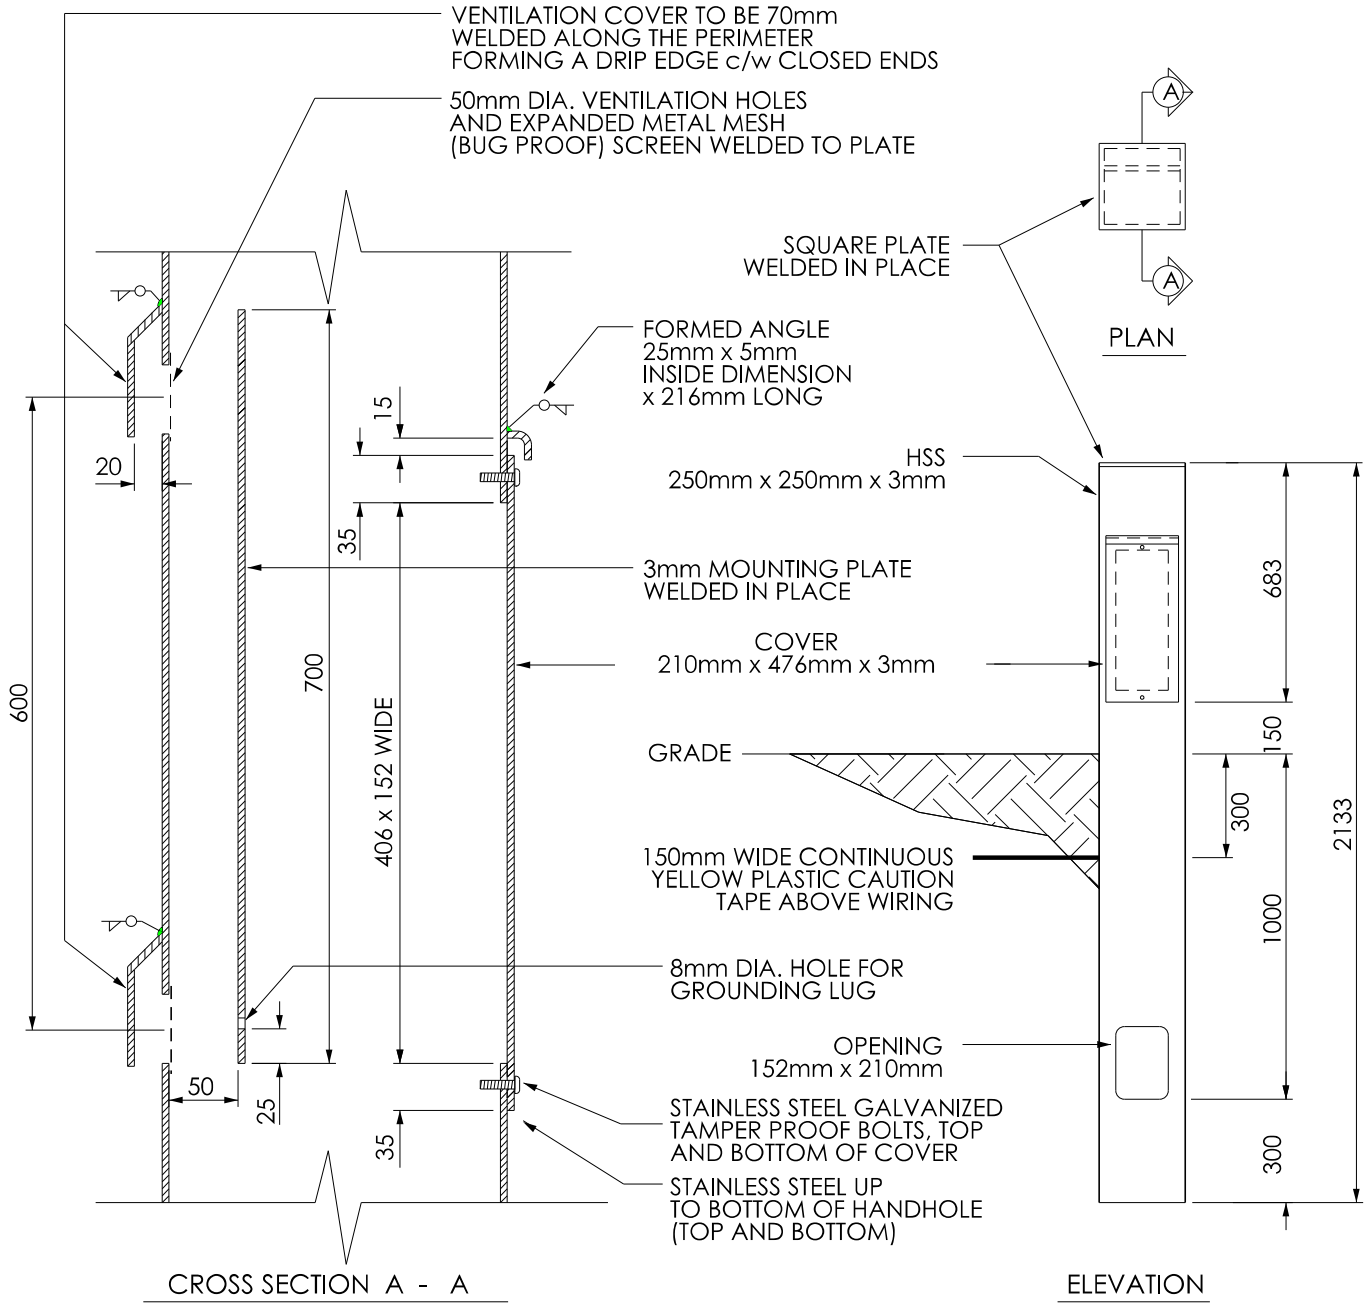

**NOTES:**

1. ALL EXPOSED EDGES ARE TO BE GROUND SMOOTH.
2. PEDESTAL TO BE HOT DIP GALVANIZED AFTER FABRICATION.
3. PAINT TO BE POLYESTER POWDER COAT PER SPECIFICATION.
4. ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED.
5. ARRANGE INSPECTIONS OF WORK PER SPECIFICATION.

N.T.S.