


16530-14

Lighting and Electrical Power Pedestal Schematic Direct Buried

NOTE:
TO BE USED AS A GUIDELINE ONLY.
NOT TO SCALE. REMOVE CITY TITLE BLOCK
AND REDRAW TO REPRESENT SITE SPECIFIC
CONDITIONS. ALL SITE SPECIFIC CONDITIONS
ARE TO BE CONFIRMED BY THE PROJECT
CONSULTANT.

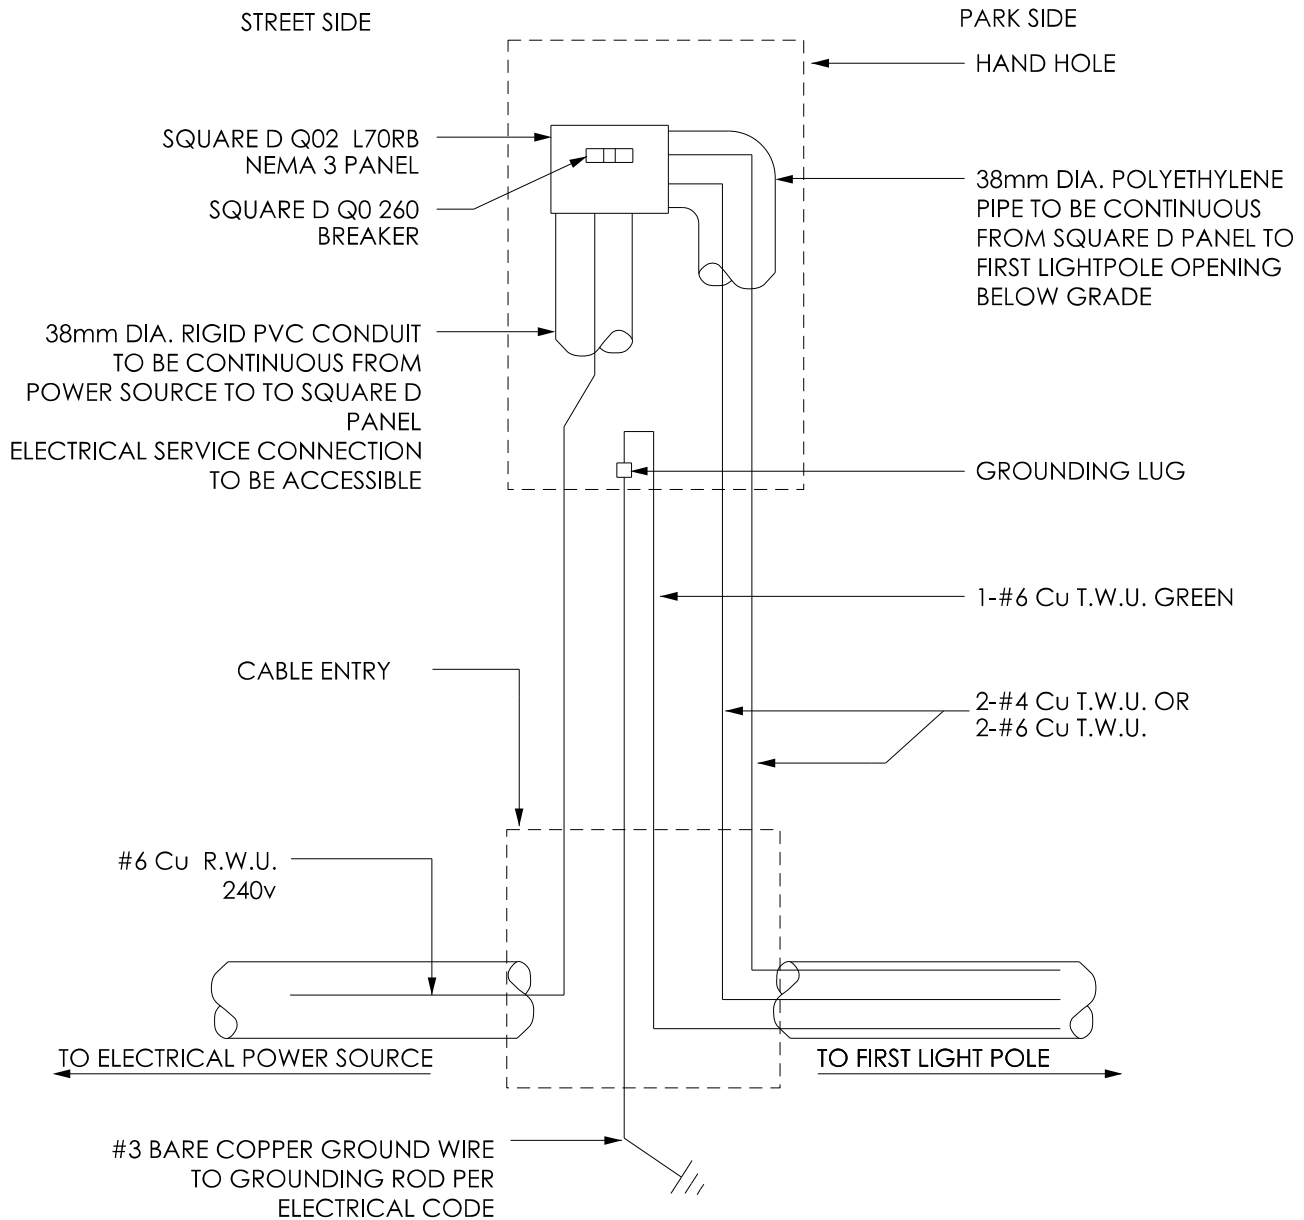

NOTES:

1. REFER TO DETAIL NO. 16530-3 FOR LOCATION OF POWER PEDESTAL.
2. ALL MEASUREMENTS ARE IN MILLIMETRES UNLESS OTHERWISE NOTED.
3. ELECTRICAL CONNECTION TO BE MADE BY PARK ELECTRICAL CONTRACTOR/ENERSOURCE.
4. WIRING/CONDUIT TO HAVE 150mm WIDE CONTINUOUS YELLOW PLASTIC CAUTION TAPE LAID 300mm ABOVE DURING BACKFILLING.
5. ARRANGE INSPECTIONS OF WORK PER SPECIFICATION.

N.T.S.