


# 02950-1


## Planting Tree Deciduous

**NOTE:**  
TO BE USED AS A GUIDELINE ONLY.  
NOT TO SCALE. REMOVE CITY TITLE BLOCK  
AND REDRAW TO REPRESENT SITE SPECIFIC  
CONDITIONS. ALL SITE SPECIFIC CONDITIONS  
ARE TO BE CONFIRMED BY THE PROJECT  
CONSULTANT.

PLAN OF GUYING:

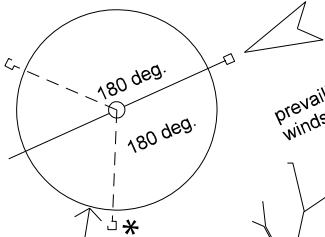

ROOTBALL

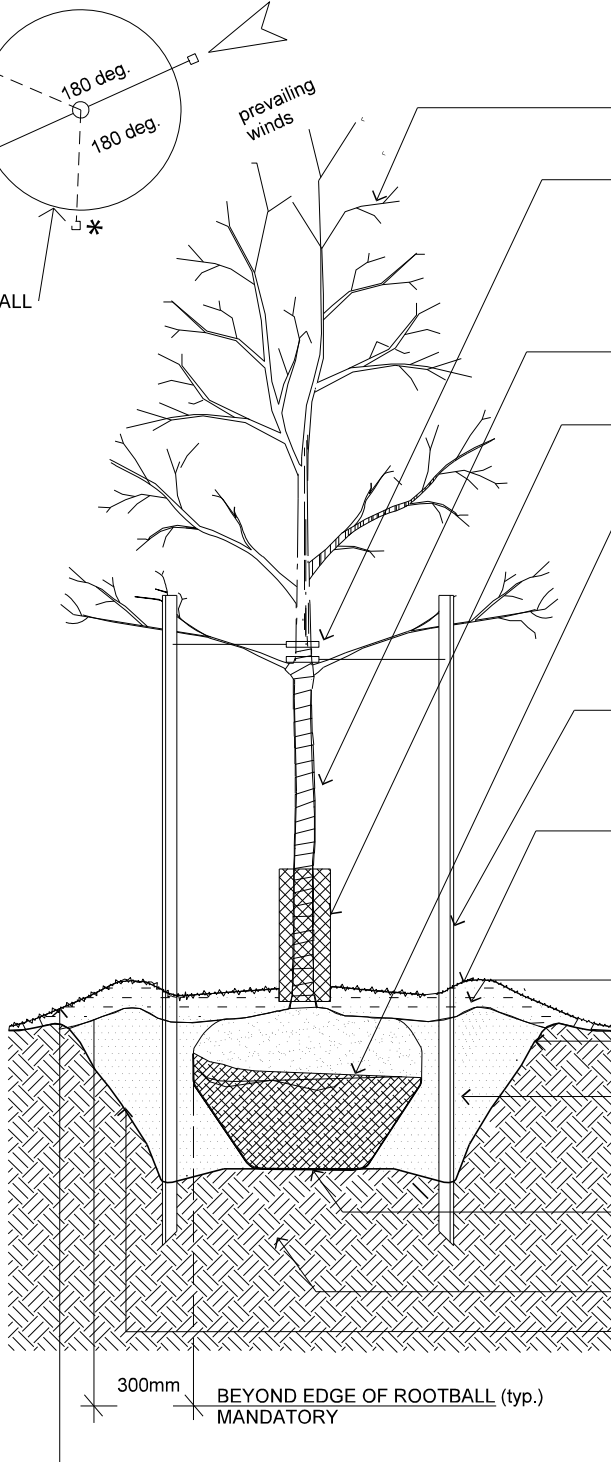

PRUNE ONLY DEAD, DAMAGED OR INTERFERING BRANCHES. LEADERS ARE NOT TO BE CUT.

PLACE AND MAINTAIN TREE IN PLUMB, UPRIGHT POSITION  
TREE TIES TO BE FASTENED AROUND THE TREE ABOVE  
LOWER BRANCHES IN FIGURE EIGHT WITH NO. 11 GAUGE  
SUPPORT WIRE TO BE FULLY ENCASED WITH 25mm DIA.  
2-PLY RUBBER HOSE ALL MATERIALS TO BE NEW  
ENSURE 25mm SPACE BETWEEN HOSE AND TREE TRUNK

REMOVE ALL TREE WRAP AND SHIPPING GAURDS  
UPON INSTALLATION

FLEXI-PIPE PLASTIC GUARD (500mm HIGH BY 100mm DIA.)  
SIDE SPLIT VERTICALLY

CUT AND REMOVE TOP 1/3 OF BURLAP WRAP TOP  
1/3 OF WIRE BASKETS TO BE CUT AND REMOVED  
ENTIRELY FROM ROOTBALL, AND DISPOSED OF OFF-SITE.

NEW STAKES AS PER CONTRACT REQUIREMENTS TO BE  
SUNK FIRMLY INTO SUBSOIL

SHREDDED PINE BARK MULCH LAYER TO A MIN.  
75mm SETTLED DEPTH  
NO LESS THAN 90% PINE BARK  
NO MORE THAN 10% WOOD FIBRE  
MAX. COMPONENT SIZE 150mm LONG  
KEEP MULCH AWAY FROM TRUNK AS PER SPECIFICATIONS

EARTH SAUCER MIN 100mm HIGH AROUND  
EXCAVATED AREA

TREE PIT TO BE EXCAVATED AS PER SPECIFICATIONS

BACKFILL WITH 50% NATIVE SOIL AND 50% PLANTING SOIL  
MIX AS PER SPECIFICATIONS, THOROUGHLY COMBINED

DEPTH OF PLANTING PIT TO BE APPROVED  
BY COMMUNITY SERVICES PROJECT MANAGER  
ROOTBALL TO BE 70mm ABOVE SURROUNDING  
GRADE TO ALLOW FOR SETTLEMENT

UNDISTURBED SUBSOIL

TAPER AND SCARIFY PIT SIDES TO MIN DEPTH OF 150mm (6")  
SCARIFY PIT BOTTOM TO MIN DEPTH OF 38mm (1-1/2")

VERTICALLY CRACK SOIL AROUND TREE PIT RADIALLY BY HAND USING  
SHOVEL TO IMPROVE INFILTRATION AND ROOT PENETRATION, MIN. 8 X  
PER TREE. RADIAL CRACKS TO BE EVENLY SPACED.

**N.T.S.**