


02950-8

Planting Tree On Slope

NOTE:

TO BE USED AS A GUIDELINE ONLY.
NOT TO SCALE. REMOVE CITY TITLE BLOCK
AND REDRAW TO REPRESENT SITE SPECIFIC
CONDITIONS. ALL SITE SPECIFIC CONDITIONS
ARE TO BE CONFIRMED BY THE PROJECT
CONSULTANT.

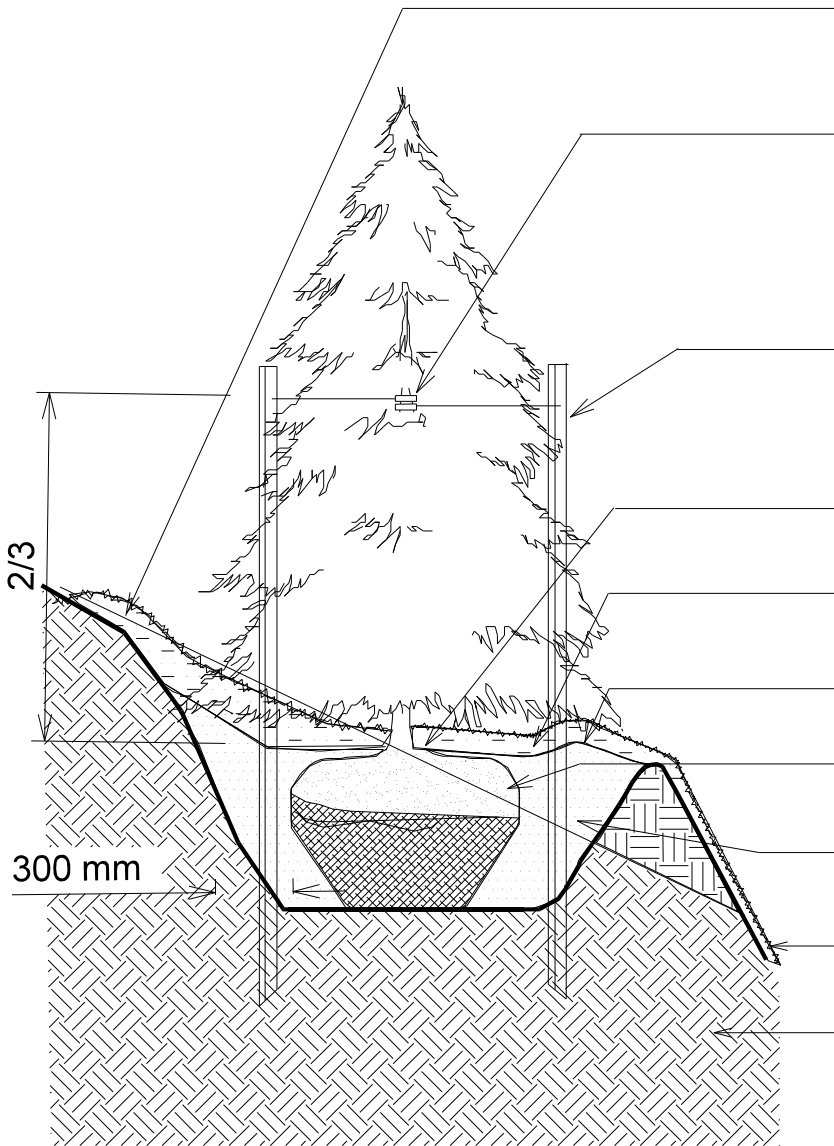

MATCH TO EXISTING GRADE

TREE TIES TO BE FASTENED AROUND TREE
IN FIGURE EIGHT WITH NO. 9 GAL. WIRE
ENCASE IN 13mm DIA. 2-PLY RUBBER HOSE
TIGHTLY COILED AND TRIM ENDS OF WIRE

NEW STAKES AS PER CONTRACT
REQUIREMENTS TO BE
SUNK FIRMLY INTO SUBSOIL

DEPTH OF PLANTING PIT TO BE APPROVED
BY COMMUNITY SERVICES REPRESENTATIVE

SHREDDED BARK MULCH LAYER
TO A MINIMUM 75mm DEPTH

EARTH SAUCER MIN 100mm HIGH
AROUND EXCAVATED AREA

CUT AND REMOVE 1/3 OF BURLAP
FOLD BACK AND BURY

TREE PIT TO BE EXCAVATED AS PER
SPECIFICATIONS

BLEND IN GRADES AT 2:1 MAX

UNDISTURBED SUBSOIL