


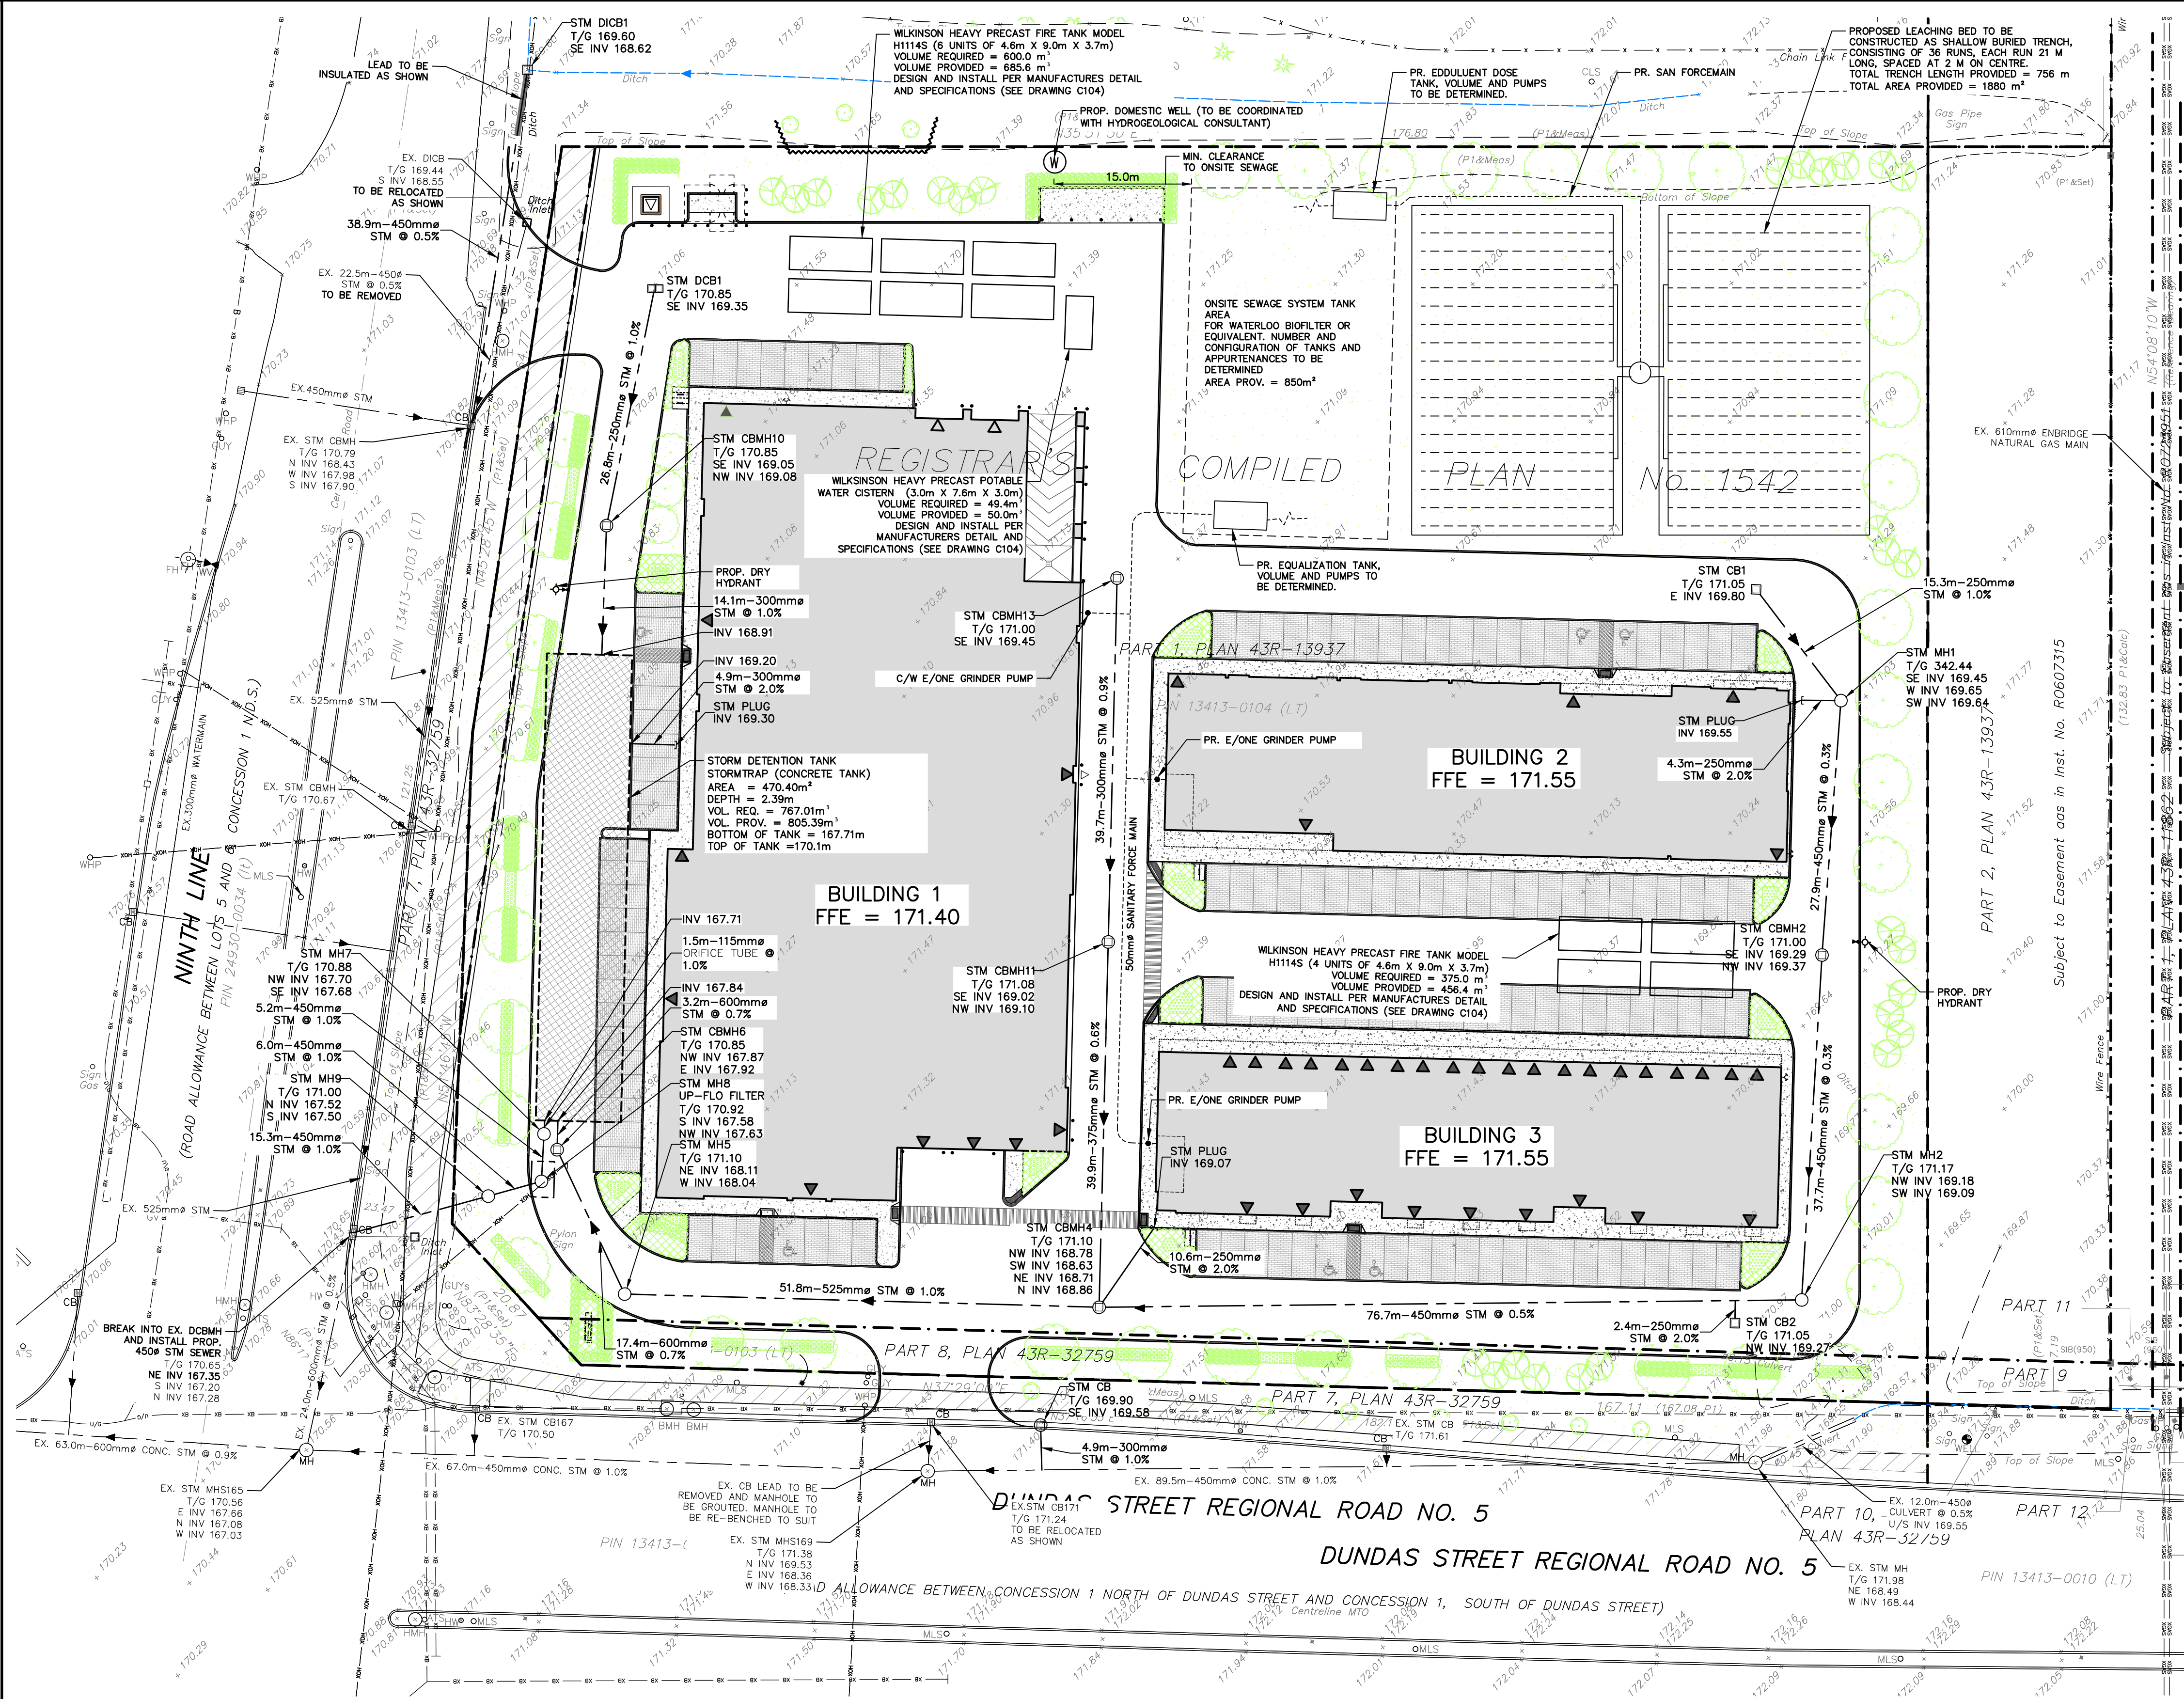

KEY PLAN

LEGEND

- PROPERTY LINE
- EXISTING WATERMAIN & GATE VALVE
- EXISTING STORM SEWER & MANHOLE
- EXISTING SINGLE / DOUBLE CATCHBASIN
- EXISTING SANITARY SEWER & MANHOLE
- PROPOSED WATERMAIN & GATE VALVE
- PROPOSED FIRE HYDRANT & GATE VALVE
- PROPOSED SIAMESE CONNECTION
- PROPOSED STORM SEWER & MANHOLE
- PROPOSED SINGLE / DOUBLE CATCHBASIN
- PROPOSED SANITARY SEWER & MANHOLE
- PROPOSED ELECTRICAL TRANSFORMER

2.0 WELL NOTES (REFER TO DRAWING C104 FOR ADDITIONAL NOTES):

WELL NOTES ARE STANDARD DETAILS FOR REFERENCE ONLY. ALL DETAILS OF PUMPS AND WELL OPERATIONS, TREATMENT, AND MAINTENANCE TO BE REVIEWED AND CONFIRMED BY MECHANICAL ENGINEER TO ENSURE CONFORMANCE WITH LOCAL REGULATIONS AND CODES

BURIED INFRASTRUCTURE

- ELECTRICAL SUPPLY LINES TO BE PROVIDED FROM THE BUILDING TO EACH WELL (#12 SUBMERSIBLE CABLE) AND FROM THE DOMESTIC WATER CISTERN TO THE BUILDING.
- A (25MM DIAMETER 100 PSI POLY PIPE) WILL BE SUPPLIED FROM EACH WELL TO THE DOMESTIC WATER CISTERN AND FROM THE DOMESTIC WATER CISTERN TO THE BUILDING.
- WATER LINE LOCATION IN ACCORDANCE WITH LOCAL RULES AND REGULATIONS, LOCATION TO BE REVIEWED WITH ENGINEER AS REQUIRED.

THE EXISTING SERVICES AND UTILITIES SHOWN ON THIS DRAWING HAVE BEEN TAKEN FROM AS-BUILT DRAWINGS PREPARED BY:

ENBRIDGE PIPELINES INC. - D-1, 773-11969-250, DATED JUNE 25, 2009.
THE CITY OF MISSISSAUGA - DWG. No. AL-83730-P8, DATED APRIL 1988.
THE TOWN OF OAKVILLE - DWG. No. O-21570 & O-21572, DATED JUNE 2011.

NOT FOR CONSTRUCTION

Stamp: A. FARINA 100523960 DEC/03/2021 PROVINCE OF ONTARIO

Stamp: CROZIER CONSULTING ENGINEERS

211 YONGE STREET SUITE 301 TORONTO, ON M5B 1M4 416-477-3392 T WWW.CFCROZIER.CA

Drawn: D.B. Design: A.D.F. Project No: 1644-5477

Check: A.D.F. Check: A.S. Scale: 1:400 Dwg: C 102

10 0m 10 20 30

SCALE: 1:400