

# Hydrant Flow Test





T: 1-800-268-0146 ; E: sales@flametamer.ca

|                        |                     |
|------------------------|---------------------|
| <b>Name of Hazard:</b> | AIRSTAR HOLDINGS    |
| <b>Location:</b>       | 7211-7233 ARPORT RD |
| <b>Date of Test:</b>   | MAY 19TH, 2021      |
| <b>Time of Test:</b>   | 10:21 AM            |
| <b>Conducted by:</b>   | RONALDO             |
| <b>Ref. Standard:</b>  | NFPA 291            |
| <b>Hydrant Class:</b>  | A                   |

## Flow Results & Calculation Data

| STATIC HYDRANT PRESSURE |                 | 88 PSI           | *QR Rated capacity at 20 psi, in GPM |          |               |              |                 |
|-------------------------|-----------------|------------------|--------------------------------------|----------|---------------|--------------|-----------------|
|                         | NUMBER OF PORTS | NOZZLE I.D. (in) | # OF                                 | C FACTOR | PITOT READING | RESIDUAL PSI | FLOW RATING GPM |
| TEST FLOW 1             | 2               | 2.5              | 1                                    | 0.99     | 58            | 77           | 1420            |

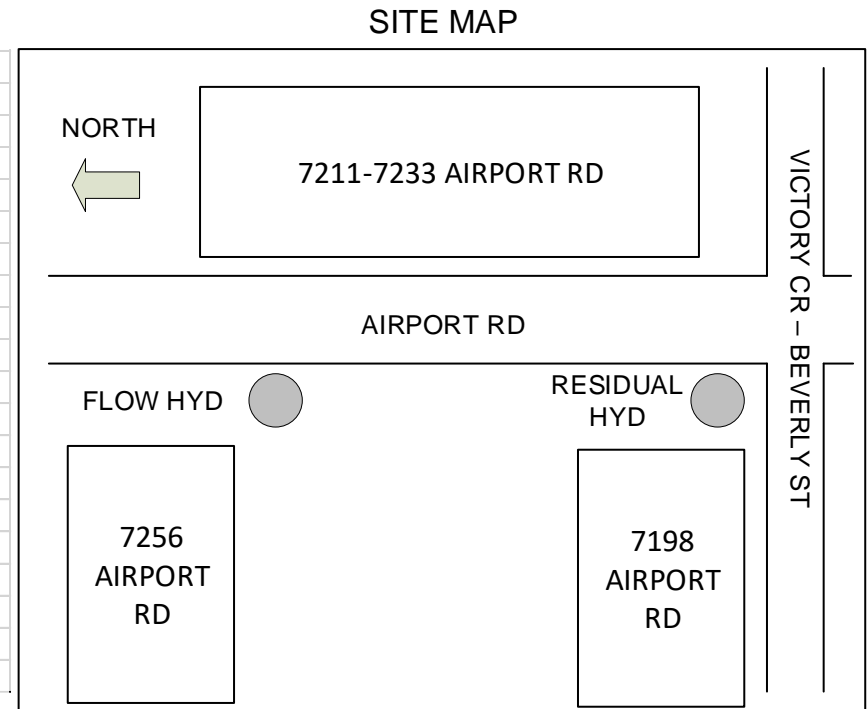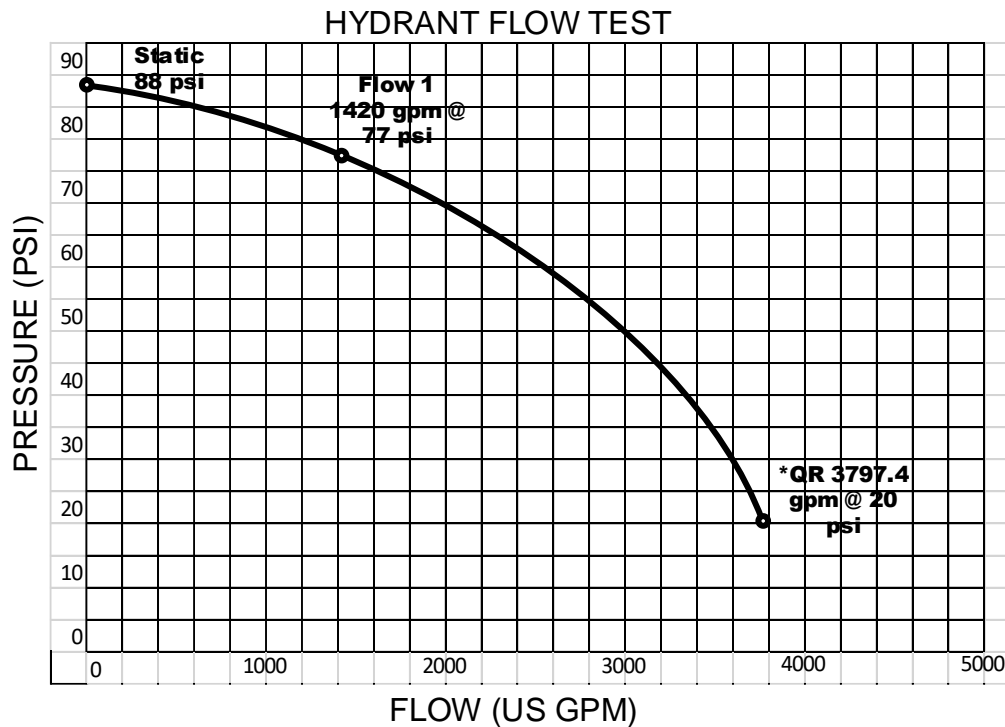

# Hydrant Flow Test




T: 1-800-268-0146 ; E: sales@flametamer.ca

|                        |                            |
|------------------------|----------------------------|
| <b>Name of Hazard:</b> | AIRSTAR HOLDINGS           |
| <b>Location:</b>       | ACROSS FROM 7246 COLLET RD |
| <b>Date of Test:</b>   | MAY 19TH, 2021             |
| <b>Time of Test:</b>   | 10:56 AM                   |
| <b>Conducted by:</b>   | RONALDO                    |
| <b>Ref. Standard:</b>  | NFPA 291                   |
| <b>Hydrant Class:</b>  | A                          |

## Flow Results & Calculation Data

| STATIC HYDRANT PRESSURE |                 | 87 PSI           | *QR Rated capacity at 20 psi, in GPM |          |               |              |                 |
|-------------------------|-----------------|------------------|--------------------------------------|----------|---------------|--------------|-----------------|
|                         | NUMBER OF PORTS | NOZZLE I.D. (in) | # OF                                 | C FACTOR | PITOT READING | RESIDUAL PSI | FLOW RATING GPM |
| <b>TEST FLOW 1</b>      | 1               | 2.5              | 1                                    | 0.99     | 60            | 65           | 1440            |

HYDRANT FLOW TEST

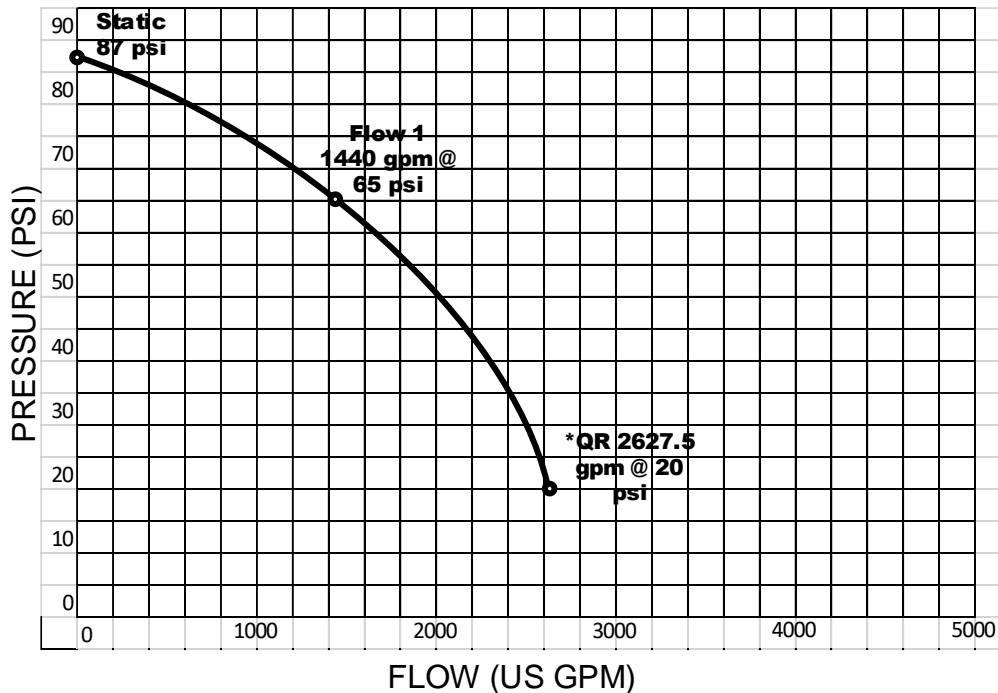

SITE MAP

