THEAKSTON ENVIRONMENTAL

Consulting Engineers • Environmental Control Specialists


REPORT

PEDESTRIAN LEVEL WIND STUDY

579, 619 LAKESHORE ROAD EAST

and

1022, 1028 Caven Street MISSISSAUGA, ON

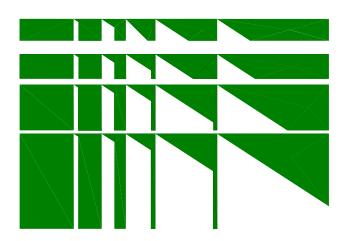

Star Seeker Inc.

REPORT NO. 21708

October 5, 2021

TABLE OF CONTENTS

1. EX	1. EXECUTIVE SUMMARY			
2. IN	NTRODUCTION	3		
3. O	BJECTIVES OF THE STUDY	3		
	ETHOD OF STUDY			
4.1	General	4		
4.2				
4.3	STATISTICAL WIND CLIMATE MODEL			
4.4	WIND SIMULATION	5		
4.5	PEDESTRIAN LEVEL WIND VELOCITY STUDY	5		
4.6	PEDESTRIAN COMFORT CRITERIA	6		
4.7	PEDESTRIAN SAFETY CRITERIA	7		
4.8	PEDESTRIAN COMFORT CRITERIA – SEASONAL VARIATION	8		
5. R	ESULTS	8		
5.1	STUDY SITE AND TEST CONDITIONS	8		
5.2	PEDESTRIAN LEVEL WIND VELOCITY STUDY			
	REVIEW OF PROBE RESULTS			
6. SI	U MMARY	17		
7. FI	IGURES	18		
	PPENDIX			
	EFERENCES			

1. EXECUTIVE SUMMARY

The mixed-use Development proposed by Star Seeker Inc. for their property municipally known as 579, 619 Lakeshore Road East and 1022, 1028 Caven Street, situated north of the intersection of Lakeshore Road East and Lagoon Street in the City of Mississauga, has been assessed for environmental standards with regard to pedestrian level wind relative to comfort and safety.

The 579, 619 Lakeshore Road East and 1022, 1028 Caven Street Development involves a proposal to remove the 1-storey commercial building, detached commercial structure, and two, 2-storey detached dwellings, and construct four buildings ranging in height from 4 to 16 storeys. A driveway providing access to the drop-offs and underground parking areas connects to Lagoon Street and Caven Street. Main residential entrances are proposed at the internal drop-off areas, and retail entrances are proposed along Lakeshore Road East. Outdoor amenity space is proposed atop various rooftops at the 5th level adjacent to the towers.

The proposed Development is, for all intents and purposes, surrounded to prevailing windward directions by a suburban mix of low to mid-rise residential, commercial, and industrial buildings and open areas. These buildings and related open areas have a sympathetic relationship with the pending wind climate.

Urban development provides turbulence inducing surface roughness that can be wind friendly, while open settings afford wind the opportunity to accelerate as the wind's boundary layer profile thickens at the pedestrian level, owing to lack of surface roughness. High-rise buildings typically exacerbate wind conditions within their immediate vicinity, to varying degrees, by redirecting wind currents to the ground level and along streets and open areas. Transition zones from open to urban, and to a lesser degree suburban, settings may prove problematic, as winds exacerbated by the relatively more open settings are redirected to flow over, around, and between urban buildings.

These phenomena were observed at the site with winds that have opportunity to accelerate over the more open setting to the south of the Development site. The proposed Development penetrates winds that formerly flowed over the more open existing site. These winds are redirected, tending to split with portions flowing over, around and down the proposed buildings' façades. At the pedestrian level, the winds redirect to travel horizontally along the buildings, around the corners and beyond, creating minor windswept areas at or near the buildings' corners, and in the gaps between buildings, and these conditions are primarily attributable to the setting. Winds emanating from remaining compass points are more effectively mitigated by the local surrounds, and as such, upon impact with the proposed, tend to split, flowing over, and to a lesser extent around and down the buildings' faces. At the pedestrian level, the winds redirect to travel horizontally along the ground, around corners and beyond.



With inclusion of the proposed Development, ground level winds at many locations will improve, with occasional localized areas of higher pedestrian level winds. This is primarily attributable to the exposure of the existing setting, which is well managed by the proposed design, and the resulting conditions are considered acceptable to the suburban context. Where mitigation was recommended, it was achieved through:

- steps in the façades
- podium
- canopies
- balconies
- landscaping
- plantings

and others, that were incorporated into the proposed Development's massing and landscape design. In summary, the proposed Development's design features will contribute to anticipated pedestrian comfort conditions that are suitable to the context. Application of a mitigation plan for the Residential Entrances to Building A and Building B, and the rooftop amenity spaces will result in conditions that are comfortable and seasonally suitable for the intended use. The proposed Development will realise wind conditions acceptable to a typical suburban context.

Respectfully submitted,

Stephen Pollock, P. Eng.

Paul Kankainen, M.A.Sc.



2. INTRODUCTION

Theakston Environmental Consulting Engineers, Fergus, Ontario, were retained by Star Seeker Inc., to study the pedestrian level wind environment for their proposed mixed-use Development at 579, 619 Lakeshore Road East and 1022, 1028 Caven Street, in the City of Mississauga. The site is depicted on the Aerial Photo in Figure 2a. The Development involves a proposal to construct four buildings comprised of a 16-storey tower rising above a 4-storey podium, two 16-storey towers with a 4-storey connective podium, and two 4-storey residential buildings with retail at grade, in the configuration shown in Figure 2b.

Jennifer Staden of Glen Schnarr & Associates initiated the request, and Quadrangle Architects Limited provided drawings. The co-operation and interest of the Client and their sponsors in all aspects of this study is gratefully acknowledged.

The specific objective of the study is to determine areas of higher than normal wind velocities induced by the shape and orientation of the proposed buildings and surroundings. The wind velocities are rated in accordance with the safety and comfort of pedestrians, notably at entrances to the buildings, sidewalks, courtyards on the property, as well as other buildings in the immediate vicinity.

In order to obtain an objective analysis of the wind conditions for the property, the wind environment was tested in two configurations. The existing configuration included existing and proposed buildings in the surrounding area. The proposed configuration removed the existing 1-storey building on site and retested with the Development's proposed buildings. Mitigation procedures were assessed during these tests to determine their impact on the various wind conditions.

The laboratory techniques used in this study are established procedures that have been developed specifically for analyses of this kind. The methodology, summarized herein, describes criteria used in the determination of pedestrian level wind conditions. The facilities used by Theakston are ideal for observance of the Development at various stages of testing, and the development of wind mitigation measures, if necessary.

3. OBJECTIVES OF THE STUDY

- 1. To quantitatively assess, by model analyses, the pedestrian level wind environment under existing conditions and future conditions with the Development.
- 2. To assess mitigative solutions.
- 3. To publish a Consultant's report documenting the findings and recommendations.



4. METHOD OF STUDY

4.1 General

The Theakston Environmental wind engineering facility was developed for the study of, among other sciences, the pedestrian level wind environment occurring around buildings, with focus on the safety and comfort of pedestrians. To this end, physical scale models of proposed Development sites, and immediate surroundings, are built, instrumented and tested at the facility with resulting wind speeds measured for different wind directions at various locations likely to be frequented by pedestrians. This quantitative analysis provides predictions of wind speeds for various probabilities of occurrence and for various percentages of time that are ultimately weighted relative to a historical range of wind conditions, and provided to the client.

The techniques applied to wind and other studies carried out at the facility, utilise a boundary layer wind tunnel and/or water flume (Figure 1). The testing facility has been developed for these kinds of environmental studies, and has been adapted with equipment, testing procedures and protocols, in order to provide results comparable to full scale. The Boundary Layer Wind Tunnel lends itself well to the simultaneous acquisition of large data streams while the water flume is excellent for flow visualisation.

The purpose of this Pedestrian Level Wind Study is to evaluate the pedestrian level wind speeds for a full range of wind directions. To accomplish this, the wind's mean speed boundary layer profiles are simulated and applied to a site-specific model under test, instrumented with differential pressure probes at locations of interest. During testing, pressure readings are taken over a one-hour model scale period of time, at a full-scale height of approximately 1.8m and correlated to mean and gust wind speeds, expressed as ratios of the gradient wind speed.

The mean and gust wind speeds at the forty-four (44) points tested were subsequently combined with the design probability distribution of gradient wind speed and direction, (wind statistics) recorded at Airports in the vicinity, to provide predictions of the full-scale pedestrian level wind environment. Predictions of the full-scale pedestrian level wind environment are presented as the wind speed exceeded 20% of the time, based on annual, and wind for the seasons in Figures 6a – 6e. Criterion employed by Theakston Environmental was developed by others and us and published in the attached references. The methodology has been applied to over 800 projects on this continent and abroad.

4.2 Meteorological Data

The wind climate for the Mississauga region that was used in the analysis was based on historical records of wind speed and direction measured at Billy Bishop Airport for the period between 1989 and 2017. The meteorological data includes hourly wind records and annual extremes. The analysis of the hourly wind records from said stations provides information to develop the



statistical climate models of wind speed and direction. From these models, predicted wind speeds regardless of wind direction for various return periods can be derived. The record of annual extremes was also used to predict wind speeds at various return periods. Based on the analysis of the hourly records, the predicted hourly-mean wind speed at 10m, corrected for a standard open exposure definition, is 25 m/s for a return period of 50 years.

4.3 Statistical Wind Climate Model

For the analysis of the data, the wind climate model is converted to a reference height of 500m using a standard open exposure wind profile. The mean-hourly wind speed at a 500m reference height used for this study is 45.6m/s for a return period of 50 years. The corresponding 1-year return period wind speed at the 500m height is 36m/s.

The design probability distribution of mean-hourly wind speed and wind direction at reference height is shown for Billy Bishop Airport in Figure 5. From the Billy Bishop Wind Roses, it is apparent that winds can occur from any direction, however, historical data indicates the directional characteristics of strong winds are from the east as well as west through southwest and said winds are most likely to occur during the winter season. In comparison, the Pearson wind climate is dominated by north through west to southwest winds with a far less significant easterly component.

4.4 Wind Simulation

To simulate the correct macroclimate, the upstream flow passes over conditioning features placed upstream of the model, essentially strakes and an appropriately roughened surface, as required to simulate the full-scale mean speed boundary layer approach flow profiles occurring at the site.

4.5 Pedestrian Level Wind Velocity Study

A physical model of the proposed Development and pertinent surroundings, including existing buildings, roadways, pathways, terrain and other features, was constructed to a scale of 1:500. The model is based upon information gathered during a virtual site visit to the proposed Development site, and surrounding area. Quadrangle Architects Limited provided architectural drawings. City of Mississauga aerial photographs were also used in development of the model to ensure the model reasonably represents conditions at the proposed Development. The model is constructed on a circular base so that, by rotation, any range of wind directions can be assessed. Structures and features that are deemed to have an impact on the wind flows are included upwind of the scale model.

In these studies, the effects of wind were analysed using omni-directional wind velocity probes that are placed on the model and located at the usual positions of pedestrian activity. The probes measure both mean and fluctuating wind speeds at a height of approximately 1.8m.



During testing, the model sample period is selected to represent 1hr of sampling time at full scale. The velocities measured by the probes are recorded by a computerized data acquisition system and combined with historical meteorological data via a post-processing program.

4.6 Pedestrian Comfort Criteria

The assignment of pedestrian comfort takes into consideration pedestrian safety and comfort attributable to mean and gust wind speeds. Gusts have a significant bearing on safety, as they can affect a person's balance, while winds flowing at or near mean velocities have a greater influence upon comfort.

Figure 6 presents results for the Gust Equivalent Mean (GEM) wind speed that is exceeded 20% of the time. These speeds are directly related to the pedestrian comfort at a particular point. The overall comfort rating, for existing and proposed, are depicted in Figure 7. Table 1, below, summarizes the comfort criteria used in the presentation of the results depicted in Figures 6 and 7.

Table 1: Comfort Criteria

ACTIVITY	Gust Equivalent Mean Speed Exceeded 20% of the Time		Description
COMFORT	km/h	<i>m/s</i> (used in	
		Fig. 6)	
Sitting	0-10	0-2.8	Calm or light breezes desired for outdoor restaurants and seating areas where one can read a paper without having it blown away.
Standing	0-15	0-4.2	Gentle breezes suitable for main building entrances and bus stops.
Walking	0-20	0-5.6	Relatively high speeds that can be tolerated if one's objective is to walk, run or cycle without lingering.
Uncomfortable	>20	>5.6	Strong winds of this magnitude are considered a nuisance for most activities, and wind mitigation is typically recommended.

The activities are described as suitable for Sitting, Standing, Walking, or Uncomfortable, depending on average wind speed exceeded 20% of the time. For a point to be rated as suitable for Sitting, for example, the wind conditions must not exceed 10km/h (2.8m/s), more than 20% of the time. Thus, in the plots (Figure 6), the upper limit of each bar ends within the range described



by the comfort category. For sitting, the rating would include conditions ranging from calm up to wind speeds that would rustle tree leaves or wave flags slightly, as presented in the Beaufort Scale included in the Appendices. As the name infers, the category is recommended for outdoor space where people might sit for extended periods.

The Standing category is slightly more tolerant of wind, including wind speeds from calm up to 15km/h (4.2m/s). In this situation, the wind would rustle tree leaves and, on occasion, move smaller branches while flags flap. This category would be suitable for locations where people might sit for short periods or stand in relative comfort. The Walking category includes wind speeds from calm up to 20km/h (5.6m/s). These winds would set tree limbs in motion, lift leaves, litter and dust, and the locations are suitable for activity areas. The Uncomfortable category covers a broad range of wind conditions that are generally a nuisance for most activities, including wind speeds above 20km/h (5.6m/s).

In Figure 6, the probe locations are listed along the bottom of the chart; beneath the graphical representation of the Mean Wind Speed exceeded 20% of the time. Along the right edge of the plot the comfort categories are shown. The background of the plot is lightly shaded in colours corresponding to the categories shown in Table 1. Each category represents a 5km/h (or more) interval. The location is rated as suitable for Sitting, Standing, Walking, or Uncomfortable, if the bar extends into the corresponding interval.

The charts represent the average person's response to wind force for the winter and summer seasons. Effects such as wind chill and humidex (based on perception) are not considered. Also clothing is not considered, since clothing and perceived comfort varies greatly among the population. There are many variables that contribute to a person's perception of the wind environment beyond the seasonal variations presented. While people are generally more tolerant of wind during the summer months, than during the winter, due to the wind cooling effect, people become acclimatized to a particular wind environment. Persons dwelling near the shore of an ocean, large lake or open field are more tolerant of wind than someone residing in a sheltered wind environment.

4.7 Pedestrian Safety Criteria

Safety criteria are also included in the analysis to ensure that strong winds do not cause a loss of balance to individuals occupying the area. The safety criteria are based on wind speeds exceeded nine times per year as shown in Table 2.

Both the Comfort and Safety Criteria are based on those developed at the Allan G. Davenport Wind Engineering Group Boundary Layer Wind Tunnel Laboratory, located on the campus of The University of Western Ontario. The comfort criteria were subsequently revised for the Mississauga Urban Design Terms of Reference for Wind Comfort and Safety Studies, in consultation with RWDI and more closely respects the Lawson criteria.



Table 2: Safety Criteria

ACTIVITY	Mean Wind Speed Exceeded 9 times per year		Description	
SAFETY	km/h	m/s (used in Fig. 8)		
All-Weather	0-90	0-25	Acceptable gust speeds that will not adversely affect a pedestrian's balance and footing.	
Exceeding All-Weather	>90	>25	Excessive gust speeds that can adversely affect a pedestrian's balance and footing. Wind mitigation is typically required.	

4.8 Pedestrian Comfort Criteria – Seasonal Variation

The level of comfort perceived by an individual is highly dependent on seasonal variations of climate. Perceived comfort is also specific to each individual, and depends on the clothing choices. The comfort criterion that is being used averages the results across the general population to remove effects of individuals and clothing choices, however, seasonal effects are important. For instance, a terrace or outdoor amenity space may have limited use during the winter season, but require acceptable comfort during the summer.

The comfort of a site is based on the "winter" results of the study, Figures 6a and 7a and 7b. In cases where seasonal comfort is important, results have been included for the summer, (see Figures 6b and Figures 7c and 7d).

When compared to the annual average wind speed, winter winds are about 12.5% higher and summer winds are about 16% lower.

5. RESULTS

5.1 Study Site and Test Conditions

Proposed Development

The proposed 579, 619 Lakeshore Road East and 1022, 1028 Caven Street Development will be constructed on a parcel of land situated to the north of the intersection of Lakeshore Road East and Lagoon Street in the City of Mississauga. The site is currently occupied by a 1-storey, multi-tenant commercial structure, a detached commercial structure and two (2) detached dwellings that will be demolished. The site is depicted in the Aerial Photo in Figure 2a. Note: Mississauga's street orientation is relative to the Lake Ontario Shoreline resulting in east/west orientated streets in the subject area being offset by approximately 45 degrees north.



The Development involves a proposal to construct 4 buildings comprised of;

- Building A, 16-storey residential tower with a 4-storey podium and outdoor amenity space at the 5th level,
- Building B, two 16-storey towers with a 4-storey connective podium, and outdoor amenity space at the 5th level,
- Building C, 4-storey residential building with retail at grade, and
- Building D, 4-storey residential building with retail at grade.

The penultimate and ultimate are connected above the 1st level to accommodate a breezeway serving as a Pedestrian Path. A driveway providing access to the drop-offs and underground parking areas connects to Lagoon Street and Caven Street. Main residential entrances are proposed at the internal drop-off areas, and retail entrances are proposed along Lakeshore Road East. The Development is proposed in the configuration shown in Figure 2b.



Proposed 579, 619 Lakeshore Road East and 1022, 1028 Caven Street Development Site Looking North.

Surrounding Area

The proposed Development site, for all intents and purposes, is surrounded to prevailing windward directions by suburban development and open areas, except for several mid-rise apartment blocks, as indicated in Figure 2a.

To the northwest of the site are three 14-storey slab style apartment buildings municipally known as 1060, 1100, and 1110 Caven Street. The penultimate and ultimate buildings are orientated with their long axis in a northwest/southeast direction, the 1060 Caven Street building, which is adjacent to the site, is perpendicular to these. To the north of the apartment building complex are railway lands with low density residential beyond.

To the southwest of the site is a townhome development with Cooksville Creek, street related commercial, and low density residential beyond.

To the southeast of the site, beyond Lakeshore Boulevard East are low-density residential dwellings, RK McMillan Park, and Lakefront Promenade Park, which are along the shores of Lake Ontario, which is approximately 500m from the site.

To the northeast of the site is low-density residential with street related commercial along Lakeshore Road East.

In summary, suburban development mainly comprised of low to mid-rise residential buildings and open lands occupy lands to all compass points relative to the subject site. The suburban landscape has mitigative effects upon the wind climate to varying degrees, providing surface roughness that reduces the wind's energy at the pedestrian level. Conversely, the relatively open areas present a relatively smooth surface to approaching winds, affording wind opportunity to accelerate. Figures 2a and 2b depict the site and its immediate context. The site model, shown in Figure 3, is built to a scale of 1:500.

Macroclimate

For the proposed Development, the upstream wind flow during testing was conditioned to simulate an atmospheric boundary layer passing over suburban terrain. The terrain within the site's immediate vicinity was incorporated into the proximity model. Historical meteorological data recorded from Billy Bishop Airport was used in this analysis and consideration was applied to Pearson International Airport data. For studies on the waterfront in the City of Mississauga, weather data from Billy Bishop Airport is deemed representative. The data is split up into two seasons, winter and summer, and the resulting wind roses are presented as mean velocity and percent frequency in Figures 5a and 5b. The mean velocities presented in the wind roses are measured at an elevation of 10m. Thus, representative ground level velocities at a height of 2m, for an urban macroclimate, are 52% of the mean values indicated on the wind rose, (for suburban and rural macroclimates the values are 63% and 78% respectively). The macroclimate for this area is suburban.

Winter (November through March) has the highest mean velocities of the seasons with prevailing winds from the west through southwest, with significant components also from the northwest and east through northeast as indicated in Figure 5a. Summer (May through October) has the lowest mean wind velocities of the seasons with prevailing winds from the east and northwest through south as well, as indicated in Figure 5b. Reported pedestrian comfort conditions generally pertain to winter conditions unless stated otherwise.

5.2 Pedestrian Level Wind Velocity Study

On the site model, forty-four (44) wind velocity measurement probes were located around the proposed Development and other buildings and activity areas to determine conditions related to comfort and safety. Figure 4 depicts probe locations at which pedestrian level wind velocity measurements were taken in the existing and proposed scenarios. For the existing setting, the subject buildings were removed, and the "existing" site model retested with the current site.



Measurements of pedestrian level mean and gust wind speeds at the various locations shown were taken over a period of time equivalent to one hour of measurements at full-scale. The mean ground level wind velocity measured is presented as a ratio of gradient wind speed, in the plots of Figure B in the Appendix, for each point in the existing and proposed scenarios. These relative wind speeds are presented as polar plots in which the radial distance for a particular wind direction represents the wind speed at the location for that wind direction, expressed as a ratio of the corresponding wind speed at gradient height. They do not assist in assessing wind comfort conditions until the probability distribution gradient wind speed and direction are applied.


The design probability distribution gradient wind speed and direction, taken from historical meteorological data for the area (see Figures 5a - 5e) was combined with pedestrian level mean and gust wind speeds measured at each point to provide predictions of the percentage of time a point will be comfortable for a given activity. These predictions of mean and maximum or "gust" wind speeds are provided on a seasonal basis in Figures 6a - 6e. Note: For assessment purposes, the proposed Development was assessed with Billy Bishop Airport.

The ratings for a given location are conservative by design; when the existing surroundings and proposed buildings' fine massing details and actual landscaping are taken into consideration, the results tend toward a more comfortable site than quantitative testing alone would indicate.

Venturi action, scour action, downwash and other factors, as discussed in the Appendix on wind flow phenomena, can be associated with large buildings, depending on their orientation and configuration. These serve to increase wind velocities. Open areas within a heavily developed area may also encounter high wind velocities. Consequently, wind force effects are common in heavily built-up areas. The Development site is open to a predominantly suburban setting to prevailing and remaining compass points with winds flowing over and between mature vegetation, low to mid-rise buildings and open spaces. As such, the surroundings can be expected to influence wind at the site to varying degrees.



High-rise buildings may exacerbate wind conditions Figure A within their immediate vicinity, to varying degrees, by redirecting wind currents to the ground level and along streets and open areas. In general, wind will split upon impact with a high-rise building, with portions flowing down the face of the building to the pedestrian level as downwash, where it is deflected, or otherwise redirected to flow along the building and around its corners, creating localized zones of increased pedestrian level wind (Figure A). Conversely, points situated to the leeside, or in the wake of buildings will often enjoy an improvement in pedestrian comfort. As such, it is reasonable to expect inclusion of the proposed development will alter wind conditions under specific wind directions and velocities from those of the existing site condition, resulting in an improvement over the existing conditions at some points, with more windy conditions at others.

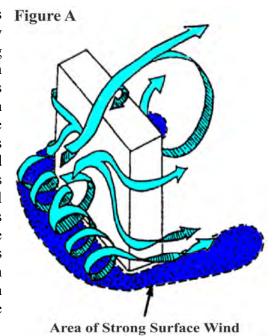

It should be noted that probes are positioned at points typically subject to windy conditions in a suburban/urban environment in order to determine the worst-case scenario.

5.3 Review of Probe Results

The probe results, as follows, were clustered into groups comprised of Public Street Conditions, Neighbouring Site Conditions, Internal Site Conditions, Pedestrian Entrance Conditions, and Outdoor Amenity Space Conditions. The measurement locations are depicted in Figure 4 and the resulting pedestrian comfort conditions are listed in Figures 6a and 6b for the winter and summer seasons, for the existing and proposed configurations. The results are also graphically depicted for winter and summer seasons in Figures 7a – 7d. The following discusses anticipated wind conditions and suitability for the points' intended use.

Public Street Conditions

Lakeshore Road East

Probes 1 through 9 were located along the sidewalks flanking Lakeshore Road East within the zone of influence of the proposed Development and probes 18 through 21 along the sidewalk serving the Lakeshore Road East façade of the proposed Development. Their locations are depicted in Figure 4, their comfort ratings are listed for the winter and summer seasons in Figures 6a – 6b and depicted in Figures 7a through 7d. In the existing setting, the probes indicate conditions suitable for standing, except for probe 4 that was rated for walking in the winter. The relatively open surrounds to the northwest transitioning to mid to low-rise buildings along the northwest side of Lakeshore Road East attribute to the localised windy areas along the street

from time to time, however more moderate conditions will be realised with winds from remaining directions, resulting in generally comfortable conditions.

Inclusion of the proposed Development causes a realignment in winds along Lakeshore Road East that results in a subtle increase in winds along the street at probe location 6, the southmost corner of Building C, that was sufficient to change the winter rating to walking. This can mainly be attributed to winds emanating from the west and east that are redirected to flow down and around the proposed buildings and over portions of Lakeshore Road East. (Appendix Figure B) The remaining points realised a slight to significant improvement, however, only probes 18 and 21 realised sufficient improvement to become suitable for standing during the winter.

Lakeshore Road East will remain comfortable and suitable for the intended use and will realise more comfortable conditions with consideration of design and landscape features that were too fine to include in the massing model under test. With inclusion of the proposed Development, Lakeshore Road East falls within the pedestrian level wind velocity safety criteria as an All-Weather Area, as described in Section 4.7 and depicted in Figure 9.

Caven Street

Probes 10 through 13 were located along Caven Street within the zone of influence of the proposed Development. Of these, probe locations 10 and 12 indicate winter conditions that are suitable for standing in the existing setting, probe 11 is suitable for sitting, and probe 13 realises conditions suitable for walking. The windy conditions at probe 13 can be attributed to its proximity to the 14-storey apartment buildings at 1060 and 1100 Caven Street, that direct winds from the north through west to flow around the buildings and over the street.

Many of these points realise an improvement over the existing setting with inclusion of the proposed Development, for specific wind directions, however, there are directions from which the wind is exacerbated, as seen in the Appendix Figure B Wind Radars. Portions of the street realise improvements due to blockage from the proposed to dominant winds emanating from the east. However, winds emanating from southern directions will be redirected to flow around the proposed building and ultimately over portions of Caven Street.

As such, most of the points retain their winter comfort rating, except for probe 11 that realises sufficient increase in winds to change the winter rating from sitting to standing. Conversely, probe 12 improved from standing to sitting during the winter. A rating of walking is appropriate for the area.

With inclusion of the proposed Development, Caven Street remains comfortable and suitable for the intended use and falls within the pedestrian level wind velocity safety criteria as an All-Weather Area, as described in Section 4.7 and depicted in Figure 9.

Lagoon Street

Probes 14, 15, and 34 were located along Lagoon Street to the southwest of the site and were rated suitable for sitting and walking respectively in the existing setting during the winter; the ultimate was displaced by an existing building and untested. Probe 15 was situated near the corner of a townhouse block and is exposed to easterly and southwesterly winds approaching



from over relatively open settings. The probes realise similar conditions with inclusion of the proposed, however probe 15 realised sufficient improvements to change the winter rating from walking to standing. (Figure 6a). Probe 34 was rated suitable for standing during the winter as proposed. Lagoon Street will be comfortable and suitable for the intended purpose and falls within the safety criteria as an All-Weather Area.

Mermaid Crescent

Probe 16 was located along Mermaid Crescent to the west of the site and was rated suitable for sitting in the existing setting during the winter. With inclusion of the proposed Development, probes 16 realise subtle changes in wind conditions, however the changes were insufficient to alter the winter ratings. Mermaid Crescent remains suitable for the intended purpose and falls within the safety criteria as an All-Weather Area.

Neighbouring Site Conditions

Probe 17 was located at the main entrance to the neighbouring 14-storey apartment building at 1060 Caven Street, the building situated adjacent to the northwest development boundary of the development site. The entrance to the building was rated as suitable for sitting during the winter in the existing setting. With inclusion of the proposed Development, a subtle increase in easterly and westerly winds was realised and changed the winter rating to standing, however the summer ratings were unchanged. Wind conditions comfortable for standing are preferable at building entrances, while conditions suitable for walking are appropriate for sidewalks.

Consideration of existing and proposed fine design and landscape features will result in more comfortable conditions than those reported. With inclusion of the proposed Development, the entrances to the neighbouring 1060 Caven Street building fall within the pedestrian level wind velocity safety criteria as an All-Weather Area.

Internal Site Conditions

Probes 22 through 38 were situated on grade at various locations about the site. Of these probes 22 through 29 were located within the gap between Building B and Buildings C and D. In the existing setting the area is assigned to a parking lot and indicated pedestrian comfort conditions that were suitable for standing during the winter months. In the proposed setting the area for the most part realises an improvement over the existing setting that was sufficient to change the comfort ratings at locations 22, 23 and 26 to sitting. Conversely probe locations 25 and 27 realised an increase in winds that was sufficient to change the winter comfort ratings to uncomfortable and walking respectively, during the winter months. The uncomfortable area, between Building B's West Tower and Building C is susceptible to westerly winds being deflected by the tower and 4-storey building to flow through the gap between. However, the rating is at the transition to walking, and with consideration of fine design and landscape elements, is expected to realise conditions suitable as such. During the summer the area is suitable for standing.



Probes 30 through 35 were situated about Building B and in the gap between Building A and Building B. In the existing setting most of these probes were displaced by the existing buildings and not tested, those tested indicated comfortable conditions, suitable for sitting during the winter. In the proposed setting the probes situated in the gap between the buildings, 31 through 33 and 35 were rated as suitable for walking during the winter months and suitable for standing during the summer, and as such are appropriate to the intended purpose. Probe 38 was situated in the Driveway along Caven Street and will be suitable for standing in the winter.

Probes 36 and 37 were located along the landscaped buffer to the northwest of Building A and realised pedestrian comfort conditions that are suitable for walking during the winter and standing during the summer. Wind conditions comfortable for walking are appropriate for sidewalks. Consideration of existing and proposed fine design and landscape features proposed for the area will result in more comfortable conditions than those reported.

With inclusion of the proposed Development, the internal site conditions remain comfortable and suitable for the intended use and fall within the pedestrian level wind velocity safety criteria as an All-Weather Area, as described in Section 4.7 and depicted in Figure 9.

Pedestrian Entrance Conditions

Probes 35 and 32 were situated adjacent to the Main Residential Entrances to the proposed Development's Building A and Building B respectively.

The entrances are protected from large portions of the wind climate by the proposed buildings; however, the area is susceptible to winds emanating from various directions as indicated in the wind velocity plots of Appendix Figure B, flowing around the corners of the proposed buildings and through the gap between. The entrances are predicted suitable for walking through the winter months and standing through the summer. The winter walking ratings are near the transition to standing, and with consideration of fine design and landscape elements, are expected to realise conditions more suitable for the intended purpose. A mitigation plan is recommended for the entrances, and this might include recessing the entrances into the lobby such that the door leaves are not exposed to winds flowing along the building. Alternate solutions might include wind screens and/or landscaping along the sidewalks adjacent to the buildings.

Probe 28 was situated adjacent to Building B's residential entrance to the south of the connective podium. The entrance is rated suitable for sitting in the summer, standing during the winter, and will be comfortable, suitable for the intended purpose.

Probe 24 was similarly situated adjacent to Building D's residential entrance in the northwest façade of the building near the westmost corner. The entrance also provides access to the residential component of Building C. The entrance is rated suitable for sitting in the summer, standing during the winter, and will be comfortable, suitable for the intended purpose.



Probe 18 through 21 were situated along the sidewalks adjacent to retail entrances to the proposed Development, in the Lakeshore Road East façade. The entrances are rated suitable for sitting and standing during the winter and sitting during the summer. The retail entrances will be comfortable and suitable for the intended purpose.

Wind conditions comfortable for standing or better are preferable at building entrances, while conditions suitable for walking are appropriate for sidewalks. The entrances to the proposed Development, with the above noted exception, will be comfortable and suitable to the intended use. Consideration of existing and proposed surface roughness features too fine to incorporate into the massing model will further improve the comfort ratings. Where mitigation was recommended it might be comprised of recessing the entrances into the lobby such that the door leaves are not exposed to winds flowing along the building, wind screens, plantings, or a combination thereof.

The proposed entrances fall within the pedestrian level wind velocity safety criteria as an All-Weather Area, as described in Section 4.7 and depicted in Figure 9.

Outdoor Amenity Space Conditions

Probes 39 and 40 were situated on the 5th level rooftop of Building A. The area is well protected by the proposed building and surrounds from the majority of the wind climate, and as such is expected to realise relatively comfortable conditions. The area is predicted to realise conditions suitable for sitting through the summer months at point 39, and slightly windier conditions, suitable for standing, through the summer, at point 40, the windier conditions attributed to the proximity to the tower.

Probes 41 through 44 were situated on the 5th level outdoor amenity space, atop the 4-storey podium of Building B. The most northeastern portion of the space, represented by probes 41 and 42, is predicted suitable for sitting in the summer, and standing through the winter months. Probes 43 and 44, located closer to the West Tower, realise windier conditions, suitable for standing in the summer, walking in the winter. The windier conditions proximate to the West Tower can be attributed to winds emanating from northerly and westerly directions being redirected to flow around and down the tower and ultimately over the area. In order to achieve comfortable conditions that are suitable for the intended use, a mitigation plan is recommended for the space. The mitigation plan may include 1.8m high perimeter wind screens, raised planters, trellises over seating areas, and/or others situated about the space as necessary. With application of an appropriate mitigation plan, the rooftop amenity space is expected to experience comfortable conditions that are suitable for the intended use, much of the time.

Consideration of the windscreens and proposed landscape plans, which includes a trellis/arbor structure to protect seating areas from winds downwashed from the building, raised planters, coarse plantings, and others, will improve the conditions realised in the area. The amenity spaces are predicted comfortable and seasonally suitable for the intended use, and further mitigation is not required at this stage.



With inclusion of the proposed Development, the above-mentioned outdoor amenity spaces fall within the pedestrian level wind velocity safety criteria as All-Weather Areas, as described in Section 4.7 and depicted in Figure 9.

6. SUMMARY

The observed wind velocity and flow patterns at the proposed Development are largely influenced by approach wind characteristics that are dictated by the suburban mix of low to midrise residential development, open parking areas, and green spaces supporting mature vegetation, mitigating the wind to different degrees, on approach. Historical weather data recorded at Billy Bishop Airport indicates that strong winds of a mean wind speed greater than 30 km/h occur approximately 21 percent of the time during the winter months and 5-6 percent of the time during the summer. Once the subject site is developed, ground level winds at many locations will improve, with occasional localized areas of higher pedestrian level winds. The relationship between surface roughness and wind is discussed in the Appendix and shown graphically in Figure A of the same section.

As such, the site is predicted comfortable under normal wind conditions; however, under high ambient winter wind conditions with winds emanating from specific directions, a few localized areas may be windy from time to time, but the areas remain appropriate to the intended purpose. The rooftop amenity spaces and the residential entrances for Building A and B will require application of a mitigation plan in order to achieve seasonally comfortable conditions that are appropriate for the intended use. The consideration of proposed surface roughness will result in conditions more comfortable than those reported herein.

The site is predicted to realise conditions suitable to a typical suburban context.

Note: The proposed Development was assessed with historical weather data from Billy Bishop Airport.

7. FIGURES

Figure 1: Laboratory Testing Facility	19
Figure 2a: Site Aerial Photo	20
Figure 2b: Site Plan	21
Figure 3: 1:500 Scale model of test site	22
Figure 4: Location plan for pedestrian level wind velocity measurements	23
Figure 5a: Winter Wind Rose – Billy Bishop Airport	24
Figure 5b: Summer Wind Rose – Billy Bishop Airport	25
Figure 6a: Wind Speed Exceeded 20% of the Time - Winter	26
Figure 6b: Wind Speed Exceeded 20% of the Time - Summer	29
Figure 7a: Pedestrian Comfort Categories – Winter - Existing	32
Figure 7b: Pedestrian Comfort Categories – Summer - Proposed	33
Figure 7c: Pedestrian Comfort Categories – Winter - Existing	34
Figure 7d: Pedestrian Comfort Categories – Summer - Proposed	35
Figure 8: Wind Speed Exceeded Nine Times Per Year	36
Figure 9a: Pedestrian Safety Criteria – Existing	39
Figure 9b: Pedestrian Safety Criteria – Proposed	40
Appendix: Background and Theory of Wind Movement	41

Figure 1: Laboratory Testing Facility





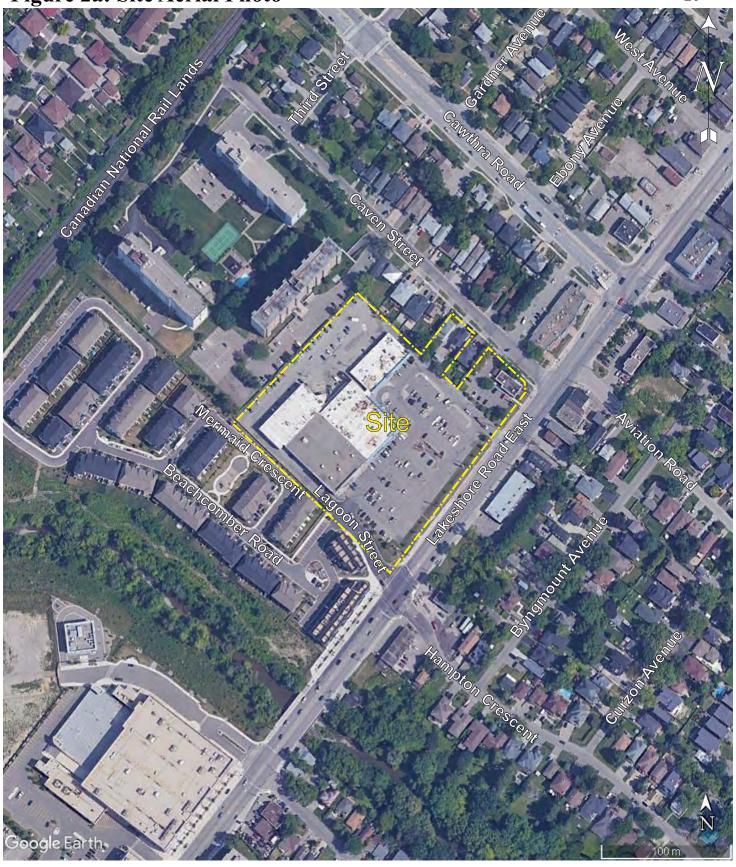




Figure 2b: Site Plan



Figure 3: 1:500 Scale model of test site




a) Overall view of model - Proposed Site




b) Close-up view of model - Proposed Site




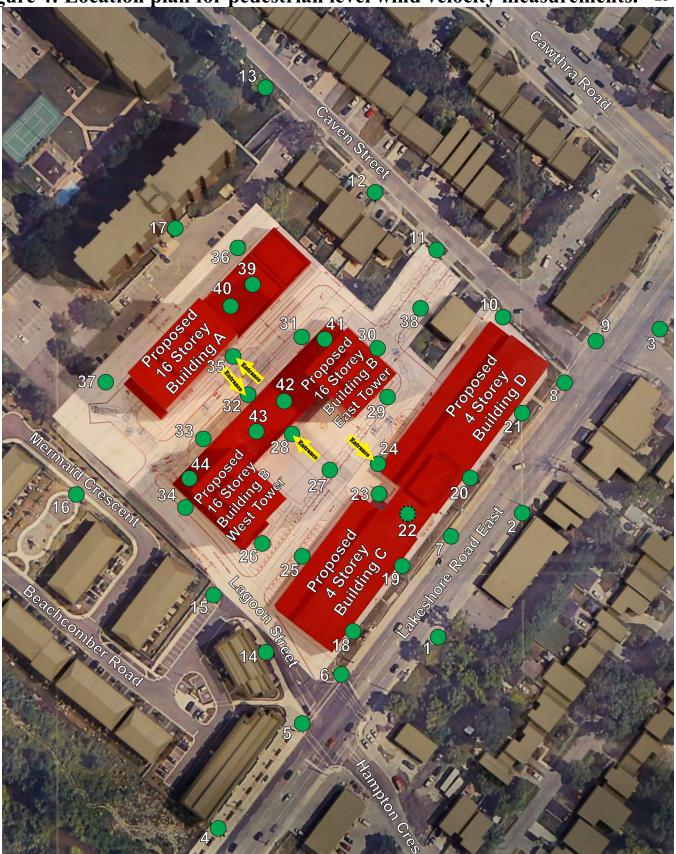


Historical Directional Distribution of Winds (@ 10m height) November through April (1989 - 2017)

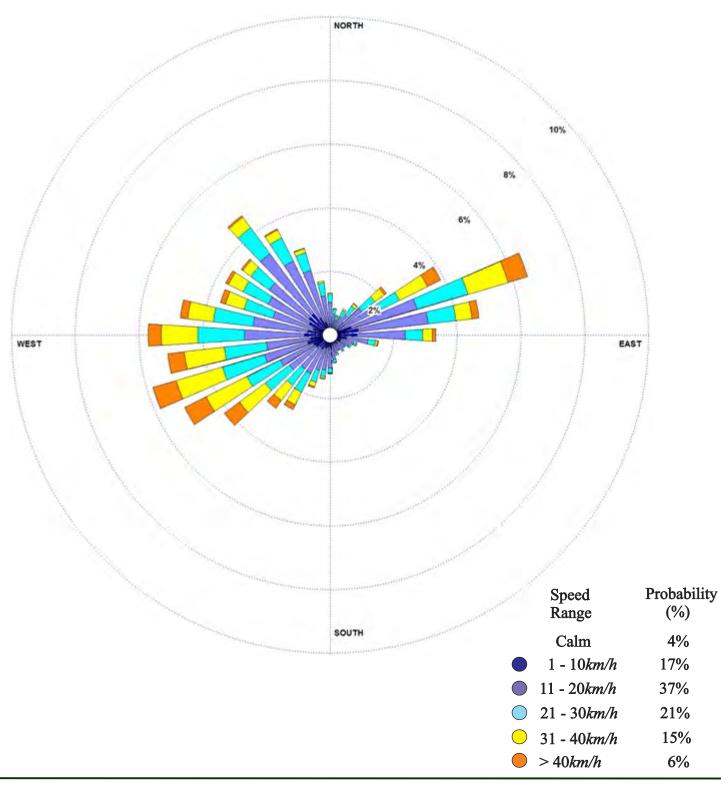


Historical Directional Distribution of Winds (@ 10m height) May through October (1989 - 2017)

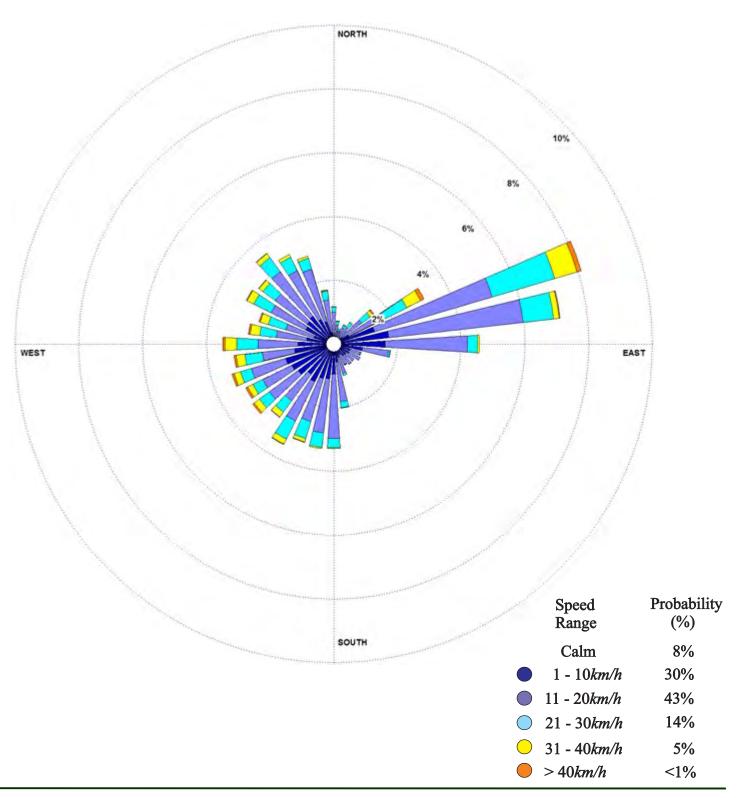


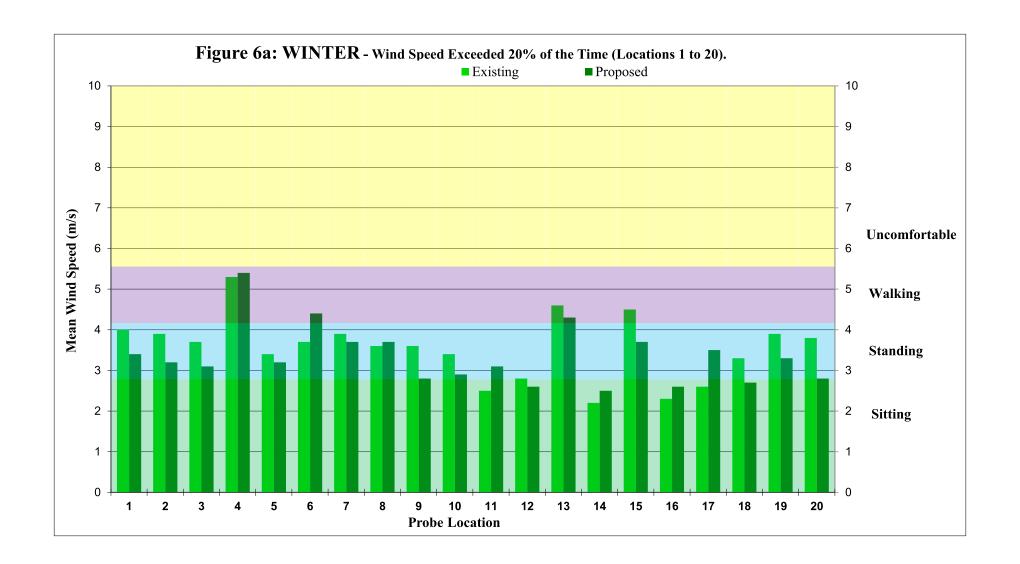




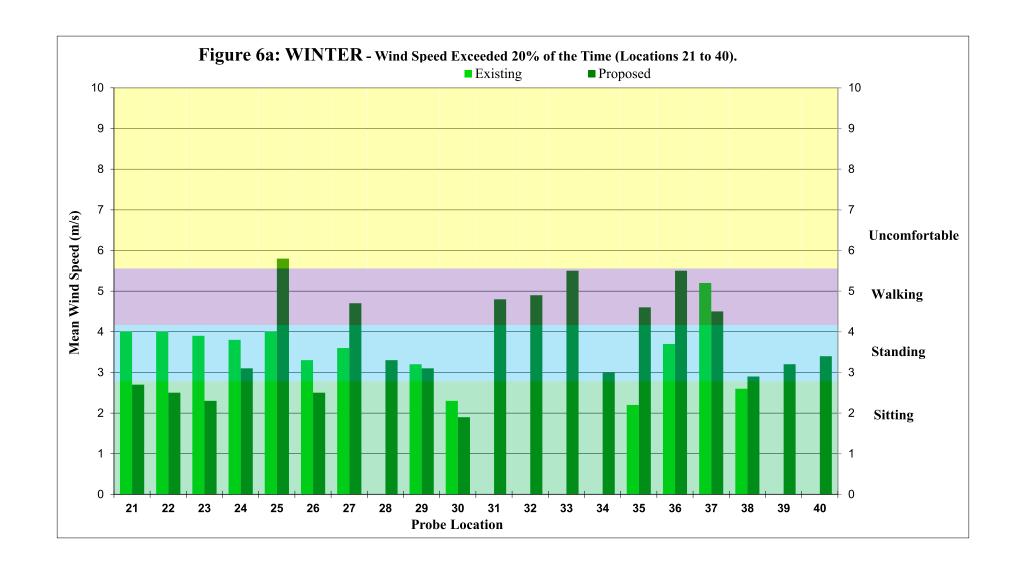




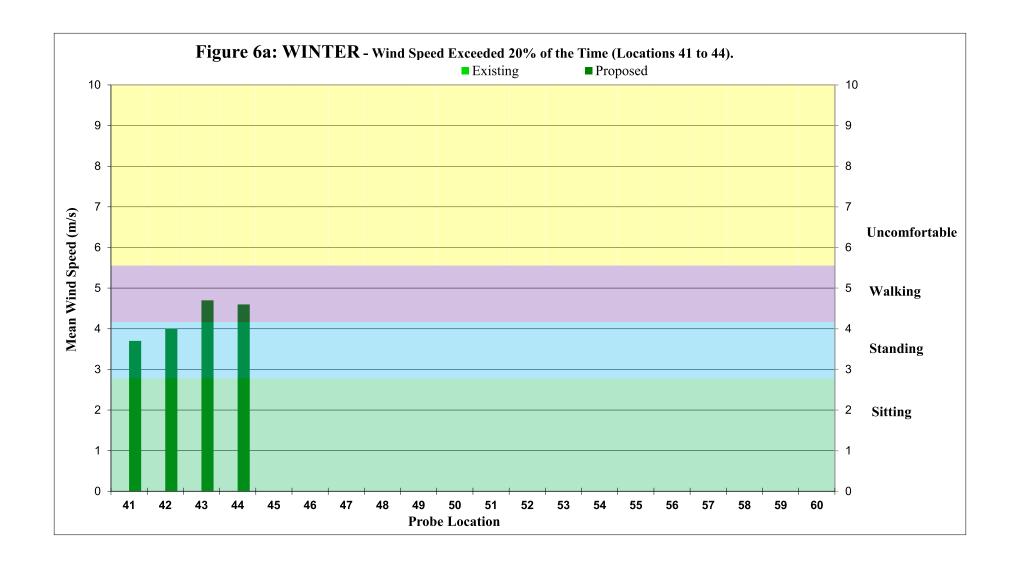




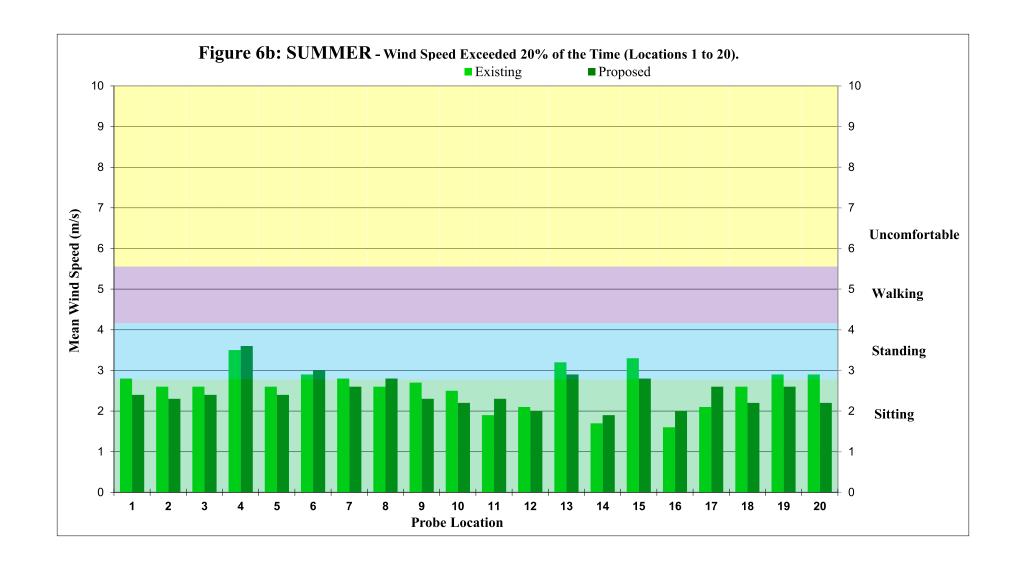




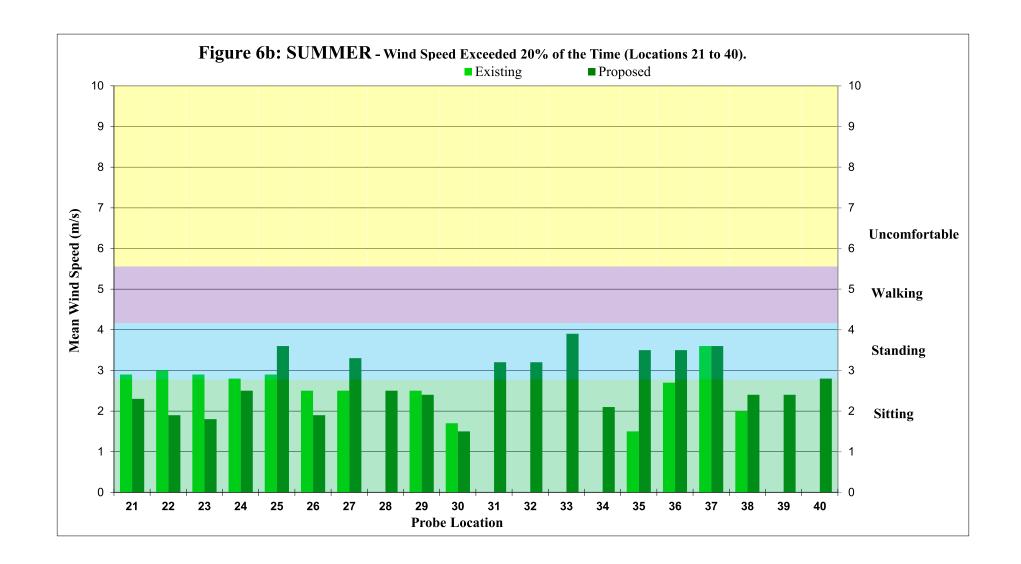



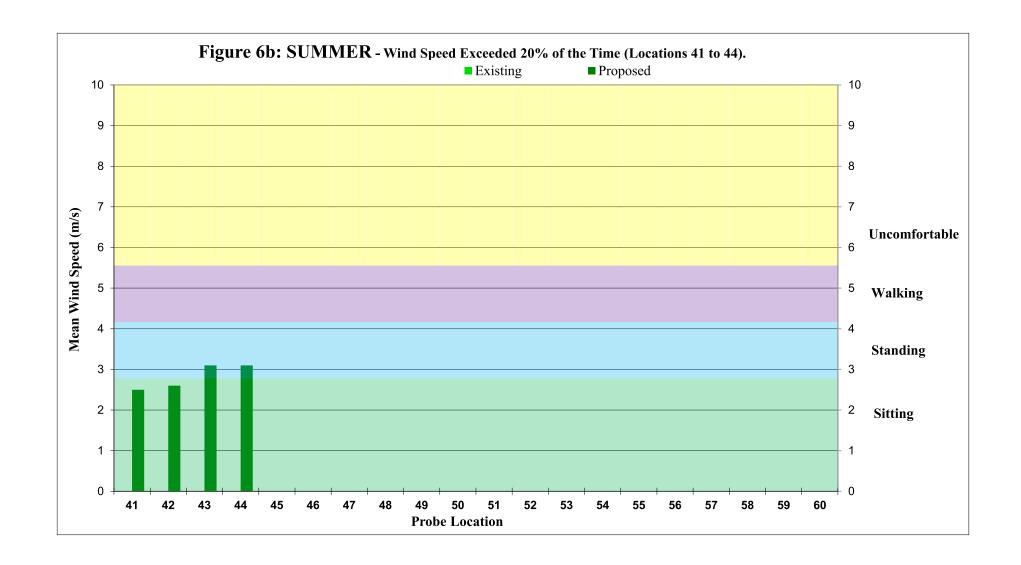




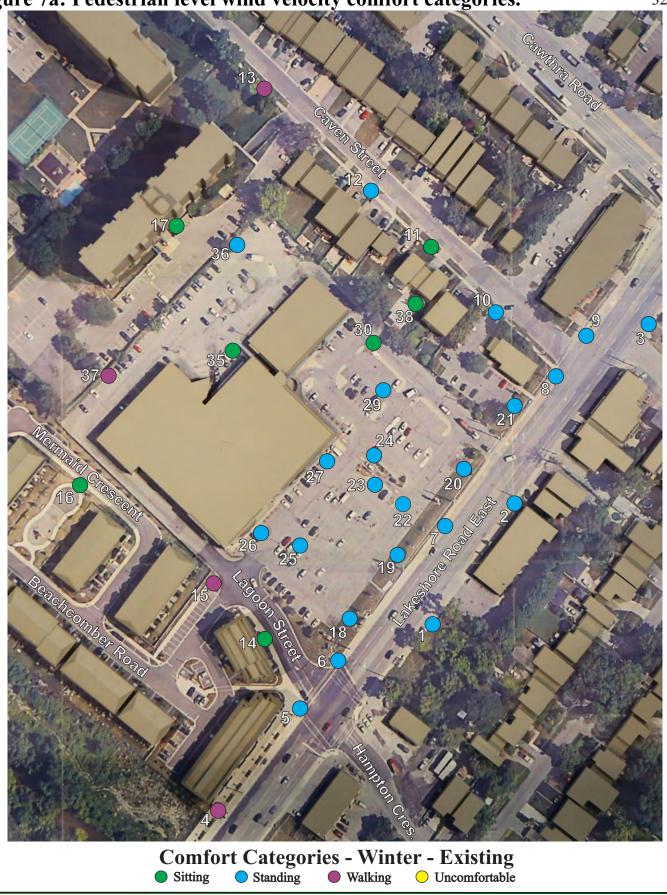








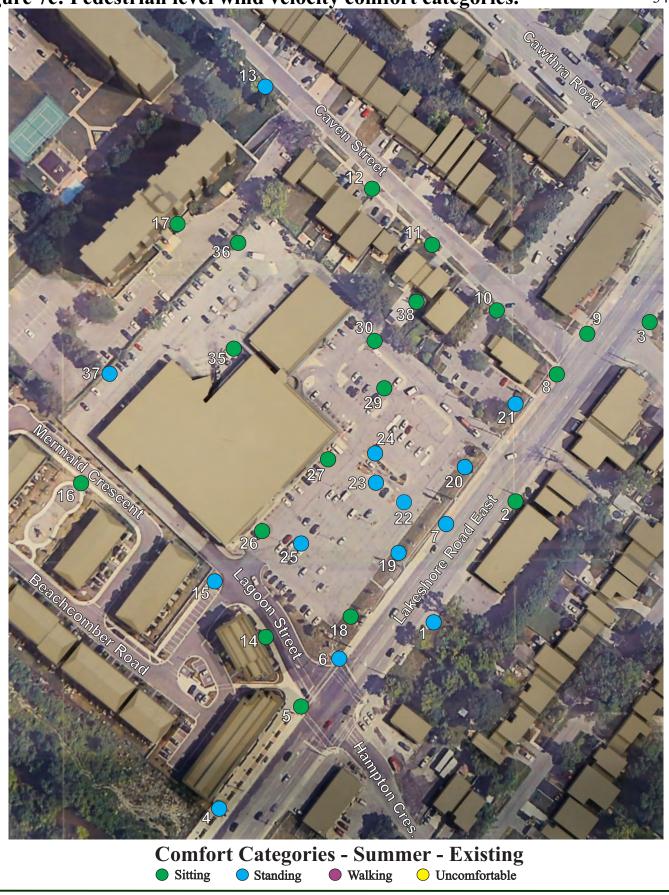









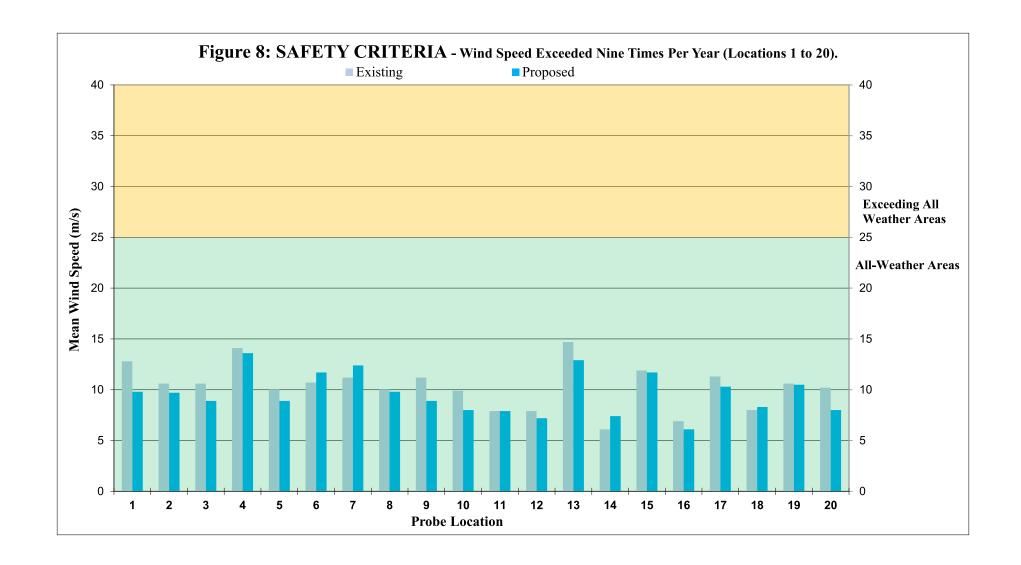




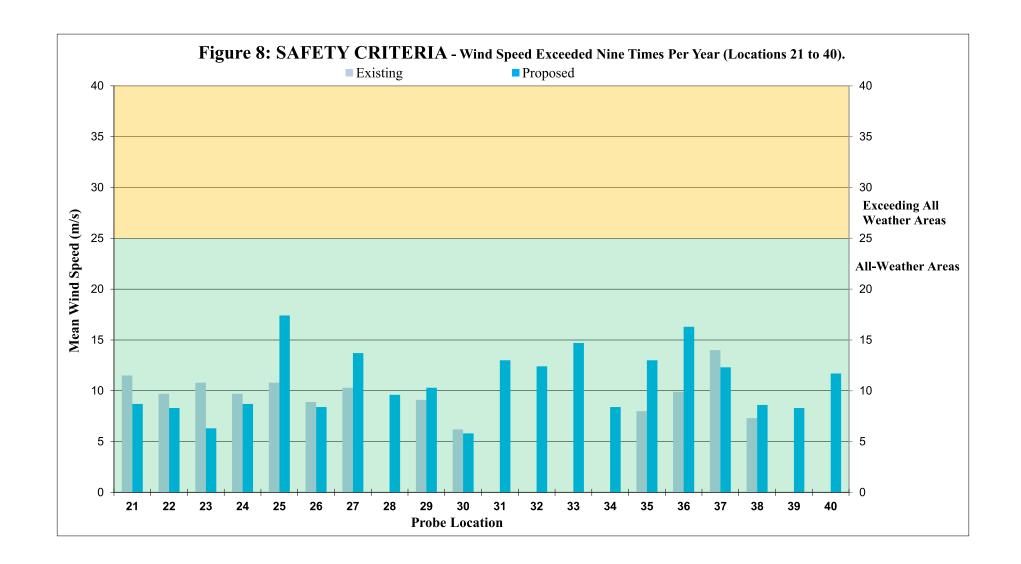



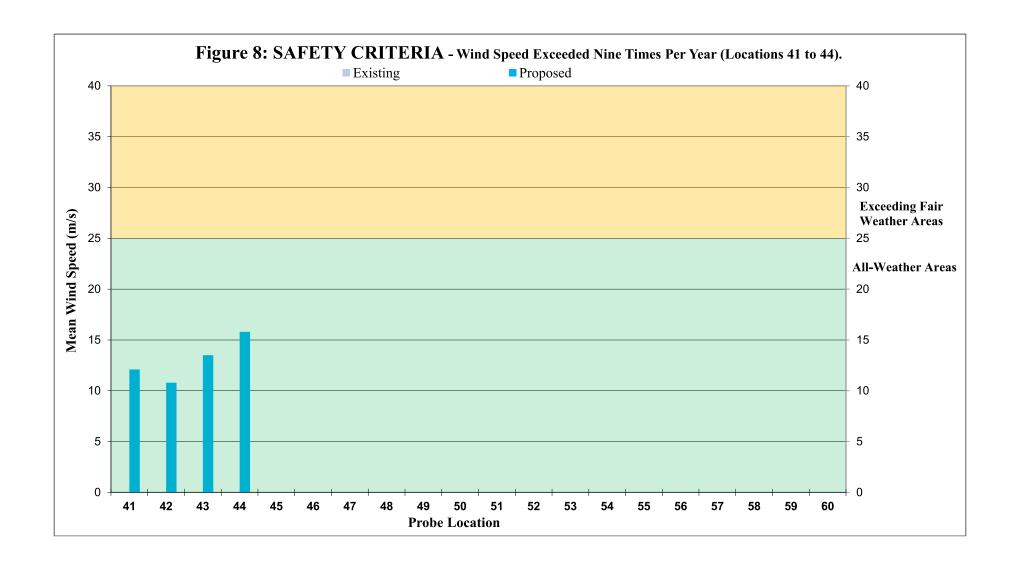




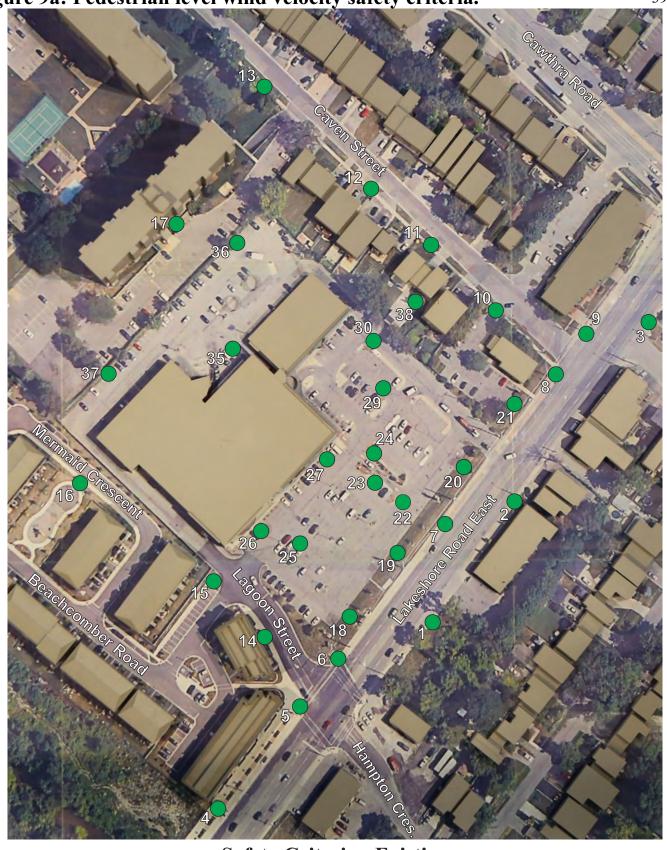

Safety Criteria - Existing

All-Weather Areas Exceeding All-Weather Areas



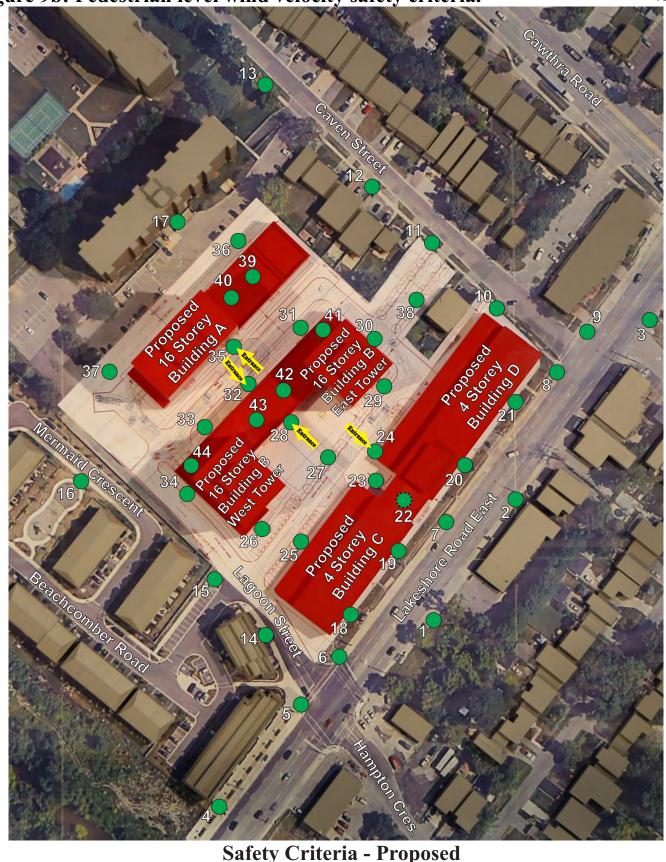

Safety Criteria - Proposed
Weather Areas Exceeding All-Weather Areas All-Weather Areas



8. APPENDIX

BACKGROUND AND THEORY OF WIND MOVEMENT

During the course of a modular analysis of an existing or proposed site, pertinent wind directions must be analysed with regard to the macroclimate and microclimate. In order for the results of the study to be valid, the effects of both climates must be modelled in test procedures.

Macroclimate

Wind velocity, frequency and directions are used in tests with models to establish part of the macroclimate. These variables are determined from meteorological data collected at the closest weather monitoring station. This information is used in the analysis of the site to establish upstream (approach) wind and weather conditions.

When evaluating approach wind velocities and characteristic profiles in the field it is necessary to evaluate certain boundary conditions. At the earth's surface, "no slip" conditions require the wind speed to be zero. At an altitude of approximately one kilometre above the earth's surface, the motion of the wind is governed by pressure distributions associated with large-scale weather systems. Consequently, these winds, known as "geostrophic" or "freestream" winds, are independent of the surface topography. In model simulation, as in the field, the area of concern is the boundary layer between the earth's surface and the geostrophic winds. The term boundary layer is used to describe the velocity profile of wind currents as they increase from zero to the geostrophic velocity.

The approach boundary layer profile is affected by specific surface topography upstream of the test site. Over relatively rough terrain (urban) the boundary layer is thicker and the wind speed increases rather slowly with height. The opposite is true over open terrain (rural). The following power law equation is used to represent the mean velocity profile for any given topographic condition:

$$\frac{U}{U_E} = \left(\frac{z}{z_E}\right)^a \qquad \text{where} \qquad U = \text{wind velocity } (m/s) \text{ at height } z \text{ } (m)$$

$$a = \text{power law exponent}$$
and subscript $_F$ refers to freestream conditions

Typical values for a and z_F are summarized below:

Terrain	а	$z_F(m)$
Rural	0.14 - 0.17	260 - 300
Suburban	0.20 - 0.28	300 - 420
Urban	0.28 - 0.40	420 - 550

Wind data is recorded at meteorological stations at a height z_{ref} , usually equal to about 10m above grade. This historical mean wind velocity and frequency data is often presented in the form of a wind rose. The mean wind velocity at z_{ref} , along with the appropriate constants based on terrain type, are used to determine the value for U_F , completing the definition of the boundary layer profile specific to the site. The following Figure shows representations of the boundary layer profile for each of the above terrain conditions:

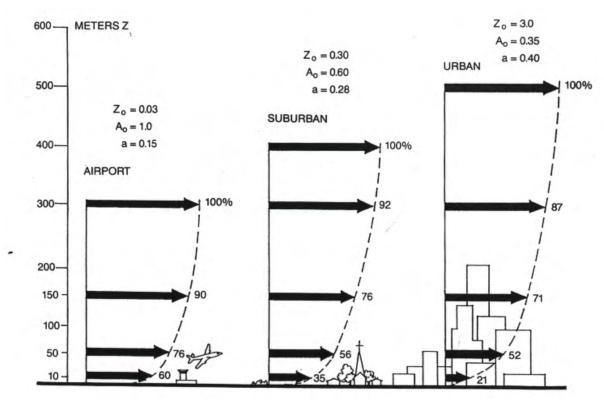


Figure A: Mean wind speed profiles for various terrain (from ASHRAE 1989).

For the above velocity profiles, ground level velocities at a height of z = 2m, for an urban macroclimate are approximately 52% of the mean values recorded at the meteorological station at a height equal to $z_{ref} = 10m$. For suburban and rural conditions, the values are 63% and 78% respectively. Thus, for a given wind speed at z_{ref} open terrain or fields (rural) will experience significantly higher ground level wind velocities than suburban or urban areas.

When a boundary layer wind flows over one terrain onto another, the boundary layer profile shape rapidly changes to that dictated by the new terrain. If the preceding wind flow is over rough suburban terrain and an open area is encountered a rapid increase in ground level winds will be realized. A similar effect will occur when large low-density residential areas are demolished to accommodate high-rise developments. The transitional open area will experience significantly higher pedestrian level winds than the previous suburban setting. Once the high-rise development is established, ground level winds will moderate with localized areas of higher pedestrian level winds likely to occur. Pedestrian level wind velocities respond to orientation and shape of the development and if the site is not appropriately engineered or mitigated, pedestrian level wind may be problematic.

Microclimate

The specific wind conditions related to the study site are known as the microclimate, which are dictated mainly by the following factors:

- The orientation and conformation of buildings within the vicinity of the site.
- The surrounding contours and pertinent landscape features.

The microclimate establishes the effect that surrounding buildings or landscape features have on the subject building and the effect the subject building has on the surrounds. For the majority of urban test sites the proper microclimate can be established by modelling an area of 300m in radius around the subject building. If extremely tall buildings



are present then the study area must be larger, and if the building elevations are on the order of a few floors, smaller areas will suffice to establish the required microclimate.

General Wind Flow Phenomena

Wind flow across undulating terrain contains parallel streamlines with the lowest streamline adjacent to the surface. These conditions continue until the streamlines approach vertical objects. When this occurs there is a general movement of the streamlines upward ("Wind Velocity Gradient") and as they reach the top of the objects turbulence is generated on the lee side. This is one of the reasons for unexpected high wind velocities as this turbulent action moves to the base of the objects on the lee side.

Other fluid action occurs through narrow gaps between buildings (Venturi Action) and at sharp edges of a building or other vertical objects (Scour Action). These conditions are predictable at selected locations but do not conform to a set direction of wind as described by a macroclimate condition. In fact, the orientation and conformation of buildings, streets and landscaping establish a microclimate.

Because of the "Wind Velocity Gradient" phenomena, there is a "downwash" of wind at the face of buildings and this effect is felt at the pedestrian level. It may be experienced as high gusty winds or drifting snow. These effects can be obviated by windbreak devices on the windward side or by canopies over windows and doors on the lee side of the building.

The intersection of two streets or pedestrian walkways have funnelling effects of wind currents from any one of the four directions and is particularly severe at corners if the buildings project to the street line or are close to walkways.

Some high-rise buildings have gust effects as the wind velocities are generated suddenly due to the orientation and conformation of the site. Since wind velocities are the result of energy induced wind currents the solution to most problems is to reduce the wind energy at selected locations by carefully designed windbreak devices, often landscaping, to blend with the surrounds.


The Beaufort Scale is often used as a numerical relationship to wind speed based upon an observation of the effects of wind. Rear-Admiral Sir Francis Beaufort, commander of the Royal Navy, developed the wind force scale in 1805, and by 1838 the Beaufort wind force scale was made mandatory for log entries in ships of the Royal Navy. The original scale was an association of integers from 0 to 12, with a description of the effect of wind on the behaviour of a full-rigged man-of-war. The lower Beaufort numbers described wind in terms of ship speed, mid-range numbers were related to her sail carrying ability and upper numbers were in terms of survival. The Beaufort Scale was adopted in 1874 by the International Meteorological Committee for international use in weather telegraphy and, with the advent of anemometers, the scale was eventually adopted for meteorological purposes. Eventually, a uniform set of equivalents that non-mariners could relate to was developed, and by 1955, wind velocities in knots had replaced Beaufort numbers on weather maps. While the Beaufort Scale lost ground to technology, there remains the need to relate wind speed to observable wind effects and the Beaufort Scale remains a useful tool.


Abbreviated Beaufort Scale


Beaufort Number	Description	Wind Speed		ed	Observations
		km/h	m/s	h=2 <i>m</i> for Urban <i>m/s</i>	
2	Slight Breeze	6-11	1.6-3.3	<~2	Tree leaves rustle; flags wave slightly; vanes show wind direction; small wavelets or scale waves.
3	Gentle Breeze	12-19	3.4-5.4	<~3	Leaves and twigs in constant motion; small flags extended; long unbreaking waves.
4	Moderate Breeze	20-28	5.5-7.9	<~4	Small branches move; flags flap; waves with whitecaps.
5	Fresh Breeze	29-38	8.0-10.7	<~6	Small trees sway; flags flap and ripple; moderate waves with many whitecaps.
6	Strong Breeze	39-49	10.8-13.8	<~8	Large branches sway; umbrellas used with difficulty; flags beat and pop; larger waves with regular whitecaps.
7	Moderate Gale	50-61	13.9-17.1	<~10	Sea heaps up, white foam streaks; whole trees sway; difficult to walk; large waves.
8	Fresh Gale	62-74	17.2-20.7	>~10	Twigs break off trees; moderately high sea with blowing foam.
9	Strong Gale	75-88	20.8-24.4		Branches break off trees; tiles blown from roofs; high crested waves.


Wind speeds indicated above, in km/h and m/s, are at a reference height of 10 metres, as are the wind speeds indicated on the Figure 5 wind roses. The mean wind speeds at pedestrian level, for an urban climate, would be approximately 56% of these values. The 3^{rd} column for wind speed is shown for reference, at a height of 2m, in an urban setting. The approximate Comfort Category Colours are shown above. The relationship between wind speed and height relative to terrain is discussed in the appendices.


 $Figure\ B$: Ground level wind velocity as a ratio of gradient wind velocity.

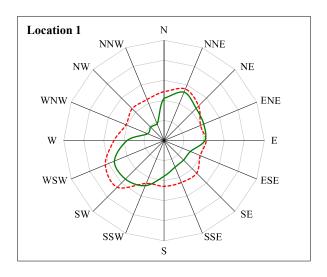


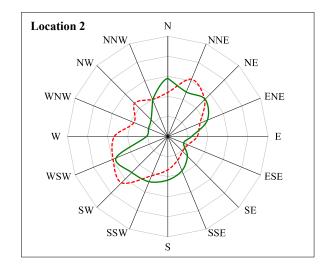



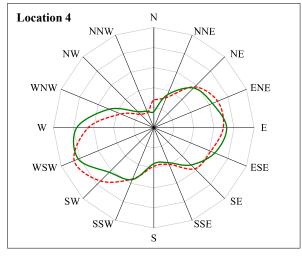


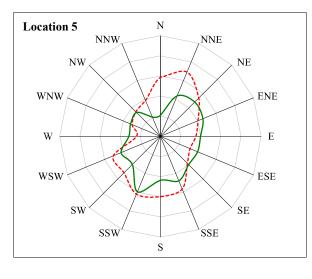


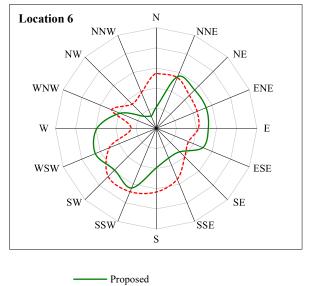



Theakston Environmental


 $Figure\ B$: Ground level wind velocity as a ratio of gradient wind velocity.

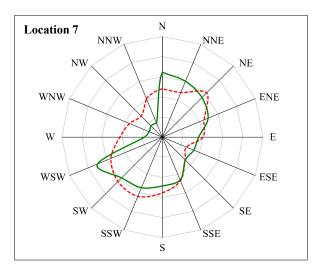


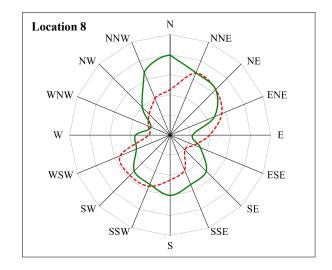



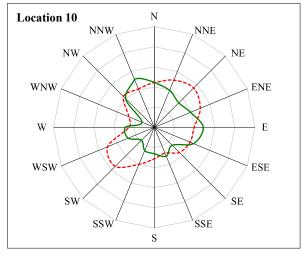


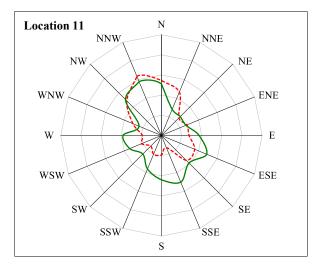


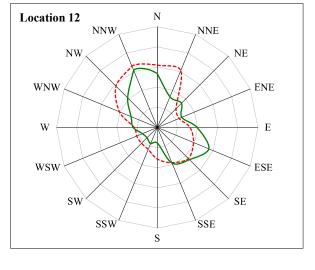



----- Existing — Proposed


 $Figure\ B$: Ground level wind velocity as a ratio of gradient wind velocity.

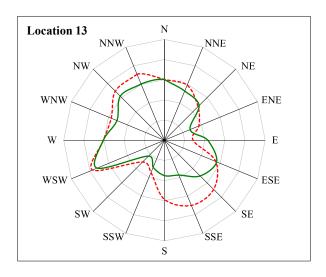


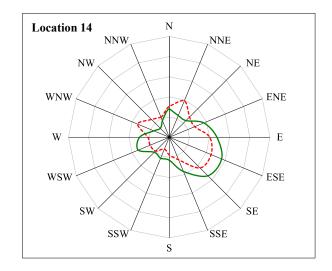



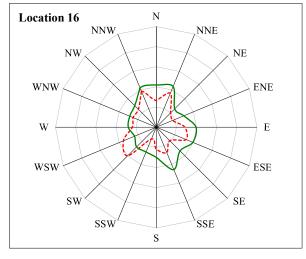


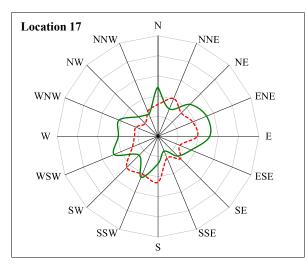


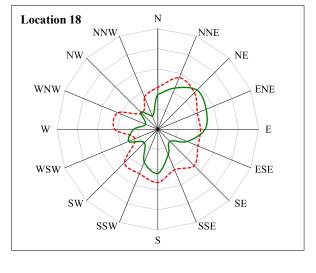



------ Proposed


 $Figure\ B$: Ground level wind velocity as a ratio of gradient wind velocity.

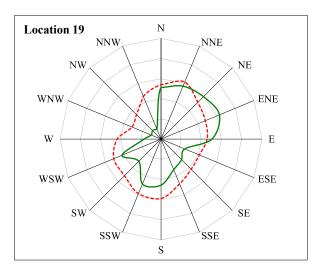


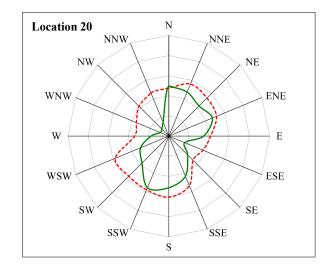




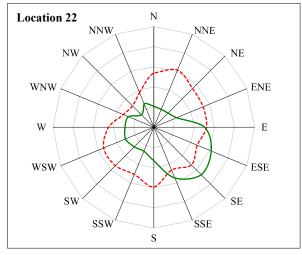


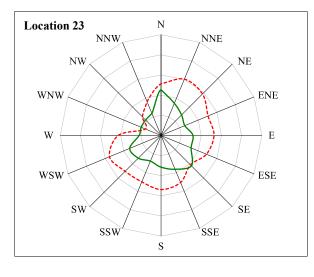


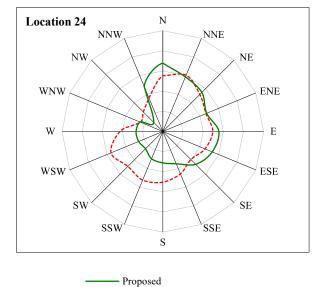



 $Figure\ B$: Ground level wind velocity as a ratio of gradient wind velocity.

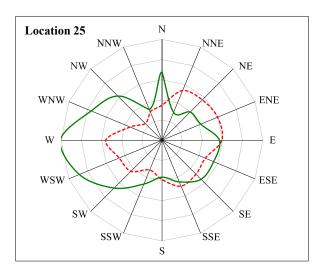


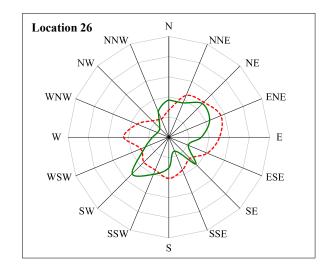



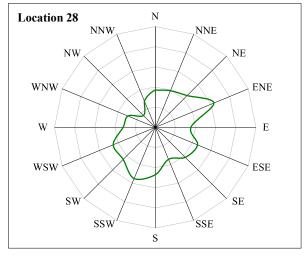


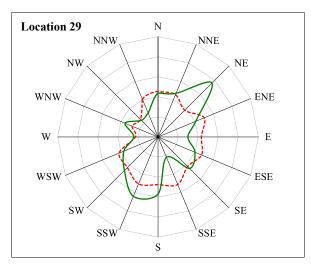


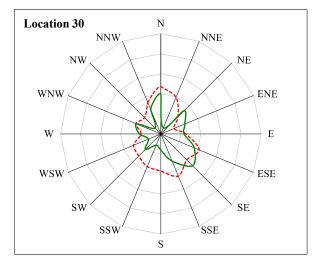



- Proposed


 $Figure\ B$: Ground level wind velocity as a ratio of gradient wind velocity.

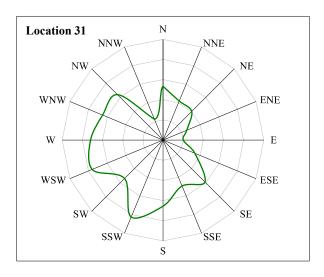

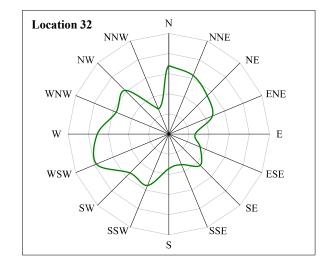



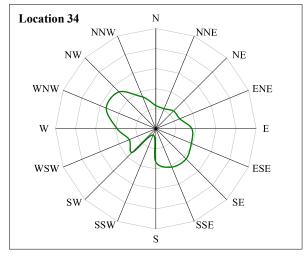

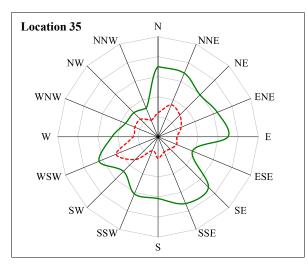





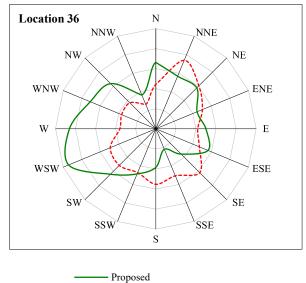



Figure B: Ground level wind velocity as a ratio of gradient wind velocity.

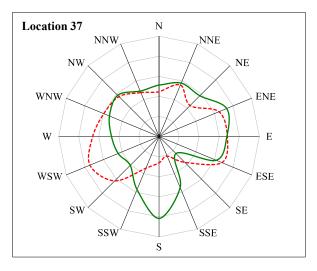


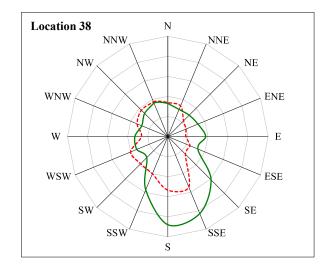




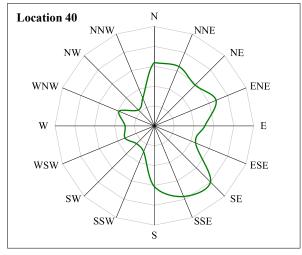


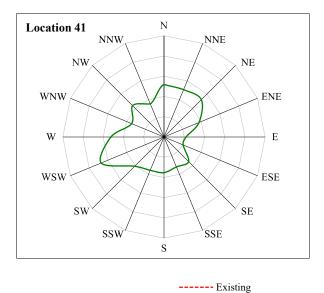


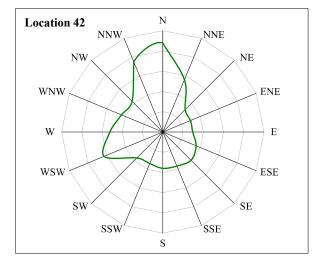



 $Figure\ B$: Ground level wind velocity as a ratio of gradient wind velocity.

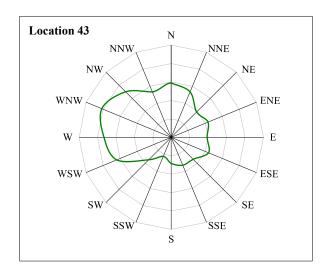


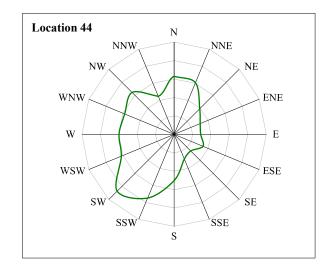

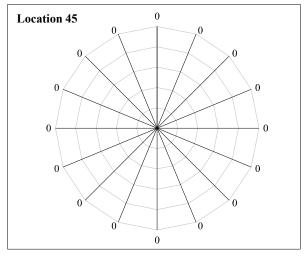

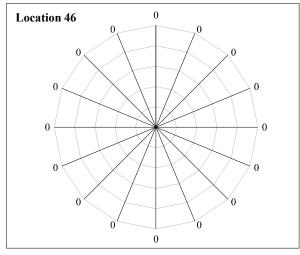

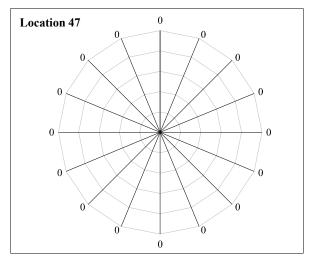

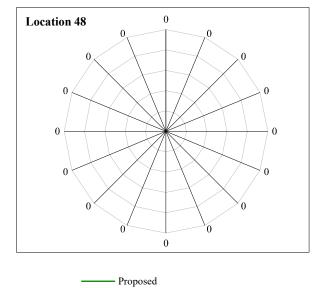

9. REFERENCES

Canadian Climate Program. <u>Canadian Climate Normals</u>, <u>1961-1990</u>. Documentation for Diskette-Based Version 2.0E (in English) Copyright 1993 by Environment Canada.

Cermak, J.E., "Applications of Fluid Mechanics to Wind Engineering A Freeman Scholar Lecture." <u>Journal of Fluids Engineering</u>, (March 1975), 9-38.

Davenport, A.G."The Dependence of Wind Loads on Meteorological Parameters." International Seminar on Wind Effects on Buildings and Structures, Ottawa, 1967.

- ----"An Approach to Human Comfort Criteria for Environmental Wind Conditions." Colloquium on Building Climatology, Stockholm, Sweden, September, 1972.
- ----"The Relationship of Wind Structure to Wind Loading." Symposium on Wind Effects on Buildings and Structures, Teddington, 1973.
- ----and N. Isyumov. "The Application of the Boundary Layer Wind Tunnel to the Prediction of Wind Loading." Proceedings of International Seminar on Wind Effects on Buildings and Structures, Ottawa, 1967.
- ----and N. Isyumov. "The Application of the Boundary Layer Wind Tunnel to the Prediction of Wind Loading." <u>International Research Seminar on Wind Effects on Buildings and Structures</u>, Toronto: University of Toronto Press, 1968.
- ----and T. Tschanz. "The Response of Tall Buildings to Wind: Effect of Wind Direction and the Direction Measurement of Force." Proceedings of the Fourth U.S.National Conference on Wind Engineering Research, Seattle, Washington, July 1981.
- -----Isyumov, N. "Studies of the Pedestrian Level Wind Environment at the Boundary Layer Wind Tunnel Laboratory University of Western Ontario." <u>Journal of Industrial Aerodynamics</u>, (1978), 187-200.
- ----and A.G.Davenport. "The Ground Level Wind Environment in Built-up Areas." Proceedings of the Fourth International Conference on Wind Effects on Buildings and Structures, London, England: Cambridge University Press, 1977, 403-422
- -----M.Mikitiuk, C.Harding and A.G.Davenport. "A Study of Pedestrian Level Wind Speeds at the Toronto City Hall, Toronto, Ontario." London, Ontario: The University of Western Ontario, Paper No.BLWT-SS17-1985, August 1985.



Milles, Irwin and John E. Freund. <u>Probability and Statistics Engineers, Toronto: Prentice-Hall</u> Canada Ltd., 1965.

National Building Code of Canada, Ottawa: National Research Council of Canada, 1990.

Simiu, Emil, <u>Wind Induced Discomfort In and Around Buildings.</u> New York: John Wiley & Sons, 1978.

Surry, David, Robert B.Kitchen and Alan Davenport, "Design Effectiveness of Wind Tunnel Studies for Buildings of Intermediate Height." <u>Canadian Journal of Civil Engineering</u> 1977, 96-116.

Theakston, F.H., "Windbreaks and Snow Barriers." Morgantown, West Virginia, ASAE Paper No. NA-62-3d, August 1962.

-----"Advances in the Use of Models to Predict Behaviour of Snow and Wind", Saskatoon, Saskatchewan: CSAE, June 1967.

Gagge, A.P., Fobelets, A.P., Berglund, L.G., "A Standard Predictive Index of Human Response to the Environment", ASHRAE Transactions, Vol. 92, p709-731, 1986.

Gagge, A.P., Nishi, Y., Nevins, R.G., "The Role of Clothing in Meeting FEA Energy Conservation Guidelines", <u>ASHRAE Transactions</u>, Vol. 82, p234-247, 1976.

Gagge, A.P., Stolwijk, J.A., Nishi, Y., "An Effective Temperature Scale Based on a Simple Model of Human Physiological Regulatory Response", <u>ASHRAE Transactions</u>, Vol. 77, p247-262, 1971.

Berglund, L.G., Cunningham, D.J., "Parameters of Human Discomfort in Warm Environments", <u>ASHRAE Transactions</u>, Vol. 92, p732-746, 1986.

ASHRAE, "Physiological Principles, Comfort, and Health", <u>ASHRAE Handbook - 1981</u> <u>Fundamentals</u>, Chapter 8, Atlanta, American Society of Heating, Refrigeration and Air-Conditioning Engineers Inc., 1981,

ASHRAE, "Airflow Around Buildings", <u>ASHRAE Handbook - 1989 Fundamentals</u>, Chapter 14, Atlanta, American Society of Heating, Refrigeration and Air-Conditioning Engineers Inc., 1989,

