



City of Mississauga

# FUNCTIONAL SERVICING AND STORMWATER MANAGEMENT REPORT

Weston Consulting.

3016-3032 Kirwin Ave & 3031 Little John Lane

December 2022

March 2021

21111

## Disclaimer

*This Report represents the work of LEA Consulting Ltd (“LEA”). This Report may not be relied upon for detailed implementation or any other purpose not specifically identified within this Report. This Document is confidential and prepared solely for the use of DVB Real Estate Investments Inc., Weston Consulting and the City of Mississauga and affiliates (the “Intended Users”). Neither LEA, its sub-consultants nor their respective employees assume any liability for any reason, including, but not limited to, negligence, to any party other than Intended Users for any information or representation herein.*

## TABLE OF CONTENTS

1	INTRODUCTION .....	1
1.1	<i>Scope of the SWM and Servicing brief</i> .....	1
1.2	<i>Site Location</i> .....	1
1.3	<i>Stormwater Management Plan Objectives</i> .....	1
1.4	<i>SWM Design Criteria – Credit Valley Conservation Authority</i> .....	1
2	EXISTING CONDITIONS .....	2
2.1	<i>General</i> .....	2
2.2	<i>Rainfall Information</i> .....	2
2.3	<i>Peak Flow Rates under Existing Condition</i> .....	3
2.4	<i>allowable rElease rate</i> .....	3
3	POST-DEVELOPMENT CONDITIONS .....	4
3.1	<i>General</i> .....	4
3.2	<i>Peak Flow Rates under Proposed Condition</i> .....	4
3.3	<i>allowable flow rate</i> .....	5
3.4	<i>Impact on Water Environment</i> .....	6
4	PROPOSED SWM PLAN .....	6
4.1	<i>Water Balance Requirement</i> .....	6
4.2	<i>Water Quantity Control Requirement</i> .....	7
4.3	<i>Water Quality Control Requirement</i> .....	8
4.4	<i>EROSION AND SEDIMENT CONTROL DURING CONSTRUCTION</i> .....	9
5	FLOODPLAIN review SUMMARY .....	9
6	SITE SERVICING .....	11
6.1	<i>Existing Municipal Services</i> .....	11
6.2	<i>Proposed Site Service Connections</i> .....	11
6.3	<i>Adequacy of Existing Municipal Services</i> .....	12
7	CONCLUSIONS .....	15

## LIST OF TABLES

Table 1: Pre-Development Runoff Coefficient.....	2
Table 2: Rainfall Parameters .....	3
Table 3: Pre-Development Peak Flow Rates (L/s) .....	3
Table 5: Post-Development Input Parameter.....	4
Table 6: Runoff Coefficient Adjustment Factors.....	5
Table 7: Post-Development Peak Flow Rates (L/s) .....	5
Table 9: Key Hydrologic Parameters .....	6
Table 10: Post Development Quantity Control as Per City's Requirement.....	8
Table 11: TTS Removal Assessment Sub-Catchment OC1.....	8
Table 13: Site Servicing Requirement .....	12
Table 14: Site Servicing Requirement .....	13

## APPENDICES

APPENDIX A	STORMWATER PEAK FLOW AND STORAGE CALCULATION FOR SUB-CATCHMENT AREA OC1 and UC1
APPENDIX B	STORMWATER PEAK FLOW CALCULATIONS FOR SUB-CATCHMENT AREA EC2 AND PC2
APPENDIX C	SANITARY AND WATER DEMAND CALCULATIONS
APPENDIX D	STORM SEWER CAPACITY ASSESSMENT AND CCTV ASSESSMENT RESULTS
APPENDIX E	HYDRANT FLOW TEST DATA AND WATERMAIN ADEQUACY ASSESSMENT DATA
APPENDIX F	FLOODLINES INFORMATION
APPENDIX G	FIGURES AND DRAWING
APPENDIX H	GEOTECHNICAL INVESTIGATION

# 1 INTRODUCTION

## 1.1 SCOPE OF THE SWM AND SERVICING BRIEF

LEA Consulting Ltd has been retained by Weston Consulting, to prepare a Functional Servicing and Stormwater Management Report for the proposed residential development project in the City of Mississauga. This Servicing and stormwater management report shall:

- ▶ Examine the potential water quality and quantity impacts of the proposed 8-storey apartment development and summarize how each will be addressed in accordance with the City of Mississauga and Credit Valley Conservation (CVC) stormwater management requirements.
- ▶ Review the existing water supply, storm, sanitary services, and propose a site servicing plan.

## 1.2 SITE LOCATION

The proposed development site is located at the southwest quadrant of Kirwin Avenue and Dundas Street East, contributory to Cooksville Creek watershed, and under the jurisdiction of Credit Valley Conservation (CVC). The site is approximately 0.64 ha in area.

## 1.3 STORMWATER MANAGEMENT PLAN OBJECTIVES

The objectives of the stormwater management plan are to review the stormwater environment impact by the proposed residential development and address the City's requirements for stormwater quantity control and quality control as required;

## 1.4 SWM DESIGN CRITERIA – CREDIT VALLEY CONSERVATION AUTHORITY

Since the Project Site is located within the City of Mississauga and the Cooksville Creek watershed, which is under jurisdiction of the Credit Valley Conservation (CVC), the following SWM criteria and guidelines were referenced during SWM analysis and design to provide direction on how to manage rainfall and runoff inside CVC and City's jurisdiction:

- ▶ City of Mississauga Development Requirements Manual, Section 8, City of Mississauga, November 2020;
- ▶ Credit Valley Conservation (CVC), Stormwater Management Criteria, August 2012;

A summary of the stormwater management criteria applied for this project is provided below:

- ▶ Storm Water Quality Control: Cooksville Creek is classified as requiring an Enhanced level of protection (80% TSS removal) by CVC quality control criteria.
- ▶ Water Quantity Control: all storm events up to 100-year post-development peak flow shall be controlled to the 2-year pre-development flow with a maximum runoff coefficient of 0.5 as required by CVC and the City of Mississauga within the Cooksville Creek Sub-watershed.
- ▶ Water Balance: The minimum on-site runoff retention will require the site to retain all runoff from a 5mm storm event through infiltration, evapotranspiration or rainwater reuse.
- ▶ Erosion Control: On-site retention of 5mm for small infill/redevelopment sites < 2.0 ha within the Cooksville Creek sub-watershed.

## 2 EXISTING CONDITIONS

### 2.1 GENERAL

The existing site is located between Kirwin Avenue and Little John Lane and consists of four single-family houses and 0.53 ha of lawn and treed area.

During rainfall events, surface rainfall-runoff of houses flows to Kirwin Avenue and runoff of the rest of the site drains to the Cooksville Creek. The total drainage area is approximately 0.64 ha.

For the purpose of SWM analysis, the development site catchment divided into the following two sub-catchment areas based on the existing drainage pattern.

- ▶ EC1 – Existing houses drains to Kirwin Ave.;
- ▶ EC2 – The green area which drains to Cooksville Creek.

The composite runoff coefficients of two sub-catchment areas are, as estimated in Appendix A and B, listed in Table 1.

Table 1: Pre-Development Runoff Coefficient

Sub-catchment No	Catchment Description	Catchment Area (ha)	Runoff Coefficient
EC1	Existing Houses	0.195	0.62*
EC2	Existing green area	0.444	0.25

\* As per City of Mississauga Design Requirements, maximum runoff coefficient of 0.5 has been considered in storm flow calculations under existing condition.

The current site does not accept any external drainage. Overland flow routes, grading and land use details under existing conditions are illustrated in Figure 1, Appendix G.

Based on our review of the topographic survey, there is no on-site stormwater management facility under the existing condition.

### 2.2 RAINFALL INFORMATION

The rainfall intensity for the site was calculated using the following equation:

$$I = A / (T_c + B)^{0.78}$$

Where; I = rainfall intensity in mm/hr,

T<sub>c</sub> = time of concentration in minutes,

A, B = constant parameters (see below)

The parameters (A and B) recommended for use in the City of Mississauga are defined in City Standard Drawing No. 2111.010 and are summarized in Table 2.

Table 2: Rainfall Parameters

Return Period (Year)	2 - Yr	5 - Yr	10 - Yr	25 - Yr	50 - Yr	100 - Yr
A	610	820	1010	1160	1300	1450
B	4.6	4.6	4.6	4.6	4.7	4.9

The initial time of concentration, TC, of 15 minutes is recommended in the City's Development Requirements Manual.

### 2.3 PEAK FLOW RATES UNDER EXISTING CONDITION

Based on the existing site condition and rainfall parameters, the Rational Method is adopted to calculate peak flows at different design storm events.

The calculated peak flow rates for each sub-catchment under pre-development condition are calculated and summarized below in Table 3. Detailed calculations are provided in Appendix A.

Table 3: Pre-Development Peak Flow Rates (L/s)

Sub-catchment ID	Sub-Catchment Description	2 - Yr	5 - Yr	10 - Yr	25 - Yr	50 - Yr	100 - Yr
EC1	Existing Houses	16.21	21.80	26.85	30.83	34.42	38.09
EC2	Existing green area	18.45	24.80	30.54	35.08	39.16	43.33

Maximum runoff coefficient of 0.5 has been considered in pre-development peak flow calculation of sub-catchment EC1.

### 2.4 Allowable Release Rate

Based on the City's record drawings, storm drainage area plan design sheets, under the existing condition, the flow from the proposed site to the Kirwin Avenue includes only the rainfall runoff from the existing houses.

In order to maintain the existing drainage condition of Kirwin Avenue, the allowable discharge flow rate from the proposed site to the existing municipal sewer on Kirwin Avenue under the proposed condition will be 16.21 l/s which is equal to the 2-yr existing flow from sub-catchment EC1 with a maximum runoff coefficient of 0.5.

## 3 POST-DEVELOPMENT CONDITIONS

### 3.1 GENERAL

The proposed development consists of construction of an 8-storey residential building with 2 underground parking levels on the northern part of the site. The proposed storm drainage condition is as follows:

Sub-catchment OC1:

This sub-catchment includes the entire development area except building frontage along the Kirwin Avenue. During rainfall events, surface storm runoff of the site will be captured by building's roof and terrace drains and proposed at-grade area drains, conveyed through internal storm piping within the underground parking to the proposed concrete storm tank and outlet to the existing municipal storm sewer on Kirwin Avenue.

Minimal landscape areas at the south and northwest side of the site will drain to the dedicated parkland. Since the land use of these small areas will remain as-is and with regard to the grading constraints, the runoff from these small areas will not be controlled.

Sub-catchment PC2:

This sub-catchment consists of the lands to be dedicated for parkland and a small portion of the development area at the west of the proposed building which will remain as-is. The existing drainage pattern will not be changed, and all storm runoff will convey and discharge to Cooksville Creek under the proposed condition

Refer to Figure 2 in Appendix G for the proposed sub-catchments, overland flow route and drainage condition.

The relevant drainage parameters of the post-development drainage areas are provided in Table 5. Refer to Appendices A and B for details. As per City's requirement, the runoff coefficient of 0.9 and was considered in the required storm storage calculation for catchment area PC1.

Sub-catchment UC1:

This sub-catchment is located North of the proposed building. Since this area is graded towards Kirwin Avenue and the flow pattern remains the runoff will not be controlled.

Table 5: Post-Development Input Parameter

Sub-Catchment No.	Drainage Area (ha)	C	Tc (min.)
OC1	0.330	0.76 (Considered 0.9 in Storm Calculations)	15
PC2 (Parkland area)	0.295	0.25	15
UC1	0.013	0.9	15

### 3.2 PEAK FLOW RATES UNDER PROPOSED CONDITION

Based on the proposed site condition and rainfall parameters, the Rational Method is adopted to calculate peak flows at different design storm events.



According to the City of Mississauga Development Requirements Manual, 2016, in order to account for the increase in runoff due to saturation of the catchment surface, for storms having a return period of more than 10 years, runoff coefficients shall be increased by the adjustment factors, up to a maximum coefficient of 1.0. Table 6 illustrate the proposed adjustment factors.

Table 6: Runoff Coefficient Adjustment Factors

Return Period (Year)	Adjustment Factor
10yr	1.00
25yr	1.10
50yr	1.20
100yr	1.25

The calculated peak flow rates for sub-catchment PC1 and PC2 under the post-development condition are summarized below in Table 7. Detailed calculations are provided in Appendices A and B.

Table 7: Post-Development Peak Flow Rates (L/s)

Sub-catchment ID	Sub-Catchment Description	2 - Yr	5 - Yr	10 - Yr	25 - Yr	50 - Yr	100 - Yr
OC1	Overcontrolled Development area	49.42	66.44	81.83	103.38 *	116.57 *	129.00 *
PC2	Parkland	12.28	16.51	20.34	23.36	26.07	28.85
UC1	Uncontrolled area	1.91	2.57	3.17	3.64	4.06	4.50

The adjusted runoff coefficients are used to calculate 25-yr to 100-yr flow.

### 3.3 OVERCONTROL TO MEET ALLOWABLE RELEASE RATE

As mentioned in Section 1.4, the proposed site is located within Cooksville Creek sub-watershed and required to control 100-year post-development flow to 2-year pre-development flow with a maximum runoff coefficient of 0.5.

Based on the City's record drawings, storm drainage area plan design sheets, under the existing condition, the flow from the proposed site to the Kirwin Avenue includes only the rainfall runoff from the existing houses.

In order to maintain the existing drainage condition of Kirwin Avenue, the allowable discharge flow rate from the proposed site to the existing municipal sewer on Kirwin Avenue under the proposed condition will be the 2-year existing flow from sub-catchment OC1.

Furthermore, as mentioned in Section 3.1, under post-development condition it is not feasible to implement discharge control for sub-catchment UC1. Therefore, the discharge from proposed residential development (sub-catchment OC1) will be overcontrolled to satisfy the City's quantity control criteria.

As a result, the allowable flow rate from proposed residential development or sub-catchment OC1 is estimated at 11.72 L/s. Detailed calculations are provided on page A-04 of Appendix A.

### 3.4 IMPACT ON WATER ENVIRONMENT

Based on the review and analysis for existing and proposed site conditions, Table 8 summarizes the key hydrologic parameters of the site under the proposed condition.

Table 9: Key Hydrologic Parameters

Sub-Catchment ID	Area (ha)		Imperviousness (%)		Runoff Coefficient		100-year Peak Flow Rate (L/s)	
	Pre-Dev	Post-Dev	Pre-Dev	Post-Dev	Pre-Dev	Post-Dev	Pre-Dev	Post-Dev
EC1 & PC1(OC1+UC1)	0.195	0.343	57.4	77.1	0.62 *	0.76 **	38.09	133.50 ***
EC2 & PC2	0.444	0.295	0	0	0.25	0.25	43.33	28.85

\*As per City's criteria, Maximum runoff coefficient of 0.5 has been considered in pre-development peak flow calculation.

\*\*As per City's comment, the overall runoff coefficient of 0.90 has been considered for sub-catchment PC1.

\*\*\*The adjusted runoff coefficient is used to calculate 100-yr flow.

The hydrologic parameters show the changes before and after the proposed development. Mitigation measures are required for sub-catchment OC1 in accordance with the CVC's design criteria. Since the land-use of the sub-catchment PC2 will not be changed and storm flow rates to the Cooksville Creek will be decreased under post development condition, no mitigation measures are required for sub-catchment PC2.

With regards to the abovementioned, the stormwater management plan is provided only for sub-catchment OC1.

## 4 PROPOSED SWM PLAN

### 4.1 WATER BALANCE REQUIREMENT

Based on the water balance criteria, the minimum on-site runoff retention requires retaining all runoff of the first 5mm from each rainfall through infiltration, evapotranspiration, etc. To satisfy the water balance criteria, an on-site storage volume of approximately 15.4 m<sup>3</sup> is required Refer to page A03 of Appendix A for detailed calculation.

The Low Impact Development (LID) methods to address the retention criteria are outlined as follows:

- ▶ Irrigation: Based on the monthly irrigation estimate provided by the design team landscape architect, the average 72-hour irrigation water use is 14.49 m<sup>3</sup>. Detailed calculations are provided in Appendix A.
- ▶ Bio-retention swale: 500 mm of 50 mm washed clear stone below the bio-retention area will provide approximately 1.2 m<sup>3</sup> of retention volume. Details and drawdown calculations for the bio-retention swales are provided in Appendix A.
- ▶ Extensive green roof: The proposed 466m<sup>2</sup> green roof reduces runoff, but does not provide retention

capacity above the first 5mm of each storm event.

Based on the provided information, a total of 15.69 m<sup>3</sup> of water retention will be re-used through irrigation and infiltration. Therefore, it is satisfactory to City's water balance requirement.

The total stormwater volume of 14.5 m<sup>3</sup> will be retained within the proposed concrete tank in the P1 parking level. The retained water will be pumped to the appropriate locations for irrigation. The pump is to be designed by the mechanical engineer in the next design stage.

In addition to the above, a water balance calculation is provided in the Hydrogeological Report. The report identified that the subject site would have a groundwater recharge deficit of 450 m<sup>3</sup>/year without any mitigation measures. The yearly irrigation demand of the subject site is 709.72 m<sup>3</sup>/year. As such, it is expected that the yearly runoff exceedance will be balanced with the irrigation of the subject site. As such, the entire water balance deficit will be covered by irrigation during the summer months.

## 4.2 WATER QUANTITY CONTROL REQUIREMENT

According to the CVC's stormwater quantity control criteria, all rainwater shall be collected by area drains, conveyed to a concrete cistern at underground parking level P1, and discharged to City's storm sewers at a 2-year pre-development flow rate with a maximum runoff coefficient of 0.5 for all storms up to and including 100-year storm.

A concrete cistern will be provided to accommodate the required stormwater storage at underground parking level P1. The location and size of the proposed cistern is shown on Architectural drawings and Dwg. C-02. A section of cistern is provided on Dwg. C-05. The detained stormwater will be discharged to Kirwin Avenue storm sewer at an overcontrolled flow rate of 11.72 L/s through a flow control device. The required orifice size to achieve the target flow would be smaller than the minimum 75mm requirement by Ministry of the Environment Conservation, and Parks (MECP). Therefore, a Contech Vortex Valve Model FA1416 with a 105mm opening will be installed at the outlet of tank to control the discharge flow.

Detail of the Vortex control device is provided in Appendix A and Dwg. C-05.

The required and provided on-site stormwater storage volumes as well as the total flow from the proposed site are calculated as shown in Appendix A and summarized in Table 10 below.

Table 10: Post Development Quantity Control as Per City's Requirement

Storm Event	Allowable Discharge Flow (L/s)	Required 5mm on-site Retention (m <sup>3</sup> )	Total Detention Storage Required (m <sup>3</sup> )	Underground Storage Provided (m <sup>3</sup> )
2-Year	11.72	15.4	36.17	170.00
5-Year			56.00	
10-Year			75.45	
25-Year			104.62	
50-Year			123.97	
100-Year			143.56	

### 4.3 WATER QUALITY CONTROL REQUIREMENT

In order to achieve the long-term average removal of 80% of Total Suspended Solids (TSS) on an annual basis from all runoff leaving the site, the following quality control measures will be provided:

Sub-catchment UC1: Based on the SWM design criteria, the residential building's rooftop area is not subject to vehicular traffic, and the application of sand and de-icing salt constituents, petroleum hydrocarbons and heavy metals. As such, runoff from the roof surface is generally considered to be clean. Table 11 provides a preliminary estimate of the TSS removal level of stormwater leaving the site.

Table 11: TSS Removal Assessment Sub-Catchment OC1

Land Use	Area (m <sup>2</sup> )	TSS Removal Efficiency (%)	Composite TSS Removal Efficiency (%)
Roof and Terraces	1300	80	31.4
Driveway and surface parking	1312	0	0
Green roof	403.0	80	9.7
Landscape	300.0	80	7.2
Jellyfish	1312.0	80	80.0
Total	3315.0	-	>80.0

To achieve a TSS removal of 80%, a stormwater quality treatment facility (StormFilter SFPD0806 or approved equivalent) is proposed to treat the flow from the proposed driveway and surface parking areas. Sizing details are provided in Appendix A.

This quality treatment unit will be installed at the inlet of the storage tank at the southeast corner of the site and outside of the underground parking footprint and will receive the flow from driveway and surface parking areas only through internal storm piping. The exact location of the unit and proper internal piping will be determined in coordination with the project team's mechanical engineer and architect in the next design stage.

## 4.4 EROSION AND SEDIMENT CONTROL DURING CONSTRUCTION

During site construction, it is recommended that all erosion and sediment control Best Management Practices (BMPs) shall be constructed and maintained in accordance with the Toronto and Region Conservation Authority (TRCA) Erosion & Sediment Control Guidelines for Urban Construction (dated 2019). In brief, the measures below are proposed to be provided on-site during the entire period of construction:

- ▶ Siltation control fence along the perimeter of the construction site before commencement of construction;
- ▶ Sediment control measures to prevent silt entry at all the existing catch basins;
- ▶ Granular mud-mats at all construction egress locations (see mud-mat details);
- ▶ An inspection and monitoring program following the *Erosion & Sediment Control Guideline for Urban Construction* (dated 2019).

An erosion and sediment control plan during construction is provided for the proposed development. Refer to Dwg. C-04 Erosion and Sediment Control Plan.

## 5 FLOODPLAIN REVIEW SUMMARY

The Cooksville Creek watershed is located within the City of Mississauga, east of the Credit River, that drains an area of approximately 33.9 Km<sup>2</sup> (3,390 ha) and outlets to Lake Ontario.

The Cooksville Creek has been modelled by R.V. Anderson Ltd. in February 1996, subsequently updated and completed by Credit Valley Conservation (CVC). The most updated floodplain map was received from CVC on September 16<sup>th</sup>, 2020 which includes the proposed development.

It should be noted that the City of Mississauga and Credit Valley Conservation approved and executed a Site Plan Agreement to permit the development of Hotel Mississauga Royale on November 27, 2012, for the proposed site. This previous approval, designed by MSAI Architects, included a northern 22-storey tower (Tower B), a southern 40-storey tower (Tower A) and a 2-story building as a connection between towers.

The previously approved regulatory floodlines, prepared by AMEC, dated February 11, 2011, and the most updated floodplain by CVC are delineated on the grading and servicing plans which are presented in Appendix G. The original floodlines drawing is provided in Appendix F.

## 6 GROUNDWATER DISCHARGE

In order to obtain information about the subsurface condition, assess any potential subsurface environmental impacts, and investigate the requirement for groundwater discharge from the development site, Azure Group Incorporated (Azure Group) is retained by Weston Consulting to provide a geotechnical investigation and hydrogeological assessment. The hydrogeological assessment report prepared by Azure Group dated October 24, 2022, is provided in Appendix H.

As per the hydrogeological report, ten (10) boreholes were drilled to a maximum depth of 9.0 meters below grade and five of them were completed as groundwater monitoring wells. The hydrogeological assessment provided the following condition with respect to sub-surface soil groundwater conditions:

- ▶ The site is underlain by a thin layer (10cm) overtop of fill mixture consisting of sand, silt and clay of different compositional percentages to a depth of around 3.5 mbgs (meter below ground surface). Below this level the boreholes intersect a native silty-clay layer to the upper contact of the underlain watershed shale bedrock which was encountered in five of the advance boreholes below 7 mbgs. The inclusion of the fragments indicate that the bedrock interface is very close to this depth.
- ▶ Groundwater depths at installed monitoring wells ranged from 4.21 to 5.29 meters below ground surface as measured on May 11<sup>th</sup> 2022. The corresponding geodetic groundwater elevations range from approximate elevations of 107.27 and 109.10 meters above sea level (masl);
- ▶ One groundwater sample was collected from monitoring well BH-3 on May 11<sup>th</sup>, 2022. Groundwater quality analysis was checked against the most stringent objectives of potential discharge points (i.e., Provincial Water Quality Objectives (PWQO), 1994). It is indicated that the only exceedance was with the Total Phosphorous. It is not noted if there are exceedances of the sewer use by-law. Therefore, if groundwater discharge is required, it must be treated for Total Phosphorous.

Based on the design of the proposed development, the total depth of the underground structure will extend to a maximum depth of approximately 6.7 meters below the ground surface (mbgs) (107.45 masl). Since the proposed construction will be below the groundwater table, groundwater will be encountered during the excavation. As such, management of groundwater will be required for both construction dewatering and long-term conditions for the proposed development site.

## 6.1 CONSTRUCTION DEWATERING

According to the Hydrogeology Assessment from Azure, a maximum rate of discharge of 83,160 L/day (0.96 L/s) will be expected from the site with a safety factor of 3, See Appendix G for more details. It is therefore anticipated that there will be groundwater discharge in excess of 50m<sup>3</sup>/day. As such, the submission of an Environmental Activity and Sector Registration (EASR) to the MECP will be required for construction dewatering. Additional dewatering would be required to manage stormwater capture during construction. However, this is expected to not trigger the need for a Permit to Take Water (PTTW) during rainfall events less than the 5-year return period. Storm events above the 5-year return period can be discharged over multiple days to avoid the need for a PTTW.

During construction, the groundwater will discharge from the excavation site to the existing 250mm sanitary sewer along Kirwin Avenue or the existing 400mm storm sewer along Kirwin Avenue. The water quality of the groundwater sample indicated only an exceedance of Total Phosphorous based on the PWQO requirements. As such, the groundwater will require Total Phosphorous treatment prior to discharge.

## 6.2 LONG-TERM DEWATERING

The building is currently proposed to be constructed to watertight standards as identified in a letter signed by the Owner. The planned watertight foundation will limit potential concerns with respect to groundwater at the site with regards to permanent dewatering of the site. The signed letter from the Owner has been provided in Appendix H.

It should be noted that if the foundation is not waterproofed, the hydrogeological report, identifies that the building would require a long-term peak dewatering flow rate of approximately 54,000 L/day (0.625 L/s) with a safety factor of 3. As the discharge rate is above the threshold of 50 m<sup>3</sup>/day, an EASR will be required. However, since the rate is below 400 m<sup>3</sup>/day, a PTTW is not required. Similar to construction dewatering,

treatments will not be required prior to discharge. In this event, the long-term dewatering would be discharged to either the 250mm sanitary sewer on Kirwin Avenue or the 400mm storm sewer on Kirwin Avenue.

## 7 SITE SERVICING

The purpose of this site servicing study is to review the site servicing requirement of the proposed new 8-storey apartment development and recommend a site servicing plan, including water supply, sanitary and storm services. Refer to Drawing C-02 in Appendix G -Site Servicing Plan for details of the proposed site service connections.

### 7.1 EXISTING MUNICIPAL SERVICES

The proposed development will require new service connections to the existing municipal storm sewers, sanitary sewers, and watermain located on Kirwin Avenue adjacent to the site. Existing underground municipal services/utilities on Kirwin Avenue are summarized below:

- a) 400mm dia. concrete storm sewer;
- b) 250mm dia. concrete sanitary sewer;
- c) 300mm dia. ductile iron watermain on the Northside of Kirwin Ave.;

### 7.2 PROPOSED SITE SERVICE CONNECTIONS

The sanitary demands have been assessed by determining the total population, sanitary generation rates, and peaking factors as outlined in the Region of Peel Criteria and the 2020 Peel Region DC Background Study. Based on the 2020 Peel Region DC Background study, the population to be considered for units less than 750 sq.ft. (69.7m<sup>2</sup>) in size and greater than 750 sq.ft. (69.7m<sup>2</sup>) in size shall be 1.6 and 3.0 respectively. As such, the total population on the subject site is 297. Using the Region of Peel standard rates and the Harmon Peaking Factor, this would result in a total domestic demand of 4.25 L/s. However, based on the total Region of Peel STD.DWG 2-5-2, the total domestic flow for populations less than 1000 should be considered as 13 L/s. Therefore, after accounting for infiltration, the total sanitary flow is 13.08 L/s.

Water demands have been calculated based on the same population estimate determined for the sanitary servicing of 297 persons. This population estimate was used in conjunction with the demand rates and factors provided by the Region of Peel to determine the maximum day demand of 0.96 L/s and the Peak Hour demand of 2.89 L/s. Using the Fire Underwriters Survey (2020) to calculate the fire demand yields a fire flow demand of 166.67 L/s. As such, the fire flow plus maximum day demand is 168.59 L/s.

Based on the project statistics of the proposed development provided by the architect, and design criteria of City and Region, sanitary flow and water demand are estimated in Appendix C and summarized in Table 13. The site storm flow discharge rate has been provided in the previous section of this report. A Single-Use Demand Table has been provided in Appendix C for use by the Region of Peel.

Table 13: Site Servicing Requirement

Site	Storm Discharge Rate (L/s)	Sanitary Discharge Rate (L/s)	Water Demand (L/s)
8-storey apartment	11.72	13.08	168.59

Through discussion with the design team, the locations and sizes of the proposed site service connections have been determined to satisfy the requirements of the City of Mississauga, Region of Peel and the Ontario Building Code (OBC). In summary:

1. Sanitary Service: A 150mm dia. sanitary service connection will be installed to service the proposed 8-storey apartment building and discharge to proposed manhole No. MH1B on the exiting 250mm concrete sanitary sewer on Kirwin Avenue.
2. Storm Service: A 200mm dia. storm service connection will be installed to drain the 8-storey apartment building area to the proposed manhole No. MH1A on the existing 400mm storm sewer on Kirwin Avenue.
3. Water service:
  - ▶ Domestic Water Service: A 100mm dia. domestic water service connection will be installed to service the proposed 8-storey apartment building and connected to the proposed 150mm dia. fire protection water service with a cut-in Tee.
  - ▶ Fire Protection Service: A 150mm fire protection PVC water service will be provided.

The existing 300mm diameter watermain on Kirwin Avenue will be utilized to service the proposed development site.

Based on the proposed underground parking P2 elevation of 107.45 m, sanitary flow from this floor will not be able to discharge to the City's sanitary sewer (Inv. 109.23m) by gravity. Therefore, pumps will be required. Pumps, piping and backflow preventers will be designed by a mechanical engineer in the next design phase.

Refer to Drawing C-02 in Appendix G for details of proposed service connections.

### 7.3 ADEQUACY OF EXISTING MUNICIPAL SERVICES

#### Sanitary

The subject development is anticipated to have a population of 297 people based on the latest architectural plans and the rates provided in the 2020 DC background study. When considering the per person sanitary demand and the Harmon peaking factor, and infiltration, the actual design flow is expected to be 4.33 L/s. However, based on the Region of Peel STD. DWG. 2-5-2 (Region of Peel, Sanitary Sewer Design Criteria, 2009), total domestic flow for areas with less than 1000 persons shall be considered to have a design flow of 13 L/s. Thus, the design flow after considering infiltration is 13.08 L/s. Refer to Appendix C for detailed calculations on the sanitary demands.

The Region of Peel will perform a capacity assessment of the downstream sanitary sewers for the subject development based on the above calculations.

#### Storm



Based on the City's design criteria, drainage area plan, record drawings, and CCTV investigation, an assessment of the existing storm sewers from the site in Kirwin Ave to the existing culvert in Dundas Street East are reviewed below:

The existing 400mm storm sewer in Kirwin Ave (identified and confirmed through the CCTV inspection), as shown on the storm drainage areas plan, is designed based on 10-year design storm and a runoff coefficient of  $C=0.45$ . The review of the drainage plan shows that the existing plaza (157 Dundas St. E.) at the northeast quadrant of Kirwin Ave and Dundas Street East has been developed later. The CCTV inspection identified the location of area drains and storm sewers within the development at the northeast quadrant of Kirwin Avenue and Dundas Street East. The drainage area plan for the downstream capacity analysis has been updated based on the location and extent of the storm management system in the property in the northeast quadrant of Kirwin Avenue and Dundas Street East.

Based on the above assumption, the runoff coefficient is updated according to the existing land use. The flow is calculated and summarized in Table 14.

Table 14: Downstream Sewer Capacity – Proposed Condition

Street	Manhole To-From	Accumulative Drainage Area (ha)*	Q 10-yr Flow (L/S)	Q <sub>full</sub> Full Capacity (L/S)	Q <sub>full</sub> /Q
Kirwin Avenue	MH31 to 5	1.019	156	233	0.67
Kirwin Avenue	5 to 4 (MH30)	1.285	218	233	0.94
Dundas Street East	4 (MH30) to 3	36.925	4013	4431	0.91
Dundas Street East	3 to 2	37.285	4013	4416	0.91
Dundas Street East	2 to 1 (culvert)	37.465	3985	4507	0.88

\*Accumulative Drainage Area in this table includes the area from the Subject Site in post-development conditions.

Under post-development conditions, the discharge storm flows from the site will be controlled to 2-yr pre-development or 16.21 L/s which is less than the 10-yr flow rate of 33.29 L/s under the existing condition. As described in Section 4, the site is overcontrolled to account for the 100-year uncontrolled release to Kirwin Avenue. In the downstream sewer analysis, this flow is accounted for as the 10-year flow. Therefore, the total flow to the existing storm sewer in Kirwin Avenue will be decreased from 240 L/s to 218 L/s which is less than the existing 400mm storm sewer capacity. The flow calculation and updated runoff coefficient and design sheets are provided in Appendix D. It should be noted that only a small portion of the 400mm sewer on Kirwin Avenue experiences a  $Q/Q_{full}$  ratio of 0.94. This occurs downstream of the location where the catch basins in the intersection of Kirwin and Dundas connect into the sewer. Refer to Figure 3 in Appendix D for details on the location of this connection point. As such, the majority of the 400mm sewer on Kirwin Avenue experiences a  $Q/Q_{full}$  ratio of 0.67 in post-development conditions.

Since the proposed conditions do not demonstrate a surcharge condition within the downstream sewers, it is not expected that any upgrades will be required within the downstream storm sewer network.

Watermain

The design water demand is estimated as 168.59 L/s (1879.68 US GPM) based on the project statistics. In order to evaluate the adequacy of the 300mm watermain located on Kirwin Avenue, a hydrant flow test was conducted on June 15, 2017, by Focus Fire Protection. Test results are included in Appendix E.

As shown by the test readings, the available water pressure ranges from 74 psi with a flow of 1521 US GPM to 76 psi with a flow of 1000 US GPM during the flow test with a static pressure of 80 psi. At the design water demand of 168.59 L/s (2672.18 US GPM) generated from the development, the flow test results show a residual pressure of 57.4 psi, which is greater than the minimum requirement of 20 psi (150 kPa). Therefore, adequate water supply and pressure are available to serve the proposed development.

It should be noted that the design and location of the building does not allow for all portions of the building faces to be less than 90m from the nearest hydrant. As such, a private hydrant is proposed on the site at the northern limit of the site. This private hydrant will provide the required coverage of all portions of all faces of the building. Please refer to Drawing C-02 for details on the location of the private hydrant.

## 8 CONCLUSIONS

### Stormwater Management Plan

- ▶ Under the existing condition, there are no existing on-site stormwater management facilities.
- ▶ An on-site storage volume of approximately 15.40 m<sup>3</sup> will be provided by the underground cistern and bio-swale for retaining the first 5mm of rainfall runoff as required to achieve the water balance target. This portion of water will be re-used on-site for irrigation during 72 hours and a small portion will infiltrate into soil through bio-swale.
- ▶ An on-site storage tank with approximately 170 m<sup>3</sup> in volume will be provided in order to control the post-development 100-year stormwater flows to 2-year pre-development level.
- ▶ To satisfy the City's 80% TSS removal, a stormwater quality treatment facility (StormFilter SFPD0806 or approved equivalent) is proposed for Sub-Catchment Area OC1.
- ▶ Sub-catchment C2 includes the land to be dedicated to the parkland and to remain as the existing condition. Therefore, no stormwater management plan is required.

### Temporary Erosion & Sediment Control Measures

- ▶ Temporary erosion and sediment control measures will be provided before construction and maintained during construction in accordance with CVC CA's "Stormwater Management Criteria"

### Site Servicing

Proposed site service connections for the proposed development site:

- ▶ Storm service: 200mm dia. PVC pipes
- ▶ Sanitary service: 150mm dia. PVC pipes
- ▶ Water service:
  - 100mm dia. PVC pipe for domestic water supply
  - 150mm dia. PVC pipe for fire water supply

Prepared By:  
LEA Consulting Ltd.



Farshid Morshedi, P.Eng.  
Water Resources Engineer


A handwritten signature in black ink that reads "Pavel Recnik".

Pavel Recnik, EIT  
Hydraulic Modelling Lead

# APPENDIX A

Stormwater Peak Flow and Storage Calculation for  
Sub-Catchment Area OC1 and UC1



 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Land Use</b>			
	Prepared:	F.M.	Page No.	A-01
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031 LITTLE          JOHN LANE          SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Checked:	B.H.		
	Proj. #	21111		
	Date:	07-Nov-22		

**Pre-Development CONDITION**

**Sub-Catchment EC1**

Existing Land Use	Area (m <sup>2</sup> )
Building	360.0
Asphalt	759.0
Lawn & Tree	830.0
<b>Sum. Area:</b>	<b>1949.0</b>

**Post-Development Condition:**

**Sub-Catchment OC1**

Proposed Land Use	Area (m <sup>2</sup> )
Building (without green roof)	1421.5
Paved Area	1096.6
Green Roof	466.0
Landscaped Area	316.4
<b>Sum. Area:</b>	<b>3300.5</b>

**Sub-Catchment UC1**

Proposed Land Use	Area (m <sup>2</sup> )
Paved Area	126.7
Landscaped Area	3.9
<b>Sum. Area:</b>	<b>130.6</b>



**LEA Consulting Ltd.**  
Consulting Engineers and  
Planners

**Composite "C" Calculation**

Prepared:	F.M.	Page No.	A-02
Checked:	B.H.		

**Project: 3016-3032 KIRWIN AVE & 3031  
LITTLE JOHN LANE  
SUB-CATCHMENT EC1 & PC1 (OC1+UC1)**

Proj. #	21111
Date:	07-Nov-22

**Pre-Development Composite Runoff Coefficient "C"**

**Sub-Catchment EC1**

Existing Land Use	Area (ha)	C	Composite "C"
Building	0.036	0.90	
Asphalt	0.076	0.90	
Lawn & Tree	0.083	0.25	

**Sum. Area: 0.195**      **0.62**  
**0.50**      As per City's Criteria

**Imperviousness Percent: 57.4**

**Post-Development Composite Runoff Coefficient "C"**

**Sub-Catchment OC1**

Proposed Land Use	Area (ha)	C	Composite "C"
Building (without green roof)	0.142	0.90	
Paved Area	0.110	0.90	
Green Roof	0.047	0.25	
Landscaped Area	0.032	0.4	

**Sum. Area: 0.330**      **0.76**  
**0.90**      As per City's request

**Imperviousness Percent: 76.3**

**Sub-Catchment UC1**

Proposed Land Use	Area (ha)	C	Composite "C"
Paved Area	0.013	0.90	
Landscaped Area	0.000	0.25	


**Sum. Area: 0.013**      **0.88**

**Imperviousness Percent: 97.0**

**Total Site Area: 0.343**

**Composite runoff coefficient for entire site: 0.76**

**Total impervious percent: 77.1**

 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>5mm Rainfall Retention Volume (Water Balance)</b>			
	Prepared:	F.M.	Page No.	A-03
	Checked:	M.D.		
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031          LITTLE JOHN LANE          SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Proj. #	21111		
	Date:	07-Nov-22		

According to the CVC Guidelines, in order to achieve the water balance target, it is required to retain all runoff from a small event - typically 5mm (in Toronto, storms with 24 hour volumes of 5mm or less contribute about 50% of the total average annual rainfall volume) through infiltration, evapotranspiration & rainwater reuse.


Site Area: 0.343 ha  
 Runoff Coefficient : 0.90 Post-development site conditions

Runoff volume from 5mm rainfall event on site:

$$V = 0.343 \times 10 \times 5 \times 0.9 = 15.4 \text{ m}^3$$

**Required on-site retention volume for 5mm rainfall event: 15.4 m<sup>3</sup>**



 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Pre-Development Peak Flow Rates Calculation</b>		
	Prepared:	F.M.	Page No. A-04
	Checked:	B.H.	
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031 LITTLE JOHN LANE</b> <b>SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Proj. #	21111	
	Date:	07-Nov-22	

**Rational Formulae:**  $Q = 2.78 CIA (L/s)$

Site Area: 0.195 ha  
 Time of Concentration: 15 minutes as per City Guidelines  
 Runoff Coefficient: 0.50 As per City's Criteria

**Rainfall Intensity:**  $I = a/(Tc+b)^c$  (City Std. 2111.010)

Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Rainfall Intensity (mm/hr):	59.89	80.51	99.17	113.89	127.13	140.69


**Peak Flow Rate (L/s):**

Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Under existing site conditions (L/s):	16.21	21.80	26.85	30.83	34.42	38.09

The proposed site is under Cooksville Creek and requires to control post development flow to 2-year pre development flow for storm events that include the regional storm based on the CVC stormwater management Criteria, 2012. Furthermore, the storm runoff from the building frontage along the Kirwin Avenue (Sub-catchment UC1) is not feasible to be controlled due to the site constraint, therefore, the stormwater discharge from catchment OC1 will be overcontrolled. I.e. allowable discharge flow rate from sub-catchment OC1 will be:

Sub-catchment UC1 (Post Development 100-yr storm): 4.50 L/s  
 Sub-catchment OC1 (Pre-development 2-yr storm): 16.21 L/s

**Overcontrolled discharge rate from sub-Catchment OC1 into municipal storm sewer on Kirwin Avenue: 11.72 L/s**

 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Post-Development Peak Flow Rates Calculation (Uncontrolled)</b>		
	Prepared:	F.M.	Page No. A-05
	Checked:	B.H.	
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031 LITTLE JOHN LANE SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Proj. #	21111	
	Date:	07-Nov-22	

**Rational Formulae:**  $Q = 2.78 \text{ CIA (L/s)}$

Overcontrolled Area (OC1): 0.330 ha  
 Time of Concentration: 15 minutes as per City Guidelines  
 Runoff Coefficient : 0.90 As per City's request

Uncontrolled Area (UC1): 0.013 ha  
 Time of Concentration: 15 minutes as per City Guidelines  
 Runoff Coefficient : 0.88

Runoff Coefficient Adjustment Factors	Adjusted runoff coefficient
1.00 (10-year)	0.9
1.10 (25-year)	0.99
1.20 (50-year)	1.0
1.25 (100-year)	1.0

**Rainfall Intensity:  $I = a/(Tc+b)^c$**  (City Std. 2111.010)

Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Rainfall Intensity (mm/hr):	59.89	80.51	99.17	113.89	127.13	140.69


**Peak Flow Rates (L/s):**

**Sub-Catchment OC1**

Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Under Post development site conditions (L/s):	49.42	66.44	81.83	93.98	104.91	116.10
Under Post development condition with Adjustment Factors (L/s):	49.42	66.44	81.83	103.38	116.57	129.00

**Sub-Catchment UC1**

Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Under Post development site conditions (L/s):	1.91	2.57	3.17	3.64	4.06	4.50

 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Post-Development Peak Flow Rates to Jellyfish Filter</b>		
	Prepared:	F.M.	Page No. A-06
	Checked:	B.H.	
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031 LITTLE JOHN LANE SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Proj. #	21111	
	Date:	07-Nov-22	

**Rational Formulae:**  $Q = 2.78 CIA (L/s)$

Non-clean drainage area 0.064 ha  
 Time of Concentration: 15 minutes as per City Guidelines  
 Runoff Coefficient : 0.90 As per City's request

Runoff Coefficient Adjustment Factors	Adjusted runoff coefficient
1.00 (10-year)	0.9
1.10 (25-year)	0.99
1.20 (50-year)	1.0
1.25 (100-year)	1.0


**Rainfall Intensity:  $I = a/(Tc+b)^c$**  (City Std. 2111.010)

Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Rainfall Intensity (mm/hr):	59.89	80.51	99.17	113.89	127.13	140.69

**Peak Flow Rates (L/s):**

**Non-clean drainage area**

Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Under Post development site conditions (L/s):	9.54	12.82	15.79	18.14	20.25	22.41
Under Post development condition with Adjustment Factors (L/s):	9.54	12.82	15.79	19.95	22.50	24.90


 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>On-Site Storage Calculation (2-Year Storm)</b>			
	Prepared:	F.M.	Page No.	A-07
	Checked:	B.H.		
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031          LITTLE JOHN LANE          SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Proj. #	21111		
	Date:	07-Nov-22		

Total Drainage Area (ha) = 0.330      ha  
 Drainage Area Composite C = 0.90  
 Allowable Release Rate = 11.72      L/s  
 Return Period = 2      Year

**Site storage Requirement:**

Time (minutes)	Rainfall Intensity (mm/hr)	Peak Flow (L/s)	Storm Runoff Volume (m <sup>3</sup> )	Release Rate (L/s)	Release Flow Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
15	59.89	49.42	44.48	11.72	10.55	33.93
20	50.16	41.40	49.67	11.72	14.06	35.61
25	43.42	35.83	53.75	11.72	17.58	36.17
30	38.45	31.73	57.11	11.72	21.09	36.02
35	34.60	28.55	59.97	11.72	24.61	35.36
40	31.54	26.03	62.46	11.72	28.12	34.34
45	29.03	23.96	64.68	11.72	31.64	33.04
50	26.94	22.23	66.68	11.72	35.16	31.52
55	25.16	20.76	68.50	11.72	38.67	29.83
60	23.62	19.49	70.18	11.72	42.19	27.99
65	22.29	18.39	71.73	11.72	45.70	26.03
70	21.12	17.42	73.18	11.72	49.22	23.96
75	20.07	16.56	74.54	11.72	52.73	21.81
80	19.14	15.80	75.82	11.72	56.25	19.57
85	18.30	15.10	77.03	11.72	59.76	17.27
90	17.54	14.48	78.18	11.72	63.28	14.90
95	16.85	13.91	79.27	11.72	66.79	12.48
100	16.22	13.39	80.32	11.72	70.31	10.01
105	15.64	12.91	81.32	11.72	73.83	7.49
110	15.11	12.47	82.27	11.72	77.34	4.93

**Required Storage Volume = 36.17 m<sup>3</sup>**


 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>On-Site Storage Calculation (5-Year Storm)</b>			
	Prepared:	F.M.	Page No.	A-08
	Checked:	B.H.		
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031          LITTLE JOHN LANE          SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Proj. #	21111		
	Date:	07-Nov-22		

Total Drainage Area (ha) = 0.330      ha  
 Drainage Area Composite C = 0.90  
 Allowable Release Rate = 11.72      L/s  
 Return Period = 23.44      Year

**Site storage Requirement:**

Time (minutes)	Rainfall Intensity (mm/hr)	Peak Flow (L/s)	Storm Runoff Volume (m <sup>3</sup> )	Release Rate (L/s)	Release Flow Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
15	80.51	66.44	59.79	11.72	10.55	49.24
20	67.43	55.65	66.78	11.72	14.06	52.72
25	58.37	48.17	72.25	11.72	17.58	54.67
30	51.68	42.65	76.76	11.72	21.09	55.67
35	46.52	38.39	80.61	11.72	24.61	56.00
40	42.40	34.99	83.97	11.72	28.12	55.85
45	39.02	32.20	86.95	11.72	31.64	55.31
50	36.21	29.88	89.64	11.72	35.16	54.48
55	33.82	27.90	92.09	11.72	38.67	53.42
60	31.76	26.21	94.34	11.72	42.19	52.15
65	29.96	24.72	96.43	11.72	45.70	50.73
70	28.38	23.42	98.37	11.72	49.22	49.15
75	26.98	22.27	100.20	11.72	52.73	47.47
80	25.73	21.23	101.92	11.72	56.25	45.67
85	24.60	20.30	103.55	11.72	59.76	43.79
90	23.58	19.46	105.09	11.72	63.28	41.81
95	22.66	18.70	106.56	11.72	66.79	39.77
100	21.81	17.99	107.97	11.72	70.31	37.66
105	21.03	17.35	109.31	11.72	73.83	35.48
110	20.31	16.76	110.60	11.72	77.34	33.26

**Required Storage Volume = 56.00 m<sup>3</sup>**


 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>On-Site Storage Calculation (10-Year Storm)</b>			
	Prepared:	F.M.	Page No.	A-09
	Checked:	B.H.		
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031          LITTLE JOHN LANE          SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Proj. #	21111		
	Date:	07-Nov-22		

Total Drainage Area (ha) = 0.330      ha  
 Drainage Area Composite C = 0.90  
 Allowable Release Rate = 11.72      L/s  
 Return Period = 10                      Year

**Site storage Requirement:**

Time (minutes)	Rainfall Intensity (mm/hr)	Peak Flow (L/s)	Storm Runoff Volume (m <sup>3</sup> )	Release Rate (L/s)	Release Flow Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
15	99.17	81.83	73.65	11.72	10.55	63.10
20	83.06	68.54	82.25	11.72	14.06	68.19
25	71.90	59.33	88.99	11.72	17.58	71.41
30	63.66	52.53	94.55	11.72	21.09	73.46
35	57.30	47.28	99.29	11.72	24.61	74.68
40	52.22	43.09	103.42	11.72	28.12	75.30
45	48.07	39.66	107.09	11.72	31.64	75.45
50	44.60	36.80	110.40	11.72	35.16	75.24
55	41.65	34.37	113.42	11.72	38.67	74.75
60	39.11	32.28	116.20	11.72	42.19	74.01
65	36.91	30.45	118.77	11.72	45.70	73.07
70	34.96	28.85	121.17	11.72	49.22	71.95
75	33.24	27.43	123.42	11.72	52.73	70.69
80	31.69	26.15	125.54	11.72	56.25	69.29
85	30.31	25.01	127.54	11.72	59.76	67.78
90	29.05	23.97	129.44	11.72	63.28	66.16
95	27.90	23.03	131.25	11.72	66.79	64.46
100	26.86	22.16	132.98	11.72	70.31	62.67
105	25.90	21.37	134.64	11.72	73.83	60.81
110	25.01	20.64	136.22	11.72	77.34	58.88

**Required Storage Volume = 75.45 m<sup>3</sup>**


 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>On-Site Storage Calculation (25-Year Storm)</b>			
	Prepared:	F.M.	Page No.	A-010
	Checked:	B.H.		
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031          LITTLE JOHN LANE          SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Proj. #	21111		
	Date:	07-Nov-22		

Total Drainage Area (ha) = 0.330      ha  
 Drainage Area Composite C = 0.90  
 Allowable Release Rate = 11.72      L/s  
 Return Period = 25      Year  
 adjusted Runoff coefficient = 1.1  
 Adjustment runoff coefficient = 0.99

**Site storage Requirement:**

Time (minutes)	Rainfall Intensity (mm/hr)	Peak Flow (L/s)	Storm Runoff Volume (m <sup>3</sup> )	Release Rate (L/s)	Release Flow Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
15	113.89	103.38	93.04	11.72	10.55	82.49
20	95.40	86.59	103.91	11.72	14.06	89.85
25	82.58	74.95	112.43	11.72	17.58	94.85
30	73.11	66.36	119.45	11.72	21.09	98.36
35	65.80	59.73	125.44	11.72	24.61	100.83
40	59.98	54.44	130.66	11.72	28.12	102.54
45	55.21	50.11	135.30	11.72	31.64	103.66
50	51.22	46.49	139.48	11.72	35.16	104.32
55	47.84	43.42	143.29	11.72	38.67	104.62
60	44.92	40.78	146.80	11.72	42.19	104.61
65	42.39	38.47	150.05	11.72	45.70	104.35
70	40.15	36.45	153.08	11.72	49.22	103.86
75	38.17	34.65	155.92	11.72	52.73	103.19
80	36.40	33.04	158.60	11.72	56.25	102.35
85	34.81	31.59	161.13	11.72	59.76	101.37
90	33.36	30.28	163.53	11.72	63.28	100.25
95	32.05	29.09	165.82	11.72	66.79	99.03
100	30.85	28.00	168.00	11.72	70.31	97.69
105	29.74	27.00	170.10	11.72	73.83	96.27
110	28.73	26.08	172.10	11.72	77.34	94.76

**Required Storage Volume = 104.62 m<sup>3</sup>**

 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>On-Site Storage Calculation (50-Year Storm)</b>			
	Prepared:	F.M.	Page No.	A-011
	Checked:	B.H.		
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031          LITTLE JOHN LANE          SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Proj. #	21111		
	Date:	07-Nov-22		


Total Drainage Area (ha) = 0.330      ha  
 Drainage Area Composite C = 0.90  
 Allowable Release Rate = 11.72      L/s  
 Return Period = 50      Year  
 Runoff coefficient adjustment factor = 1.2  
 Adjustment runoff coefficient = 1.0

**Site storage Requirement:**

Time (minutes)	Rainfall Intensity (mm/hr)	Peak Flow (L/s)	Storm Runoff Volume (m <sup>3</sup> )	Release Rate (L/s)	Release Flow Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
15	127.13	116.57	104.91	11.72	10.55	94.36
20	106.57	97.71	117.26	11.72	14.06	103.20
25	92.30	84.63	126.94	11.72	17.58	109.36
30	81.75	74.95	134.92	11.72	21.09	113.83
35	73.60	67.48	141.72	11.72	24.61	117.11
40	67.10	61.52	147.65	11.72	28.12	119.53
45	61.77	56.64	152.92	11.72	31.64	121.28
50	57.32	52.56	157.67	11.72	35.16	122.51
55	53.54	49.09	162.00	11.72	38.67	123.33
60	50.28	46.11	165.98	11.72	42.19	123.79
65	47.45	43.50	169.67	11.72	45.70	123.97
70	44.95	41.22	173.11	11.72	49.22	123.89
75	42.74	39.18	176.33	11.72	52.73	123.60
80	40.76	37.37	179.37	11.72	56.25	123.12
85	38.97	35.73	182.24	11.72	59.76	122.48
90	37.36	34.25	184.97	11.72	63.28	121.69
95	35.89	32.91	187.56	11.72	66.79	120.77
100	34.54	31.67	190.04	11.72	70.31	119.73
105	33.31	30.54	192.41	11.72	73.83	118.58
110	32.17	29.50	194.69	11.72	77.34	117.35

**Required Storage Volume = 123.97 m<sup>3</sup>**



 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>On-Site Storage Calculation (100 - Year Storm)</b>			
	Prepared:	F.M.	Page No.	A-012
	Checked:	B.H.		
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031          LITTLE JOHN LANE          SUB-CATCHMENT EC1 &amp; PC1 (OC1+UC1)</b>	Proj. #	21111		
	Date:	07-Nov-22		

Total Drainage Area (ha) = 0.330      ha  
 Drainage Area Composite C = 0.90  
 Allowable Release Rate = 11.72      L/s  
 Return Period = 100      Year  
 Runoff coefficient adjustment factor = 1.25  
 Adjustment runoff coefficient = 1.0

**Site storage Requirement:**

Time (minutes)	Rainfall Intensity (mm/hr)	Peak Flow (L/s)	Storm Runoff Volume (m <sup>3</sup> )	Release Rate (L/s)	Release Flow Volume (m <sup>3</sup> )	Required Storage Volume (m <sup>3</sup> )
15	140.69	129.00	116.10	11.72	10.55	105.55
20	118.12	108.30	129.96	11.72	14.06	115.90
25	102.41	93.90	140.85	11.72	17.58	123.27
30	90.77	83.23	149.81	11.72	21.09	128.72
35	81.77	74.98	157.45	11.72	24.61	132.84
40	74.58	68.38	164.11	11.72	28.12	135.99
45	68.68	62.97	170.03	11.72	31.64	138.39
50	63.75	58.45	175.36	11.72	35.16	140.20
55	59.56	54.61	180.22	11.72	38.67	141.55
60	55.95	51.30	184.68	11.72	42.19	142.49
65	52.81	48.42	188.82	11.72	45.70	143.12
70	50.03	45.88	192.68	11.72	49.22	143.46
75	47.58	43.62	196.29	11.72	52.73	143.56
80	45.38	41.60	199.70	11.72	56.25	143.45
85	43.39	39.79	202.92	11.72	59.76	143.16
90	41.60	38.14	205.97	11.72	63.28	142.69
95	39.97	36.65	208.88	11.72	66.79	142.09
100	38.47	35.28	211.65	11.72	70.31	141.34
105	37.10	34.02	214.31	11.72	73.83	140.48
110	35.84	32.86	216.86	11.72	77.34	139.52

**Required Storage Volume = 143.56 m<sup>3</sup>**

## APPENDIX A-13

Estimation of the Percolation Rate and  
Permeability of the Soil Letter

Azure Group





October 13, 2022

2202-001

Page 1 of 2

Weston Consulting  
201 Millway Avenue #19, Concord  
ON L4K 5K8

Attention: Mr. Kaveh Wahdat - Planner

Re: **Estimation of the Percolation Rate and Permeability of the Soil** at  
3016 - 3032 Kirwin Avenue and 3031 Little John Lane, Mississauga

---

Dear Sir,

Azure Group carried out geotechnical investigations for the site located at 3016 - 3031 Kirwin Avenue and 3031 Little John Lane in Mississauga, Ontario, project number 2202-001 dated April 2022 to provide recommendations for the design and construction of multi storey building. Ten (10) boreholes were advanced at various locations to depths ranging between  $\pm 8$  m and refusal depth of  $\pm 11$  m below the existing ground surface and were sampled at 0.75 m (up to 3 m depth) and 1.5 m interval below 3 m depth with a conventional 50 mm diameter split barrel samplers when Standard Penetration Test (SPT) was carried out. The soil samples obtained from the spoons were then tested to obtain the engineering parameters and properties to be used for the design of the building.

However, parameters to obtain the percolation rate "T" and permeability "K" of the soils (for the design of Storm Water Managements "SWM" and/or swells) were not determined since they were not in the scope of work.

The percolation rate "T" and permeability "K" may be obtained directly from field test or indirectly from soil description (grain size analysis) as recommended by the Ontario Building Code (OBC) Supplementary Standard SP-7 Table 2. Table 2 provides an estimate of percolation Rate "T" and coefficient of permeability "K" of the soil based on soil description.

Since field percolation tests were not carried out at the time of the geotechnical investigation, OBC Supplementary Standard tables were used to estimate the percolation rate and permeability of the soil.

Table 1 provides a summary of the percolation and permeability of the soils obtained from the boreholes at various depths:

BH No.	Depth (m)	Type of soil	K (cm/sec)	T (min./cm)	Comments
BH101	0 - 2.3	Silty clay/clayey silt	$10^{-5} - 10^{-6}$	20 - 50	Medium to low permeability
	2.3 - 4.6	Silty sand/sandy silt	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
BH102	0 - 1.5	Silty clay/clayey silt	$10^{-5} - 10^{-6}$	20 - 50	Medium to low permeability
	1.5 - 2.3	Silty clay/clayey silt	$10^{-5} - 10^{-6}$	20 - 50	Medium to low permeability

**Azure Group Inc.**

6751 Professional Court, Suite 201, Mississauga, ON, L4V 1Y3, Canada

T: 905 673 2694 C: 416 7792694 F: 416 907 26944 E: [info@azuregroup.ca](mailto:info@azuregroup.ca) [www.azuregroup.ca](http://www.azuregroup.ca)



	2.3 - 4.6	Sand & gravel	$10^{-1} - 10^{-3}$	2 - 8	Medium to low permeability
BH103	0 - 2.3	Silty clay	$10^{-5} - 10^{-6}$	20 - 50	Medium to low permeability
	2.3 - 4.6	Silty sand/sandy silt	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
BH104	0 - 0.8	Silty sand/sandy silt	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
	0.8 - 4.6	Clayey silt/silty clay	$10^{-5} - 10^{-6}$	20 - 50	Medium to low permeability
BH105	0 - 0.8	Silty sand/sandy silt	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
	0.8 - 1.5	Sand trace clay	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
	1.5 - 4.6	Sand/silty sand	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
BH106	0 - 1.5	Silty sand/sandy silt	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
	1.5 - 4.6	Clayey silt	$10^{-5} - 10^{-6}$	20 - 50	Medium to low permeability
BH107	0 - 4.6	Silty sand/sandy silt	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
BH108	0 - 4.6	Silty sand/sandy silt	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
BH109	0 - 1.5	Silty sand/sandy silt	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
	1.5 - 4.6	Clayey silt trace gravel	$10^{-5} - 10^{-6}$	20 - 50	Medium to low permeability
BH110	0 - 1.5	Silty sand/sandy silt	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability
	1.5 - 3.0	Clayey silt/sandy silt	$10^{-5} - 10^{-6}$	20 - 50	Medium to low permeability
	3.0 - 4.6	Silty sand/sandy silt	$10^{-3} - 10^{-5}$	8 - 20	Medium permeability

*Table 1: Percolation and Permeability of the Soil*

**Discussion:**

The percolation and permeability of the soils were obtained indirectly from soil description based on Table 2 of the OBC Supplementary Standard SP-7. In general, the soils tested may be classified as of Medium Permeability. However, the soils at some locations and depths may be classified as of medium to low permeability.

**Recommendations:**

The Percolation Rate “T” and Permeability “K” which were estimated from the soil description, do not represent the actual values since there were only a limited portion of samples collected from the layer tested. For more accurate values, additional field testing should be carried out at the location of the proposed Storm Water Management (SWM).


Should you have any questions, please contact us at your convenience.

Yours very truly,

**AZURE GROUP INC.**

Janan Sulaiman, Ph.D., P.Eng.  
Senior Geotechnical Engineer  
[jsulaiman@azuregroup.ca](mailto:jsulaiman@azuregroup.ca)

Ahmed Al-Temimi, M.Sc., P.Eng., QP<sub>(ESA)</sub>  
Ontario Designated Consulting Engineer  
[aaltemimi@azuregroup.ca](mailto:aaltemimi@azuregroup.ca)

 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Drawdown Time Calculation</b>			
	Prepared:	P.R.	Table No.	A-014
	Checked:	F.M.		
<b>Project: 3016-3032 Kirwin Avenue</b> <b>Bio-swale</b>	Proj. #	21036		
	Date	07-Nov-22		

Based on the Estimation of the Percolation and Permeability of the Soil (dated October 13, 2022)

Hydraulic Conductivity (K):	$1 \times 10^{-6}$ m/s
Infiltration Rate Estimated from Hydraulic Conductivity:	46.264 mm/hr
Safety factor:	4.5

The Hydraulic Conductivity (K) of soil was selected to produce the smallest infiltration rate based on the range provided by Azure. This results in a conservative estimation of the drawdown time.

Due to high conductivity soils in lower strata, it is expected that the factor should be 2.5. However, this calculation uses a conservative safety factor to demonstrate that the drawdown will be sufficient.

**Adjusted infiltration rate: 10.3 mm/hr**

**Drainage to Bioswale: 73.0 m<sup>2</sup>**

**Runoff from a 10mm storm event: 0.73 m<sup>3</sup>**

**Clear Stone Detention Design Parameters:**

Depth of Granular Stones:	500.0 mm
Porosity (n):	0.40
Granular Area (A):	5.8 m <sup>2</sup>
Distance to Water Table (D <sub>WT</sub> ):	3.3 m
<b>Water Storage Volume (V):</b>	<b>1.2 m<sup>3</sup></b>

$$A = (1000V) / Pnt$$

**Drawdown time (t) 48.63 hrs**


A = Bottom Area                      n = Porosity  
 V = Volume                              t = Drawdown time  
 P = Infiltration Rate (mm/hr)

# APPENDIX A-15

## Vortex Valve Flow Control Device



FA1416 with 105 mm Outlet	
Head (m)	Flow (l/s)
0.000	0.000
0.038	1.168
0.076	2.389
0.114	3.713
0.152	4.389
0.191	4.513
0.229	4.318
0.267	4.439
0.305	4.902
0.343	5.278
0.381	5.578
0.419	5.858
0.457	6.159
0.610	7.185
0.762	8.070
0.914	8.902
1.067	9.468
1.219	9.893
1.372	10.212
1.524	10.513
1.676	10.757
1.829	10.990
1.981	11.192
2.134	11.394
2.286	11.567
2.438	11.741
2.591	11.904
2.743	12.056
2.896	12.208
3.048	12.343

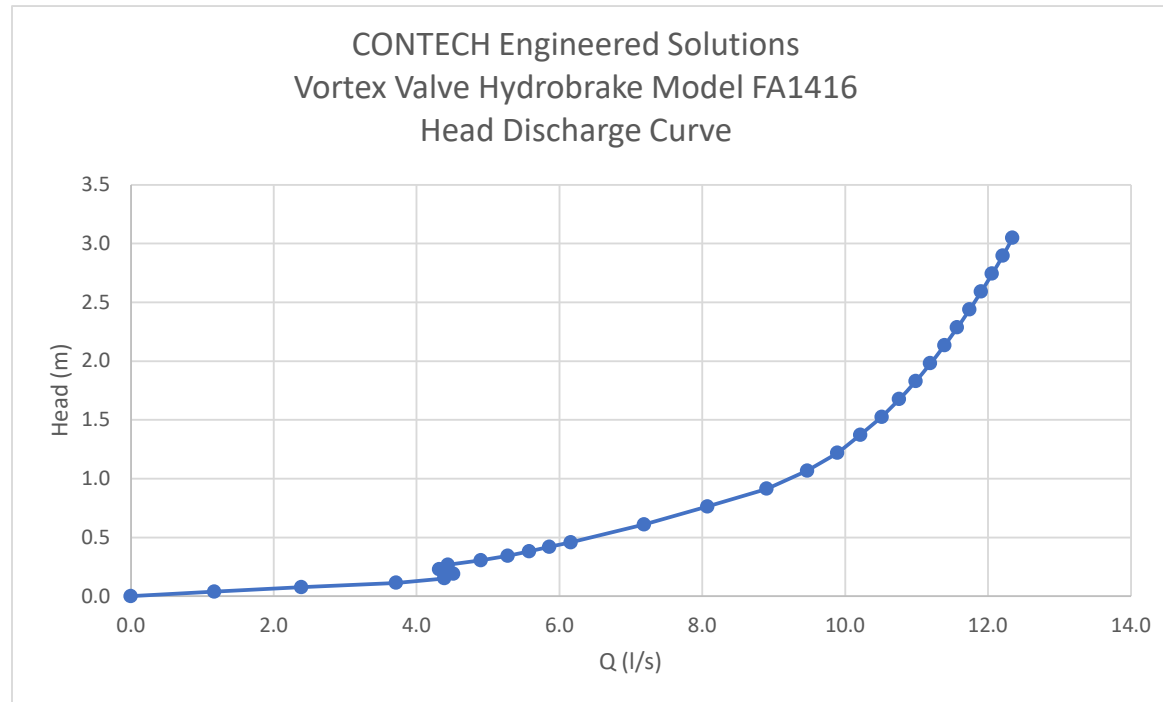

NOTES

1. FLUIDIC-AMP SIZES VARY BASED ON SITE REQUIREMENTS (SEE FLOW CHARTS)

2. SLEEVE DIAMETER & LENGTH DEPEND ON PIPE SIZE AND MATERIAL.



3. ATTACHMENT MAY BE MADE BY A PLATE, A SLEEVE (AS SHOWN) OR A BOLTING FLANGE

4. OUTLET SIZE VARIES BASED ON DESIRED OUTFLOW RATES (Ø3" MINIMUM)

5. ALL WELDS CONTINUOUS UNLESS NOTED OTHERWISE

**MATERIALS:**

12 GA. 304L STAINLESS STEEL  
 (1) Ø5/8" AND (1) Ø9/16"  
 BUNA N, 50 DUROMETER O-RINGS

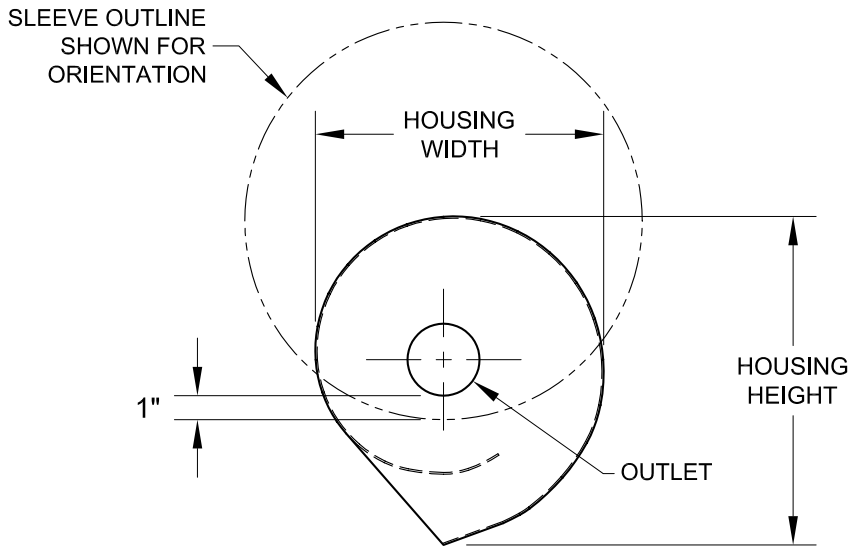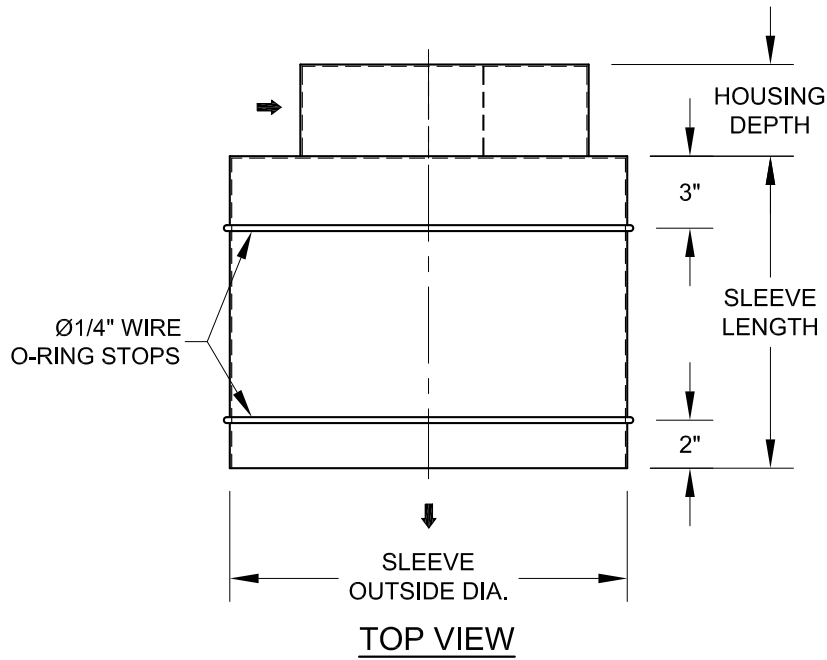

FRONT VIEW  
 (SLEEVE DETAILS OMITTED THIS VIEW)

This CADD file is for the purpose of specifying stormwater flow control devices to be furnished by CONTECH Stormwater Solutions and may only be transferred to other documents exactly as provided by CONTECH Stormwater Solutions. Title block information, excluding the CONTECH Stormwater Solutions logo and the Fluidic-Cone or Fluidic-Amp HydroBrake designation and patent number, may be deleted if necessary. Revisions to any part of this CADD file without prior coordination with CONTECH Stormwater Solutions shall be considered unauthorized use of proprietary information.



TYPICAL DETAIL  
 FLUIDIC-AMP™ HYDROBRAKE  
 WITH SLEEVE ATTACHMENT

NOT INTENDED FOR CONSTRUCTION PURPOSES

DATE: 4/10/06

SCALE: NONE

FILE NAME: TYPFASLV

DRAWN: JBS

CHECKED: NDG



## NOTES

1. FLUIDIC-AMP SIZES VARY BASED ON SITE REQUIREMENTS (SEE FLOW CHARTS)

2. ATTACHMENT PLATE WIDTH AND HEIGHT VARIES BASED ON CONCRETE OPENING SIZE



3. ATTACHMENT MAY BE MADE BY A PLATE (AS SHOWN), A SLEEVE OR A BOLTING FLANGE

4. OUTLET SIZE VARIES BASED ON DESIRED OUTFLOW RATES ( $\varnothing 3"$  MINIMUM)

5. ALL WELDS CONTINUOUS UNLESS NOTED OTHERWISE

### MATERIALS:

12 GA. 304L STAINLESS STEEL

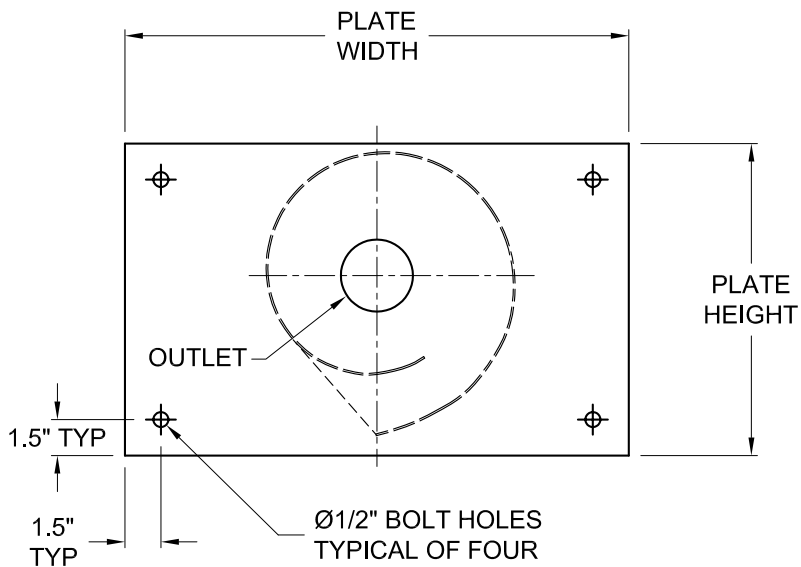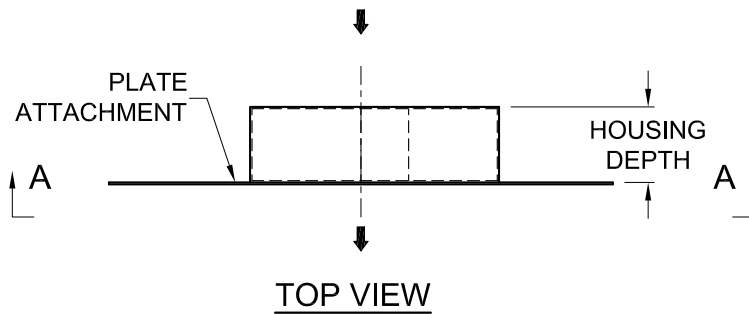

This CADD file is for the purpose of specifying stormwater flow control devices to be furnished by CONTECH Stormwater Solutions and may only be transferred to other documents exactly as provided by CONTECH Stormwater Solutions. Title block information, excluding the CONTECH Stormwater Solutions logo and the Fluidic-Cone or Fluidic-Amp HydroBrake designation and patent number, may be deleted if necessary. Revisions to any part of this CADD file without prior coordination with CONTECH Stormwater Solutions shall be considered unauthorized use of proprietary information.



## TYPICAL DETAIL FLUIDIC-AMP™ HYDROBRAKE WITH PLATE ATTACHMENT

NOT INTENDED FOR CONSTRUCTION PURPOSES

DATE: 4/10/06

SCALE: NONE

FILE NAME: TYPFAPLT

DRAWN: JBS

CHECKED: NDG



# **CONTECH VORTEX VALVES**

## **FLOW CONTROL FOR STORMWATER DRAINAGE AND STORAGE SYSTEMS**

### **OPERATIONS AND MAINTENANCE GUIDE**

#### **OPERATION of a CONTECH Vortex Valve**

A Vortex Valve is a self-activating vortex flow control with no moving parts. When the upstream water level reaches a suitable level the water entering the unit spins within it. This causes the formation of an air-filled core which takes up a significant proportion of the outlet of the unit. Water discharges around the periphery of the outlet from the Vortex Valve enabling the use of a significantly larger outlet than if a simple orifice was used. The outlet diameter is typically 2 to 4 times larger than an equivalent simple orifice required to meet the same stage and discharge condition. Because of the large outlet diameter there is less potential for blockage.


In the case of a downstream surcharge condition an air vent pipe may be required to ensure that the air core can form within the valve. The flow through a Vortex Valve is dependent upon the physical size of the unit itself and the differential head of water acting upon it.

#### **MAINTENANCE**

The need for maintenance will be site specific and depend on the following: 1) the size of the Vortex Valve (the larger the unit the less the likelihood of a blockage occurring); 2) the pollutant loading (e.g., a unit would be more susceptible to blockage were it placed on a foul system than a stormdrain catching a relatively clean impervious surface); 3) the physical characteristics of the control chamber itself (adequate benching or sump depth is essential); 4) and the presence of any pretreatment measures such as a sediment and debris removal structure.

All parts are made of corrosion resistant 304 stainless steel material which provides for exceptional design life in comparison to other drainage structures on the site.

The Vortex Valve flow control is fitted with an integral pivoting bypass door mounted to the front face of the unit. If a blockage occurs it is likely to occur on the intake of the flow control. The bypass door is fitted with a stainless steel wire rope that can be pulled from ground level, the door opens exposing a larger aperture on the front plate of the unit allowing the system to be drained of water. Once the water level in the housing structure subsides, which is typically a round manhole, the blockage can be easily accessed and cleared with a rod, debris grabbing or jetting device. Figure 1 shows a typical Vortex Valve installation.

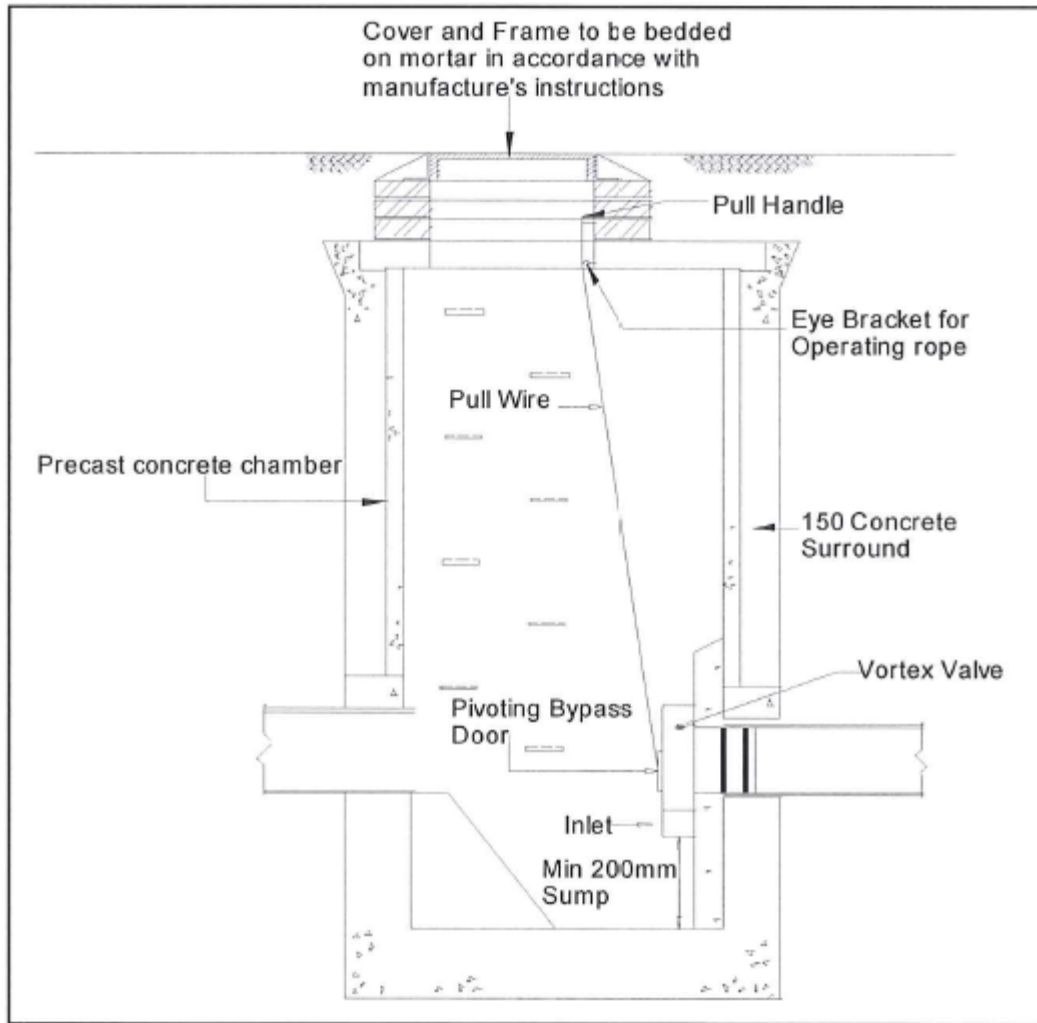

# APPENDIX A-16

## Jellyfish Filter Unit Sizing and Design





# Determining Number of Cartridges for Flow Based Systems

Date

26/05/2022

Black Cells = Calculation

## Site Information

Project Name	3016-3032 Kirwin Avenue	
Project Location	Mississauga, ON	
OGS ID	OGS 1	
Drainage Area, Ad	0.16 ac	(0.0637 ha)
Impervious Area, Ai	0.16 ac	
Pervious Area, Ap	0.00	
% Impervious	100%	
Runoff Coefficient, Rc	0.90	
Treatment storm flow rate, $Q_{treat}$	0.07 cfs	(2.1 L/s)
Peak storm flow rate, $Q_{peak}$	0.88 cfs	(24.9 L/s)

## Filter System

Filtration brand	StormFilter
Cartridge height	18 in
Specific Flow Rate	1.67 gpm/ft <sup>2</sup>
Flow rate per cartridge	12.53 gpm



## SUMMARY

Number of Cartridges	3
Media Type	Perlite

Event Mean Concentration (EMC)	150 mg/L
Annual TSS Removal	80%
Percent Runoff Capture	90%

Recommend SFPD0806 vault or CIP


200 Enterprise Drive  
 Scarborough, ME 04074  
 Phone 877-907-8676  
 Fax 207-885-9825

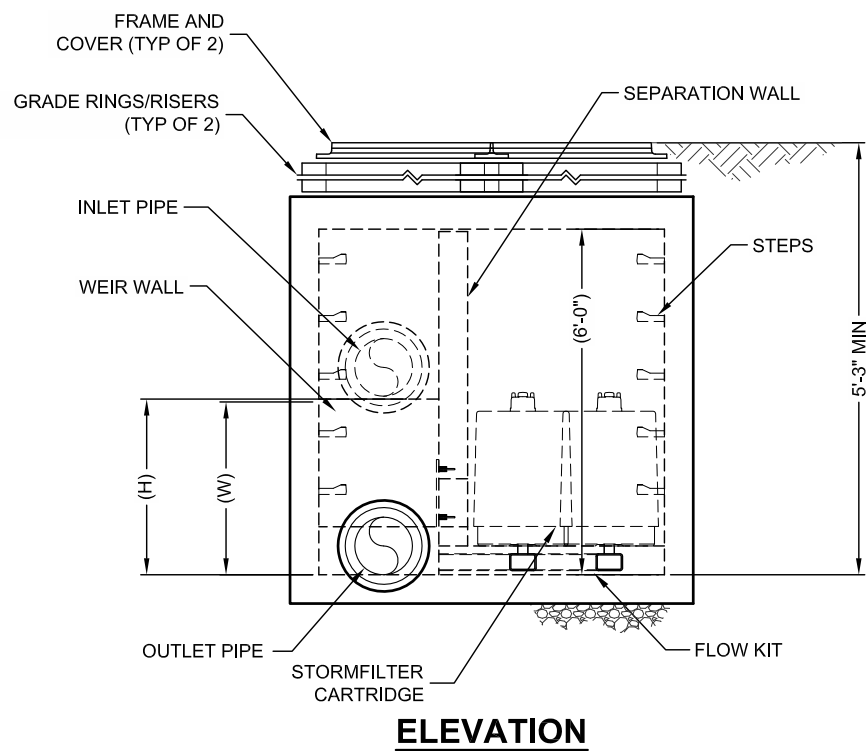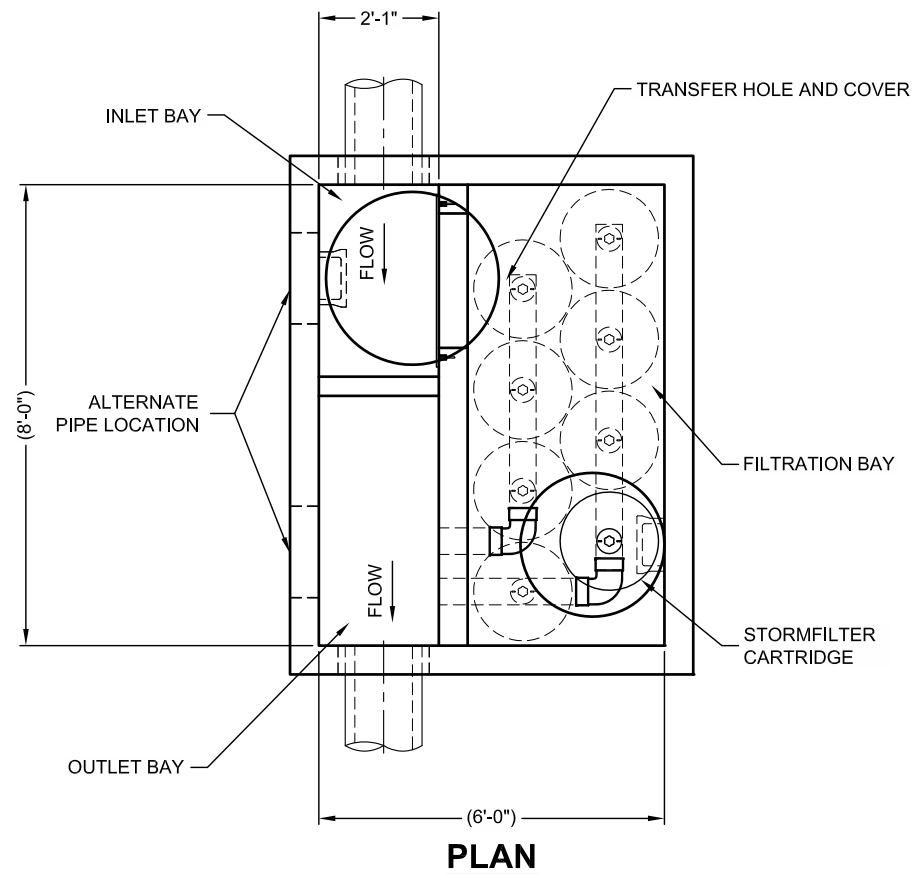

### STORMFILTER DESIGN TABLE

- THE 8' x 6' PEAK DIVERSION STORMFILTER TREATMENT CAPACITY VARIES BY CARTRIDGE COUNT AND LOCALLY APPROVED SURFACE AREA SPECIFIC FLOW RATE. PEAK CONVEYANCE CAPACITY TO BE DETERMINED BY ENGINEER OF RECORD.
- THE PEAK DIVERSION STORMFILTER IS AVAILABLE IN A LEFT INLET (AS SHOWN) OR RIGHT INLET CONFIGURATION.
- ALL PARTS AND INTERNAL ASSEMBLY PROVIDED BY CONTECH UNLESS OTHERWISE NOTED.

CARTRIDGE HEIGHT	27"		18"		LOW DROP	
SYSTEM HYDRAULIC DROP (H - REQ'D. MIN.)	3.05'		2.3'		1.8'	
HEIGHT OF WEIR (W)	3.00'		2.25'		1.75'	
TREATMENT BY MEDIA SURFACE AREA	2 gpm/ft <sup>2</sup>	1 gpm/ft <sup>2</sup>	2 gpm/ft <sup>2</sup>	1 gpm/ft <sup>2</sup>	2 gpm/ft <sup>2</sup>	1 gpm/ft <sup>2</sup>
CARTRIDGE FLOW RATE (gpm)	22.5	11.25	15	7.5	10	5

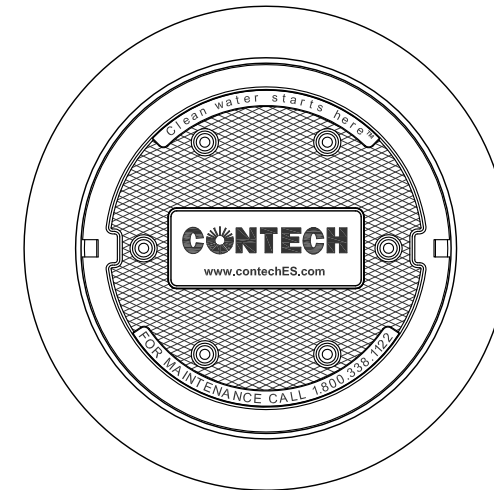

**FRAME AND COVER**  
(DIAMETER VARIES)  
N.T.S.

SITE SPECIFIC DATA REQUIREMENTS			
STRUCTURE ID	*		
WATER QUALITY FLOW RATE (cfs)	*		
PEAK FLOW RATE (cfs)	*		
RETURN PERIOD OF PEAK FLOW (yrs)	*		
# OF CARTRIDGES REQUIRED	*		
CARTRIDGE FLOW RATE	*		
MEDIA TYPE (CSF, PERLITE, ZPG)	*		
PIPE DATA:	I.E.	MATERIAL	DIAMETER
INLET PIPE	*	*	*
OUTLET PIPE	*	*	*
INLET BAY RIM ELEVATION	*		
FILTER BAY RIM ELEVATION	*		
ANTI-FLOTATION BALLAST	WIDTH	HEIGHT	
	*	*	
NOTES/SPECIAL REQUIREMENTS:			

#### PERFORMANCE SPECIFICATION

FILTER CARTRIDGES SHALL BE MEDIA-FILLED, PASSIVE, SIPHON ACTUATED, RADIAL FLOW, AND SELF CLEANING. **RADIAL MEDIA DEPTH SHALL BE 7-INCHES**. FILTER MEDIA CONTACT TIME SHALL BE AT LEAST **37 SECONDS**. SPECIFIC FLOW RATE SHALL BE **2 GPM/SF (MAXIMUM)**. SPECIFIC FLOW RATE IS THE MEASURE OF THE FLOW (GPM) DIVIDED BY THE MEDIA SURFACE CONTACT AREA (SF). MEDIA VOLUMETRIC FLOW RATE SHALL BE **6 GPM/CF OF MEDIA (MAXIMUM)**.

#### GENERAL NOTES

1. CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
2. DIMENSIONS MARKED WITH ( ) ARE REFERENCE DIMENSIONS. ACTUAL DIMENSIONS MAY VARY.
3. FOR FABRICATION DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT YOUR CONTECH REPRESENTATIVE. [www.ContechES.com](http://www.ContechES.com)
4. STORMFILTER WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING. CONTRACTOR TO CONFIRM STRUCTURE MEETS REQUIREMENTS OF PROJECT.
5. STRUCTURE SHALL MEET AASHTO HS20 LOAD RATING, ASSUMING EARTH COVER OF 0' - 5' AND GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION. CASTINGS SHALL MEET AASHTO M306 AND BE CAST WITH THE CONTECH LOGO.

#### INSTALLATION NOTES

- A. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE STORMFILTER STRUCTURE (LIFTING CLUTCHES PROVIDED).
- C. CONTRACTOR TO INSTALL JOINT SEALANT BETWEEN ALL SECTIONS AND ASSEMBLE STRUCTURE.
- D. CONTRACTOR TO PROVIDE, INSTALL, AND GROUT PIPES. MATCH OUTLET PIPE INVERT WITH OUTLET BAY FLOOR.
- E. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION-RELATED EROSION RUNOFF.
- F. CONTRACTOR TO REMOVE THE TRANSFER HOLE COVER WHEN THE SYSTEM IS BROUGHT ONLINE.



THIS PRODUCT MAY BE PROTECTED BY ONE OR MORE OF THE FOLLOWING: U.S. PATENT NO. 8,322,228; 8,344,410; 8,714,107; 8,848,767; 8,822,838; 8,822,839; 8,822,840; 8,822,841; 8,822,842; 8,822,843; 8,822,844; 8,822,845; 8,822,846; 8,822,847; 8,822,848; 8,822,849; 8,822,850; 8,822,851; 8,822,852; 8,822,853; 8,822,854; 8,822,855; 8,822,856; 8,822,857; 8,822,858; 8,822,859; 8,822,860; 8,822,861; 8,822,862; 8,822,863; 8,822,864; 8,822,865; 8,822,866; 8,822,867; 8,822,868; 8,822,869; 8,822,870; 8,822,871; 8,822,872; 8,822,873; 8,822,874; 8,822,875; 8,822,876; 8,822,877; 8,822,878; 8,822,879; 8,822,880; 8,822,881; 8,822,882; 8,822,883; 8,822,884; 8,822,885; 8,822,886; 8,822,887; 8,822,888; 8,822,889; 8,822,890; 8,822,891; 8,822,892; 8,822,893; 8,822,894; 8,822,895; 8,822,896; 8,822,897; 8,822,898; 8,822,899; 8,822,900; 8,822,901; 8,822,902; 8,822,903; 8,822,904; 8,822,905; 8,822,906; 8,822,907; 8,822,908; 8,822,909; 8,822,910; 8,822,911; 8,822,912; 8,822,913; 8,822,914; 8,822,915; 8,822,916; 8,822,917; 8,822,918; 8,822,919; 8,822,920; 8,822,921; 8,822,922; 8,822,923; 8,822,924; 8,822,925; 8,822,926; 8,822,927; 8,822,928; 8,822,929; 8,822,930; 8,822,931; 8,822,932; 8,822,933; 8,822,934; 8,822,935; 8,822,936; 8,822,937; 8,822,938; 8,822,939; 8,822,940; 8,822,941; 8,822,942; 8,822,943; 8,822,944; 8,822,945; 8,822,946; 8,822,947; 8,822,948; 8,822,949; 8,822,950; 8,822,951; 8,822,952; 8,822,953; 8,822,954; 8,822,955; 8,822,956; 8,822,957; 8,822,958; 8,822,959; 8,822,960; 8,822,961; 8,822,962; 8,822,963; 8,822,964; 8,822,965; 8,822,966; 8,822,967; 8,822,968; 8,822,969; 8,822,970; 8,822,971; 8,822,972; 8,822,973; 8,822,974; 8,822,975; 8,822,976; 8,822,977; 8,822,978; 8,822,979; 8,822,980; 8,822,981; 8,822,982; 8,822,983; 8,822,984; 8,822,985; 8,822,986; 8,822,987; 8,822,988; 8,822,989; 8,822,990; 8,822,991; 8,822,992; 8,822,993; 8,822,994; 8,822,995; 8,822,996; 8,822,997; 8,822,998; 8,822,999; 8,823,000.

**CONTECH**  
ENGINEERED SOLUTIONS LLC  
[www.ContechES.com](http://www.ContechES.com)  
9025 Centre Pointe Dr., Suite 400, West Chester, OH 45069  
800-338-1122 513-645-7000 513-645-7993 FAX

THE STORMWATER MANAGEMENT STORMFILTER  
8' x 6' PEAK DIVERSION STORMFILTER  
STANDARD DETAIL


I:\COMMON\CAD\TREATMENT\10 STORMFILTER\40 STANDARD DRAWINGS\SPD\STANDARDIN PROCESS\DWG\SFPD0608-DTL.DWG 10/20/2020 3:06 PM

### STORMFILTER DESIGN NOTES


- STORMFILTER TREATMENT CAPACITY VARIES BY CARTRIDGE COUNT AND LOCALLY APPROVED SURFACE AREA SPECIFIC FLOW RATE. PEAK CONVEYANCE CAPACITY TO BE DETERMINED BY ENGINEER OF RECORD
- A 6' x 8' [1829 x 2438] PEAK DIVERSION STYLE STORMFILTER IS SHOWN WITH THE MAXIMUM NUMBER OF CARTRIDGES (8) AND IS AVAILABLE IN A LEFT INLET (AS SHOWN) OR A RIGHT INLET CONFIGURATION
- ALL PARTS AND INTERNAL ASSEMBLY PROVIDED BY CONTECH UNLESS NOTED OTHERWISE

CARTRIDGE SIZE (in. [mm])	27 [686]			18 [457]			LOW DROP		
RECOMMENDED HYDRAULIC DROP (H) (ft. [mm])	3.05 [930]			2.3 [701]			1.8 [549]		
HEIGHT OF WEIR (W) (ft. [mm])	3.00 [914]			2.25 [686]			1.75 [533]		
SPECIFIC FLOW RATE (gpm/sf [L/s/m <sup>2</sup> ])	2 [1.36]	1.67* [1.13]*	1 [0.68]	2 [1.36]	1.67* [1.13]*	1 [0.68]	2 [1.36]	1.67* [1.13]*	1 [0.68]
CARTRIDGE FLOW RATE (gpm [L/s])	22.5 [1.42]	18.79 [1.19]	11.25 [0.71]	15 [0.95]	12.53 [0.79]	7.5 [0.47]	10 [0.63]	8.35 [0.53]	5 [0.32]


\* 1.67 gpm/sf [1.13 L/s/m<sup>2</sup>] SPECIFIC FLOW RATE IS APPROVED WITH PHOSPHOSORB® (PSORB) MEDIA ONLY

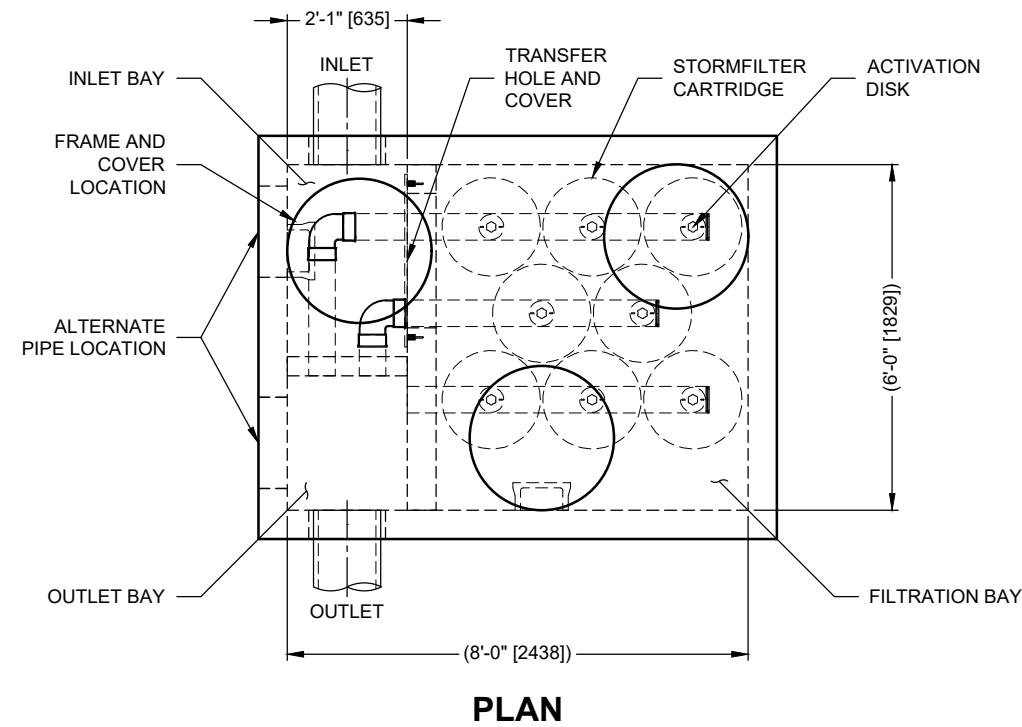


**PLAN**

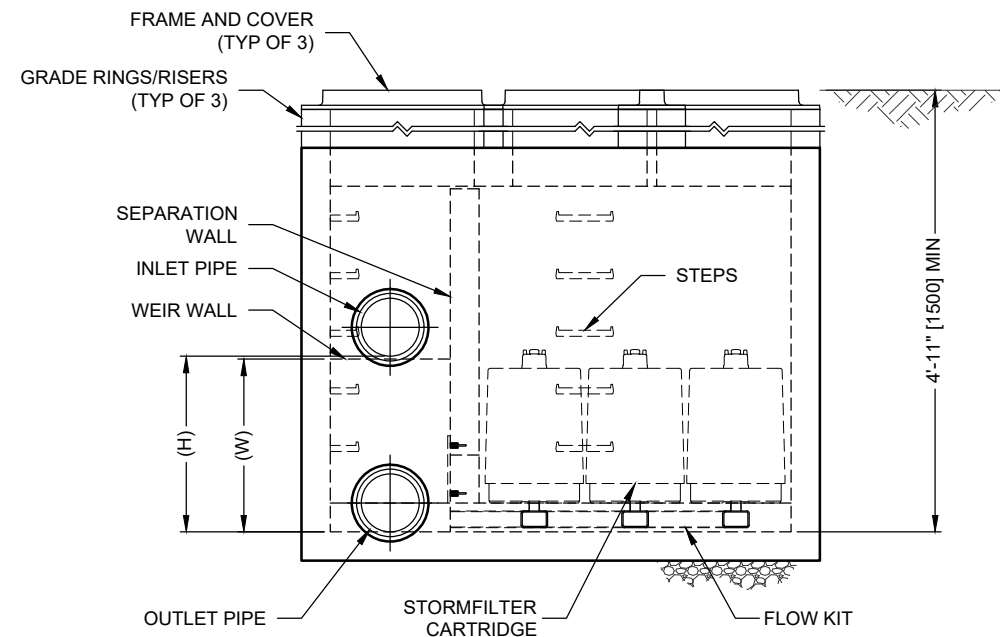

**ELEVATION**



**FRAME AND GRATE**  
(24" SQUARE)  
(NOT TO SCALE)



**FRAME AND COVER**  
(30" ROUND)  
(NOT TO SCALE)

### SITE SPECIFIC DATA REQUIREMENTS

STRUCTURE ID	
WATER QUALITY FLOW RATE (cfs [L/s])	
PEAK FLOW RATE (cfs [L/s])	
RETURN PERIOD OF PEAK FLOW (yrs)	
CARTRIDGE FLOW RATE	
CARTRIDGE SIZE (27, 18, LOW DROP (LD))	
MEDIA TYPE (PERLITE, ZPG, PSORB)	
NUMBER OF CARTRIDGES REQUIRED	
INLET BAY RIM ELEVATION	
FILTER BAY RIM ELEVATION	
PIPE DATA:	INVERT MATERIAL DIAMETER
INLET PIPE 1	
INLET PIPE 2	
OUTLET PIPE	
NOTES/SPECIAL REQUIREMENTS:	

#### PERFORMANCE SPECIFICATION

FILTER CARTRIDGES SHALL BE MEDIA-FILLED, PASSIVE, SIPHON ACTUATED, RADIAL FLOW, AND SELF CLEANING. **RADIAL MEDIA DEPTH SHALL BE 7" [178]**. FILTER MEDIA CONTACT TIME SHALL BE AT LEAST **37 SECONDS**. SPECIFIC FLOW RATE SHALL BE **2 GPM/SF [1.36 L/s/m<sup>2</sup>] (MAXIMUM)**. SPECIFIC FLOW RATE IS THE MEASURE OF THE FLOW (GPM) DIVIDED BY THE MEDIA SURFACE CONTACT AREA (SF). MEDIA VOLUMETRIC FLOW RATE SHALL BE **6 GPM/CF [13.39 L/s/m<sup>3</sup>] OF MEDIA (MAXIMUM)**.

#### GENERAL NOTES

1. CONTECH TO PROVIDE ALL MATERIALS UNLESS NOTED OTHERWISE.
2. DIMENSIONS MARKED WITH ( ) ARE REFERENCE DIMENSIONS. ACTUAL DIMENSIONS MAY VARY.
3. ALTERNATE DIMENSIONS ARE IN MILLIMETERS [mm] UNLESS NOTED OTHERWISE.
4. FOR FABRICATION DRAWINGS WITH DETAILED STRUCTURE DIMENSIONS AND WEIGHTS, PLEASE CONTACT YOUR CONTECH REPRESENTATIVE. [www.ContechES.com](http://www.ContechES.com)
5. STORMFILTER WATER QUALITY STRUCTURE SHALL BE IN ACCORDANCE WITH ALL DESIGN DATA AND INFORMATION CONTAINED IN THIS DRAWING. CONTRACTOR TO CONFIRM STRUCTURE MEETS REQUIREMENTS OF PROJECT.
6. STRUCTURE SHALL MEET AASHTO HS20 LOAD RATING, ASSUMING EARTH COVER OF 0' - 10' [3048] AND GROUNDWATER ELEVATION AT, OR BELOW, THE OUTLET PIPE INVERT ELEVATION. ENGINEER OF RECORD TO CONFIRM ACTUAL GROUNDWATER ELEVATION. CASTINGS SHALL MEET AASHTO M306 AND BE CAST WITH THE CONTECH LOGO.

#### INSTALLATION NOTES

- A. ANY SUB-BASE, BACKFILL DEPTH, AND/OR ANTI-FLOTATION PROVISIONS ARE SITE-SPECIFIC DESIGN CONSIDERATIONS AND SHALL BE SPECIFIED BY ENGINEER OF RECORD.
- B. CONTRACTOR TO PROVIDE EQUIPMENT WITH SUFFICIENT LIFTING AND REACH CAPACITY TO LIFT AND SET THE STORMFILTER STRUCTURE.
- C. CONTRACTOR TO INSTALL JOINT SEALANT BETWEEN ALL SECTIONS AND ASSEMBLE STRUCTURE.
- D. CONTRACTOR TO PROVIDE, INSTALL, AND GROUT PIPES. MATCH OUTLET PIPE INVERT WITH OUTLET BAY FLOOR.
- E. CONTRACTOR TO TAKE APPROPRIATE MEASURES TO PROTECT CARTRIDGES FROM CONSTRUCTION-RELATED EROSION RUNOFF.
- F. CONTRACTOR TO REMOVE THE TRANSFER OPENING COVER WHEN THE SYSTEM IS BROUGHT ONLINE.



THIS PRODUCT MAY BE PROTECTED BY ONE OR MORE OF THE FOLLOWING U.S. PATENTS: 5,322,629; 5,524,576; 5,707,527; 5,985,157; 6,027,639; 6,649,048; RELATED FOREIGN PATENTS, OR OTHER PATENTS PENDING.



[www.ContechES.com](http://www.ContechES.com)  
9025 Centre Pointe Dr., Suite 400, West Chester, OH 45069  
800-338-1122 513-645-7000 513-645-7993 FAX

SFPD0608 (6' x 8')  
PEAK DIVERSION STORMFILTER  
STANDARD DETAIL

# APPENDIX A-17

## Area Drain Typical Details








**Z610**

12-1/2 [318] SQUARE TOP HEAVY-DUTY DRAIN

**SPECIFICATION SHEET**

**TAG** \_\_\_\_\_

Dimensional Data (inches and [ mm ]) are Subject to Manufacturing Tolerances and Change Without Notice

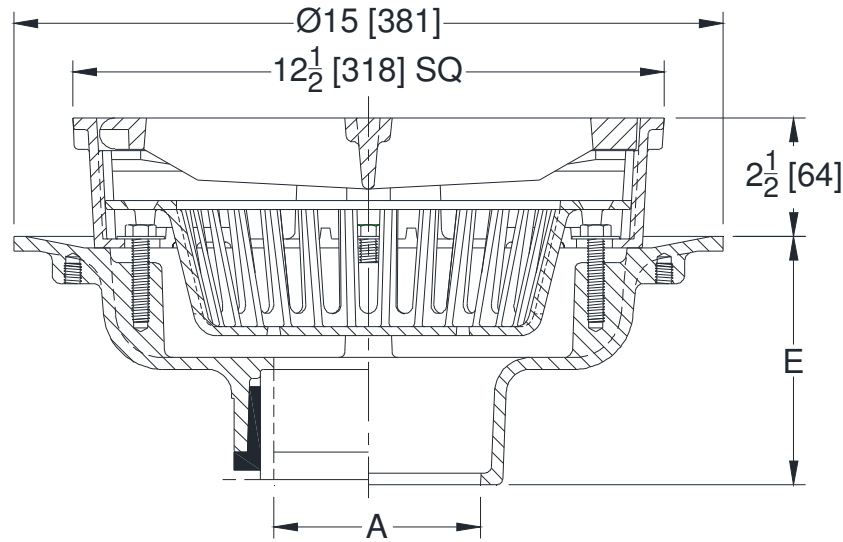

A Pipe Size In. [mm]	Approx. Wt. Lbs. [kg]	Grate Open Area Sq. In. [cm <sup>2</sup> ]
2, 3, 4, 6 [51, 76, 102, 152]	54 [24]	42 [271]
8 [203]	56 [25]	

**ENGINEERING SPECIFICATION: ZURN Z610**  
 12-1/2" [305mm] Square top drain, Dura-Coated cast iron body with bottom outlet, seepage pan and combination membrane flashing clamp and frame for heavy-duty cast iron loose slotted duresist grate, with suspended polypropylene sediment bucket.

**OPTIONS** (Check/specify appropriate options)

**PIPE SIZE**

- 3, 4, 6 [76, 102, 152]
- 3, 4, 6 [76, 102, 152]
- 2, 3, 4, 6, [51, 76, 102, 152]
- 2, 3, 4, 6, 8 [51, 76, 102, 152, 203]
- 2, 3, 4 [51, 76, 102]

(Specify size/type) **OUTLET**

- \_\_\_\_\_ IC Inside Caulk
- \_\_\_\_\_ IG Inside Gasket
- \_\_\_\_\_ IP Threaded
- \_\_\_\_\_ NH No-Hub
- \_\_\_\_\_ NL Neo-Loc

**'E' BODY HT. DIM.**

- 5-1/4 [133]
- 5-1/4 [133]
- 3-3/4 [95]
- 5-1/4 [133]
- 4-5/8 [117]

**PREFIXES**

- \_\_\_\_\_ Z D.C.C.I. Body and Top\*
- \_\_\_\_\_ ZB D.C.C.I Body w/Polished Bronze Top (Add 3/16 [5] to 2-1/2 [64] Dim. and 3/4 [19] to 12-1/2 [318] Dim.)
- \_\_\_\_\_ ZN D.C.C.I Body w/Polished Nickel Bronze Top (Add 3/16 [5] to 2-1/2 [64] Dim. and 3/4 [19] to 12-1/2 [318] Dim.)

**SUFFIXES**

- \_\_\_\_\_ -AR Acid Resistant Epoxy Coated Cast Iron
- \_\_\_\_\_ -DS Ductile Iron Solid Cover
- \_\_\_\_\_ -DX Dex-O-Tex Flange (ZB, ZN Only)
- \_\_\_\_\_ -F 2 [51] High Extension
- \_\_\_\_\_ -G Galvanized Cast Iron
- \_\_\_\_\_ -H Hinged Grate
- \_\_\_\_\_ -HC Hinged Solid Cover
- \_\_\_\_\_ -HL Hinged Locking Grate
- \_\_\_\_\_ -HLC Hinged Locking Cover
- \_\_\_\_\_ -LY (Less) Sediment Bucket
- \_\_\_\_\_ -P Trap Primer Connection
- \_\_\_\_\_ -S Secondary Strainer
- \_\_\_\_\_ -SC Solid Cover
- \_\_\_\_\_ -SS Stainless Steel Mesh Liner for Bucket
- \_\_\_\_\_ -TC Neo-Loc Test Cap Gasket (2, 3, 4 [51, 76, 102] NL Bottom Outlet Only)
- \_\_\_\_\_ -TS Top Secured with Slotted Screws
- \_\_\_\_\_ -V Backwater Valve (See Z1099)
- \_\_\_\_\_ -VP Vandal-Proof Secured Top
- \_\_\_\_\_ -YA Aluminum Sediment Bucket
- \_\_\_\_\_ -YC Cast Iron Sediment Bucket
- \_\_\_\_\_ -90 90° Threaded Side Outlet Body

\* Regularly furnished unless otherwise specified.




# Z1730

## 9 [229] DIAMETER FLOOR DRAIN SHALLOW TYPE

SPECIFICATION SHEET

TAG \_\_\_\_\_

Dimensional Data (inches and [ mm ]) are Subject to Manufacturing Tolerances and Change Without Notice

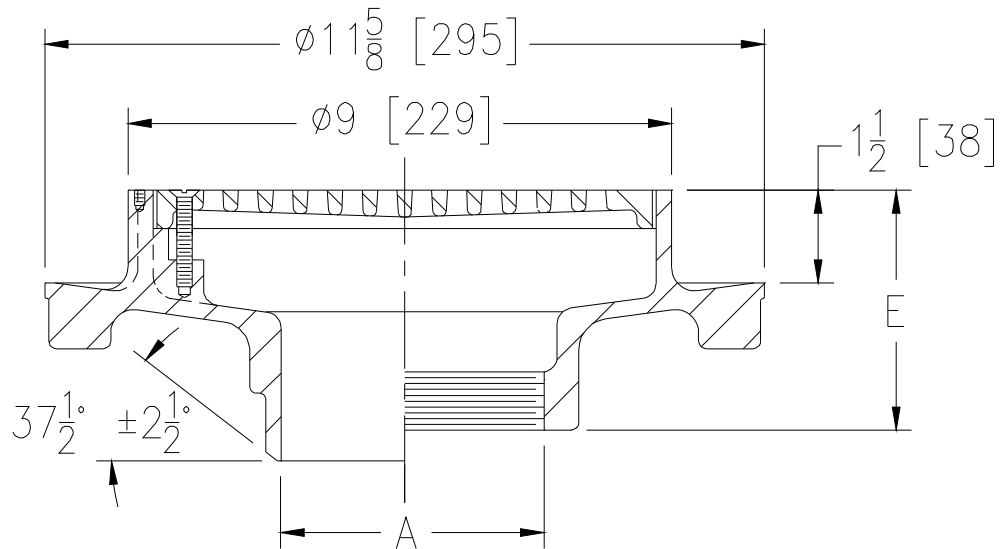

A Pipe Size In.[mm]	Approx. Wt. Lbs. [kg]	Grate Open Area Sq. In. [cm <sup>2</sup> ]
2, 3, 4 [51, 76, 102]	20 [9]	21 [135]

### ENGINEERING SPECIFICATION: ZURN Z1730

9" [229mm] Diameter shallow type heavy-duty floor drain, all Type 304 (CF8) stainless steel with integral anchor flange, and non-tilt grate with plain finish.

### OPTIONS (Check/specify appropriate options)

#### PIPE SIZE

2, 3, 4 [51, 76, 102]

#### (Specify size/type) OUTLET

\_\_\_ BW Butt-Weld  
(Specify Schedule 10 or 40)

#### 'E' BODY HT. DIM.

4-13/16 [122]

2, 3, 4 [51, 76, 102]

\_\_\_ NH No-Hub

4-13/16 [122]

2, 3, 4 [51, 76, 102]

\_\_\_ IP Threaded

4-13/16 [122]

#### PREFIXES

\_\_\_ Z Type 304 (CF8) Stainless Steel Body\*  
\_\_\_ ZM Type 316 (CF8M) Stainless Steel Body

#### SUFFIXES

\_\_\_ -K Seepage Holes Only  
\_\_\_ -KC Clamp Collar with Seepage Holes  
\_\_\_ -TS Top Secured with Slotted Screws  
\_\_\_ -VP Vandal-Proof Secured Top

\* Regularly furnished unless otherwise specified.

# APPENDIX B

Stormwater Peak Flow Calculation for Sub- Sub-Catchment Area EC2 and PC2





**LEA Consulting Ltd.**  
Consulting Engineers  
and Planners

**Land Use**

Prepared:	P.R.	Page No.	B-01
Checked:	F.M.		

**Project: 3016-3032 KIRWIN AVE & 3031  
LITTLE JOHN LANE  
SUB-CATCHMENT EC2 & PC2**

Proj. #	21111
Date:	07-Nov-22

**Pre-Development CONDITION**


Sub-Catchment EC2

<b>Existing Land Use</b>	<b>Area (m<sup>2</sup>)</b>
Lawn & Tree	4435.0
<b>Total Area:</b>	<b>4435.0</b>

**Post-Development Condition:**

Sub-Catchment PC2

<b>Proposed Land Use</b>	<b>Area (m<sup>2</sup>)</b>
Lawn & Tree	2953.0
<b>Total Area</b>	<b>2953.0</b>

 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Composite "C" Calculation</b>		
	Prepared:	P.R.	Page No.   B-02
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031          LITTLE JOHN LANE          SUB-CATCHMENT EC2 &amp; PC2</b>	Checked:	F.M.	
	Proj. #	21111	
	Date:	07-Nov-22	

**Pre-Development Composite Runoff Coefficient "C"**


Sub-Catchment EC2

Location	Area (ha)	C	Composite "C"
Lawn & Tree	0.444	0.25	
<b>Total Area:</b>	<b>0.444</b>		<b>0.25</b>
Imperviousness Percent:			<b>0.0</b>

**Post-Development Composite Runoff Coefficient "C"**

Sub-Catchment PC2

Location	Area (ha)	C	Composite "C"
Lawn & Tree	0.295	0.25	
<b>Total Area</b>	<b>0.295</b>		<b>0.25</b>
Imperviousness Percent:			<b>0.0</b>

 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Pre-Development Peak Flow Rates Calculation</b>		
	Prepared:	P.R.	Page No. B-03
	Checked:	F.M.	
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031 LITTLE JOHN LANE SUB-CATCHMENT EC2 &amp; PC2</b>	Proj. #	21111	
	Date:	07-Nov-22	

**Rational Formulae:**  $Q = 2.78 \text{ CIA (L/s)}$


Site Area: 0.444 ha  
 Time of Concentration 15 minutes as per City Guidelines  
 Runoff Coefficient : 0.25 Pre-development condition

**Rainfall Intensity:  $I = aT^c$**

Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Rainfall Intensity (mm/hr):	59.89	80.51	99.17	113.89	127.13	140.69

**Peak Flow Rate (L/s):**

Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Under existing site conditions (L/s):	18.45	24.80	30.54	35.08	39.16	43.33

 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Post-Development Peak Flow Rates Calculation (Uncontrolled)</b>		
	Prepared:	P.R.	Page No. B-04
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031          LITTLE JOHN LANE          SUB-CATCHMENT EC2 &amp; PC2</b>	Checked:	F.M.	
	Proj. #	21111	
	Date:	07-Nov-22	

**Rational Formulae:**  $Q = 2.78 CIA (L/s)$

Site Area: 0.295 ha  
 Time of Concentration: 15 minutes as per City Guidelines  
 Runoff Coefficient: 0.25 Pre-development condition

**Rainfall Intensity:  $I = aT^c$**

Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Rainfall Intensity (mm/hr):	59.89	80.51	99.17	113.89	127.13	140.69

**Peak Flow Rate (L/s):**


Return Period:	2-yr	5-yr	10-yr	25-yr	50-yr	100-yr
Under existing site conditions (L/s):	12.28	16.51	20.34	23.36	26.07	28.85

# APPENDIX C

## Sanitary and Water Demand Calculations





 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Sanitary Flow Rate Calculation</b>		
	Prepared:	P.R.	Page No. C-01
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031          LITTLE JOHN LANE</b>	Checked:	F.M.	
	Proj. #	21111	
	Date:	11-Nov-22	

### POPULATION CALCULATION


Net Site Area 3923 m<sup>2</sup>  
 Number of Townhouses 148 units

Proposed Building Type	Units	Density (P.P.U)	Population
Residential			0.00
>750 SQF	43	3	129
<=750 SQF	105	1.6	168
<b>Total</b>			<b>297.00</b>

### SANITARY FLOW CALCULATION

Harmon Peaking Factor:  $M=1+14/(4+P^{0.5})$

Peaking Factor 4.08  
 Average Daily Wastewater Flow 302.8 L/cap/day  
 Total Actual Domestic Flow 4.25 L/sec  
 Total Domestic Flow (For less than 1000 person shall be 13.0 L/sec-STD.DWG. 2-5-2, Region of Peel) 13.00 L/sec  
 Infiltration Allowance (@ 0.2 L/sec/ha) 0.08 L/sec  
**Actual Design flow 4.33 L/sec**  
**Standard Design Flow 13.08 L/sec**

 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Water Demand Calculation BLK A</b>			
	Prepared:	P.R.	Page No.	C-02
	Checked:	F.M.		
<b>Project: 3016-3032 KIRWIN AVE &amp; 3031 LITTLE          JOHN LANE</b>	Proj. #	21111		
	Date:	11-Nov-22		

This calculation is following the "Water Supply for Public Fire Protection" by Fire Underwriters Survey.

Formula:  $F = 220C\sqrt{A}$

where

F = the required fire flow in litres per minute

C = coefficient related to the type of construction.

= 0.8 for non-combustible construction

A = the total floor area in square metres. For non-combustible buildings with unprotected openings, the areas shall be calculated by taking the largest two adjoining floors plus 50% of each floor above, up to 8 floors.

**STEP 1**

According the building stats, Dated Nov. 12, 2020	BLK A Area (m2)	
1st Floor	1583.0	Not Used
2nd Floor	1585.0	Largest joined floor
3rd Floor	1703.0	Largest joined floor
4th Floor	1508.0	Above Floor
5th Floor	1427.0	Above Floor
6th Floor	1370.0	Above Floor
7th Floor	1311.0	Above Floor
8th Floor	1106.0	Above Floor
<b>A</b>	<b>6649</b>	

Therefore, F (l/min)= 14000

**STEP 2**

**Occupancy reduction:**

For occupancies with a low contents fire hazard, the reduction rate is 25%,

Therefore: F (l/min)= 10500

Reduction for sprinkler protection:

Using the NFPA sprinkler system, a reduction rate of 30% is used.

Therefore: F (l/min)= 7350

**STEP 3**

Separation charge:

Charge for the separations on each side:

Exposure Charge		Charge	
0 to 3m	25%	0%	West
3.1 to 10m	20%	15%	North
10.1 to 20m	15%	15%	South
20.1 to 30m	10%	10%	East
30.1 to 45m	5%		
>45m	0%		

Total charge in % 40%

Total charge in l/min 2900

**STEP 4**

Required Fire Flow: 10000 l/min  
 or 166.67 l/s  
 or 2642 US GPM



**LEA Consulting Ltd.**  
Consulting Engineers  
and Planners

**Water Demand Calculation**

<b>Project: 3016-3032 KIRWIN AVE &amp; 3031 LITTLE JOHN LANE</b>	<b>Prepared:</b>	P.R.	<b>Page No.</b>	C-03
	<b>Checked:</b>	F.M.		
	<b>Proj. #</b>	21111		
	<b>Date:</b>	11-Nov-22		

**Total Population:** 297 (See Page C-01)

**Average Day Demand Calculation:**

Residential Per Capita Demand 280 L/cap/day  
**Average Day Flow** 0.963 L/sec

**Peak Hour Demand Calculation:**

Residential Per Capita Demand 280 L/cap/day  
Peaking Factor 3  
**Peak Hour Demand** 2.888 L/sec


**Maximum Day Demand Calculation:**

Residential Per Capita Demand 280 L/cap/day  
Peaking Factor 2  
**Maximum Day Demand** 1.925 L/sec

**Fire Flow for Residential:** 166.67 L/sec

**Max. Day Demand plus Fire Flow:** 168.59 L/sec

**Design Water Demand** 168.59 L/sec  
or 2672.18 US GPM

 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Connection Demand Table</b>			
	Prepared:	F.M.	Page No.	C-04
<b>Project: 3016-3032 KIRWIN AVE &amp; LITTLE JOHN LANE</b> <b>City Of Mississauga</b>	Checked:	M.D.		
	Proj. #	21111		
	Date:	11-Nov-22		

### Connection Demand Table

#### WATER CONNECTION

Connection Point	Kirwin Ave
Pressure zone of connection point	Zone 2
Total equivalent population to be serviced	297 Based on Region of Peel 2020 Criteria
Total lands to be serviced	0.392 ha

#### HYDRANT FLOW TEST

Hydrant flow test location	KIRWIN AVE		
	Pressure (kPa)	Flow (l/s)	Time
Minimum water pressure	20	332.8	
Maximum water pressure	76	63.1	

No.	Wate Demand	Demand	Units
	Demand type		
1	Average day flow	0.96	l/s
2	Maximum day flow	1.93	l/s
3	Peak hour flow	2.89	l/s
4	Fire flow	166.67	l/s
Analysis			
5	Maximum day plus fire flow	168.59	l/s

#### HYDRANT FLOW TEST

Connection Point	Existing 300mm Watermain on Kirwin Ave
Total equivalent population to be serviced	297
Total lands to be serviced	0.392 ha
Standard Wastewater Sewer Effluent (L/s)	13.08
Actual Wastewater Sewer Effluent (L/s)	4.33

# APPENDIX D

## Storm Sewer Capacity Assessment




# APPENDIX D-01

Historic Drainage Area Plan 1979

City of Mississauga



Note: 2.11 ha up to the tracks

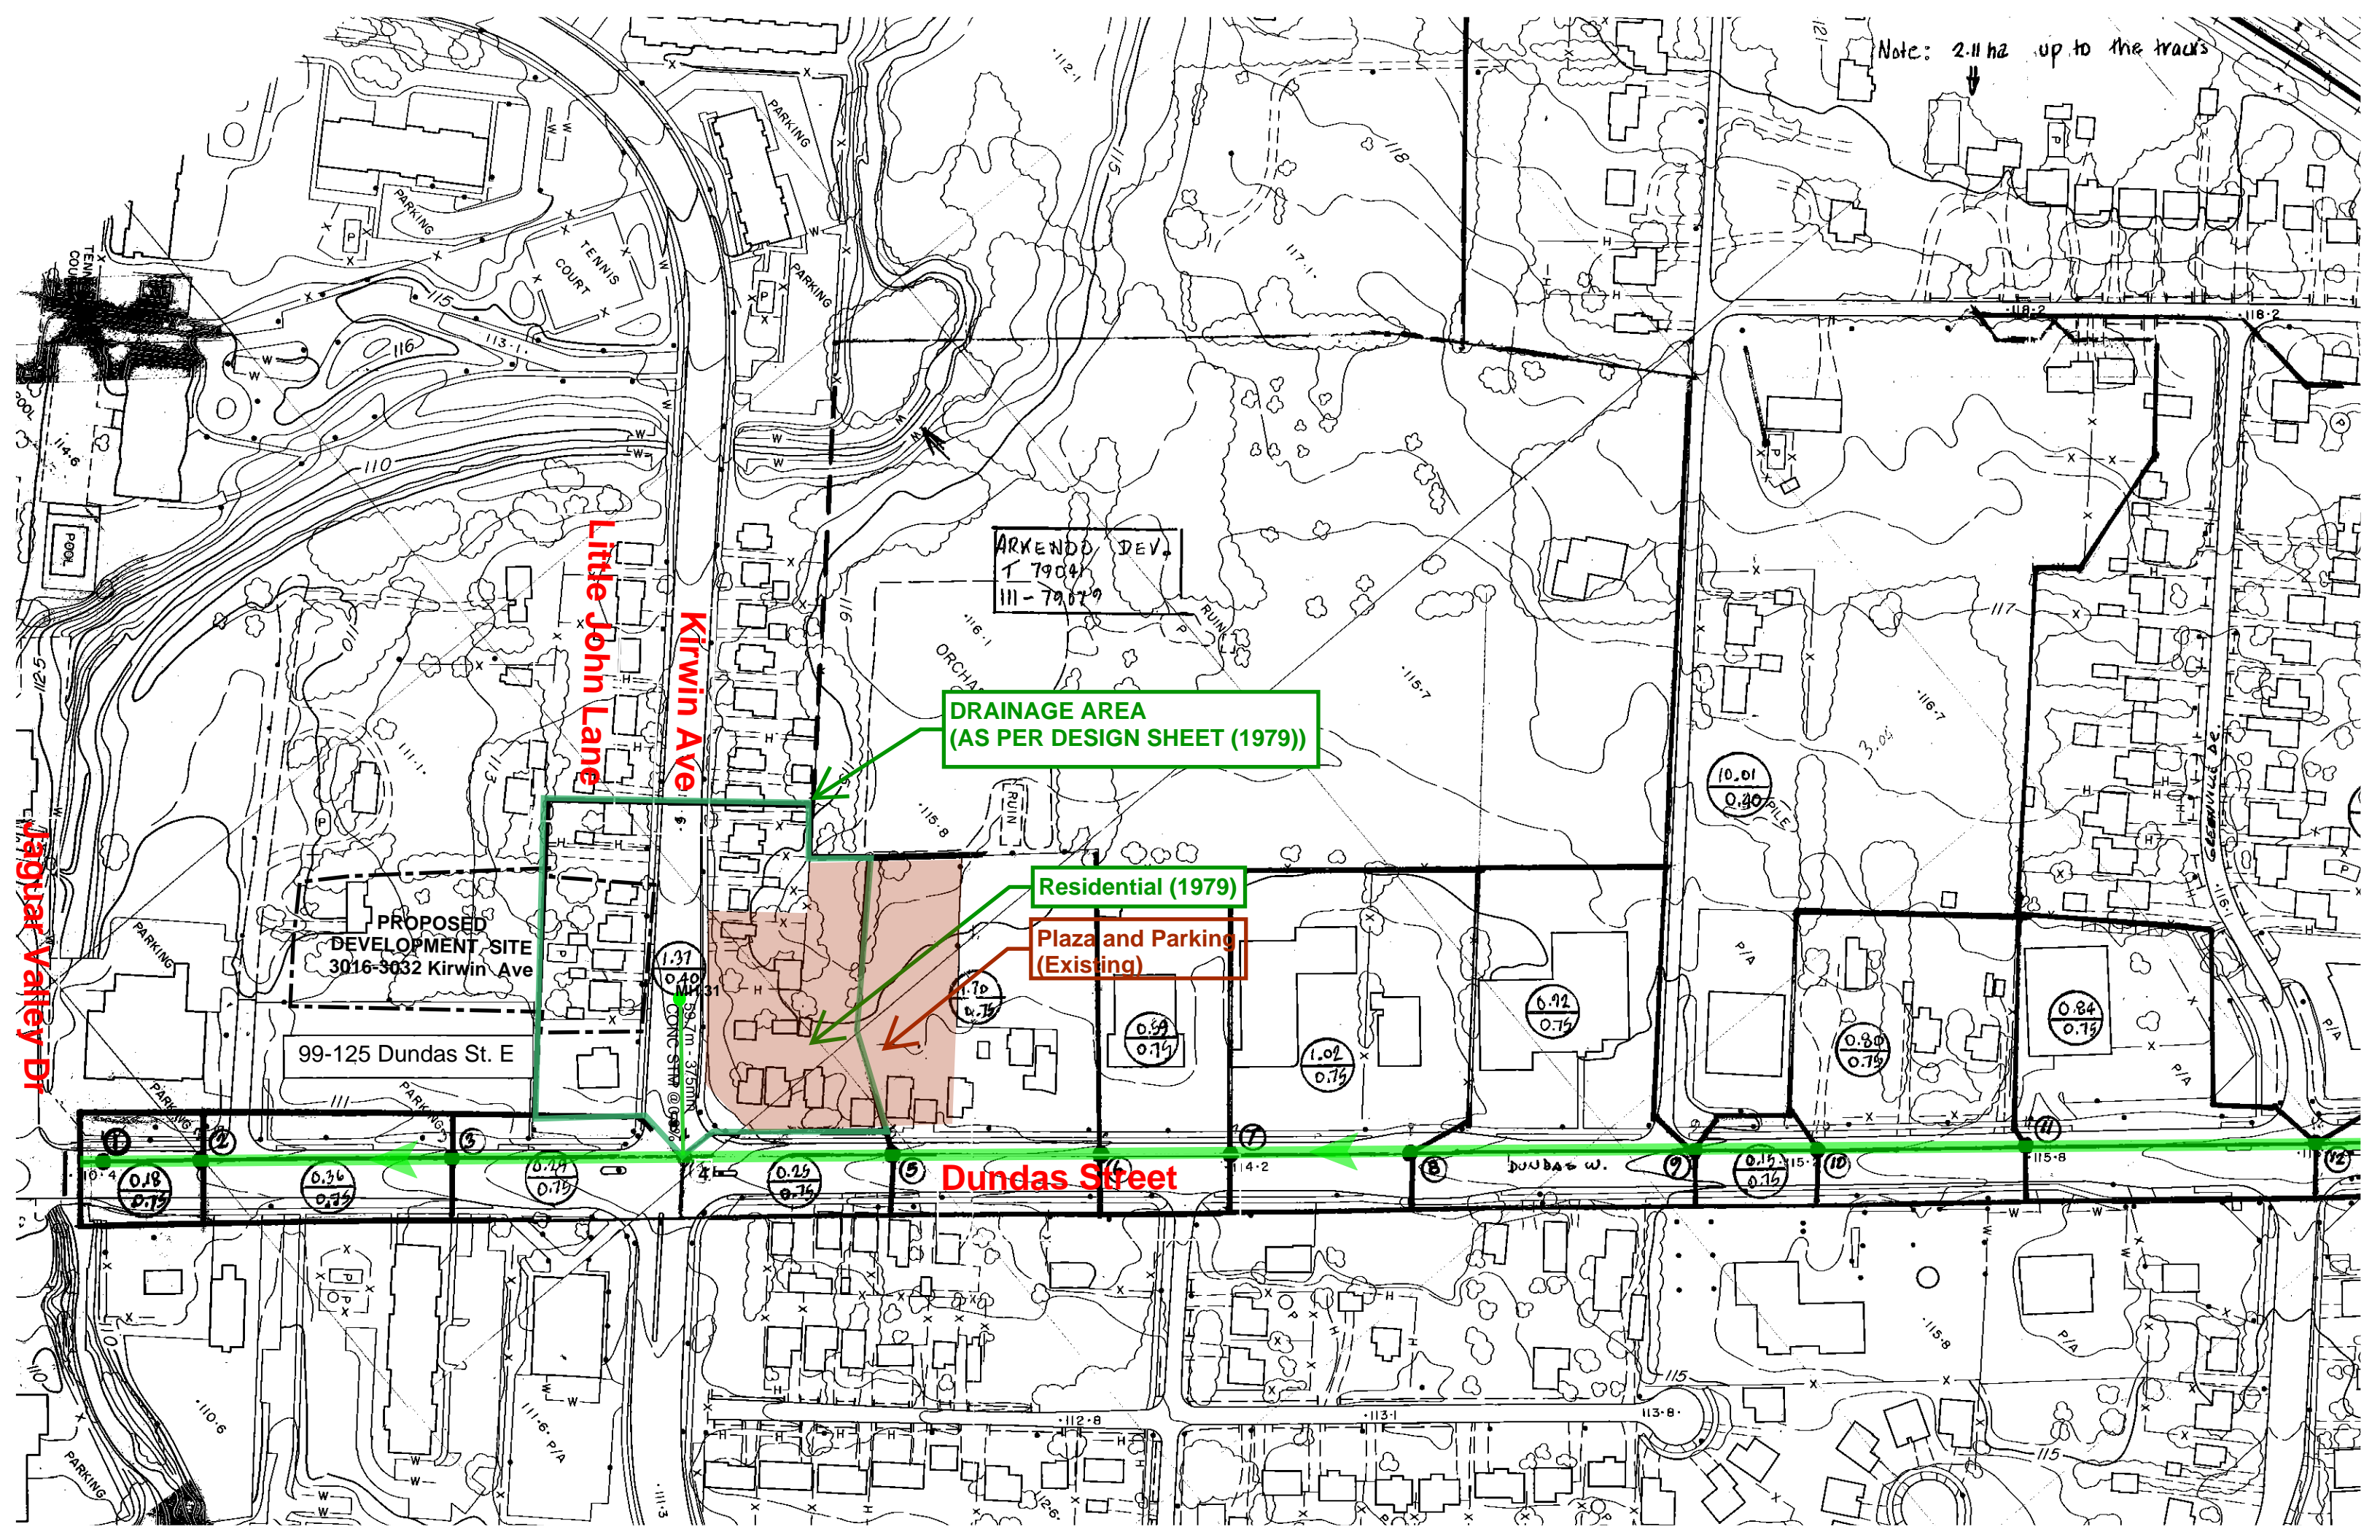

ARKENDS DEV.  
T 7904  
111-79049

DRAINAGE AREA  
(AS PER DESIGN SHEET (1979))

Residential (1979)

Plaza and Parking  
(Existing)

Dundas Street

Little John Lane


Kirwin Ave

PROPOSED  
DEVELOPMENT SITE  
3016-3032 Kirwin Ave

99-125 Dundas St. E

Jaguar Valley Dr

1.37  
0.40  
39.7m - 375mm  
CONC. STW @ 0.8%

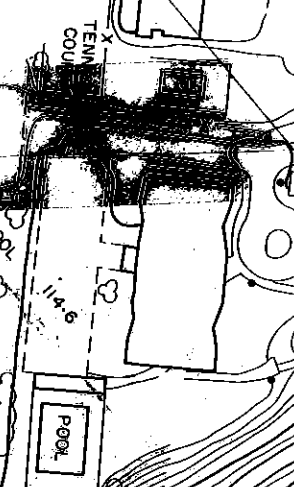

# APPENDIX D-02

Historic Design Sheet 1979

City of Mississauga





# DESIGN SHEET (1979)

SUBDIVISION _____		CITY OF MISSISSAUGA												SHEET No. <u>2</u> OF <u>3</u> DATE _____								
CONSULTANT _____		STORM DRAINAGE DESIGN CHART FOR CIRCULAR DRAINS FLOWING FULL												PROJECT No. _____								
MAJOR DRAINAGE AREA _____														DESIGNED BY _____								
LOCATION OF SECTION	FROM UPSTREAM	TO DOWNSTREAM	ADJACENT CONTRIBUTARY AREA	RUNOFF COEFFICIENT		ACCUMULATIVE AREA DRAINED BY SECTION	ACCUMULATIVE AREA TIMES RUNOFF COEFFICIENT FOR SECTION	FLOW TIME TO SECTION (FROM EXTREME UPSTREAM INLET)	INITIAL TIME OF CONCENTRATION AT EXTREME UPSTREAM INLET	TIME OF CONCENTRATION AT UPSTREAM END OF SECTION	INTENSITY OF RAINFALL	QUANTITY OF FLOW TO BE ACCOMMODATED IN SECTION.	TYPE OF PIPE	MANNINGS ROUGHNESS COEFFICIENT	SLOPE	DIAMETER	LENGTH OF SECTION	VELOCITY OF FLOW WITH PIPE FLOWING FULL	CAPACITY OF PIPE FLOWING FULL	PIPE INVERT AT UPSTREAM M.H.	PIPE INVERT AT DOWNSTREAM M.H.	TIME OF FLOW IN SECTION
	MH#	MH#	A <sub>A</sub>	C <sub>A</sub>	A <sub>A</sub> × C <sub>A</sub>	A = Σ A <sub>A</sub>	A × C = Σ A <sub>A</sub> × C <sub>A</sub>	t <sub>CF</sub>	t <sub>C1</sub>	t <sub>C</sub> = t <sub>CF</sub> + t <sub>C1</sub>	I	$Q = \frac{I \times A \times C}{360}$		n	S	D	L	V	Q	m	m	t = $\frac{L}{V \times 60}$
			(ha)			(ha)		(min)	(min)	min	mm/hr	m <sup>3</sup> /sec		%	mm	m	m/sec	m <sup>3</sup> /sec	m	m	min	
DUNDAS ST	9	8	10.01	0.40	4.00																	
			0.92	0.75	0.69	31.79	17.00			23.50	75	3.54		0.44	1050	105	2.11	1.27				0.83
								PSS						0.45	1050	91	2.14	1.90				3.79
	8	7	1.02	0.75	0.77	32.81	17.77			24.33	73	3.60		0.47	1050	65	2.23	1.99				0.47
								PSS						0.45	1050	91	2.14	1.90				3.89
	7	6	0.59	0.75	0.44	33.40	18.21			24.82	72	3.64		0.29	1050	47	1.73	1.55				0.45
	6	5	1.70	0.75	1.28	35.10	19.49			25.27	71	3.84		0.63	1050	76	2.55	2.26				0.50
								PSS						0.63	1050	91	2.55	2.26				4.52
	5	4	0.25	0.75	0.19	35.35	19.68			25.77	70	3.84		0.81	1050	74	2.87	2.56				0.43
								PSS						0.80	975	91	2.71	2.09				4.65
	4	3	1.37	0.40	0.55																	
			0.29	0.75	0.22	27.01	20.45			26.20	69	3.92		0.79	1050	86	2.87	2.53				0.50
								PSS						0.80	975	91	2.71	2.09				4.62

SUBDIVISION \_\_\_\_\_  
 CONSULTANT \_\_\_\_\_  
 MAJOR DRAINAGE AREA \_\_\_\_\_

**CITY OF MISSISSAUGA**  
 STORM DRAINAGE DESIGN CHART  
 FOR CIRCULAR DRAINS FLOWING FULL

SHEET No. 3 OF 3 DATE \_\_\_\_\_  
 PROJECT No. \_\_\_\_\_  
 DESIGNED BY \_\_\_\_\_

LOCATION OF SECTION	FROM UPSTREAM	TO DOWNSTREAM	ADJACENT CONTRIBUTORY AREA	RUNOFF COEFFICIENT		ACCUMULATIVE AREA DRAINED BY SECTION	ACCUMULATIVE AREA TIMES RUNOFF COEFFICIENT FOR SECTION	FLOW TIME TO SECTION (FROM EXTREME UPSTREAM INLET)	INITIAL TIME OF CONCENTRATION AT EXTREME UPSTREAM INLET	TIME OF CONCENTRATION AT UPSTREAM END OF SECTION	INTENSITY OF RAINFALL	QUANTITY OF FLOW TO BE ACCOMMODATED IN SECTION.	TYPE OF PIPE	MANNINGS ROUGHNESS COEFFICIENT	SLOPE	DIAMETER	LENGTH OF SECTION	VELOCITY OF FLOW WITH PIPE FLOWING FULL	CAPACITY OF PIPE FLOWING FULL	PIPE INVERT AT UPSTREAM M.H.	PIPE INVERT AT DOWNSTREAM M.H.	TIME OF FLOW IN SECTION
	MH#	MH#	A <sub>A</sub>	C <sub>A</sub>	A <sub>A</sub> × C <sub>A</sub>	A = Σ A <sub>A</sub>	A <sub>A</sub> × C <sub>A</sub> = Σ A <sub>A</sub> × C <sub>A</sub>	t <sub>Cf</sub>	t <sub>Ci</sub>	t <sub>C</sub> = t <sub>Cf</sub> + t <sub>Ci</sub>	I	$Q = \frac{1.486}{360} A C I$						n	S	D	L	V
			(ha)			(ha)		(min)	(min)	min	mm/hr	m <sup>3</sup> /SEC			%	mm	m	m/SEC	m <sup>3</sup> /SEC			min
DUNDAS ST	3	2	0.36	0.75	0.27	37.37	20.72			26.70	60	3.92			0.70	1050	91	2.81	2.52			0.54
								PSS							0.80	975	76	2.71	2.09			
																			4.61			
	2	CULV	0.18	0.75	0.14	37.55	20.86			27.24	67	3.92			0.84	1050	43	2.92	2.61			0.25
								PSS							0.80	975	35	2.71	2.09			
																			4.70			

# APPENDIX D-03

## Updated Existing Drainage Area Plan for Kirwin



UPDATED EXISTING DRAINAGE AREAS (2022)

SUBJECT SITE



E2 | 0.62  
0.138 ha

E1 | 0.75  
0.682 ha

E3 | 0.62  
0.057 ha

E4 | 0.9  
0.266 ha

CB1  
SE INV 0.89m DIA 250mm

CB2  
SW INV 0.85m DIA 250mm

CB5

MH 32  
W INV 1.63 DIA 250mm  
N INV not surveyed  
S INV not surveyed

MH31  
S INV 2.69m DIA 400mm  
E INV 2.56m DIA 250mm  
NE INV 2.56m DIA 250mm  
NW INV 2.55m DIA 250mm

CB6


CB4  
SW 0.65m DIA 250mm

CB3  
SE INV 1.37m DIA 250mm

MH33  
NE INV 1.08m DIA 250mm  
SW INV 1.24m DIA 250mm

MH30 (4)  
N INV 2.71m 400mm

5  
Location marker for  
D/S Storm Analysis

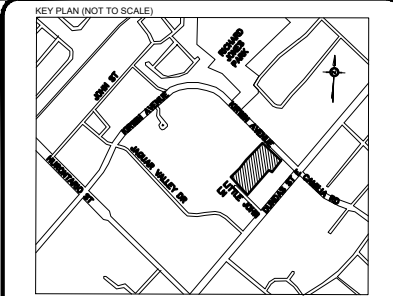

- LEGEND**
- MH EXISTING MANHOLE
  - ▣ CB EXISTING CATCHBASIN
  - SUBJECT SITE EXISTING PROPERTY LINE
  - DRAINAGE BOUNDARY
  - C1 | 0.25  
0.388 ha DRAINAGE ID/RUNOFF COEFFICIENT DRAINAGE AREA (ha)

No.	Revision	Date	By	App.
1	ISSUED FOR SPA SUBMISSION	2022-11-16	F.M.	

625 Cochrane Drive, Suite 900 Markham, Ontario L3R 9R9, Canada Tel: (905)470-0015 Fax: (905)470-0030		
--	--	--

Owner/Client:  
**DASS METAL**

Location:  
**3031 LITTLE JOHN & 3016-3032  
KIRWIN AVE DEVELOPMENT**

Title:  
**KIRWIN AVE STORM SEWER ANALYSIS  
EXISTING DRAINAGE PLAN**

Designed By: F.M.	Drawn By: J.W.	Checked By: F.M.
Scale: 1:500	Date: FEB, 2021	Drawing No.: FIG-3
Project No.: 21111		

# APPENDIX D-04

## Updated Design Sheet



DEVELOPMENT: 3016 Kirwin Ave

CONSULTANT: LEA Consulting Ltd

MAJOR DRAINAGE AREA: Cooksville Creek

**MISSISSAUGA**  
*Transportation and Works*  
**STORM DRAINAGE DESIGN CHART**  
**FOR CIRCULAR DRAINS FLOWING FULL**

SHEET No.: DATE: 16-Nov-22

DESIGNED BY: F.M.

CHECKED BY: F.F.



City of Mississauga Intensity 10yr = 1010/(tc+4.6)<sup>0.78</sup>

**Pre-Development Condition**

FROM UPSTREAM	TO DOWNSTREAM	Drainage area ID	Catchment AREA	RUNOFF COEFFICIENT	AREA TIMES RUNOFF COEFFICIENT	ACCUMULATIVE AREA DRAINED BY SECTION	ACCUMULATIVE AREA TIMES RUNOFF COEFFICIENT FOR SECTION	FLOW TIME TO SECTION FROM EXTREME UPSTREAM INLET	INITIAL TIME OF CONCENTRATION AT EXTREME UPSTREAM INL.	TIME OF CONCENTRATION UPSTREAM END OF SECTION	INTENSITY OF RAINFALL	QUANTITY OF FLOW ACCUMULATED IN SECTION	TYPE OF PIPE	MANNING ROUGHNESS COEFFICIENT	SLOPE	DIAMETER	LENGTH OF SECTION	VELOCITY OF FLOW WITH PIPE FLOWING FULL	CAPACITY OF PIPE FLOWING FULL	PIPE INVERT AT UPSTREAM M.H.	PIPE INVERT AT DOWNSTREAM M.H.	TIME OF FLOW IN SECTION	QUANTITY OF FLOW TO PIPE FLOWING FULL	NOTES	
MH#	MH#		A ha	C	AxC	SUM. A ha	SUM AxC	tc <sub>i</sub> min	tc <sub>i</sub> min	tc=tc <sub>i</sub> +tc <sub>i</sub> min	i mm/hr	Q=iAC/360 m3/sec		n	S %	D mm	L m	V m/sec	Q <sub>r</sub> m3/sec	m	m	t=L/Vx60 min	Q/Q <sub>r</sub> %		
MH31	5	E1	0.682	0.75	0.51	0.682	0.51	0	15	15	99.2	0.141	CONC	0.013	1.25	400	49.33	1.85	0.233	110.35	N/A	0.44	0.71	Surcharged  SUM AxC= 19.68, Q=3840l/s, Tc=25.77 min	
		E2	0.138*	0.62	0.09	0.138	0.09	0	15	15	99.2	0.024**													
5	4 (MH30)	E4	0.266	0.90	0.24	1.143	0.87	0.44	15	15.44	97.5	0.236***	CONC	0.013	1.25	400	4.56	1.85	0.233	N/A	109.69	0.04	1.01		
		E3	0.057*	0.62	0.04																				
Flow from STM Sewer on Dundas Street						35.350	19.68			25.77	70.5	3.85											0.43		
4 (MH30)	3		0.290	0.75	0.22	36.783	20.77	0.43	25.77	26.20	69.7	4.02	CONC	0.013	0.79	1050	86.00	2.80	2.43			0.51	0.91		
													CONC	0.013	0.80	975	91.00	2.68	2.00			0.56			
																						4.43			
3	2		0.360	0.75	0.27	37.143	21.04	0.51	26.20	26.71	68.8	4.02	CONC	0.013	0.78	1050	91.00	2.79	2.41			0.54	0.91		
													CONC	0.013	0.80	975	76.00	2.68	2.00			0.47			
2	CULVERT		0.180	0.75	0.14	37.323	21.17	0.54	26.71	27.26	67.9	3.99	CONC	0.013	0.84	1050	35.97	2.89	2.50			0.21	0.89		
													CONC	0.013	0.80	975	35.00	2.68	2.00			0.22			
																						4.51			

\* Drainage area from Subject Site

\*\* 10-yr storm flow from the proposed site under existing conditions, using actual runoff coefficient. (i.e. not discounting to 0.5)

\*\*\* includes flow from 0.057 ha from the subject site, equivalent to 9.7 L/s

**Post-Development Condition**

FROM UPSTREAM	TO DOWNSTREAM	Catchment AREA	RUNOFF COEFFICIENT	AREA TIMES RUNOFF COEFFICIENT	ACCUMULATIVE AREA DRAINED BY SECTION***	ACCUMULATIVE AREA TIMES RUNOFF COEFFICIENT FOR SECTION	FLOW TIME TO SECTION FROM EXTREME UPSTREAM INLET	INITIAL TIME OF CONCENTRATION AT EXTREME UPSTREAM INL.	TIME OF CONCENTRATION UPSTREAM END OF SECTION	INTENSITY OF RAINFALL	QUANTITY OF FLOW ACCUMULATED IN SECTION	TYPE OF PIPE	MANNING ROUGHNESS COEFFICIENT	SLOPE	DIAMETER	LENGTH OF SECTION	VELOCITY OF FLOW WITH PIPE FLOWING FULL	CAPACITY OF PIPE FLOWING FULL	PIPE INVERT AT UPSTREAM M.H.	PIPE INVERT AT DOWNSTREAM M.H.	TIME OF FLOW IN SECTION	QUANTITY OF FLOW TO PIPE FLOWING FULL	NOTES		
MH#	MH#	A ha	C	AxC	SUM. A ha	SUM AxC	tc <sub>i</sub> min	tc <sub>i</sub> min	tc=tc <sub>i</sub> +tc <sub>i</sub> min	i mm/hr	Q=iAC/360 m3/sec		n	S %	D mm	L m	V m/sec	Q <sub>r</sub> m3/sec	m	m	t=L/Vx60 min	Q/Q <sub>r</sub> %			
MH31	5	E1	0.682	0.75	0.51	0.682	0.51	0	15	15	99.2	0.141	CONC	0.013	1.25	400	49.33	1.85	0.233	110.35	N/A	0.44	0.67	SUM AxC= 19.68, Q=3840l/s, Tc=25.77 min	
		E2+E3	0.337*									0.015**													
5	4 (MH30)	E4	0.266	0.90	0.24	0.948	0.75	0.44	15	15.44	97.5	0.218	CONC	0.013	1.25	400	4.56	1.85	0.233	N/A	0.00	0.04	0.94		
Flow from STM Sewer on Dundas Street						35.350	19.68			25.77	70.5	3.85											0.43		
4	3		0.290	0.75	0.22	36.588	20.65	0.43	25.77	26.20	69.7	4.013	CONC	0.013	0.79	1050	86.00	2.80	2.43			0.51	0.91		
													CONC	0.013	0.80	975	91.00	2.68	2.00			0.56			
																						4.431			
3	2		0.360	0.75	0.27	36.948	20.92	0.51	26.20	26.71	68.8	4.013	CONC	0.013	0.78	1050	91.00	2.79	2.41			0.54	0.91		
													CONC	0.013	0.80	975	76.00	2.68	2.00			0.47			
2	CULVERT		0.180	0.75	0.14	37.128	21.05	0.54	26.71	27.26	67.9	3.985	CONC	0.013	0.84	1050	35.97	2.89	2.50			0.21	0.88		
													CONC	0.013	0.80	975	35.00	2.68	2.00			0.22			
																						4.507			

\* Controlled Drainage area from Subject Site, post-development conditions.

\*\* Overcontrolled flows based on the 2-year pre-development with C = 0.5 was used for flow from the proposed site under post-development condition. Includes 10-year uncontrolled flow from the subject site under post-development conditions.



Note: Area from Overcontrolled site is not included in the Accumulated Area so that it does not impact the flow calculation. The overcontrolled flow has been directly included in the flow in all downstream sewers.

\*\*\* Cumulative Drainage area does not include controlled/uncontrolled area from the subject site.

# APPENDIX D-05

## CCTV Report



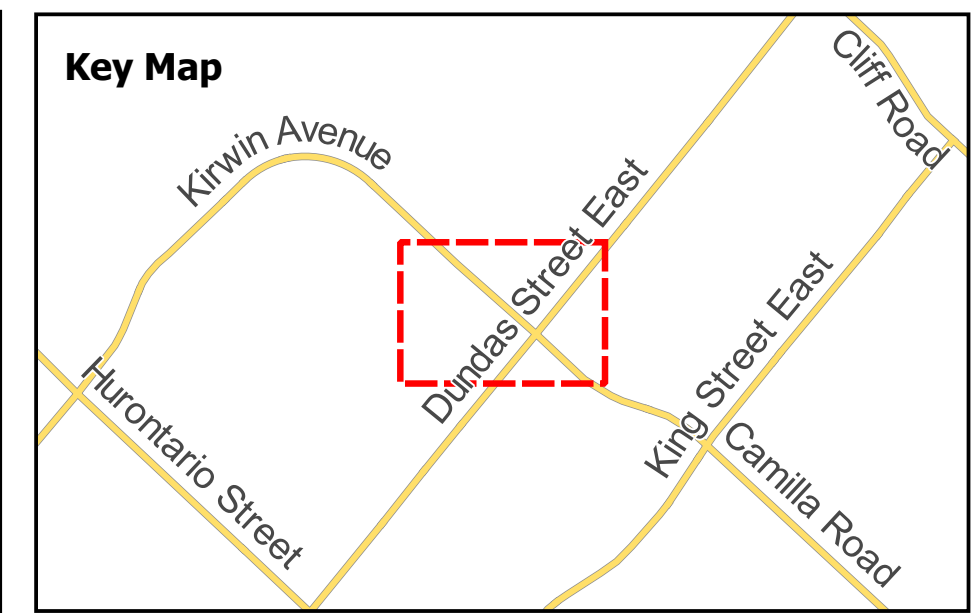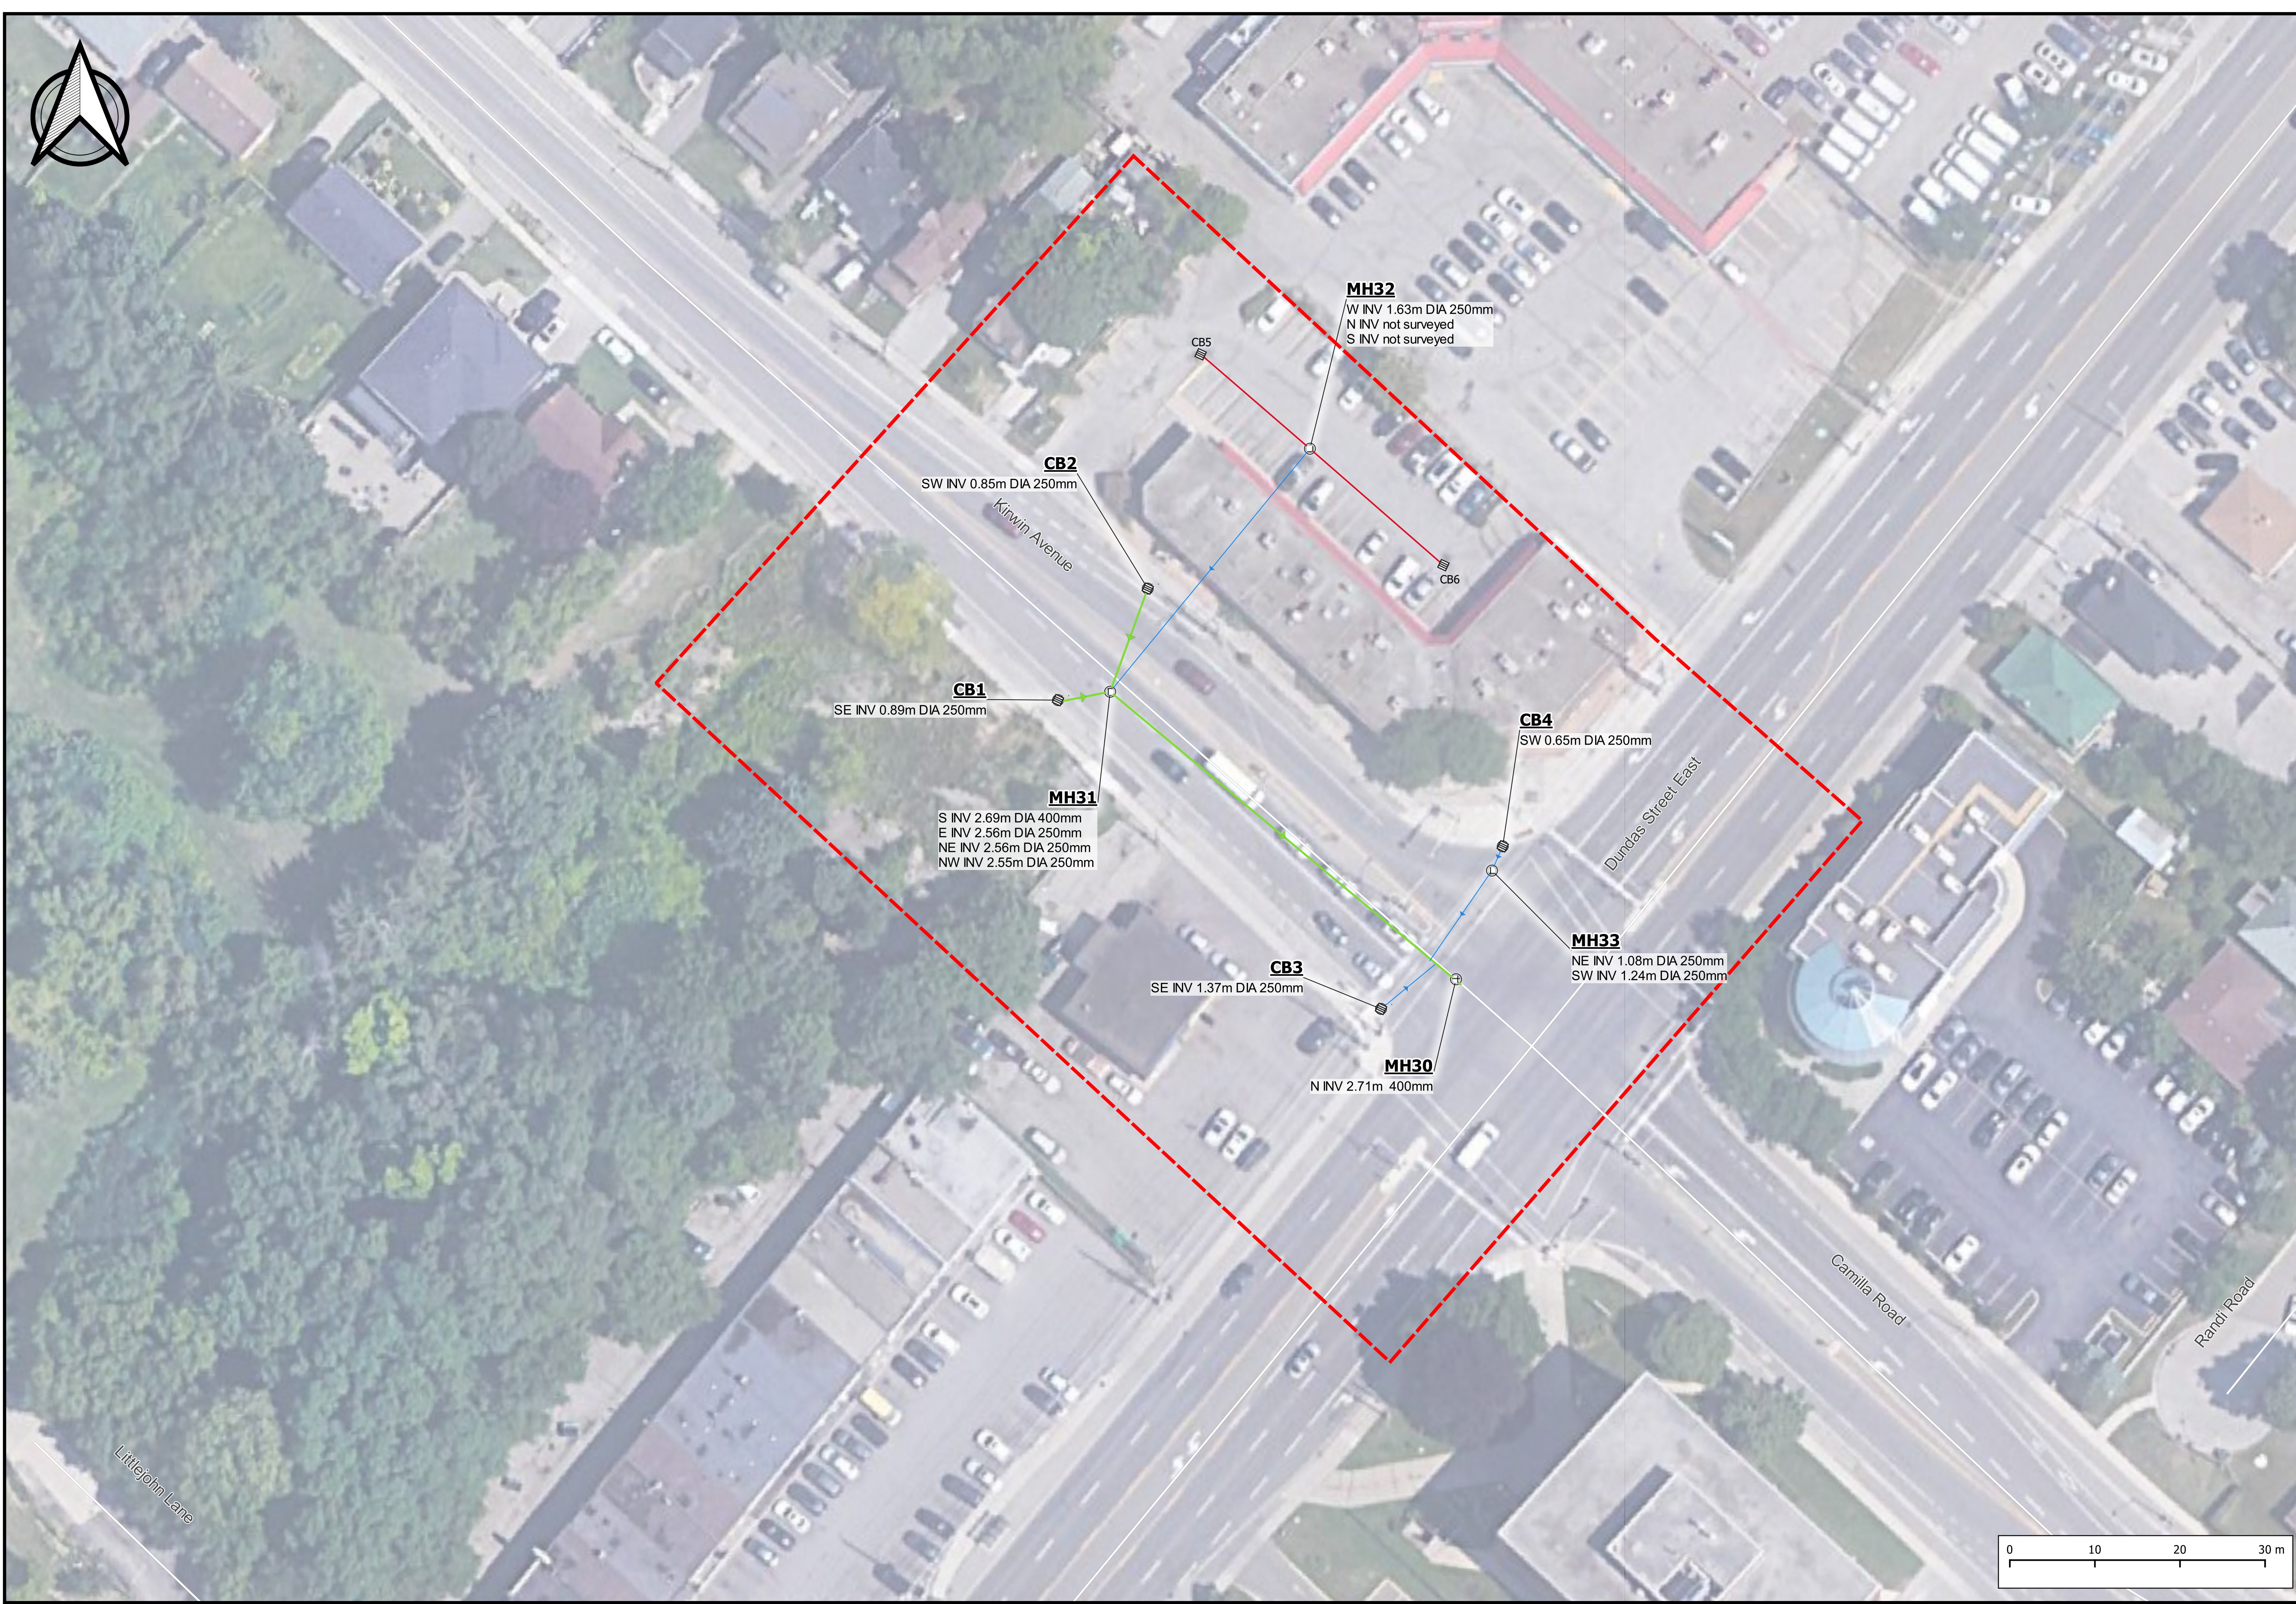

**General Notes**

1. Field inspection was performed on March 31, 2022. The scope of work included sewer flushing, sewer CCTV inspections, and invert measurements.
2. The location of the sewers and direction of flow were defined based on line-of-sight and judgment of the field technician.
3. Other buried utilities within the Investigation Limits are not shown.

**Map Legend**


Sewerlines

- Storm Sewer
- Lateral Lines
- Sewer not Surveyed

Point Features

- CB
- MH Manhole

**Sources:**  
Projection System: NAD 83 UTM ZONE 17N

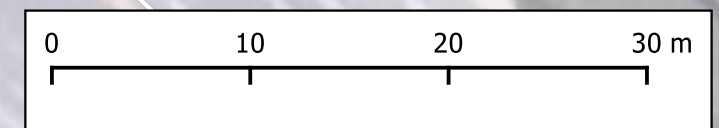

Prepared By: Associated With:



**Drawn:** M.Skerlan Apr 7, 2022  
**Checked:** A.Durante Apr 7, 2022  
**Approved:**

**Revision History**

**Project: Dundas Street E and Kirwin Avenue, Mississauga**

**Project #: 2022-602  
CCTV and Flush**





### Asset

Owner:

PSR:

Upstream MH:

Downstream MH:

	USMH	DSMH
Rim to Invert:	<input type="text" value="0.89 m"/>	<input type="text" value="2.55 m"/>
Rim to Grade:	<input type="text"/>	<input type="text"/>
Pipe Geometry:	<input type="text" value="250 mm (Circular)"/>	
Material:	<input type="text" value="Concrete Pipe (non-reinforced)"/>	
Lining Method:	<input type="text"/>	
Coating Method:	<input type="text"/>	
Year Constructed:	<input type="text"/>	
Pipe Use:	<input type="text" value="Stormwater Pipe"/>	
Total Length:	<input type="text" value="(unspecified)"/>	

### Project

Project:

Work Order:

Customer:

PO Number:

Additional Info:

### Inspection

Media Date/Time:

Surveyed By:

Reviewed By:

Camera Direction:

Purpose:

Technology:

Pre-Cleaning:

Date Cleaned:

Flow Control:

Length Surveyed:

Weather:

### Location

Address:

Drainage Area:

Latitude:

Longitude:

Elevation:

GPS Accuracy:


Location Code:

Location Details:

### Ratings

	Structural	O & M	Overall
Quick:	<input type="text" value="4131"/>	<input type="text" value="0000"/>	<input type="text" value="4131"/>
$\sum_{i=1}^5 SG_i$ Pipe Rating (OR):	<input type="text" value="7"/>	<input type="text" value="0"/>	<input type="text" value="7"/>
Rating Index (RI):	<input type="text" value="3.5"/>	<input type="text" value="0"/>	<input type="text" value="3.5"/>
Consequence of Failure:	<input type="text"/>		

### Summary

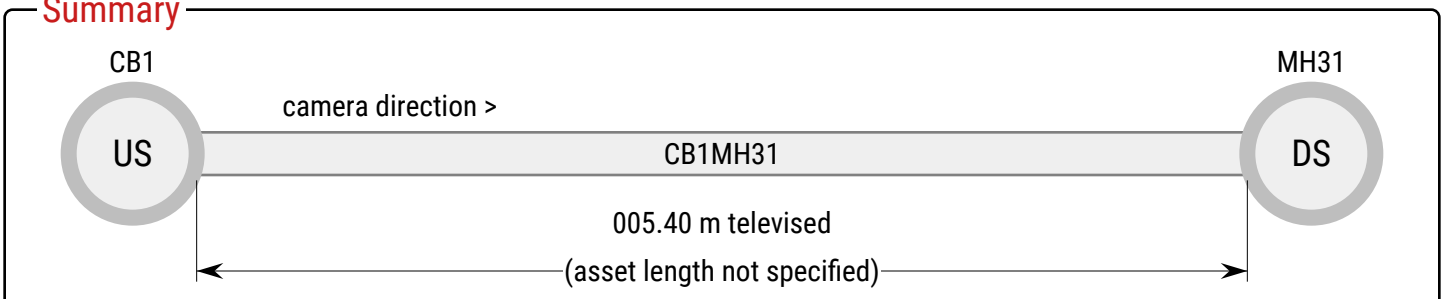

# Observations

CB1

camera direction >

flow >

Metres	Code	Clock	Value	Grade	Description	Remarks
--------	------	-------	-------	-------	-------------	---------


000.00	AMH				Access Point Manhole	Starting MH: CB1. Cannot view cb due to slope
	MWL		5%		Miscellaneous Water Level	

003.20	FL	9		3	Fracture Longitudinal	
--------	----	---	--	---	-----------------------	--

005.30	JOL			4	Joint Offset Large	
005.40	MSA				Miscellaneous Survey Abandoned	Survey abandoned due to offset joint.

MH31

# Snapshots

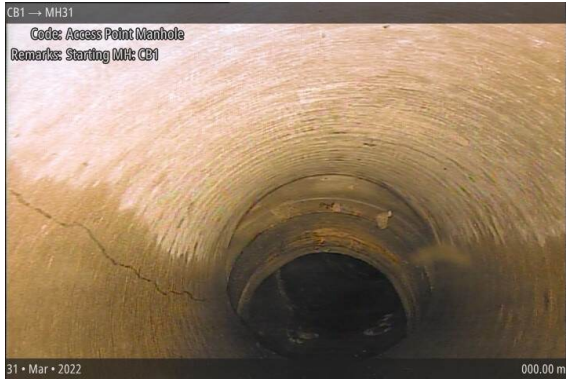

Access Point Manhole at 000.00 m | Starting MH: CB1. Cannot view cb due to slope



Miscellaneous Water Level at 000.00 m



Fracture Longitudinal at 003.20 m, 9 o'clock



Joint Offset Large at 005.30 m



Miscellaneous Survey Abandoned at 005.40 m | Survey abandoned due to offset joint.

### Asset

Owner:

PSR:

Upstream MH:

Downstream MH:

	USMH	DSMH
Rim to Invert:	<input type="text" value="1.37 m"/>	<input type="text"/>
Rim to Grade:	<input type="text"/>	<input type="text"/>

Pipe Geometry:

Material:

Lining Method:

Coating Method:

Year Constructed:

Pipe Use:

Total Length:

### Project

Project:

Work Order:

Customer:

PO Number:

Additional Info:

### Inspection

Media Date/Time:

Surveyed By:

Reviewed By:

Camera Direction:

Purpose:

Technology:

Pre-Cleaning:

Date Cleaned:

Flow Control:

Length Surveyed:

Weather:

### Location

Address:

Drainage Area:

Latitude:

Longitude:

Elevation:

GPS Accuracy:


Location Code:

Location Details:

### Ratings


	Structural	O & M	Overall
Quick:	<input type="text" value="0000"/>	<input type="text" value="0000"/>	<input type="text" value="0000"/>
$\sum_{i=1}^5 SG_i$ Pipe Rating (OR):	<input type="text" value="0"/>	<input type="text" value="0"/>	<input type="text" value="0"/>
Rating Index (RI):	<input type="text" value="0"/>	<input type="text" value="0"/>	<input type="text" value="0"/>
Consequence of Failure:	<input type="text"/>		

### Summary

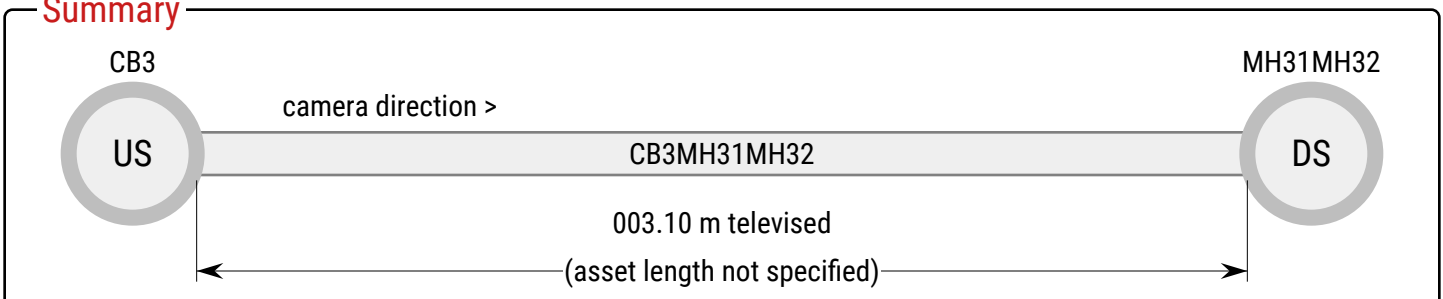

# Observations

CB3

Metres	Code		Clock	Value	Grade	Description	Remarks
000.00	AMH					Access Point Manhole	Starting MH: CB3. Cannot view CB due to slope.
	MWL			5%		Miscellaneous Water Level	

camera direction >

flow >


003.10 ADP

Access Point Discharge Point


MH31MH32. Survey Complete.

MH31MH32

## Snapshots

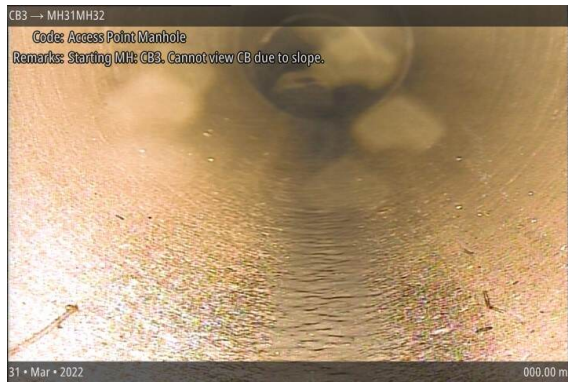

Access Point Manhole at 000.00 m | Starting MH: CB3. Cannot view CB due to slope.

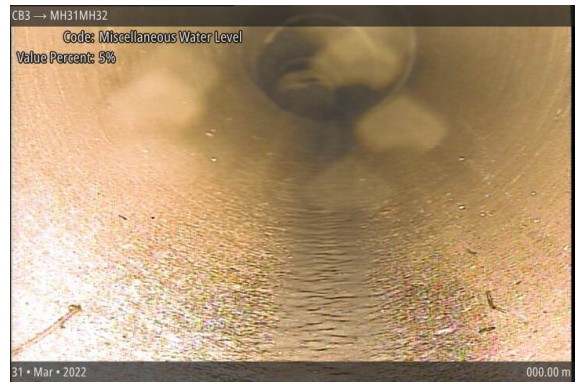

Miscellaneous Water Level at 000.00 m



Access Point Discharge Point at 003.10 m | MH31MH32. Survey Complete.

## Asset

Owner:

PSR:

Upstream MH:

Downstream MH:

	USMH	DSMH
Rim to Invert:	<input type="text" value="0.65 m"/>	<input type="text"/>
Rim to Grade:	<input type="text"/>	<input type="text"/>
Pipe Geometry:	<input type="text" value="250 mm (Circular)"/>	
Material:	<input type="text" value="Concrete Pipe (non-reinforced)"/>	
Lining Method:	<input type="text"/>	
Coating Method:	<input type="text"/>	
Year Constructed:	<input type="text"/>	
Pipe Use:	<input type="text" value="Stormwater Pipe"/>	
Total Length:	<input type="text" value="(unspecified)"/>	

## Project

Project:

Work Order:

Customer:

PO Number:

Additional Info:

## Inspection

Media Date/Time:

Surveyed By:

Reviewed By:

Camera Direction:

Purpose:

Technology:

Pre-Cleaning:

Date Cleaned:

Flow Control:

Length Surveyed:

Weather:

## Location

Address:

Drainage Area:

Latitude:

Longitude:

Elevation:

GPS Accuracy:


Location Code:

Location Details:

## Ratings

	Structural	O & M	Overall
Quick:	<input type="text" value="3100"/>	<input type="text" value="0000"/>	<input type="text" value="3100"/>
$\sum_{i=1}^5 SG_i$ Pipe Rating (OR):	<input type="text" value="3"/>	<input type="text" value="0"/>	<input type="text" value="3"/>
Rating Index (RI):	<input type="text" value="3"/>	<input type="text" value="0"/>	<input type="text" value="3"/>
Consequence of Failure:	<input type="text"/>		

## Summary

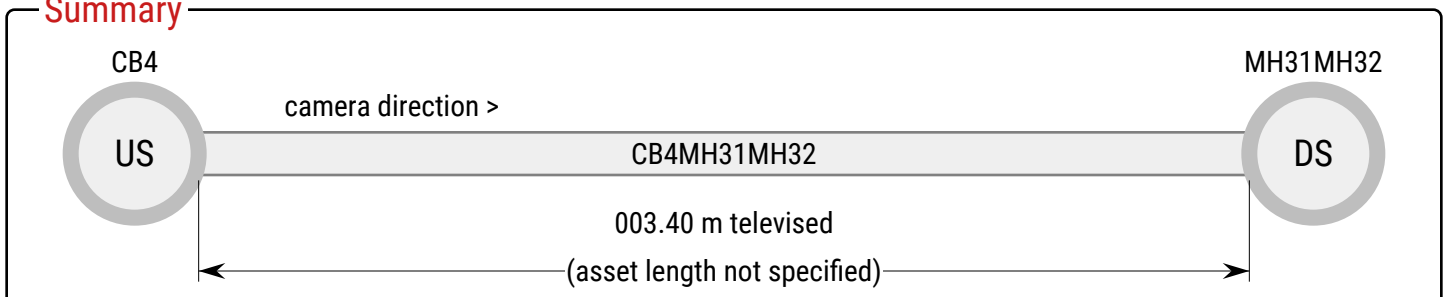



# Observations

CB4

camera direction >

flow >

Metres	Code	Clock	Value	Grade	Description	Remarks
--------	------	-------	-------	-------	-------------	---------

000.00	AMH				Access Point Manhole	Starting MH: CB4 Cannot view CB due to slope.
--------	-----	--	--	--	----------------------	---


	MWL		5%		Miscellaneous Water Level	
--	-----	--	----	--	---------------------------	--

001.40	JOM			3	Joint Offset Medium	
--------	-----	--	--	---	---------------------	--


003.40	ADP				Access Point Discharge Point	MH31MH32. Survey Complete.
--------	-----	--	--	--	------------------------------	----------------------------

MH31MH32


## Snapshots

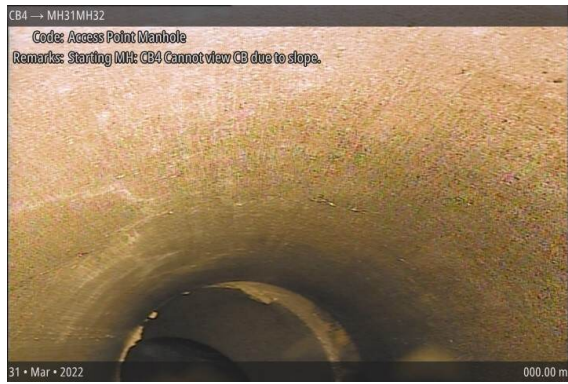

Access Point Manhole at 000.00 m | Starting MH:  
CB4 Cannot view CB due to slope.

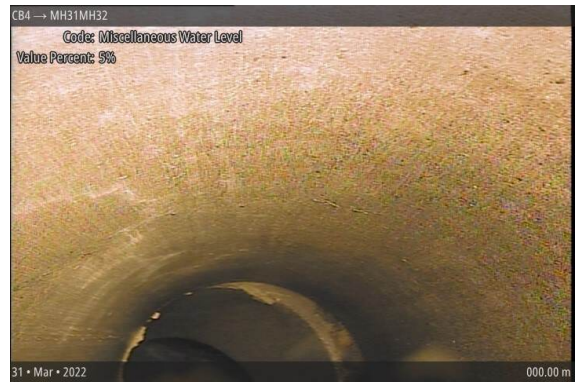

Miscellaneous Water Level at 000.00 m

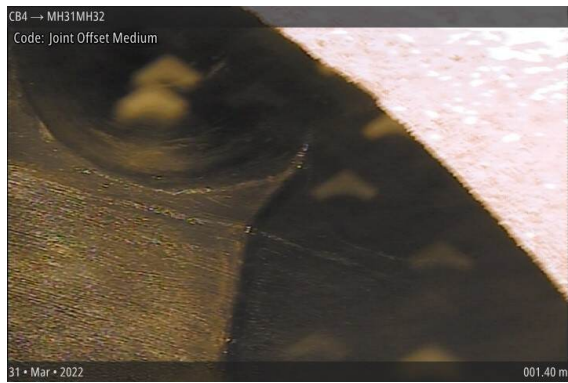

Joint Offset Medium at 001.40 m



Access Point Discharge Point at 003.40 m |  
MH31MH32. Survey Complete.

### Asset

Owner:

PSR:

Upstream MH:

Downstream MH:

	USMH	DSMH
Rim to Invert:	<input type="text" value="0.89 m"/>	<input type="text" value="2.55 m"/>
Rim to Grade:	<input type="text"/>	<input type="text"/>
Pipe Geometry:	<input type="text" value="250 mm (Circular)"/>	
Material:	<input type="text" value="Concrete Pipe (non-reinforced)"/>	
Lining Method:	<input type="text"/>	
Coating Method:	<input type="text"/>	
Year Constructed:	<input type="text"/>	
Pipe Use:	<input type="text" value="Stormwater Pipe"/>	
Total Length:	<input type="text" value="(unspecified)"/>	

### Project

Project:

Work Order:

Customer:

PO Number:

Additional Info:

### Inspection

Media Date/Time:

Surveyed By:

Reviewed By:

Camera Direction:

Purpose:

Technology:

Pre-Cleaning:

Date Cleaned:

Flow Control:

Length Surveyed:

Weather:

### Location

Address:

Drainage Area:

Latitude:

Longitude:

Elevation:

GPS Accuracy:


Location Code:

Location Details:

### Ratings

	Structural	O & M	Overall
Quick:	<input type="text" value="0000"/>	<input type="text" value="0000"/>	<input type="text" value="0000"/>
$\sum_{i=1}^5 SG_i$ Pipe Rating (OR):	<input type="text" value="0"/>	<input type="text" value="0"/>	<input type="text" value="0"/>
Rating Index (RI):	<input type="text" value="0"/>	<input type="text" value="0"/>	<input type="text" value="0"/>
Consequence of Failure:	<input type="text"/>		

### Summary

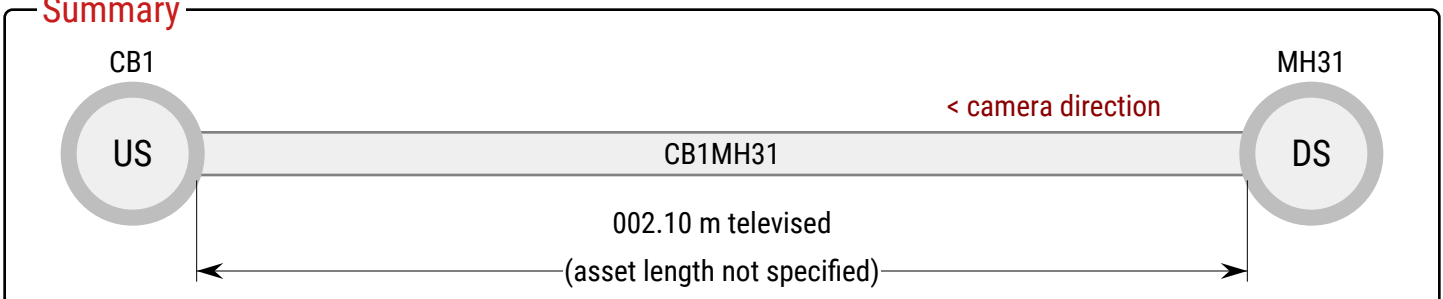

# Observations

CB1

Metres	Code		Clock	Value	Grade	Description	Remarks
--------	------	---	-------	-------	-------	-------------	---------

002.10	AM					Access Point Meter	Cannot get to reversal point do to offset joint. Reversal complete.
--------	----	--	--	--	--	--------------------	---


< Wofj

camera direction >


000.00	MWL AMH			5%		Miscellaneous Water Level Access Point Manhole	Starting MH: MH31. Cannot view MH due to slope.
--------	------------	--	--	----	--	---	---

MH31


## Snapshots

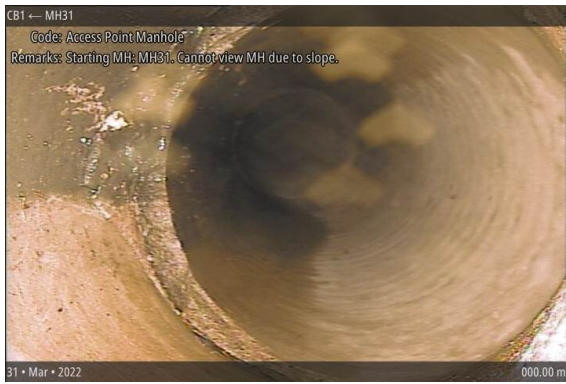

Access Point Manhole at 000.00 m | Starting MH: MH31. Cannot view MH due to slope.

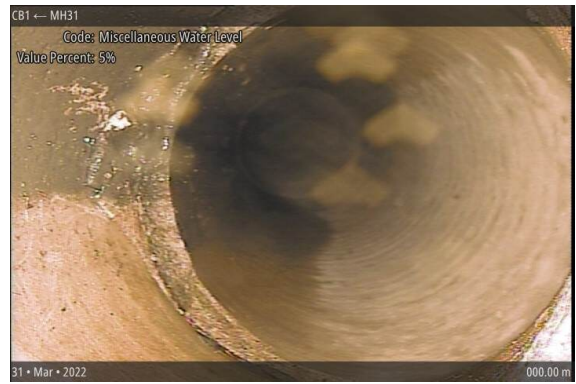

Miscellaneous Water Level at 000.00 m

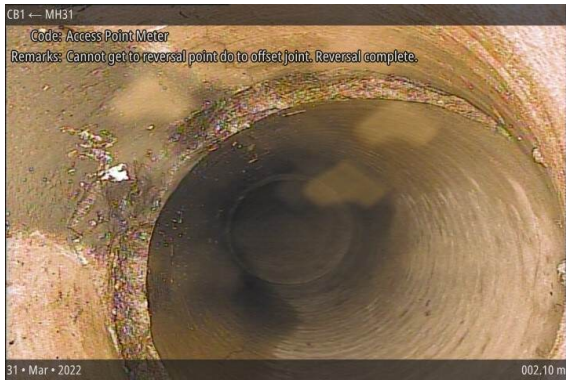

Access Point Meter at 002.10 m | Cannot get to reversal point do to offset joint. Reversal complete.

### Asset

Owner:

PSR:

Upstream MH:

Downstream MH:

	USMH	DSMH
Rim to Invert:	<input type="text" value="0.92 m"/>	<input type="text" value="1.63 m"/>
Rim to Grade:	<input type="text"/>	<input type="text"/>
Pipe Geometry:	<input type="text" value="250 mm (Circular)"/>	
Material:	<input type="text" value="Concrete Pipe (non-reinforced)"/>	
Lining Method:	<input type="text"/>	
Coating Method:	<input type="text"/>	
Year Constructed:	<input type="text"/>	
Pipe Use:	<input type="text" value="Stormwater Pipe"/>	
Total Length:	<input type="text" value="(unspecified)"/>	

### Project

Project:

Work Order:

Customer:

PO Number:

Additional Info:

### Inspection

Media Date/Time:

Surveyed By:

Reviewed By:

Camera Direction:

Purpose:

Technology:

Pre-Cleaning:

Date Cleaned:

Flow Control:

Length Surveyed:

Weather:

### Location

Address:

Drainage Area:

Latitude:

Longitude:

Elevation:

GPS Accuracy:


Location Code:

Location Details:

### Ratings

	Structural	O & M	Overall
Quick:	<input type="text" value="0000"/>	<input type="text" value="0000"/>	<input type="text" value="0000"/>
$\sum_{i=1}^5 SG_i$ Pipe Rating (OR):	<input type="text" value="0"/>	<input type="text" value="0"/>	<input type="text" value="0"/>
Rating Index (RI):	<input type="text" value="0"/>	<input type="text" value="0"/>	<input type="text" value="0"/>
Consequence of Failure:	<input type="text"/>		

### Summary

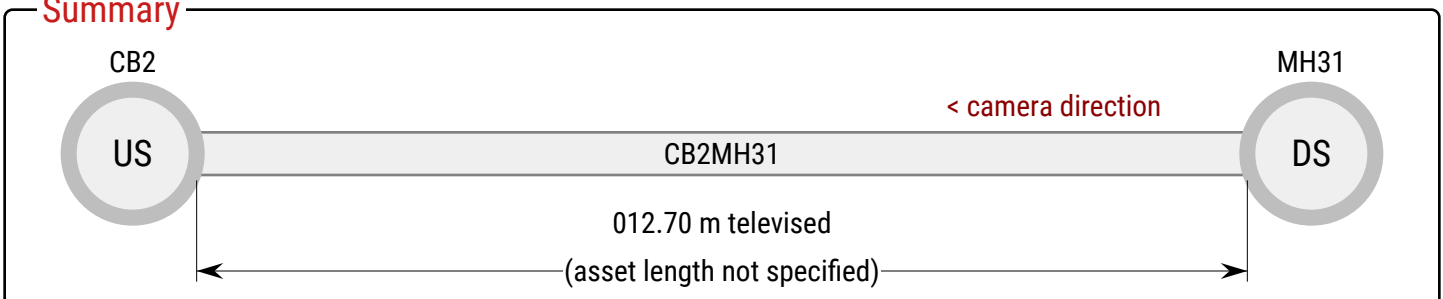

# Observations

CB2

Metres	Code	Clock	Value	Grade	Description	Remarks
012.70	AMH				Access Point Manhole	Ending MH: CB2. Survey Complete.

< W01j

camera direction >

000.00	MWL AMH		5%		Miscellaneous Water Level Access Point Manhole	Starting MH: MH31. Cannot view MH due to slope.
--------	------------	--	----	--	---	--

MH31

## Snapshots



Access Point Manhole at 000.00 m | Starting MH: MH31. Cannot view MH due to slope.



Miscellaneous Water Level at 000.00 m



Access Point Manhole at 012.70 m | Ending MH: CB2. Survey Complete.



### Asset

Owner:

PSR:

Upstream MH:

Downstream MH:

	USMH	DSMH
Rim to Invert:	<input type="text" value="2.69 m"/>	<input type="text"/>
Rim to Grade:	<input type="text"/>	<input type="text"/>
Pipe Geometry:	<input type="text" value="400 mm (Circular)"/>	
Material:	<input type="text" value="Concrete Pipe (non-reinforced)"/>	
Lining Method:	<input type="text"/>	
Coating Method:	<input type="text"/>	
Year Constructed:	<input type="text"/>	
Pipe Use:	<input type="text" value="Stormwater Pipe"/>	
Total Length:	<input type="text" value="(unspecified)"/>	

### Project

Project:

Work Order:

Customer:

PO Number:

Additional Info:

### Inspection

Media Date/Time:

Surveyed By:

Reviewed By:

Camera Direction:

Purpose:

Technology:

Pre-Cleaning:

Date Cleaned:

Flow Control:

Length Surveyed:

Weather:

### Location

Address:

Drainage Area:

Latitude:

Longitude:

Elevation:

GPS Accuracy:


Location Code:

Location Details:

### Ratings

	Structural	O & M	Overall
Quick:	<input type="text" value="3100"/>	<input type="text" value="3200"/>	<input type="text" value="3300"/>
$\sum_{i=1}^5 SG_i$ Pipe Rating (OR):	<input type="text" value="3"/>	<input type="text" value="6"/>	<input type="text" value="9"/>
Rating Index (RI):	<input type="text" value="3"/>	<input type="text" value="3"/>	<input type="text" value="3"/>
Consequence of Failure:	<input type="text"/>		

### Summary

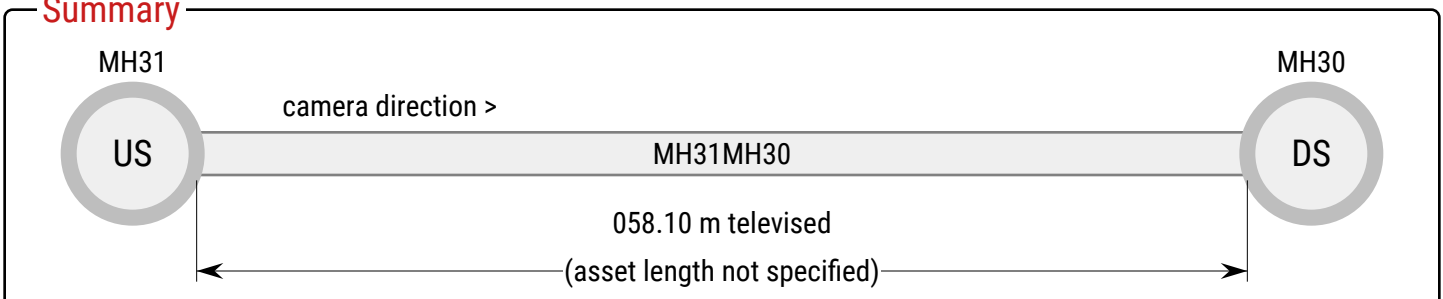

# Observations

MH31

camera direction >

flow >

Metres	Code	Clock	Value	Grade	Description	Remarks
000.00	AMH MWL		5%		Access Point Manhole Miscellaneous Water Level	Starting MH: MH31
035.50	MWL		15%		Miscellaneous Water Level	
037.30	OBN	5 - 7	20%	3	Obstruction Construction Debris	
050.20	TB	10	200 mm		Tap Break-in/Hammer	
051.50	TB	2	200 mm		Tap Break-in/Hammer	
052.10	CM	10 - 2		3	Crack Multiple	
055.60	ISSRH	4 - 8	20%	3	Intruding Sealing Ring Hanging	
058.10	AMH				Access Point Manhole	Starting MH: MH30. Cannot view MH due to hanging seal ring.

MH30

# Snapshots



Access Point Manhole at 000.00 m | Starting MH: MH31



Miscellaneous Water Level at 000.00 m




Miscellaneous Water Level at 035.50 m




Obstruction Construction Debris at 037.30 m, 5 - 7 o'clock




Tap Break-in/Hammer at 050.20 m, 10 o'clock

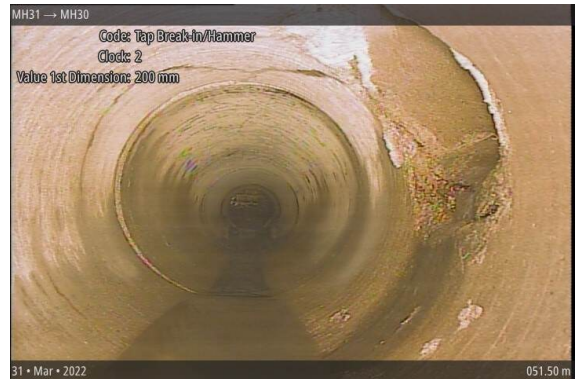

Tap Break-in/Hammer at 051.50 m, 2 o'clock

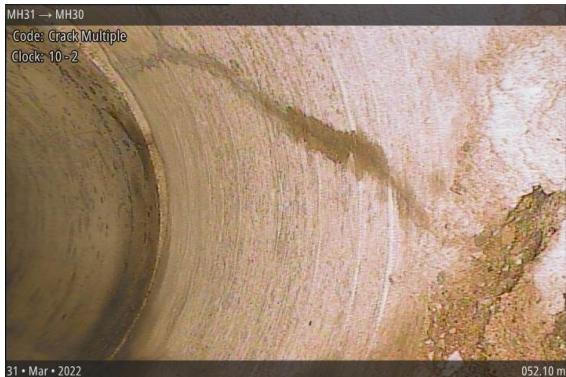


Crack Multiple at 052.10 m, 10 - 2 o'clock

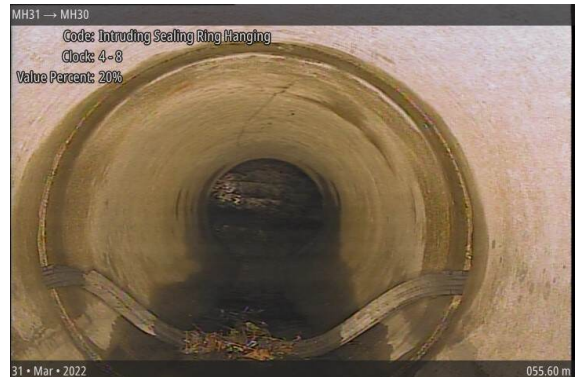

Intruding Sealing Ring Hanging at 055.60 m, 4 - 8 o'clock

## Snapshots

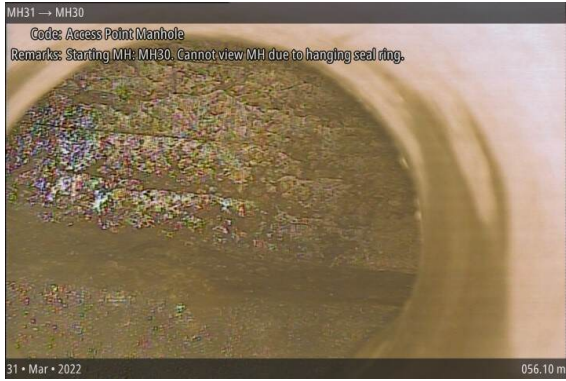

Access Point Manhole at 058.10 m | Starting MH:  
MH30. Cannot view MH due to hanging seal ring.

### Asset

Owner:

PSR:

Upstream MH:

Downstream MH:

	USMH	DSMH
Rim to Invert:	<input type="text" value="1.63 m"/>	<input type="text" value="2.56 m"/>
Rim to Grade:	<input type="text"/>	<input type="text"/>
Pipe Geometry:	<input type="text" value="250 mm (Circular)"/>	
Material:	<input type="text" value="Concrete Pipe (non-reinforced)"/>	
Lining Method:	<input type="text"/>	
Coating Method:	<input type="text"/>	
Year Constructed:	<input type="text"/>	
Pipe Use:	<input type="text" value="Stormwater Pipe"/>	
Total Length:	<input type="text" value="(unspecified)"/>	

### Project

Project:

Work Order:

Customer:

PO Number:

Additional Info:

### Inspection

Media Date/Time:

Surveyed By:

Reviewed By:

Camera Direction:

Purpose:

Technology:

Pre-Cleaning:

Date Cleaned:

Flow Control:

Length Surveyed:

Weather:

### Location

Address:

Drainage Area:

Latitude:

Longitude:

Elevation:

GPS Accuracy:


Location Code:

Location Details:

### Ratings


	Structural	O & M	Overall
Quick:	<input type="text" value="0000"/>	<input type="text" value="0000"/>	<input type="text" value="0000"/>
$\sum_{i=1}^5 SG_i$ Pipe Rating (OR):	<input type="text" value="0"/>	<input type="text" value="0"/>	<input type="text" value="0"/>
Rating Index (RI):	<input type="text" value="0"/>	<input type="text" value="0"/>	<input type="text" value="0"/>
Consequence of Failure:	<input type="text"/>		

### Summary

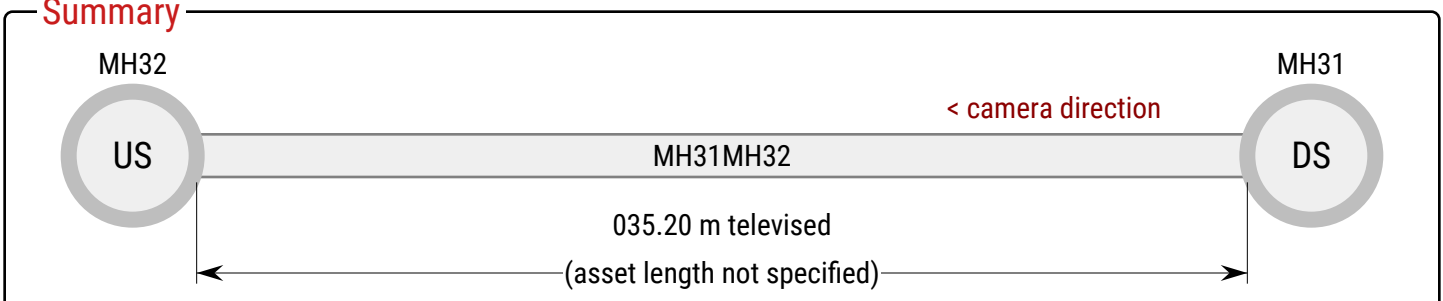

# Observations

MH32


Metres	Code		Clock	Value	Grade	Description	Remarks
035.20	AMH					Access Point Manhole	Ending MH: MH32. Survey Complete.
024.70	TB		2	100 mm		Tap Break-in/Hammer	
000.00	MWL AMH			5%		Miscellaneous Water Level Access Point Manhole	Starting MH: MH31. Cannot view MH due to slope.

< MOJf

camera direction >

MH31


## Snapshots

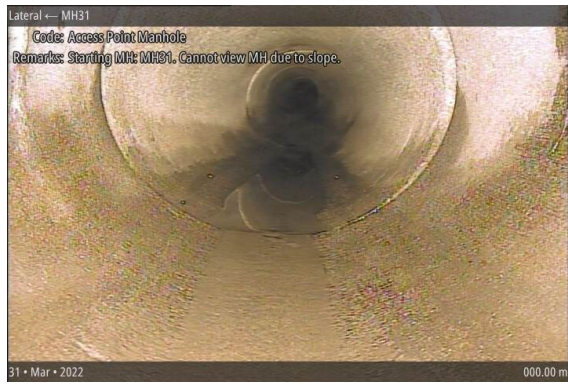


Access Point Manhole at 000.00 m | Starting MH: MH31. Cannot view MH due to slope.



Miscellaneous Water Level at 000.00 m

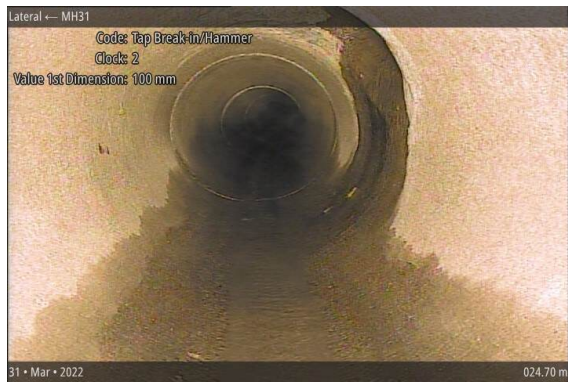

Tap Break-in/Hammer at 024.70 m, 2 o'clock

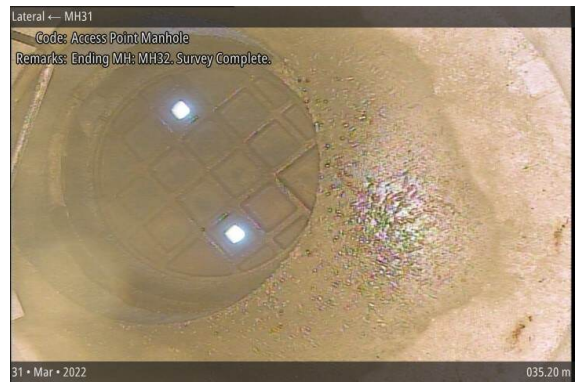

Access Point Manhole at 035.20 m | Ending MH: MH32. Survey Complete.

### Asset

Owner:

PSR:

Upstream MH:

Downstream MH:

	USMH	DSMH
Rim to Invert:	<input type="text" value="1.24 m"/>	<input type="text"/>
Rim to Grade:	<input type="text"/>	<input type="text"/>
Pipe Geometry:	<input type="text" value="250 mm (Circular)"/>	
Material:	<input type="text" value="Concrete Pipe (non-reinforced)"/>	
Lining Method:	<input type="text"/>	
Coating Method:	<input type="text"/>	
Year Constructed:	<input type="text"/>	
Pipe Use:	<input type="text" value="Stormwater Pipe"/>	
Total Length:	<input type="text" value="(unspecified)"/>	

### Project

Project:

Work Order:

Customer:

PO Number:

Additional Info:

### Inspection

Media Date/Time:

Surveyed By:

Reviewed By:

Camera Direction:

Purpose:

Technology:

Pre-Cleaning:

Date Cleaned:

Flow Control:

Length Surveyed:

Weather:

### Location

Address:

Drainage Area:

Latitude:

Longitude:

Elevation:

GPS Accuracy:


Location Code:

Location Details:

### Ratings

	Structural	O & M	Overall
Quick:	<input type="text" value="0000"/>	<input type="text" value="0000"/>	<input type="text" value="0000"/>
$\sum_{i=1}^5 SG_i$ Pipe Rating (OR):	<input type="text" value="0"/>	<input type="text" value="0"/>	<input type="text" value="0"/>
Rating Index (RI):	<input type="text" value="0"/>	<input type="text" value="0"/>	<input type="text" value="0"/>
Consequence of Failure:	<input type="text"/>		

### Summary

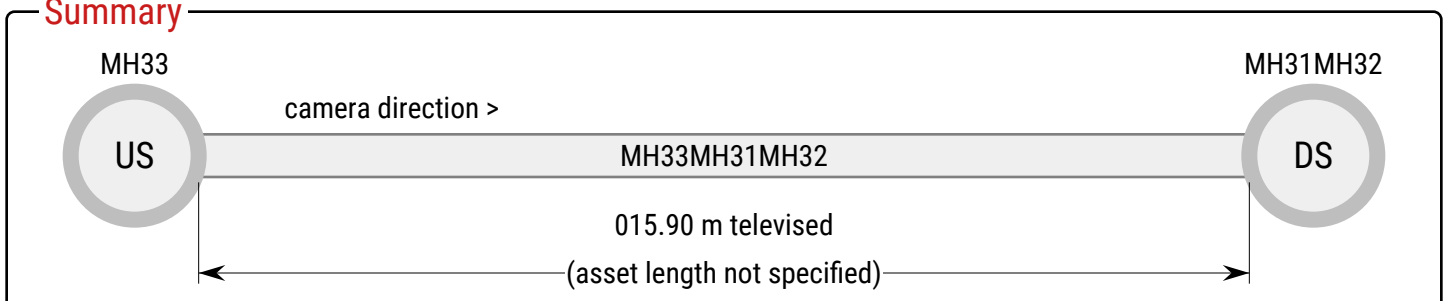



# Observations

MH33

camera direction >

flow >

Metres	Code		Clock	Value	Grade	Description	Remarks
--------	------	---	-------	-------	-------	-------------	---------

000.00	AMH					Access Point Manhole	Starting MH: MH33. Cannot view MH due to slope.
	MWL			10%		Miscellaneous Water Level	


015.90	ADP					Access Point Discharge Point	MH31MH30. Survey Complete.
--------	-----	--	--	--	--	------------------------------	----------------------------

MH31MH32


## Snapshots



Access Point Manhole at 000.00 m | Starting MH: MH33. Cannot view MH due to slope.

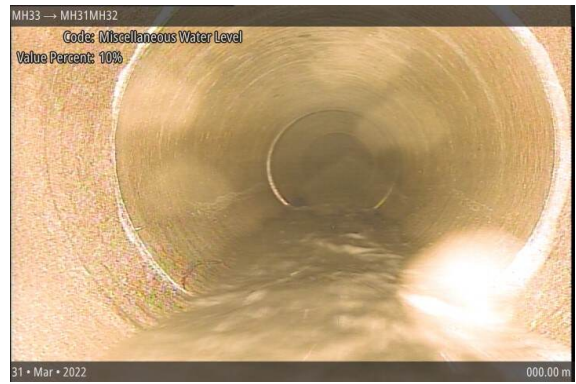

Miscellaneous Water Level at 000.00 m

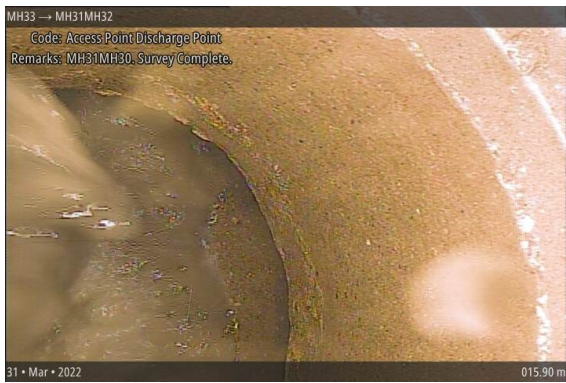


Access Point Discharge Point at 015.90 m | MH31MH30. Survey Complete.

# APPENDIX E

Hydrant Flow Test Data and Watermain Adequacy Assessment Data



 <b>LEA Consulting Ltd.</b> Consulting Engineers and Planners	<b>Residual Pressure</b>		
	Prepared:	F.M.	Page No. E-01
	Checked:	B.H	
<b>Project: Proposed Development</b> <b>3016 Kirwin Ave, Mississauga</b>	Proj. #	21111	
	Date:	07-Nov-22	

**Hydrant Test Readings (300mm watermain, 3016 Kirwin Ave)  
 undertaken on June 15, 2017, by Focus Fire Protection**

Flow	Residual Pressure	
0 US GPM	80 psi	
1000 US GPM	76 psi	
1521 US GPM	74 psi	
5274 US GPM	20 psi	Focus Fire Protection Estimate


**Interpolated**

Flow (US GPM)	Residual Pressure (psi)
0	<b>80.0</b>
250	79.0
500	78.0
750	77.0
<b>1000</b>	<b>76.0</b>
1250	75.0
1500	74.1
<b>1521</b>	<b>74.0</b>
1600	72.9
1800	70.0
1879.7	68.8
2000	67.1
3000	52.7
4000	38.3
4500	31.1
5000	23.9
<b>5274</b>	<b>20.0</b>

Existing 300mm Watermain on Kirwin Ave, Mississauga

FLOW TEST CHART (BASED ON FOCUS FIRE PROTECTION TEST, JUN. 15, 2017)

Page: E-02


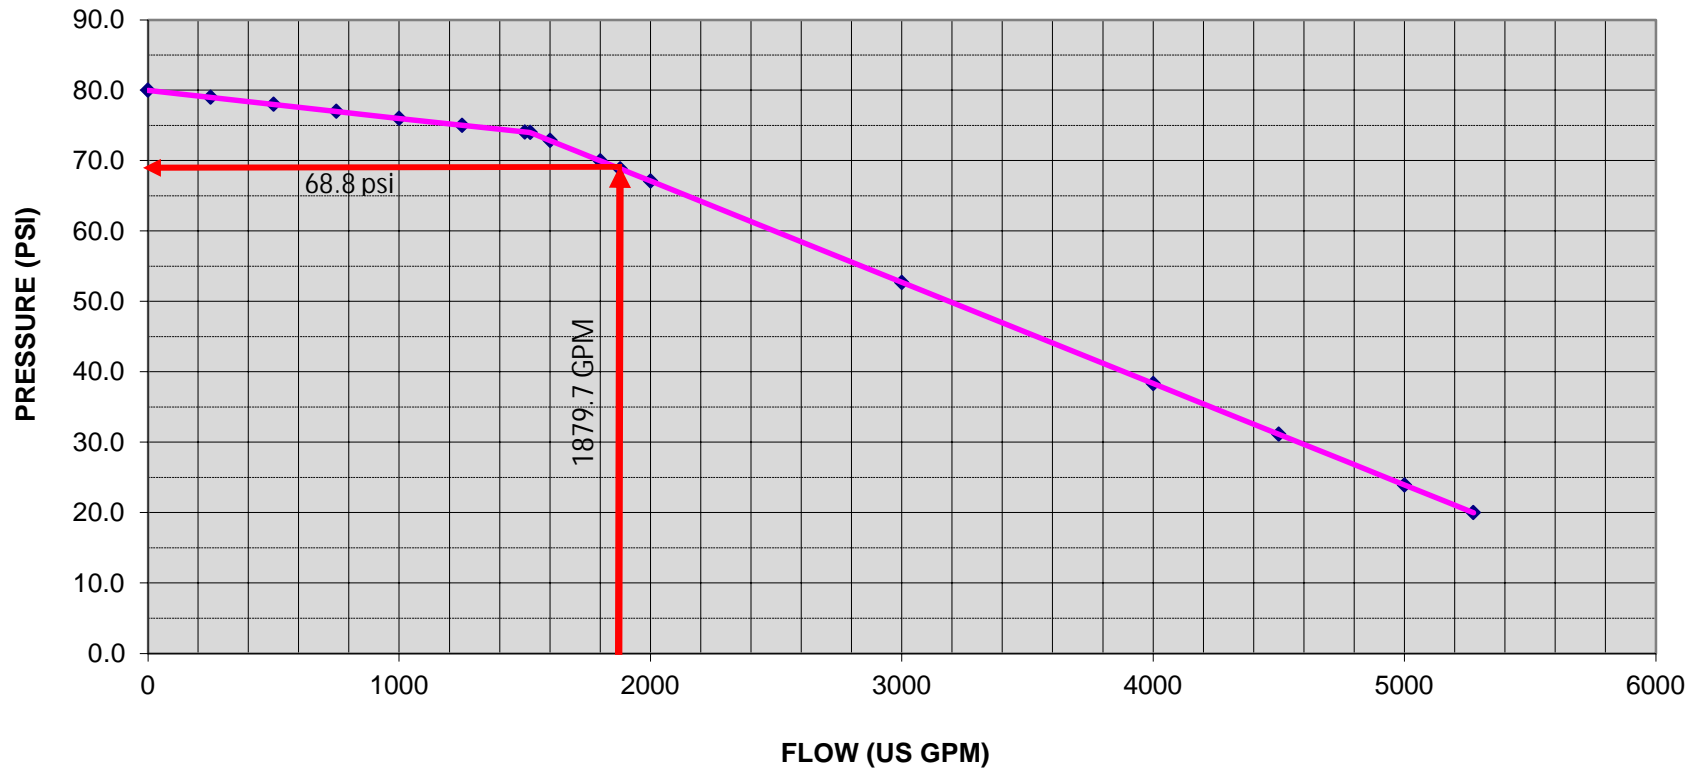


# APPENDIX E-02




Hydrant Test

Classic Fire Protection 2017-06-15




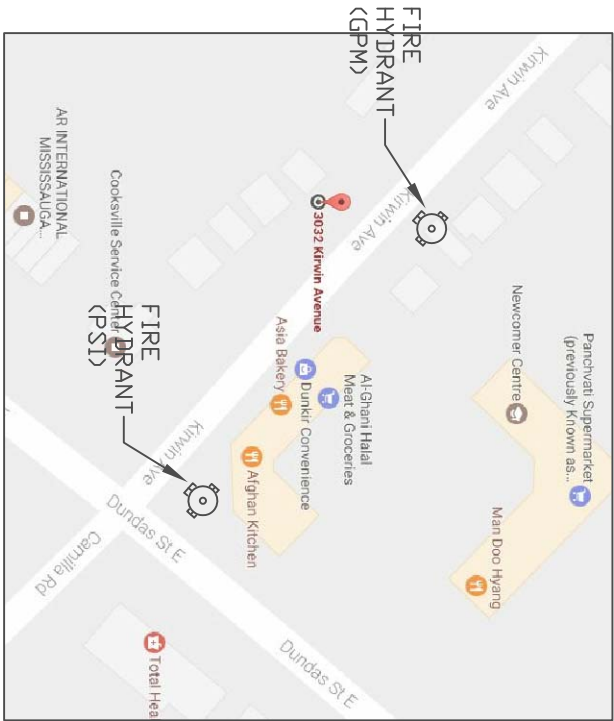

TEST:	PLAY PIPE	C=	STATIC(PSI)	RESIDUAL(PSI)	PITOT(PSI)	FLOW(USGPM)
	1x1 1/8					
	2x1 1/8					
	3x1 1/8					
	4x1 1/8					
	1x1 3/4					
	2x1 3/4					
	3x1 3/4					
	4x1 3/4					
	<b>HYDRANT BUTT</b>					
1	1x2 1/2	.80	80	76	45	1000
2	2x2 1/2	.80	80	74	26	1521
	3x2 1/2					
	4x2 1/2					
	<b>FM NOZZLE</b>					
	1x2 1/4	.88				
	2x2 1/4	.88				
	3x2 1/4	.88				
	4x2 1/4	.88				

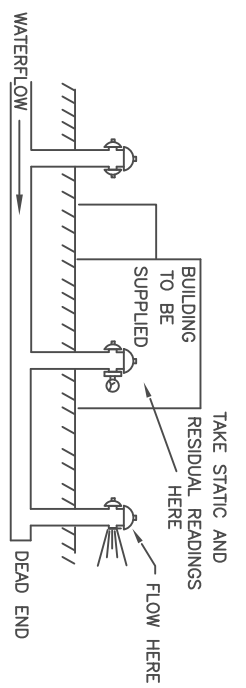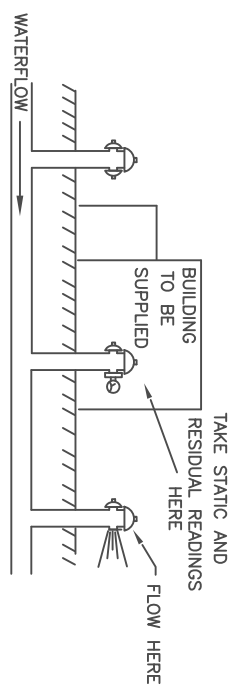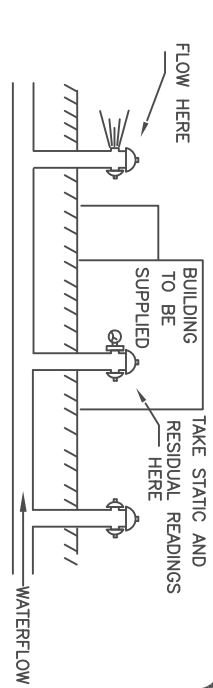

**OUTLET TYPE**



Client:

Location:


3016-3032 Kirwin Ave

Mississauga, ON

**CLASSIC**  
 FIRE PROTECTION INC.  
 645 GARRAVAY DR.  
 North York, ON  
 (416) 740-3000  
 Web: www.classicfire.com

# WATER SUPPLY GRAPH

DATE	June 15, 2017	JOB No.	17-0026593
PROPERTY OF	3016-3032 Kirwin Ave, Mississauga		
LOCATION	3016-3032 Kirwin Ave, Mississauga		
BY	CFP	NOTES	-
<b>CLASSIC</b> FIRE PROTECTION INC. (416) 740-3000			

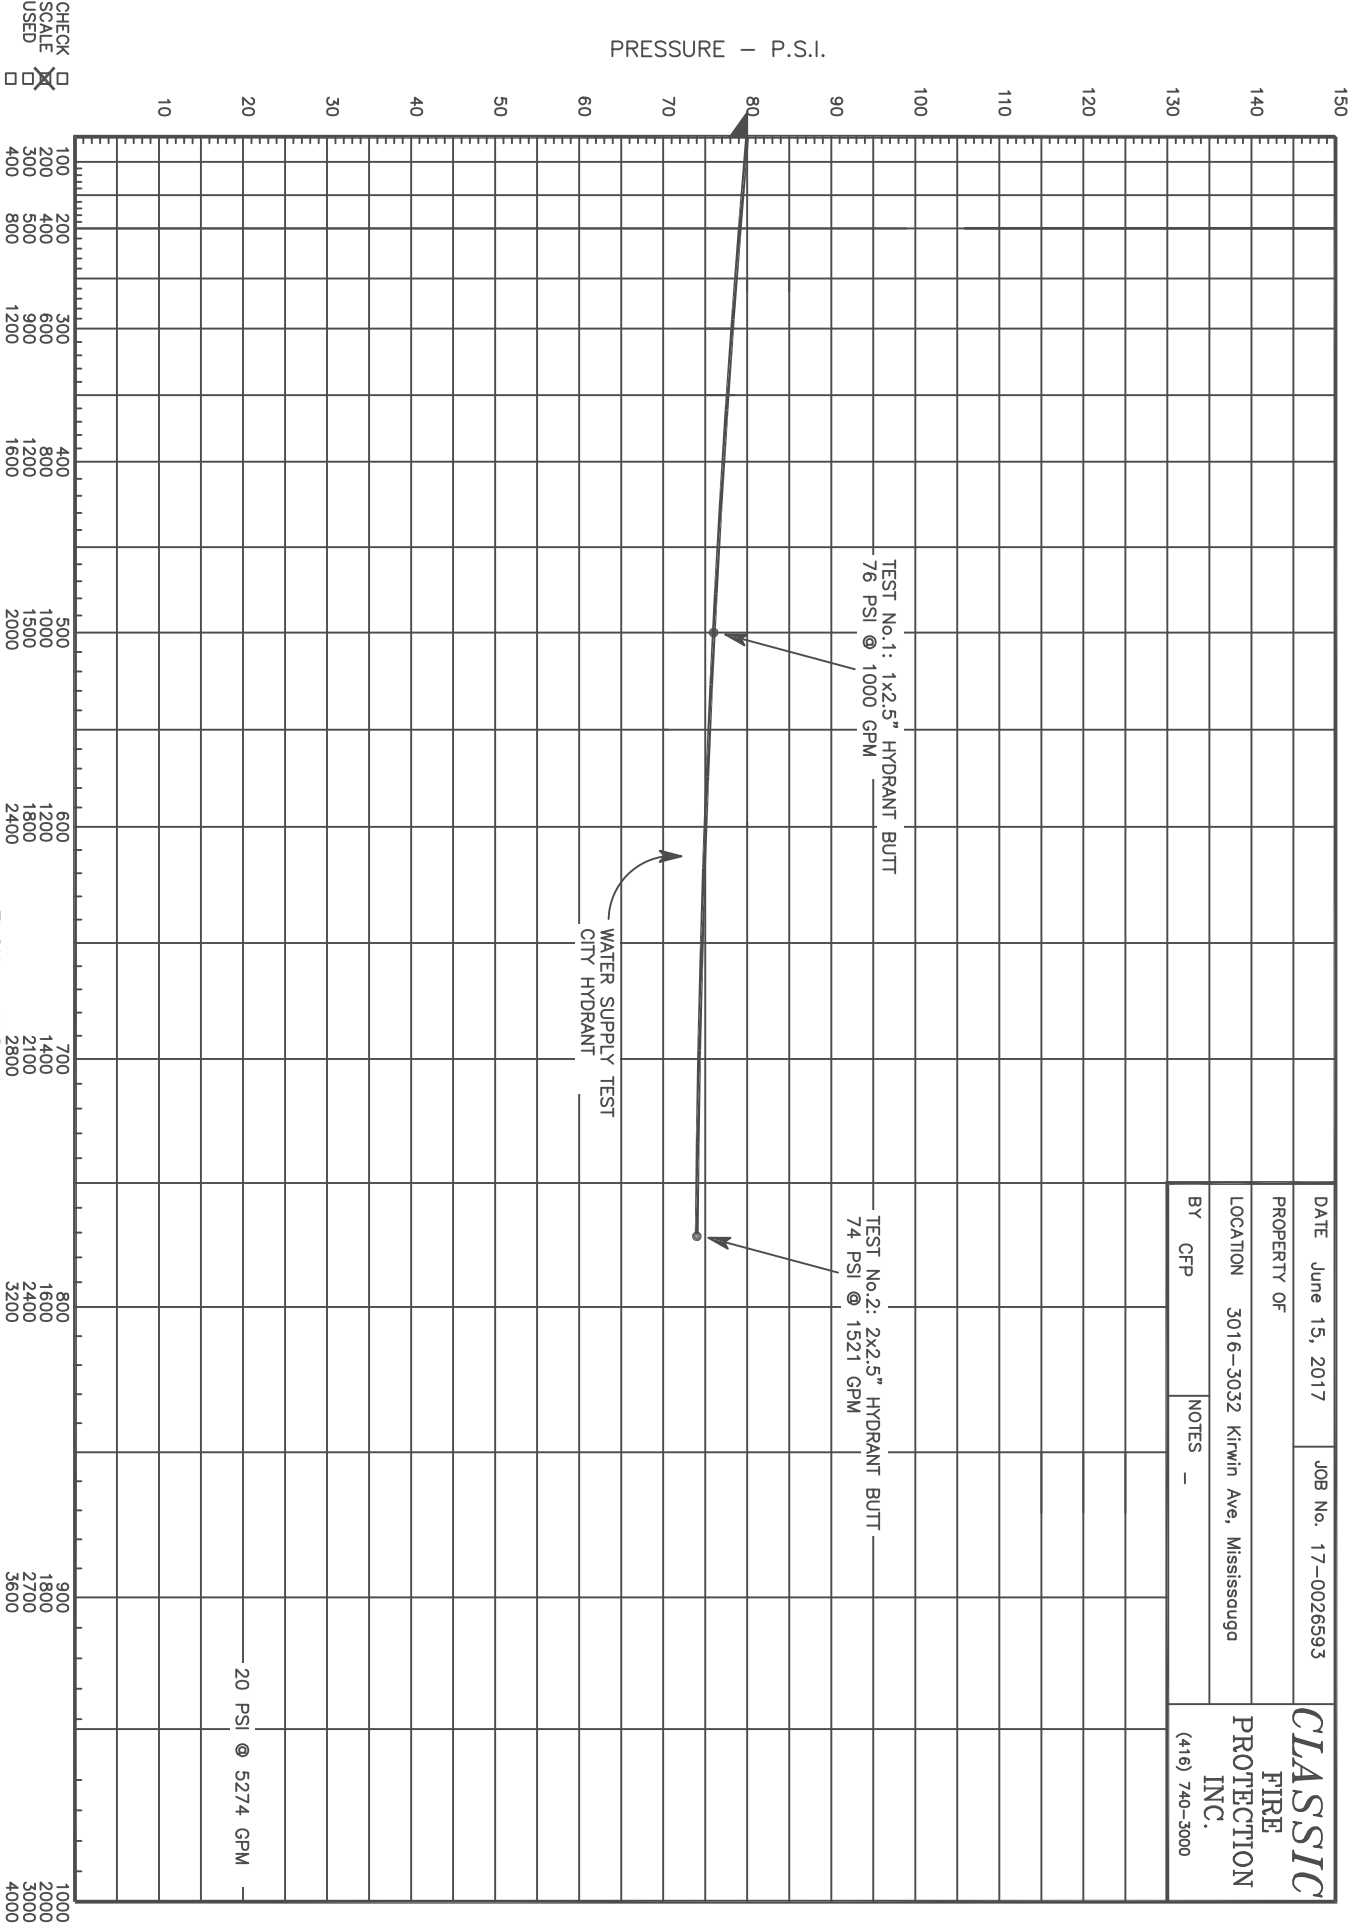

CHECK SCALE USED

FLOW - U.S. g.p.m.



# APPENDIX F

## Floodlines Information





**LEGEND**

- REGULATORY FLOODLINE (BASED ON 1D MODEL)
- REGULATORY FLOODPLAIN (BASED ON 2D MODEL)
- 88.9 REGULATORY WATER SURFACE ISOLINE (0.1m)
- 111.1 REGULATORY WATER SURFACE SPOT ELEVATION

← → 1D-2D LIMIT

NOTES:  
 1. AREA UNDER CONSTRUCTION.  
 2. FLOODLINE REFLECTS POST CONSTRUCTION GRADING.

NOTES:  
 1. AREA UNDER CONSTRUCTION.  
 2. FLOODLINE REFLECTS POST CONSTRUCTION GRADING.

**COOKSVILLE CREEK - 2D AREA CO3  
 REGULATED AREAS (2D MODELLING)**




FIGURE NO:	CO3-2D
Date:	Sep. 16, 2020
Dwn By:	JGS
SCALE:	AS SHOWN



# FLOOD HAZARD MAP


## COOKSVILLE CREEK WATERSHED

### LEGEND

Bridges.....	Marsh.....	Spot Height.....	+123.45
Building.....	Municipal Boundary.....	Trail.....	.....
Building Under Construction.....	Overhead Walkway.....	Wall.....	.....
Contour Index.....	Parcel Fabric.....	Watershed Boundary.....	.....
Contour Intermediate.....	Parking Lot.....	Waterbody Elevation.....	+97.5
Culvert Symbol.....	Pile.....	Wooded Area.....	.....
Culvert to Scale.....	Pipe.....	Regulatory Floodline.....	.....
Dam.....	Pit.....	Regulatory Floodplain (2D Model).....	.....
Ditch.....	Playground.....	1D-2D Model Limits.....	1D <-> 2D
Dock, Wharf, Pier.....	Pole.....	Two-Zone Policy Area.....	.....
Driveway.....	Pool.....	Section.....	.....
Falls, Rapids.....	Railway.....	Overflow Section.....	.....
Fire Hydrant.....	Railway Abandoned.....	Structure ID.....	10
Flow Direction.....	River, Creek, Shoreline.....	Spill.....	.....
Footbridge.....	Road.....	Regional Flood Elevation	15426
Guiderail.....	Road Shoulder.....	Section Number	98.75
Headwall.....	Road Understruction (UC).....	100 Year Flood Elevation	98.25
Hedge.....	Sidewalk.....		
	Silo.....		

Note: The Regulatory flood elevation and floodline is the greater of the Regional and 100 Year storms.

### SHEET INDEX

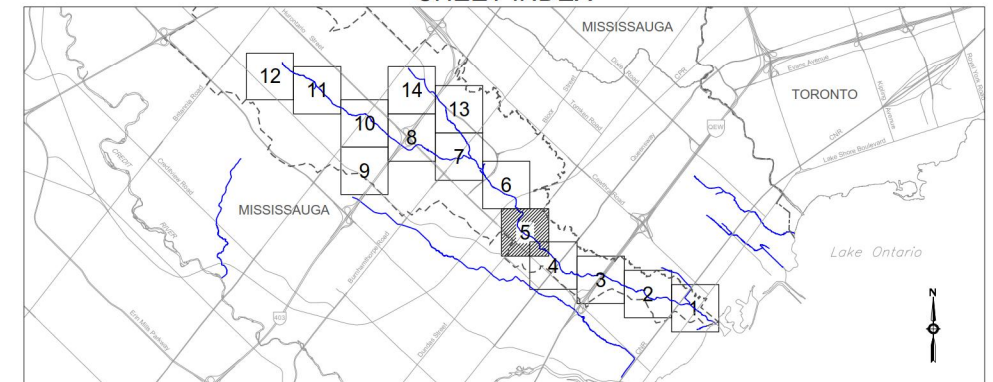

Metres 100 0 100 200 METRES

SCALE 1:2000  
CONTOUR INTERVAL 0.5 METRE


#### General Notes:

1. Contourlines on this map were generated by Airborne Imaging using the Spring of 2015 LIDAR point cloud, breaklines and hydrologic enforcement at bridges. The vertical accuracy of the original points is 0.10 metres RMSE.
2. The planimetric data was obtained from the City of Mississauga in 2017.
3. The vertical datum is mean sea level established by the CGVD 28, 1978 Southern Ontario adjustment.
4. The horizontal datum is North American Datum 1983 CSRS (Epoch 2010) UTM Zone 17.
5. To obtain City of Mississauga datum, add 0.121 metres to elevation data.




No	Amendment/Revision	By	Date

G:\Work\103068\land\dwg\contract\sub4\cvc\1\_floodupdate.dwg



- 5.12 112.47 (111.80)
- 5.110 112.44 (111.73)
- 5.089 112.44 (111.74)
- 5.088 112.44 (111.74)
- 5.087 112.44 (111.74)
- 5.086 112.44 (111.74)
- 5.085 112.42 (111.70)
- 5.084 112.42 (111.70)
- 5.083 112.42 (111.70)
- 5.082 112.40 (111.68)

- 5.080 112.20 (111.42)
- 5.053 111.01 (110.70)

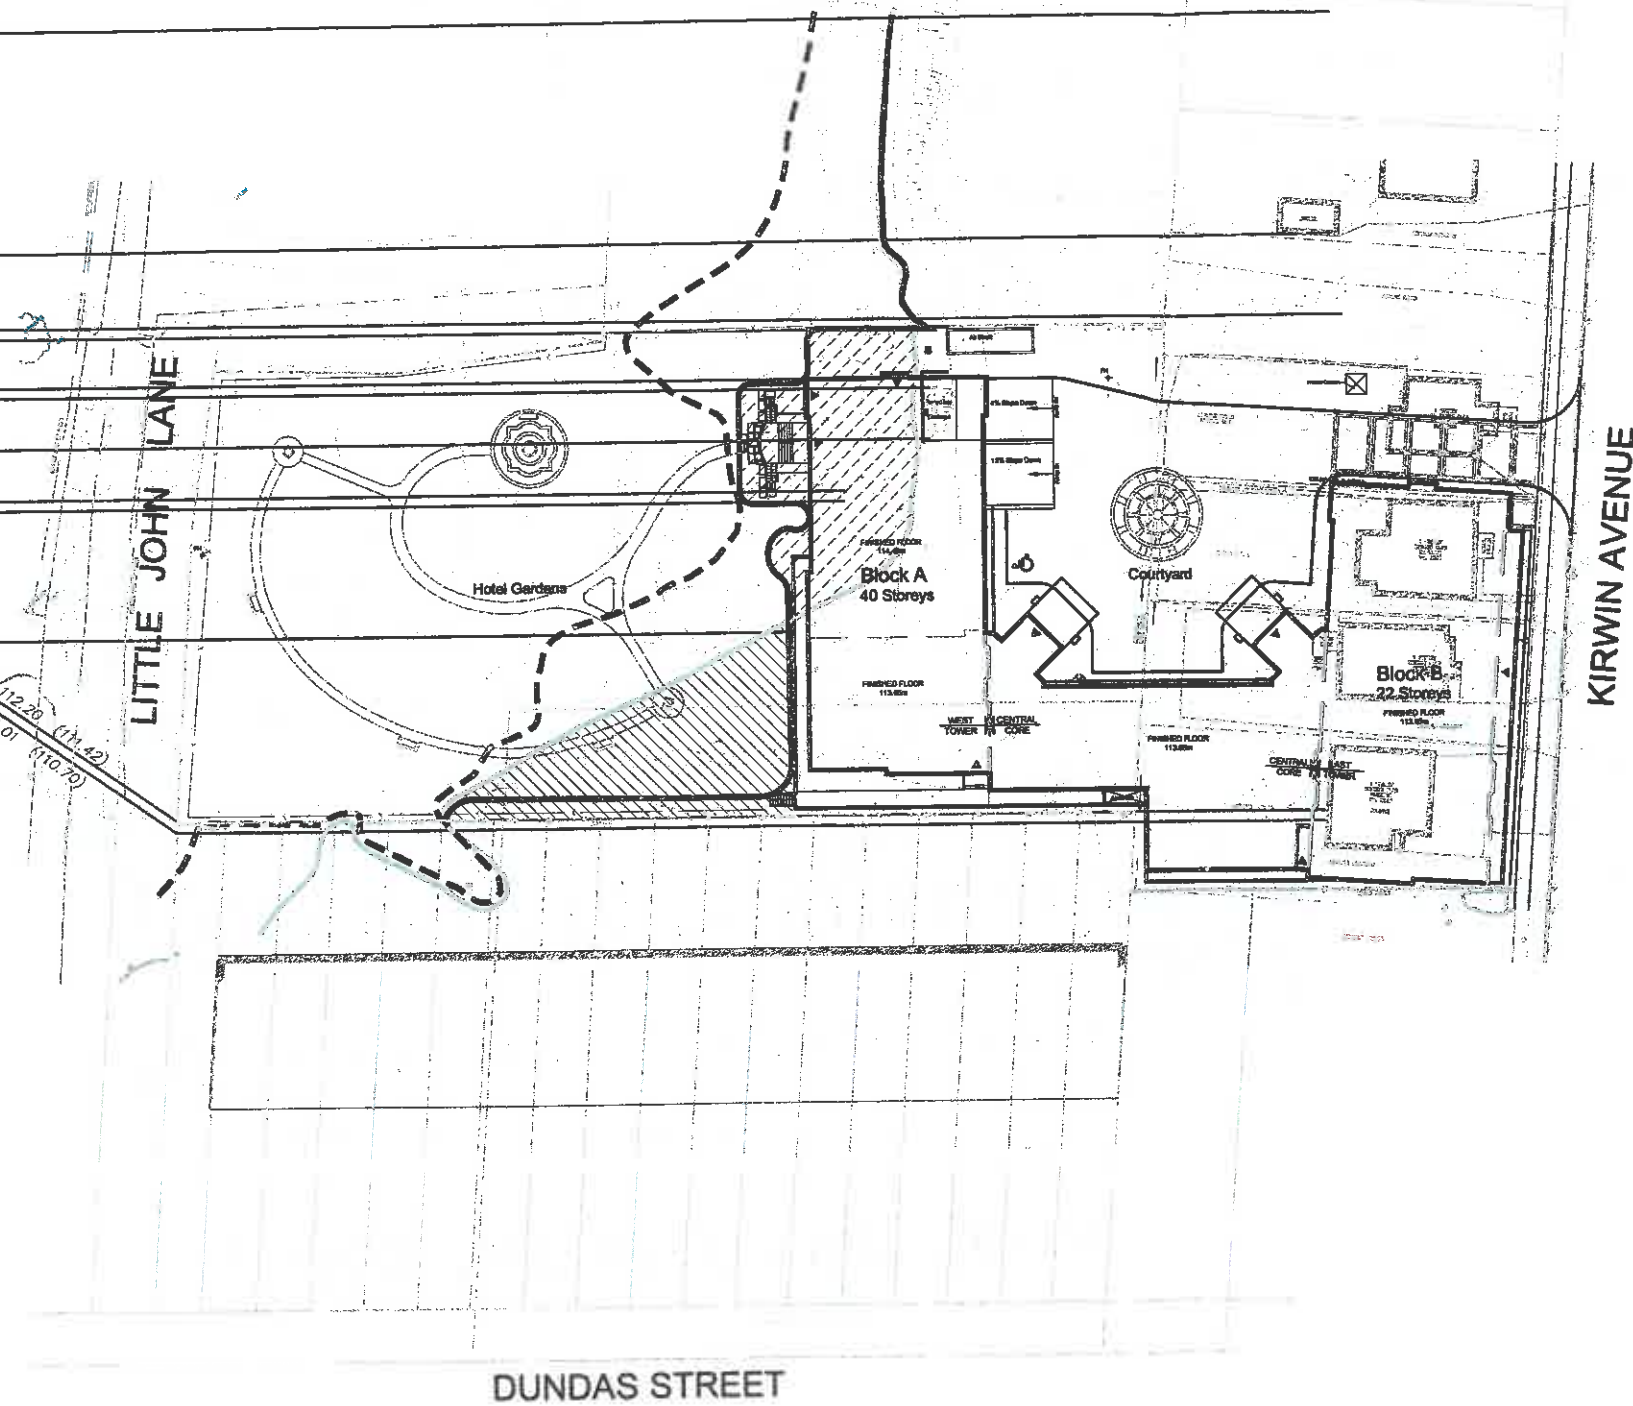

**NOTE:**  
 MAXIMUM REGIONAL FLOOD ELEVATION = 112.47m  
 MINIMUM PROPOSED FLOOR ELEVATION = 113.65m  
 PROPOSED FREEBOARD = 0.77m

**LEGEND**


- 5.053 HEC-2 CROSS SECTION AND LABEL
- FUT WITH HOTEL
- 111.03 REGIONAL FLOOD LEVEL
- (109.78) 100 YEAR FLOOD LEVEL
- EXISTING REGIONAL FLOODLINE
- CUT AREA = 365m<sup>2</sup>
- FILL AREA = 272m<sup>2</sup>

LITTLE JOHN LANE HYDRAULIC ASSESSMENT ACTIVE MANAGEMENT LTD. PROPOSED DEVELOPMENT FLOODPLAIN		PROJECT No. 103068
		DATE FEBRUARY 2011
		SCALE 1:750
		DRAWING No. 2

# APPENDIX G

Figures and Drawings



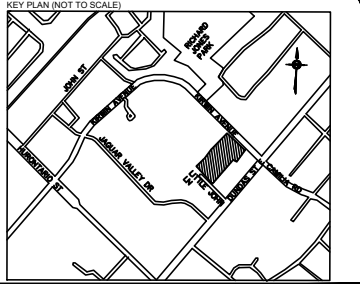



**LEGEND**

- EXISTING MANHOLE
- EXISTING CATCHBASIN
- EXISTING WV
- PROPERTY LINE
- OVERLAND FLOW ROUTE
- DRAINAGE BOUNDARY
- DRAINAGE ID/RUNOFF COEFFICIENT  
DRAINAGE AREA (ha)
- EXISTING TREE
- EXISTING BUILDING

No.	Revision	Date	By	App.
2	ISSUED FOR ZBA RE-SUBMISSION	2022-12-19	P.R.	F.M.
1	ISSUED FOR ZBA SUBMISSION	2021-03-19	M.N.	B.H.

625 Cochrane Drive, Suite 900 Markham, Ontario L3R 9R9, Canada Tel: (905)470-0015 Fax: (905)470-0000		
<b>LEA</b>		
Owner/Client:  <b>DASS METAL</b>		
Location:  <b>3031 LITTLE JOHN &amp; 3016-3032 KIRWIN AVE DEVELOPMENT</b>		
Title:  <b>EXISTING DRAINAGE PLAN</b>		
Designed By: F.M.	Drawn By: J.W.	Checked By: F.M.
Scale: 1:500	Date: FEB, 2021	Drawing No.: FIG-1
Project No.: 21111		

625 Cochrane Drive, Suite 900  
 Markham, Ontario  
 L3R 9R9, Canada  
 Tel: (905)470-0015  
 Fax: (905)470-0000  
 LEA CONSULTANTS INC.

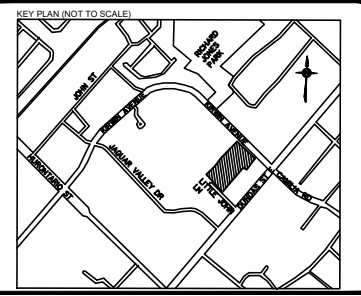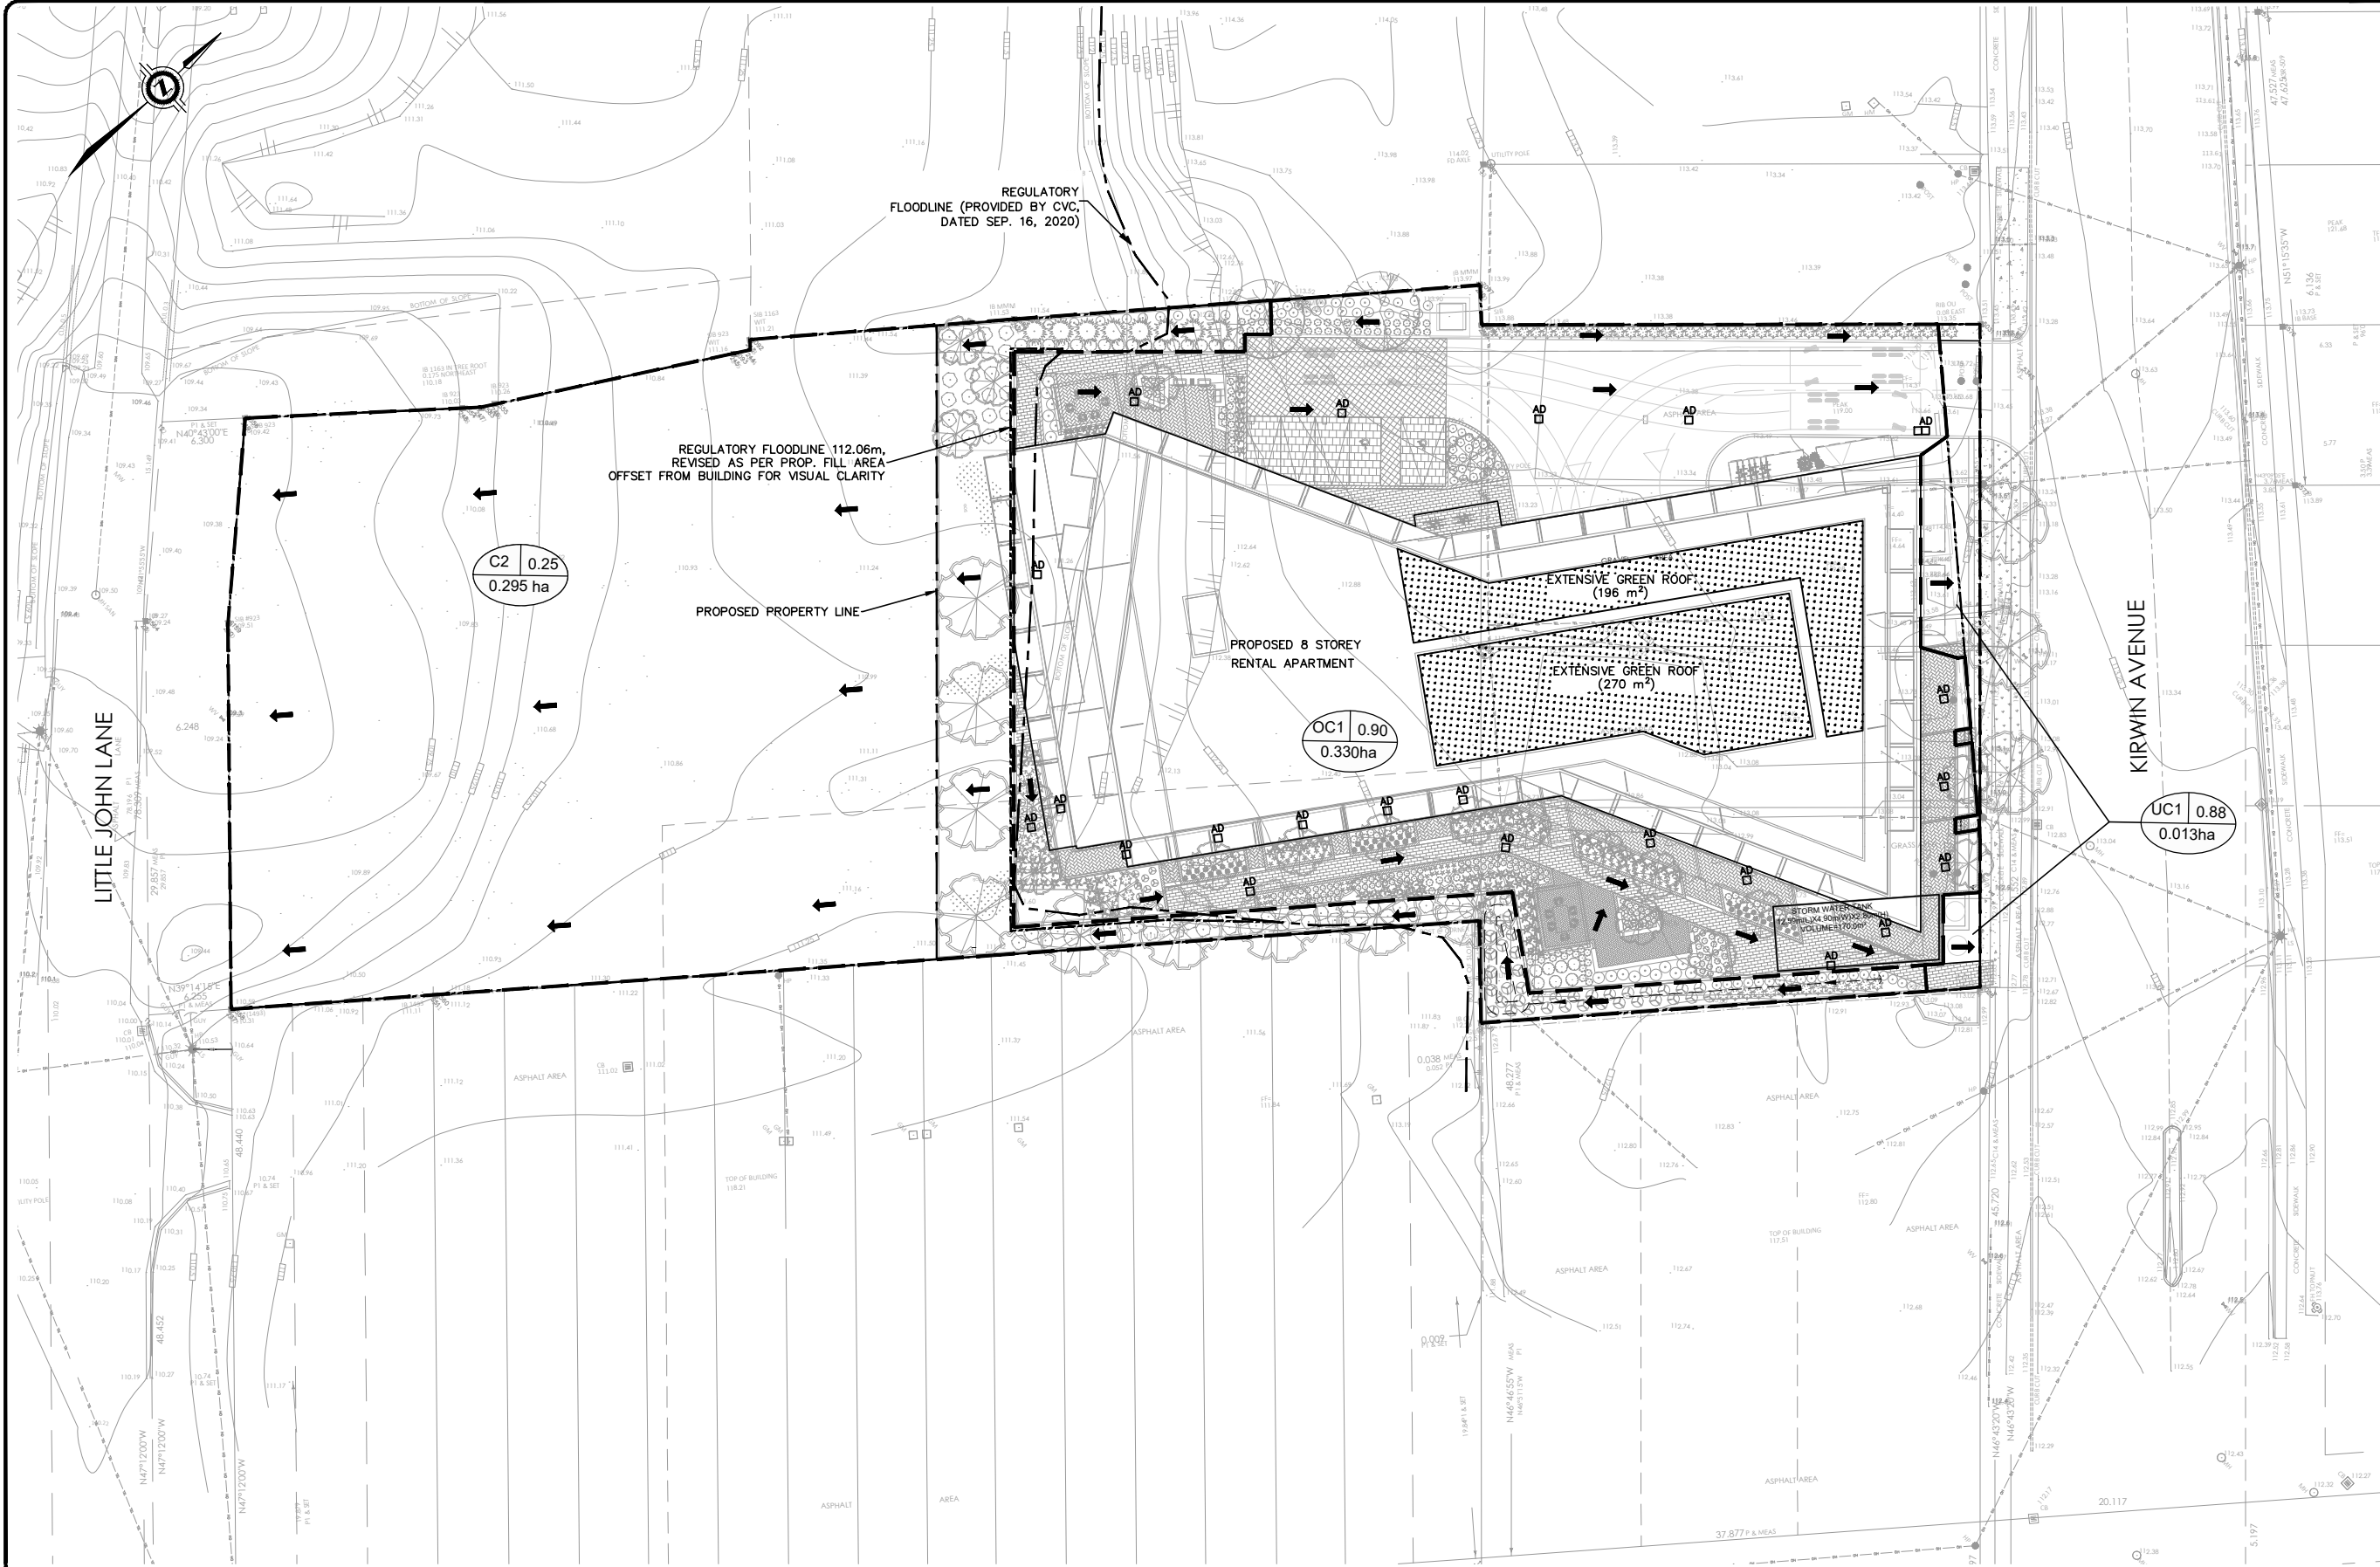

- LEGEND**
- EXISTING MANHOLE
  - EXISTING CATCHBASIN
  - EXISTING WV
  - PROPERTY LINE
  - OVERLAND FLOW ROUTE
  - DRAINAGE BOUNDARY
  - DRAINAGE ID/RUNOFF COEFFICIENT DRAINAGE AREA (ha)
  - PROPOSED TREE
  - SOFT LANDSCAPE AREA
  - UNCONTROLLED AREA
  - PROPOSED AREA DRAIN
  - PROPOSED CATCHBASIN
  - PROPOSED SWALE

No.	Revision	Date	By	App.
2	ISSUED FOR ZBA RE-SUBMISSION	2022-12-19	P.R.	F.H.
1	ISSUED FOR ZBA SUBMISSION	2021-03-19	M.N.	B.H.

--	--

625 Cochrane Drive, Suite 900  
 Markham, Ontario  
 L3R 9R9, Canada  
 Tel: (905)470-0015  
 Fax: (905)470-0030

Owner/Client:  
**DASS METAL**

Location:  
**3031 LITTLE JOHN & 3016-3032  
KIRWIN AVE DEVELOPMENT**

Title:  
**PROPOSED DRAINAGE PLAN**

Designed By: F.M.	Drawn By: J.W.	Checked By: F.M.
Scale: 1:500	Date: FEB, 2021	Drawing No.: FIG-2
Project No.: 21111		

UPDATED EXISTING DRAINAGE AREAS (2022)

SUBJECT SITE



E2 | 0.62  
0.138 ha

E1 | 0.75  
0.682 ha

E3 | 0.62  
0.057 ha

E4 | 0.9  
0.266 ha

CB1  
SE INV 0.89m DIA 250mm

CB2  
SW INV 0.85m DIA 250mm

CB5

MH 32  
W INV 1.63 DIA 250mm  
N INV not surveyed  
S INV not surveyed

MH31  
S INV 2.69m DIA 400mm  
E INV 2.56m DIA 250mm  
NE INV 2.56m DIA 250mm  
NW INV 2.55m DIA 250mm


CB6

CB4  
SW 0.65m DIA 250mm

CB3  
SE INV 1.37m DIA 250mm

MH33  
NE INV 1.08m DIA 250mm  
SW INV 1.24m DIA 250mm

MH30 (4)  
N INV 2.71m 400mm

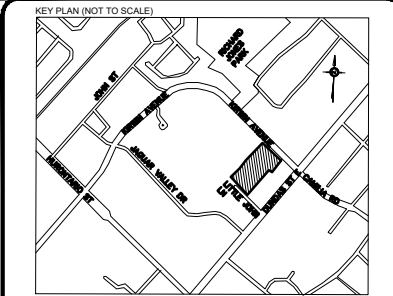

- LEGEND**
- MH EXISTING MANHOLE
  - ▣ CB EXISTING CATCHBASIN
  - SUBJECT SITE EXISTING PROPERTY LINE
  - DRAINAGE BOUNDARY
  - C1 | 0.25  
0.388 ha DRAINAGE ID/RUNOFF COEFFICIENT DRAINAGE AREA (ha)

No.	Revision	Date	By	App.
1	ISSUED FOR SPA SUBMISSION	2022-11-16	F.M.	

625 Cochrane Drive, Suite 900 Markham, Ontario L3R 9R9, Canada Tel: (905)470-0015 Fax: (905)470-0030		
--	--	--



Owner/Client:  
**DASS METAL**

Location:  
**3031 LITTLE JOHN & 3016-3032  
KIRWIN AVE DEVELOPMENT**

Title:  
**KIRWIN AVE STORM SEWER ANALYSIS  
EXISTING DRAINAGE PLAN**

Designed By: F.M.	Drawn By: J.W.	Checked By: F.M.
Scale: 1:500	Date: FEB, 2021	Drawing No.: FIG-3
Project No.: 21111		



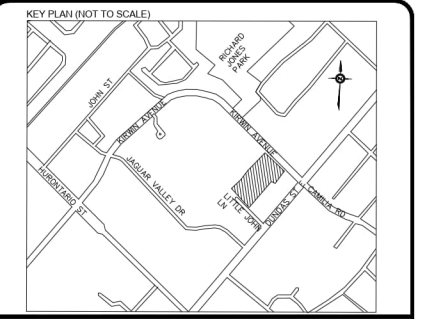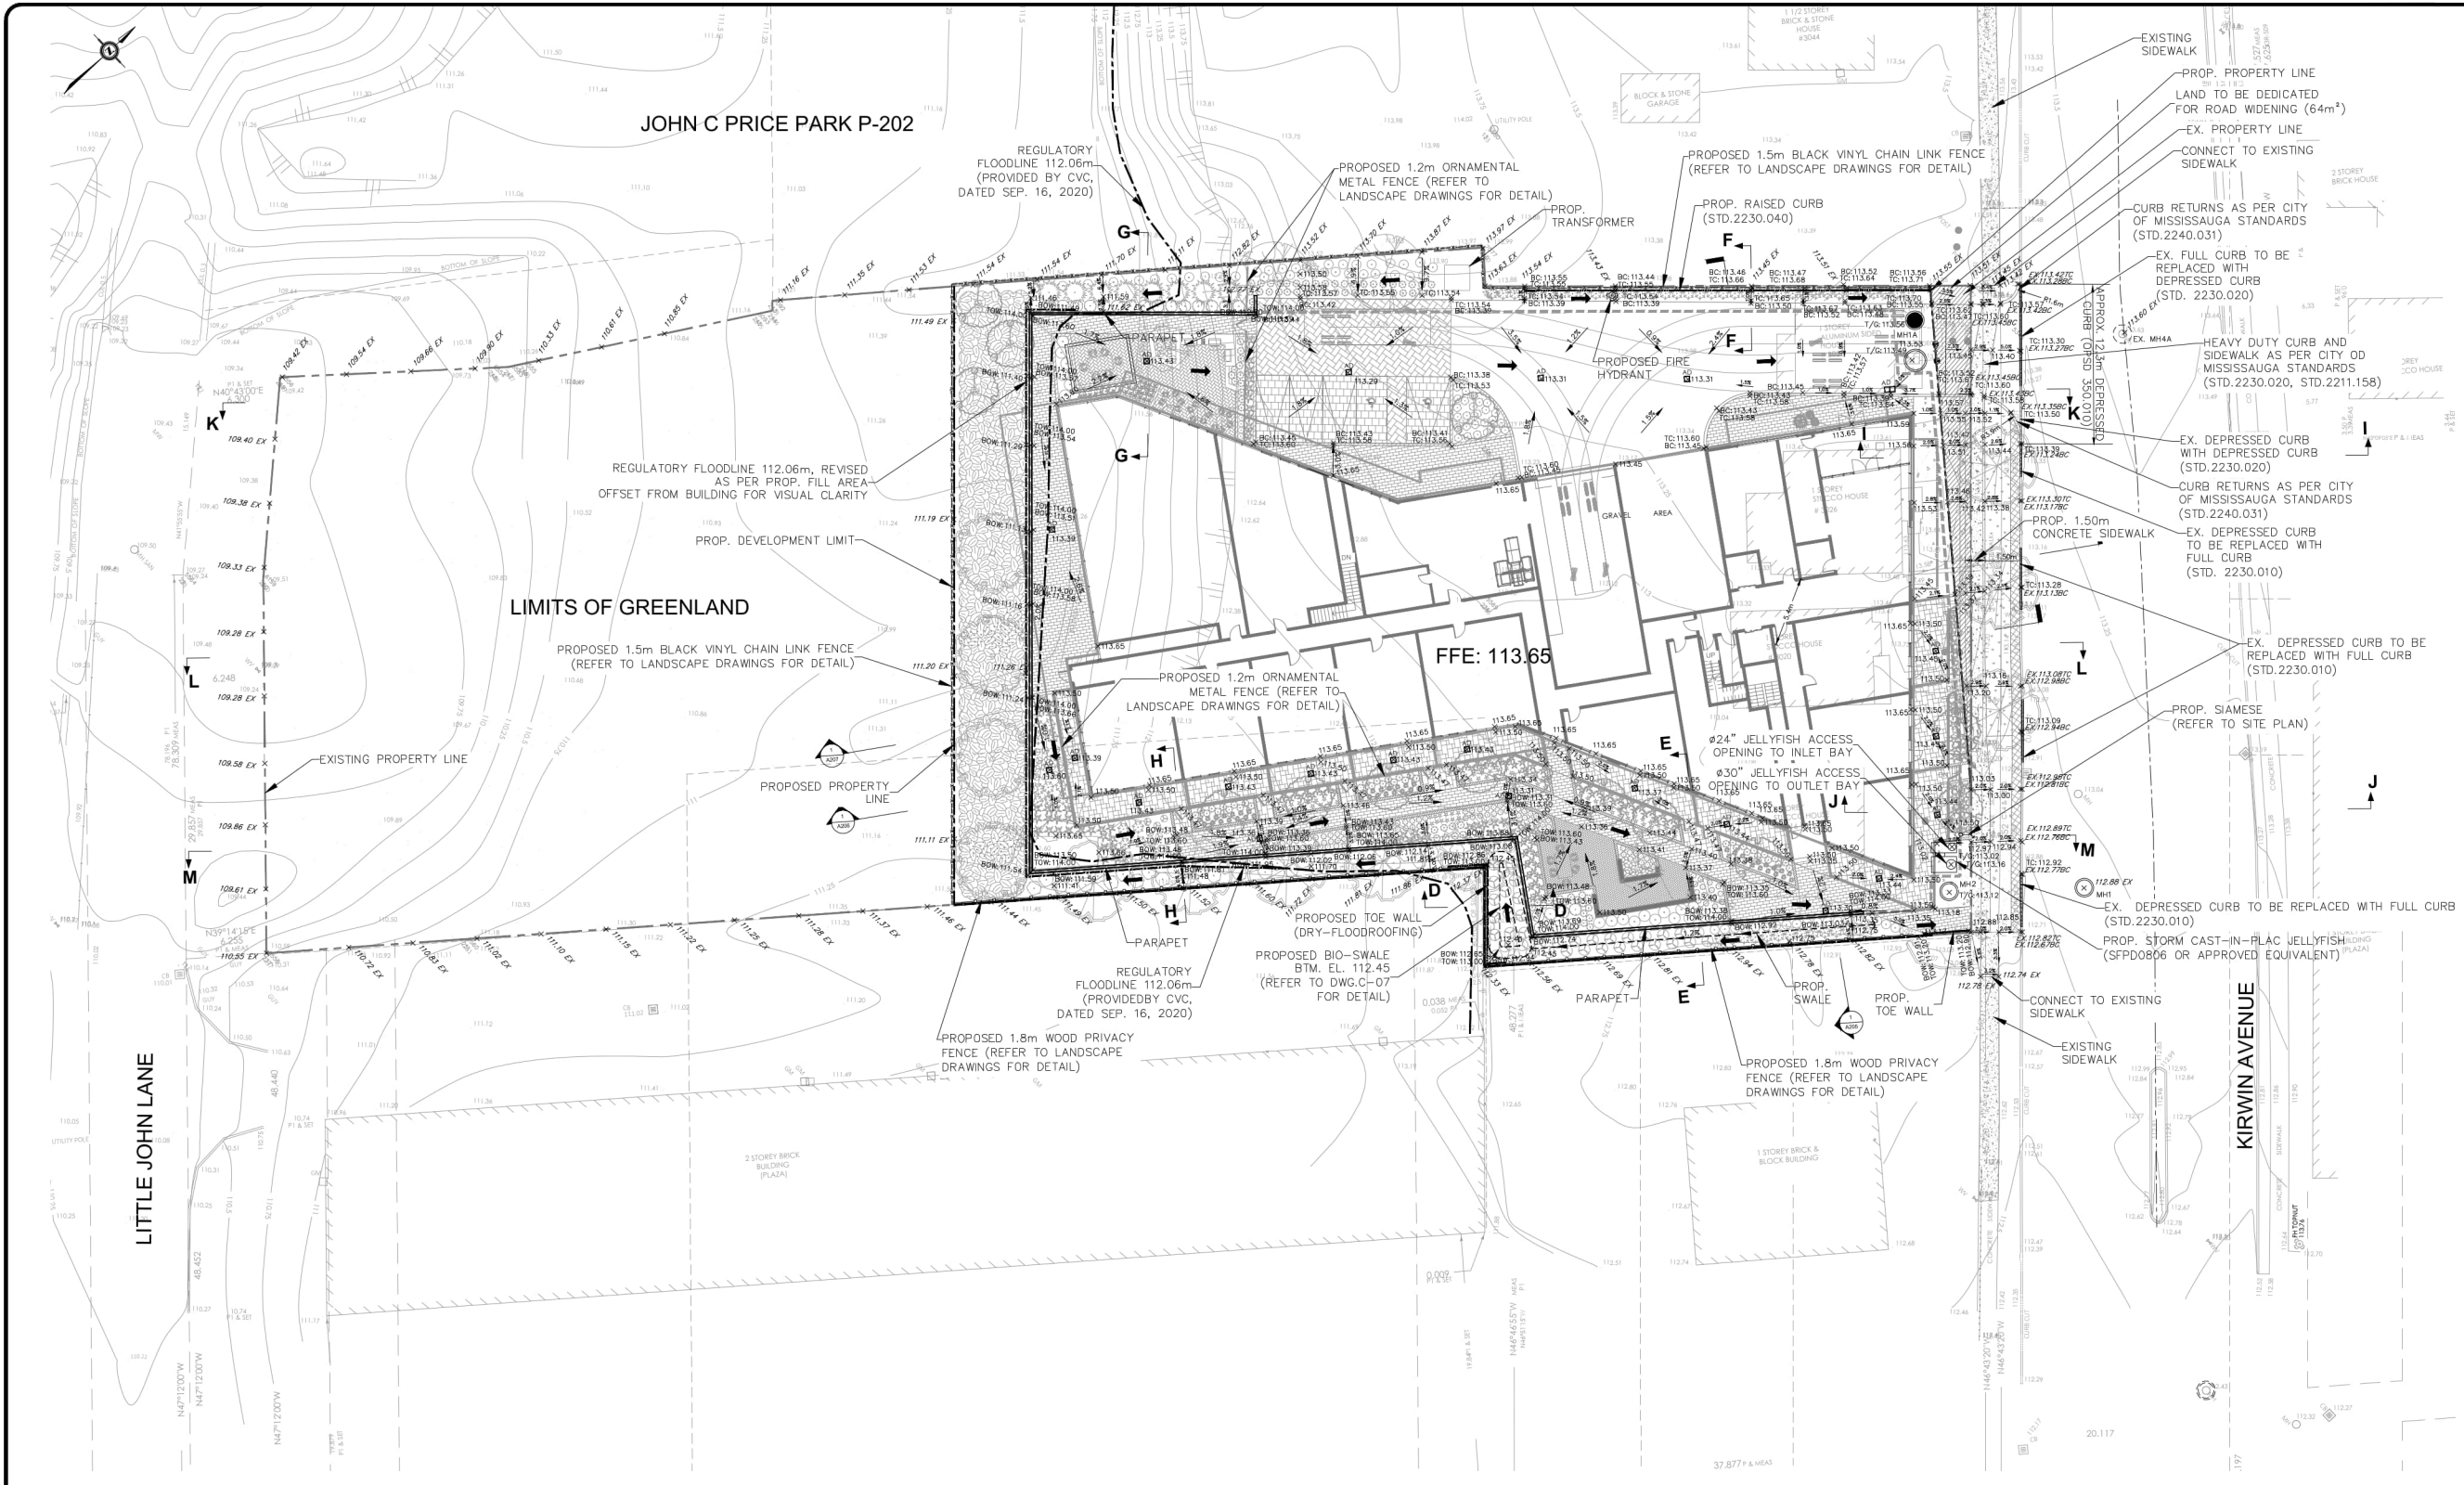

**LEGEND:**

	PROPOSED V & B
	PROPOSED DETECTOR CHECK VALVE CHAMBER
	PROPERTY LINE
	EXISTING CATCHBASIN
	EXISTING SANITARY MANHOLE
	EXISTING STORM MANHOLE
	PROPOSED SANITARY MANHOLE
	PROPOSED STORM MANHOLE
	EXISTING FIRE HYDRANT
	EXISTING FIRE HYDRANT
	EXISTING HYDRO POLE
	PROPOSED AREA DRAIN
	PROPOSED CATCHBASIN
	EXISTING GROUND ELEVATION (WHERE THE EXISTING GRADES ARE TO BE MATCHED)
	EX 113.24
	EX 800/113.24
	112.88
	100/113.01
	800/113.86
	10M/113.23
	80M/112.36
	1/6/113.91
	OVERLAND FLOW ROUTE
	UNDERGROUND PARKING WALL
	OUTLINE OF THE BUILDING
	PROPOSED SHALE
	ACOUSTIC WALL
	1.5m BLACK VINYL CHAIN LINK FENCE
	1.8m WOOD PRIVACY FENCE
	ARCHITECTURAL CROSS SECTIONS

**GENERAL NOTES:**

- ELEVATIONS ARE REFERRED TO THE CITY OF MISSISSAUGA BENCHMARK NO. 793 LOCATED ON THE NORTH FACE AT THE EAST CORNER OF CONCRETE END POST OF BOX CULVERT UNDER DUNDAS STREET EAST ON SOUTH SIDE OF DUNDAS STREET EAST, 1.5M EAST OF JAGUAR VALLEY DRIVE HAVING A PUBLISHED ELEVATION OF 110.955 METERS.
- NO EXTERNAL DRAINAGE OR GRADING PERMITTED INTO PARK BLOCKS.
- VEGETATION CLEARING AND TREE REMOVAL ACTIVITIES SHOULD BE AVOIDED BETWEEN APRIL-OCTOBER OF EACH YEAR TO PROTECT THE BREEDING SEASONS OF MIGRATORY BIRDS AND BATS.
- REFER TO DWG C-108 "STREETSCAPE CROSS SECTIONS" FOR CROSS SECTION H & J-J.

2	ISSUED FOR ZBA RE-SUBMISSION	2022-12-19	P.R.	F.M.
1	ISSUED FOR ZBA SUBMISSION	2021-03-19	M.N.	B.H.
No.	Revision	Date	By	App



625 Cochrane Drive, Suite 900  
 Markham, Ontario  
 L3R 9R9, Canada  
 Tel: (905)470-0015  
 Fax: (905)470-0030




Owner/Client:

**DVB REAL ESTATE INVESTMENTS INC.**


Location:  
**3031 LITTLE JOHN & 3016-3032 KIRWIN AVE DEVELOPMENT**

Title:  
**PRELIMINARY SITE GRADING PLAN**


Designed By:	F.M.	Drawn By:	J.W.	Checked By:	F.M.
Scale:	1:250	Date:		Drawing No.:	C-01
Project No.:	21111				

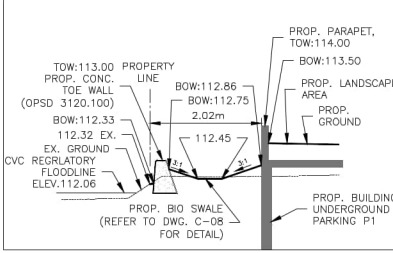


**SECTION D-D**  
SC 1:100

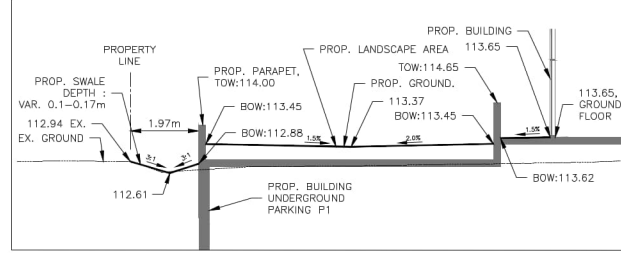


**SECTION E-E**  
SC 1:100

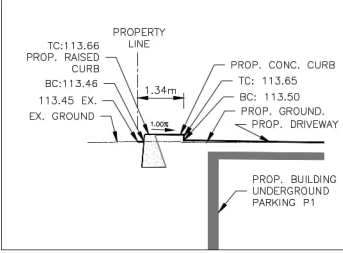



**SECTION F-F**  
SC 1:100

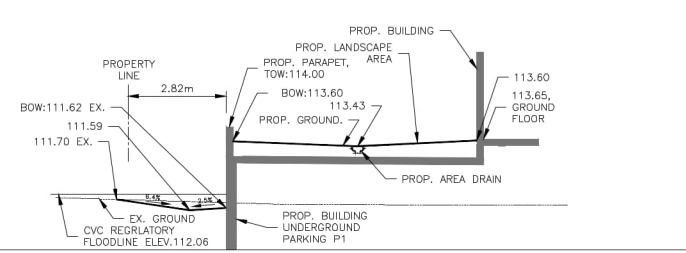

**SECTION G-G**  
SC 1:100

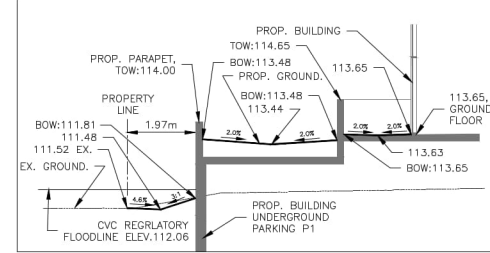

**SECTION H-H**  
SC 1:100

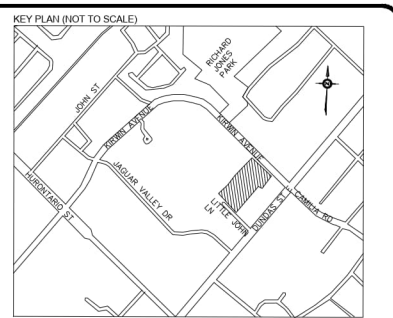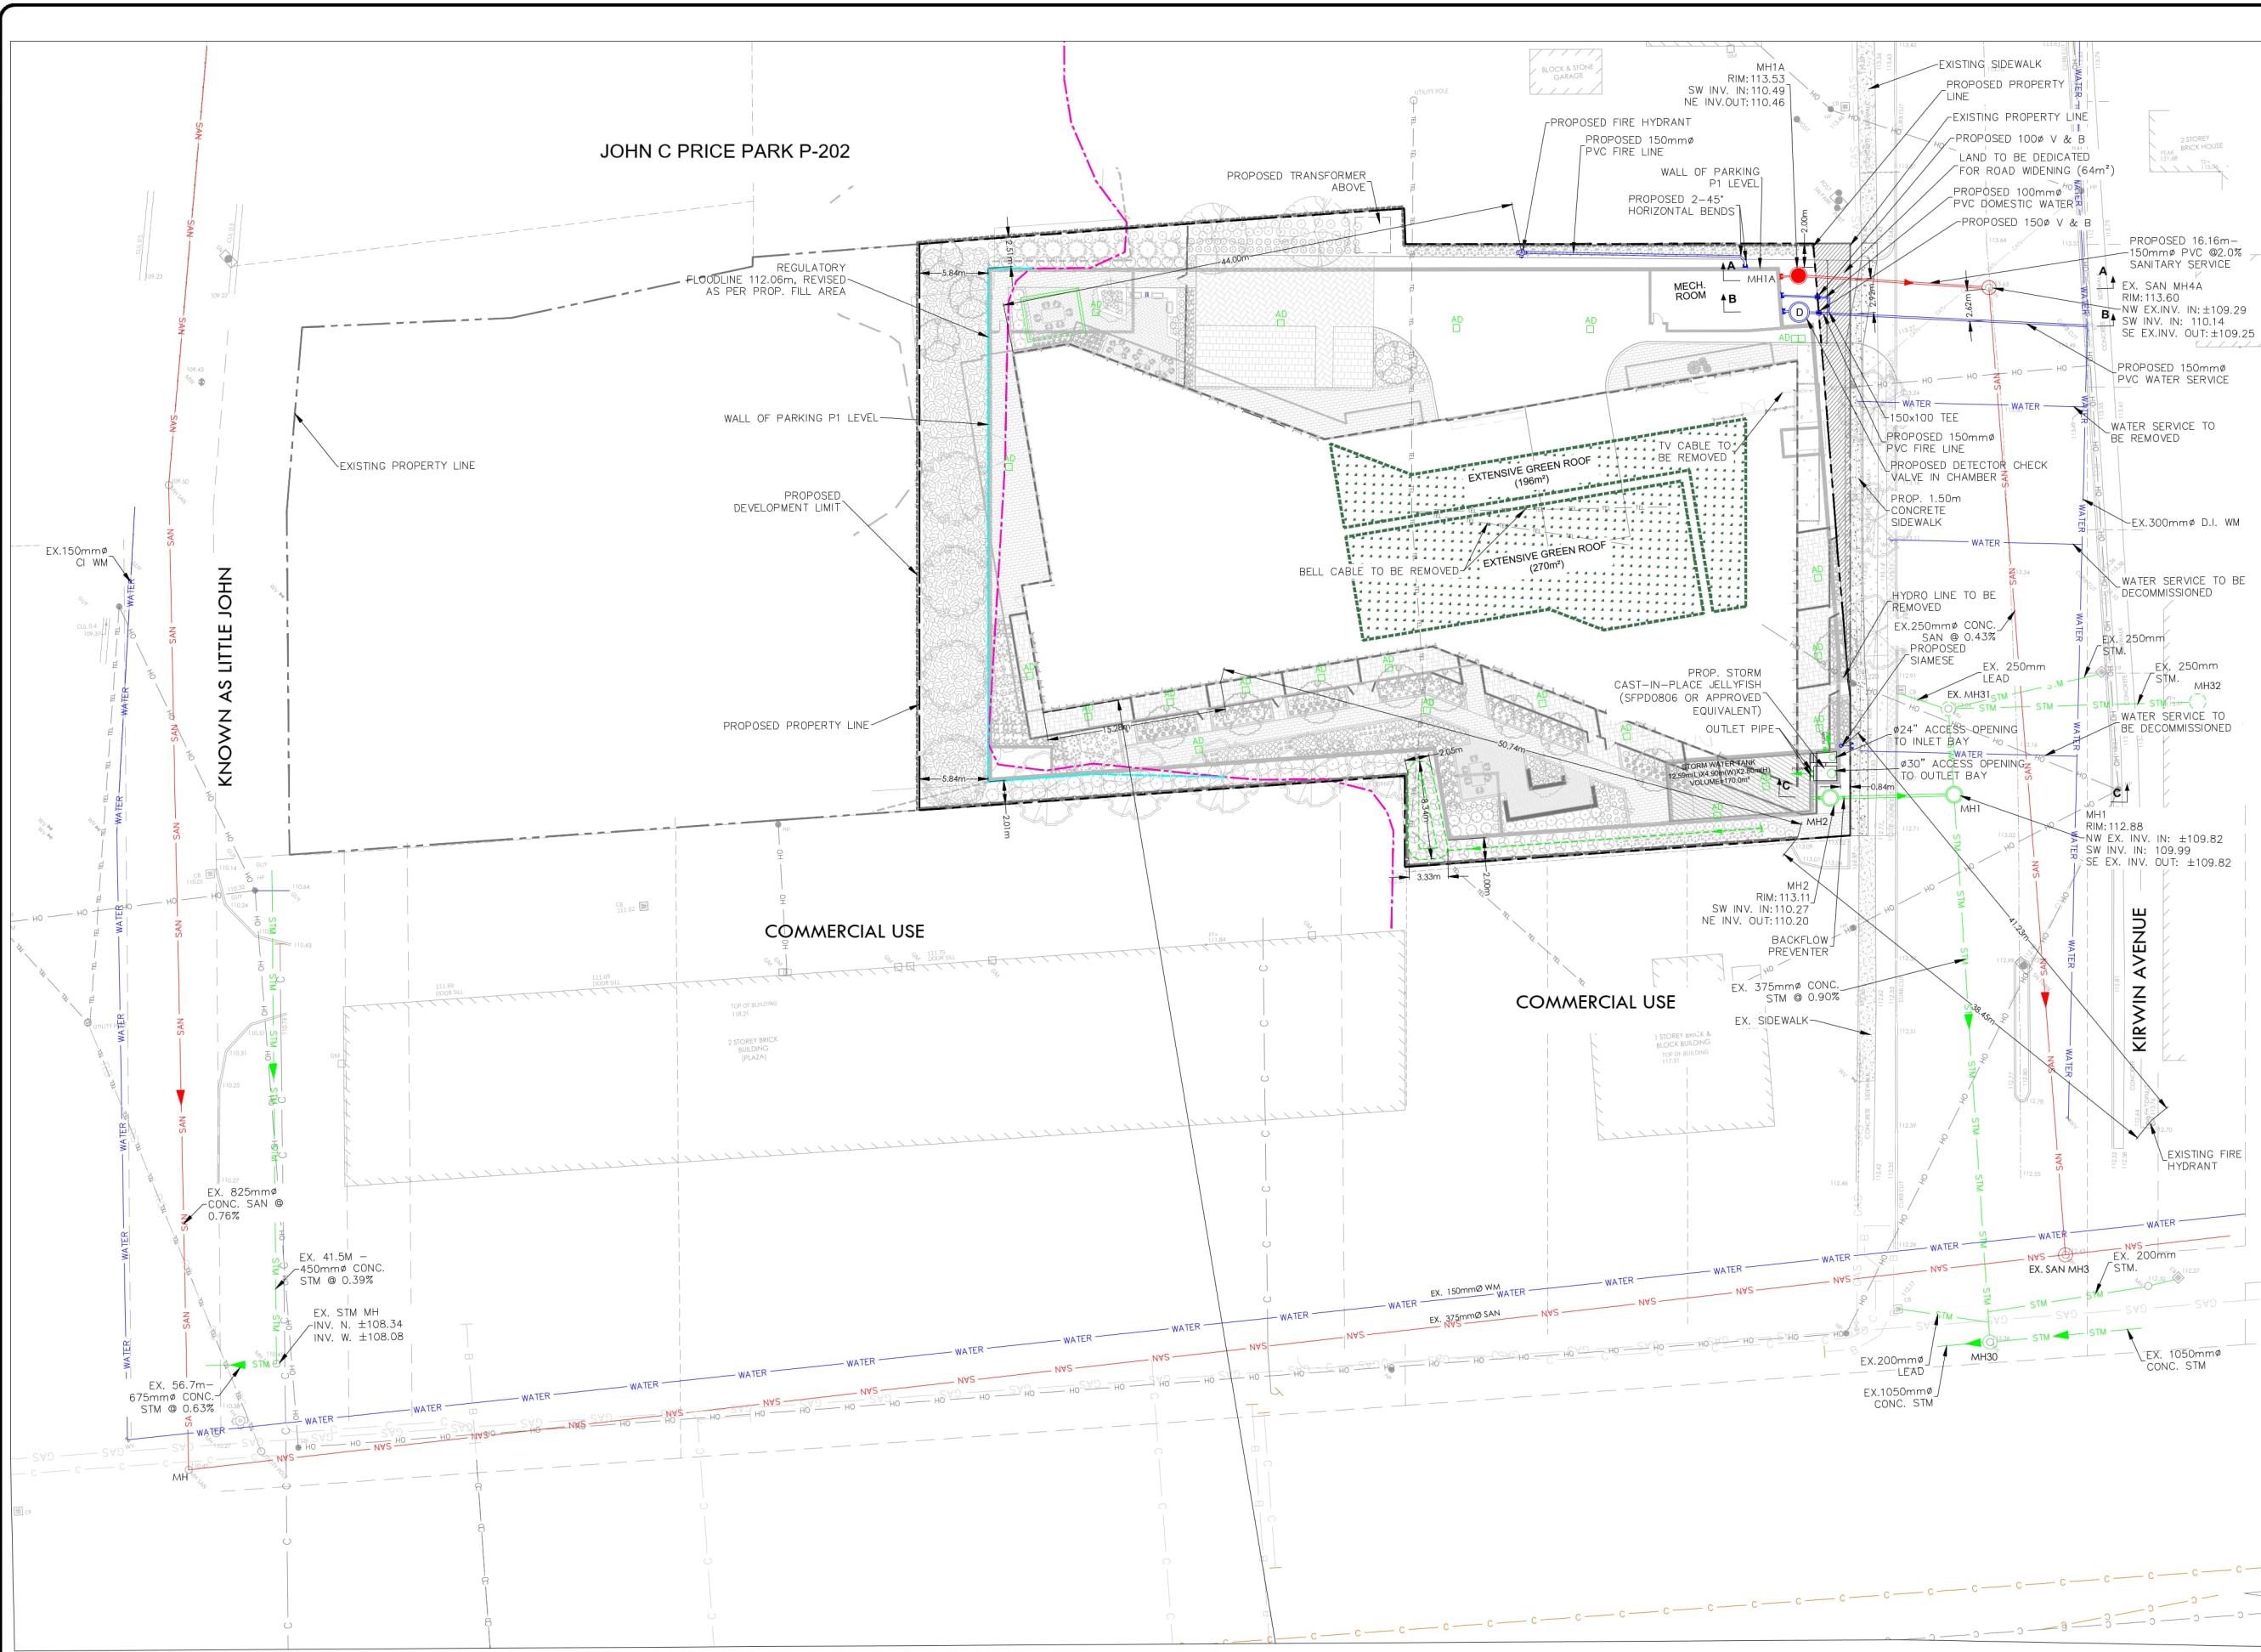


**LEGEND:**

	PROPOSED STORM MANHOLE
	PROPOSED SANITARY MANHOLE
	PROPOSED OIL GRIT SEPARATOR
	PROPOSED DETECTOR CHECK VALVE CHAMBER
	PROPOSED CATCHBASIN
	PROPOSED AREA DRAIN
	PROPERTY LINE
	BUILDING OUTLINE ABOVE
	EXISTING CATCHBASIN
	EXISTING SANITARY MANHOLE
	EXISTING STORM MANHOLE
	EXISTING FIRE HYDRANT
	EXISTING HYDRO POLE
	EXISTING WATER MAIN
	EXISTING SANITARY SEWER
	EXISTING STORM SEWER
	EXISTING GAS MAIN
	EXISTING HYDRO
	EXISTING BELL CABLE
	EXISTING TV CABLE
	EXISTING BELL CONDUIT
	EXISTING BURIED BELL CABLE
	EXISTING AERIAL ROGERS CABLE
	1.5m BLACK VINYL CHAIN LINK FENCE
	1.8m WOOD PRIVACY FENCE

- GENERAL NOTES:**
- REFER TO DWG C-105 "SITE SERVICING CROSS SECTIONS" FOR SERVICING CROSS SECTIONS.
  - NO EXTERNAL DRAINAGE OR GRADING IS PERMITTED INTO PARK BLOCKS.
  - ALL AREA DRAINS TO BE CONNECTED TO INTERNAL BUILDING PLUMBING. THE ENTIRE MECHANICAL STORM PIPING BELOW FINISHED FLOOR TO BE JOINT RESTRAINED AND WATER TIGHT.
  - VEGETATION CLEARING AND TREE REMOVAL ACTIVITIES SHOULD BE AVOIDED BETWEEN APRIL-OCTOBER OF EACH YEAR TO PROTECT THE BREEDING SEASONS OF MIGRATORY BIRDS AND BATS.

No.	Revision	Date	By	App.
2	ISSUED FOR ZBA RE-SUBMISSION	2022-12-19	F.M.	
1	ISSUED FOR ZBA SUBMISSION	2021-03-19	F.M.	B.H.



625 Cochrane Drive, Suite 900  
 Markham, Ontario  
 L3R 9K9, Canada  
 Tel: (905)470-0015  
 Fax: (905)470-0030




Owner/Client:  
**DVB REAL ESTATE INVESTMENTS INC.**

Location:  
**3031 LITTLE JOHN & 3016-3032 KIRWIN AVE DEVELOPMENT**

Title:  
**PRELIMINARY SITE SERVICING PLAN**

Designed By:	F.M.	Drawn By:	J.W.	Checked By:	F.M.
Scale:	1:250	Date:	FEB, 2021	Drawing No.:	C-02
Project No.:	21111				

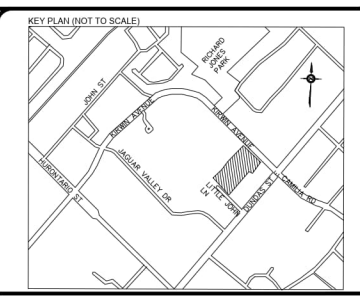


- LEGEND:**
- PROPOSED STORM MANHOLE
  - PROPOSED SANITARY MANHOLE
  - PROPOSED OIL GRIT SEPARATOR
  - PROPOSED V & B
  - PROPOSED VALVE CHAMBER
  - PROPERTY LINE
  - EXISTING CATCHBASIN
  - EXISTING SANITARY MANHOLE
  - EXISTING STORM MANHOLE
  - EXISTING FIRE HYDRANT
  - EXISTING FIRE HYDRANT
  - EXISTING HYDRO POLE
  - EXISTING WATER MAIN
  - EXISTING SANITARY SEWER
  - EXISTING STORM SEWER
  - EXISTING GAS MAIN
  - EXISTING HYDRO
  - EXISTING BELL CABLE
  - EXISTING TV CABLE
  - EXISTING BELL COUPLER
  - EXISTING BURIED BELL LABEL
  - EXISTING AERIAL ROGERS CABLE
  - EXISTING TREE

**GENERAL NOTES:**

- ELEVATIONS ARE REFERRED TO THE CITY OF MISSISSAUGA BENCHMARK NO. 793 LOCATED ON THE NORTH FACE AT THE EAST CORNER OF CONCRETE END POST OF BOX CULVERT UNDER DUNDAS STREET EAST ON SOUTH SIDE OF DUNDAS STREET EAST, 184 EAST OF JAGUAR VALLEY DRIVE, HAVING A PUBLISHED ELEVATION OF 110.953 METERS.
- REFER TO DWG C-05 and C-06 FOR CROSS SECTIONS.
- I HEREBY CERTIFY THAT THE INFORMATION FOR GAS AND WATER MAIN LINES AND THE DEVELOPMENT SITE ON KIRWIN AVE. ON THIS PLAN IS COMPLETE, ACCURATE AND BASED ON TEST PITS, AS PROVIDED BY TWO UTILITY ENGINEERS, ON OCTOBER 23, 2019.

Engineer's Signature: *F. Morshedi*

No.	Revision	Date	By	App.
2	ISSUED FOR IBA RE-SUBMISSION	2022-12-19	P.R.	F.M.
1	ISSUED FOR IBA SUBMISSION	2021-03-19	F.M.	B.H.



625 Cochrane Drive, Suite 900  
 Markham, Ontario  
 L3R 9R9, Canada  
 Tel: (905) 470-0015  
 Fax: (905) 470-0030





Owner/Client:  
**DVB REAL ESTATE INVESTMENTS INC.**

Location:  
**3031 LITTLE JOHN & 3016-3032  
 KIRWIN AVE DEVELOPMENT**

Title:  
**COMPOSITE UTILITY PLAN**

Designed By: F.M.	Drawn By: J.W.	Checked By: F.M.
Scale: 1:200	Date: FEB., 2021	Drawing No.: C-03
Project No.: 21111		

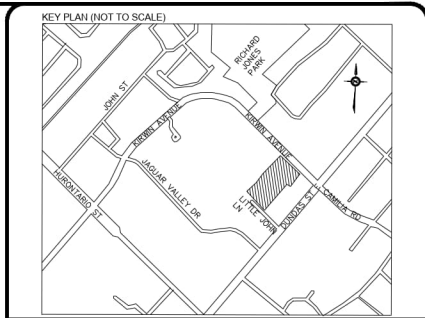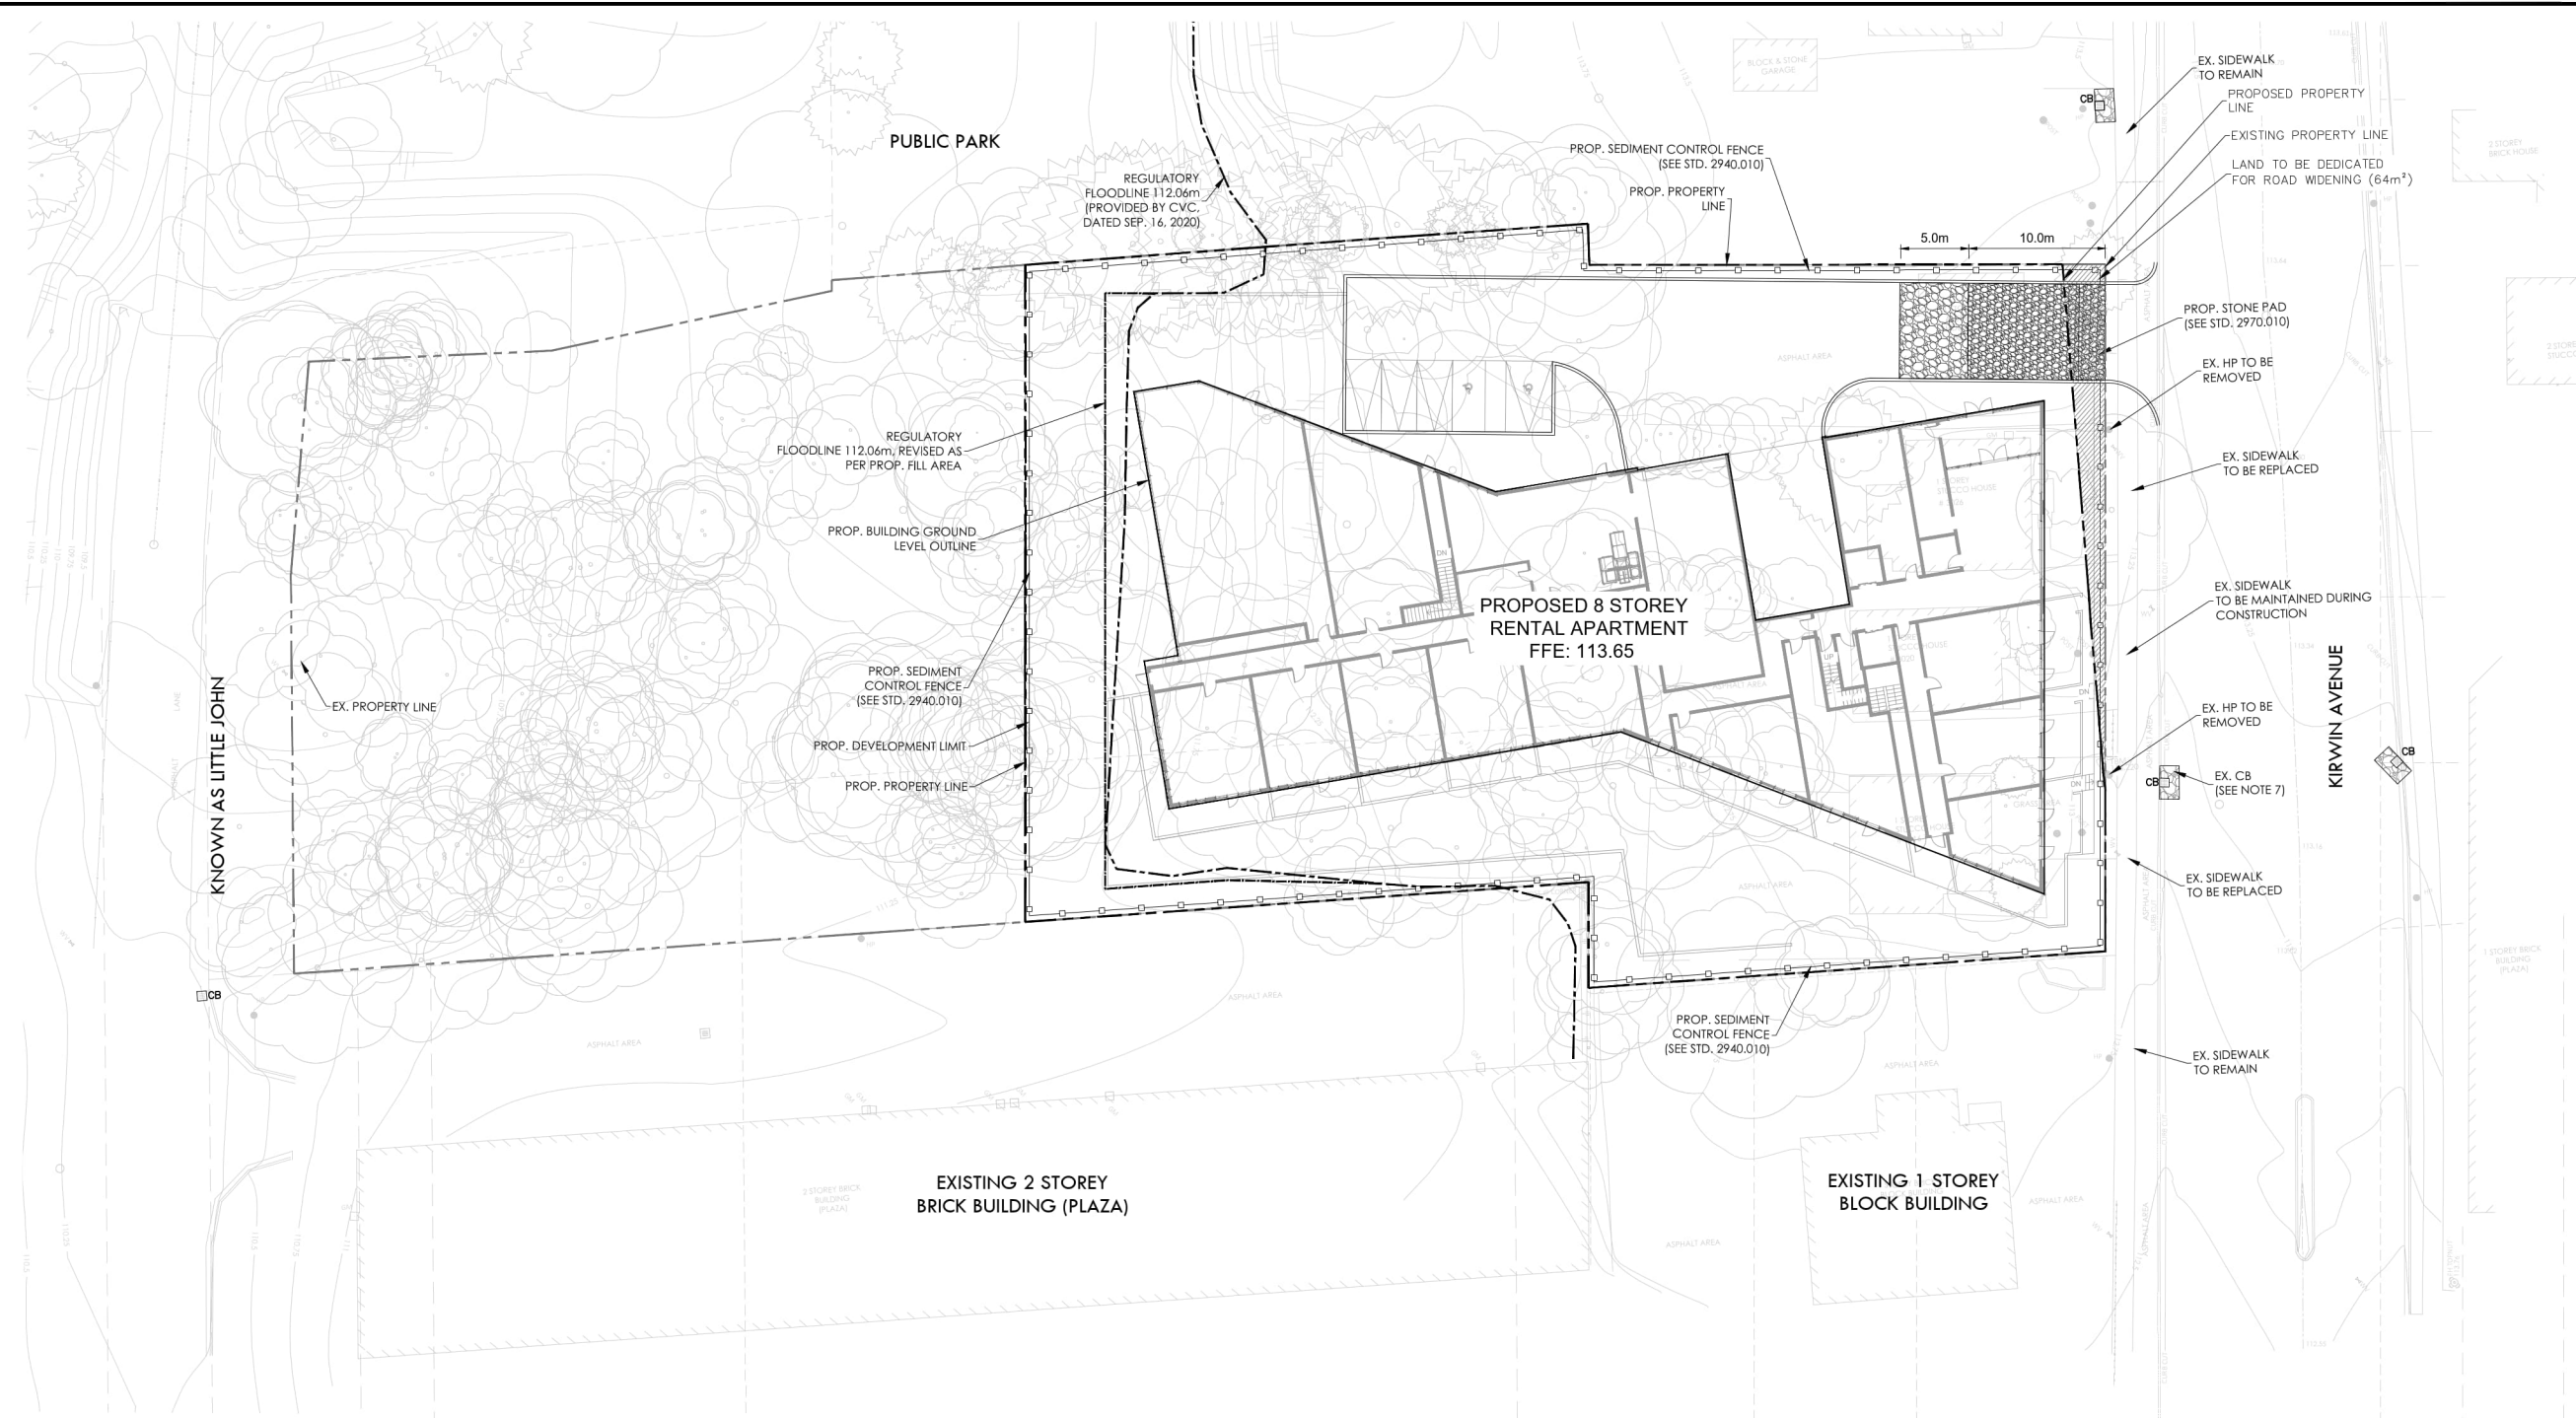




**LEGEND:**

	CATCHBASIN TO BE COVERED (SEE NOTE 7)		EXISTING CATCHBASIN
	STONE PAD		EXISTING HYDRO POLE
	PROPOSED SEDIMENT CONTROL FENCE		EXISTING FIRE HYDRANT
	EXISTING CURB		EXISTING MANHOLE
	PROPOSED PROPERTY LINE		EXISTING TREE
	EXISTING CONTOUR LINE		

**GENERAL NOTES:**  
 CONTRACTOR MUST CHECK & VERIFY ALL DIMENSIONS ON THE JOB.  
 DO NOT SCALE DRAWINGS.  
 ALL DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS ARE THE COPYRIGHT PROPERTY OF THE ARCHITECT AND MUST BE RETURNED UPON REQUEST. REPRODUCTION OF DRAWINGS, SPECIFICATIONS AND RELATED DOCUMENTS IN PART OR IN WHOLE IS FORBIDDEN WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT.  
 THIS DRAWING IS NOT TO BE USED FOR CONSTRUCTION UNLESS SIGNED BY THE ARCHITECT.

- TEMPORARY EROSION AND SEDIMENT CONTROL NOTES:**
1. ALL SEDIMENT CONTROL DEVICES TO BE INSTALLED PRIOR TO THE BEGINNING OF CONSTRUCTION.
  2. SEDIMENTATION AND EROSION CONTROL MEASURES SHALL BE IN PLACE PRIOR TO AND MAINTAINED DURING CONSTRUCTION TO PREVENT ENTRY OF SEDIMENT INTO PERMANENT DRAINAGE SYSTEMS. CONTRACTOR SHALL PERFORM ROUTINE INSPECTION OF ALL SEDIMENTATION AND EROSION CONTROL MEASURES WEEKLY AND AFTER SIGNIFICANT WEATHER EVENTS AND DAILY DURING EROSION RAIN OR SNOWMELT PERIODS.
  3. ALL MAINTENANCE TO SEDIMENTATION AND EROSION CONTROL TO BE COMPLETED WITHIN 48 HOURS OF INSPECTION.
  4. CONTRACTOR SHALL MAINTAIN AND MAINTAIN STONE PAD AT ALL CONSTRUCTION SITES.
  5. ALL EROSION AND SEDIMENT CONTROL TO REMAIN IN PLACE UNTIL SITE IS COMPLETELY STABILIZED.
  6. THE EROSION AND SEDIMENT CONTROL MEASURES SHOWN ON THIS PLAN, THE CONTRACTOR IS RESPONSIBLE FOR MAINTAINING AND MONITORING THE EROSION AND SEDIMENT CONTROL MEASURES. NOTES SHOWN ON THIS DRAWING AND AS PER EROSION AND SEDIMENT CONTROL SCHEDULE FOR URBAN CONSTRUCTION BY THE TRCA DURING ALL CONSTRUCTION PHASES OF THE PROJECT. THE CONTRACTOR SHALL PROVIDE WRITTEN PLANS TO THE CITY WHERE LOCATED TO THE PLAN OCCUR.
  7. ALL EXISTING CATCHBASINS SHALL HAVE GEOTEXTILE FILTER CLOTH PLACED ON THE 1 TO CONTROL ANY SILT THAT MAY ENTER THE DRAINAGE SYSTEM. ALL FILTERS ARE TO BE MAINTAINED BY THE CONTRACTOR AND TO BE RE-INSTALLED UPON COMPLETION OF THE PROJECT.
  8. ELEVATIONS ARE REFERRED TO THE CITY OF MISSISSAUGA BENCH MARK NO. 193 LOCATED ON THE NORTH FACE AT THE EAST CORNER OF CONCRETE AND FOOT OF BOX CULVERT UNDER DUNDAS STREET EAST ON SOUTH SIDE OF DUNDAS STREET EAST, 151 EAST OF JAGUAR VALLEY DRIVE HAVING A PUBLISHED ELEVATION OF 110.953 METERS.
  9. ALL SLOPE FINISHING AND SEDIMENT CONTROL FENCING TO BE ERECTED AROUND PERIMETER OF DISTURBED AREA PRIOR TO ANY GRADING OPERATIONS AS PER CITY STD. 2940.010.
  10. ALL ROADSIDE CATCHBASINS TO HAVE SEDIMENT PROTECTION AS PER CITY STD. 2930.04 INSTALLED IMMEDIATELY AFTER CB INSTALLATION. SEDIMENT PROTECTION TO BE MAINTAINED ON A REGULAR BASIS UNTIL NO LONGER REQUIRED.
  11. UNDER THE EROSION AND SEDIMENT CONTROL BY-LAW NO. 512-91, AS APPLIED TO SITE CONSTRUCTION IS INTERRUPTED AND/OR INACTIVITY EXCEEDS 30 DAYS ALL STROPPED AND/OR BARE AREAS SHALL BE STABILIZED BY SEEDING.
  12. EXISTING SIDEWALKS TO BE MAINTAINED DURING CONSTRUCTION.
  13. VEGETATION CLEARING AND TREE REMOVAL ACTIVITIES SHOULD BE AVOIDED BETWEEN APRIL/OCTOBER OF EACH YEAR TO PROTECT THE BREEDING SEASONS OF MIGRATORY BIRDS AND BATS.
  14. EROSION AND SEDIMENT CONTROL METHODS ARE TO BE CONTINUOUSLY EVALUATED, AND UPDATES ARE TO BE IMPLEMENTED, WHEN NECESSARY.
  15. ADDITIONAL EROSION AND SEDIMENT CONTROL MATERIALS (I.E. SILT FENCE, STRAW BALES, CLEAR STONES ETC.) ARE TO BE KEPT ON SITE FOR EMERGENCIES AND REPAIRS.
  16. THE CONTRACTOR IS ULTIMATELY RESPONSIBLE FOR CONTROLLING SEDIMENT AND EROSION WITHIN THE CONSTRUCTION SITE FOR THE DURATION OF THE CONSTRUCTION. THE SEDIMENT LADEN WATER WILL NOT BE ALLOWED TO DISCHARGE TO THE CREEK.
  17. AN AFTER HOURS CONTACT NUMBER IS TO BE VISIBLY POSTED ON-SITE FOR EMERGENCIES.
  18. ANY SEDIMENT SPILL FROM THE SITE MUST BE REPORTED TO MINISTRY OF ENVIRONMENT AND CLIMATE CHANGE (CALL SPILL ACTION CENTER AT 1-800-388-5886).

No.	Revision	Date	By	App.
2	ISSUED FOR ZBA SUBMISSION	2022-12-19	F.M.	
1	ISSUED FOR ZBA SUBMISSION	2021-03-19	F.M.	B.H.

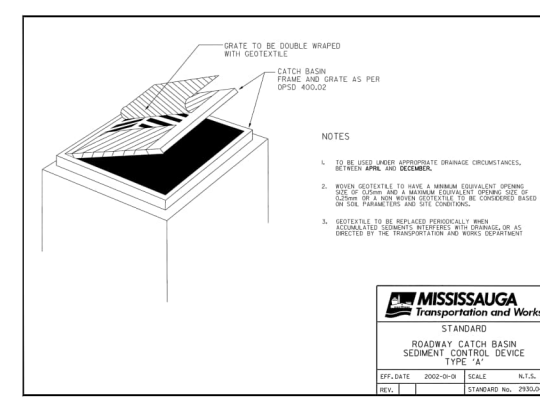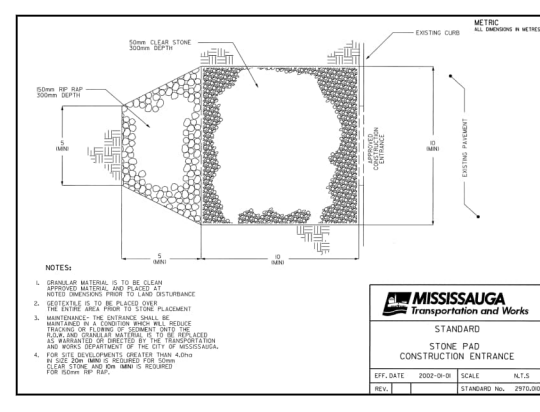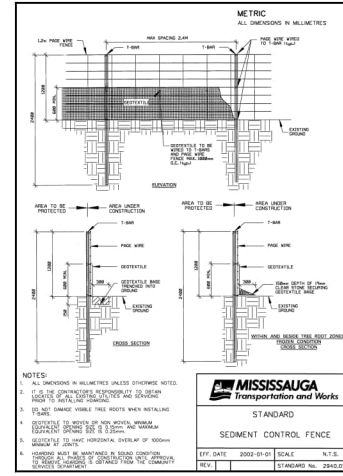

**NOTES:**  
 1. ALL DIMENSIONS IN MILLIMETERS UNLESS OTHERWISE NOTED.  
 2. EXISTING DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR.  
 3. EXISTING DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR.  
 4. EXISTING DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR.  
 5. EXISTING DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR.  
 6. EXISTING DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR.  
 7. EXISTING DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR.  
 8. EXISTING DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR.  
 9. EXISTING DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR.  
 10. EXISTING DIMENSIONS SHALL BE VERIFIED BY THE CONTRACTOR.

**NOTES:**  
 1. GRANULAR MATERIAL IS TO BE CLEAN APPROVED MATERIAL AND TO BE 20% OVERSIZE.  
 2. GEOTEXTILE IS TO BE PLACED OVER THE ENTIRE AREA PRIOR TO STONE PLACEMENT.  
 3. MAINTENANCE: THE DISTANCE SHALL BE MAINTAINED TO A MINIMUM OF 100MM FROM THE EDGE OF THE STONE PAD TO THE EXISTING CURB AND SIDEWALK.  
 4. FOR SITE OF ROADWAY CATCH BASIN, THE AREA CLEAR STONE AND SIDEWALK IS REQUIRED FOR SETBACK OF 100MM.

**NOTES:**  
 1. TO BE USED UNDER APPROPRIATE DRAINAGE CIRCUMSTANCES, BETWEEN APRIL AND DECEMBER.  
 2. MUST BE MAINTAINED TO HAVE A MINIMUM EQUIVALENT OPENING SIZE OF 3MM WITH A MAXIMUM EQUIVALENT OPENING SIZE OF 5MM OF A 100MM WIDE GEOTEXTILE TO BE CONSIDERED BASED ON THE FRAME SIZE AND SITE CONDITIONS.  
 3. GEOTEXTILE TO BE REPLACED PERIODICALLY WHEN NECESSARY. FREQUENCY TO BE DETERMINED BY THE TRANSPORTATION AND WORKS DEPARTMENT.

**MISSISSAUGA Transportation and Works**  
 STANDARD  
 SEDIMENT CONTROL FENCE  
 EFF. DATE: 2002-01-01 SCALE: N.T.S.  
 REV. 1

**MISSISSAUGA Transportation and Works**  
 STANDARD  
 STONE PAD CONSTRUCTION ENTRANCE  
 EFF. DATE: 2002-01-01 SCALE: N.T.S.  
 REV. 1

**MISSISSAUGA Transportation and Works**  
 STANDARD  
 ROADWAY CATCH BASIN SEDIMENT CONTROL DEVICE  
 TYPE 'A'  
 EFF. DATE: 2002-01-01 SCALE: N.T.S.  
 REV. 1



625 Cochrane Drive, Suite 900  
 Markham, Ontario  
 L3R 9R9, Canada  
 Tel: (905)470-0015  
 Fax: (905)470-0030




Owner/Client:  
**DVB REAL ESTATE INVESTMENTS INC.**


Location:  
**3031 LITTLE JOHN & 3016-3032 KIRWIN AVE DEVELOPMENT**

Title:  
**TEMPORARY EROSION AND SEDIMENT CONTROL PLAN**


Designed By: F.M. Drawn By: J.W. Checked By: F.M.  
 Scale: 1:250 Date: FEB, 2021 Drawing No: C-04  
 Project No: 21111

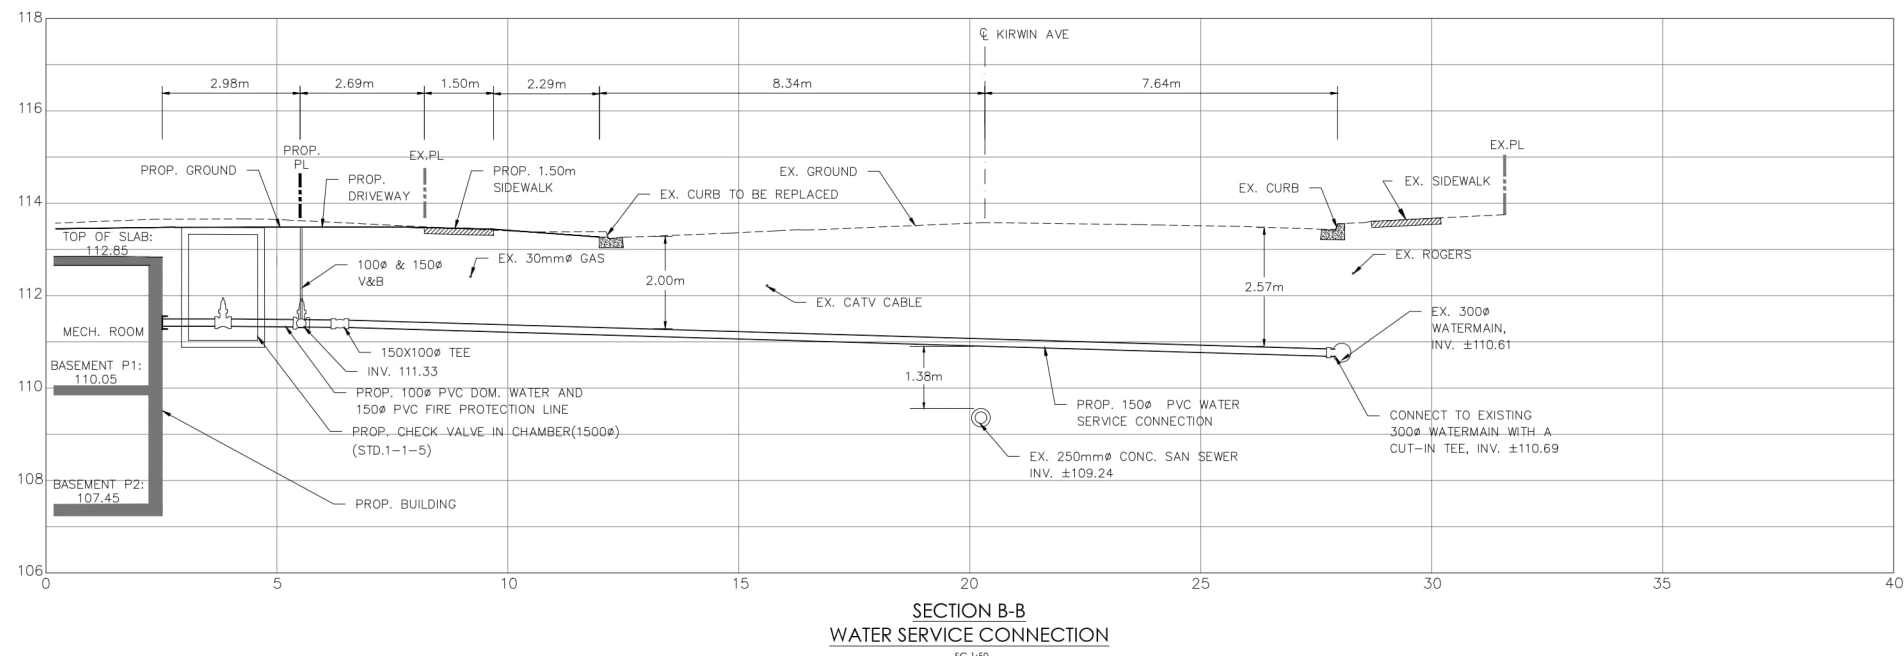


SECTION B-B  
WATER SERVICE CONNECTION  
SC 1:50

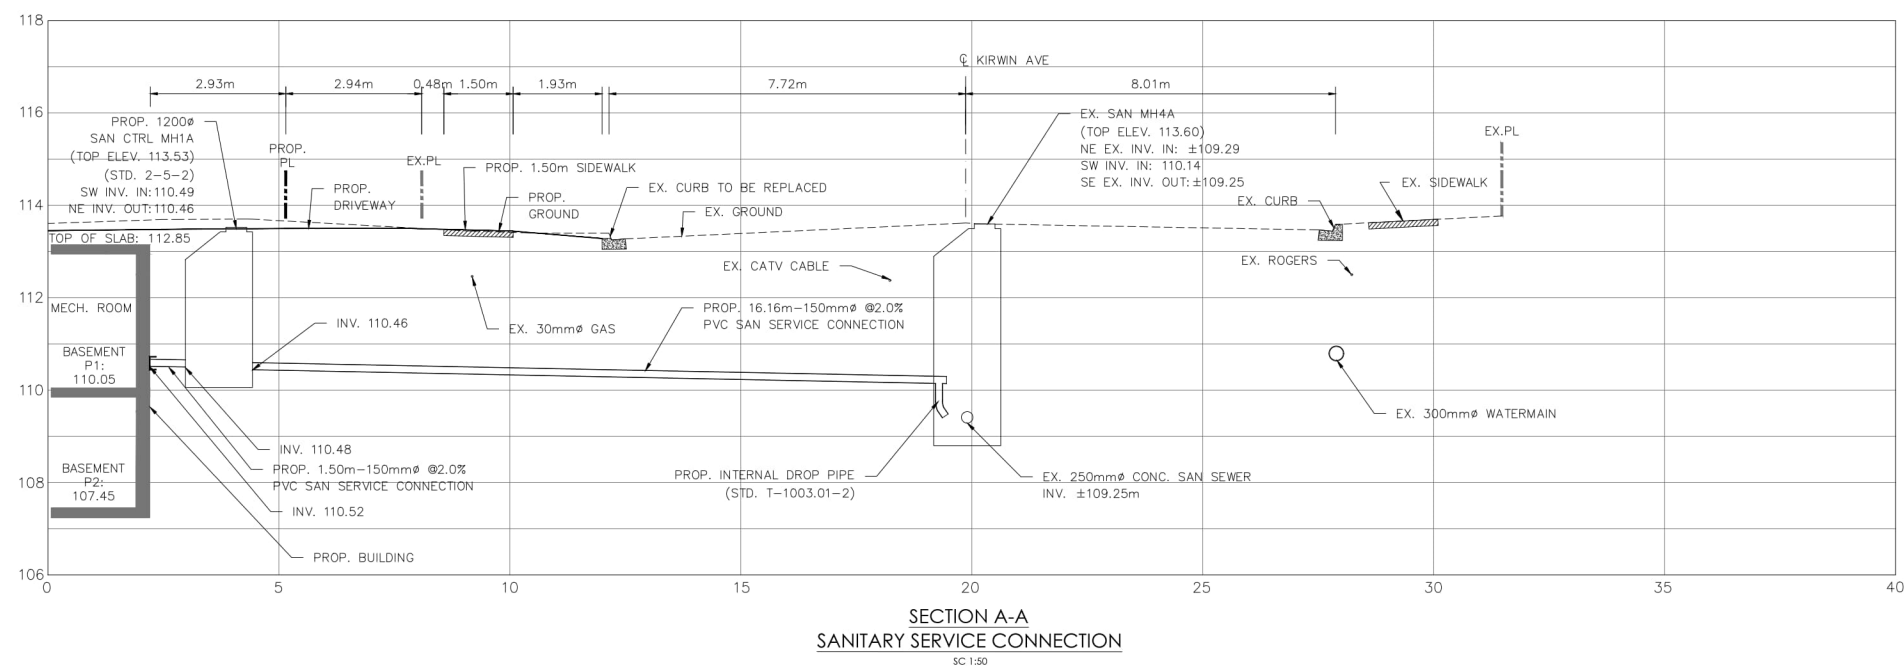

SECTION A-A  
SANITARY SERVICE CONNECTION  
SC 1:50

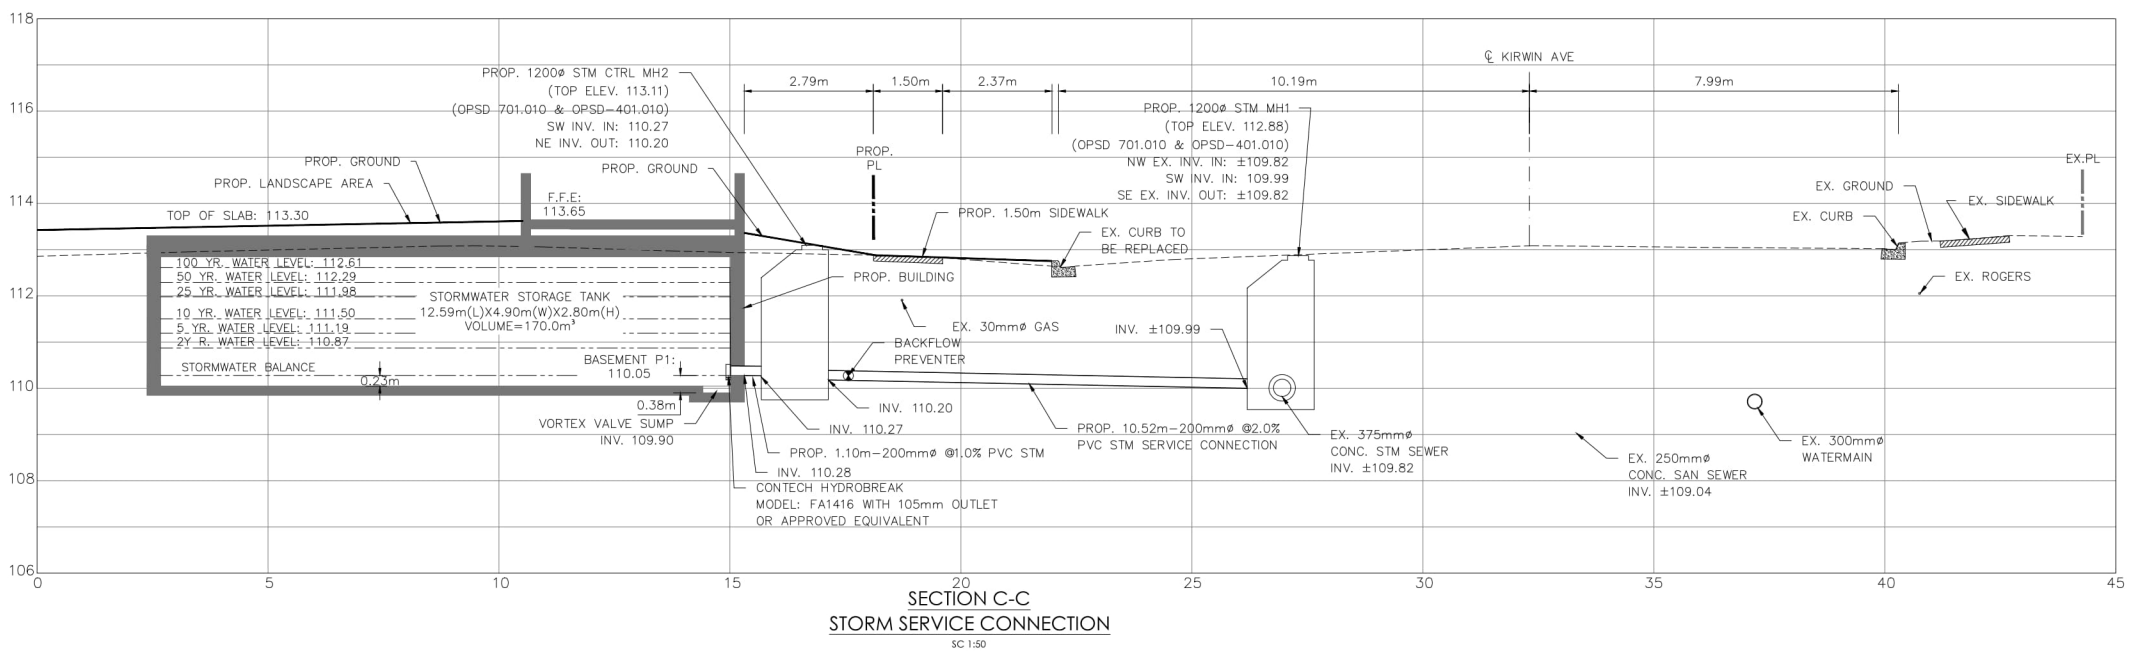

SECTION C-C  
STORM SERVICE CONNECTION  
SC 1:50

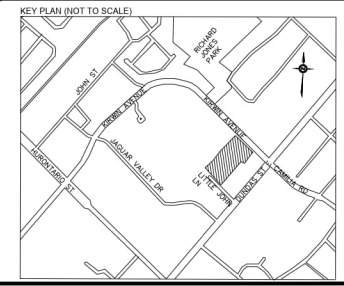

GENERAL NOTES:  
REFER TO DWG C-102 'SITE SERVICING PLAN' AND C-103 'COMPOSITE UTILITY PLAN' FOR LOCATION OF CROSS SECTIONS

No.	Revision	Date	By	App
2	ISSUED FOR ZBA RE-SUBMISSION	2022-12-19	F.M.	
1	ISSUED FOR ZBA SUBMISSION	2021-03-19	F.A.J.	B.H.



625 Cochrane Drive, Suite 900  
Markham, Ontario  
L3R 9R9, Canada  
Tel: (905)470-0015  
Fax: (905)470-0030




Owner/Client:  
**DVB REAL ESTATE INVESTMENTS INC.**


Location:  
**3031 LITTLE JOHN & 3016-3032  
KIRWIN AVE DEVELOPMENT**

Title:  
**SERVICING CROSS SECTIONS**


Designed By:	F.M.	Drawn By:	J.W.	Checked By:	F.M.
Scale:	1:50	Date:	FEB. 2021	Drawing No.:	C-05
Project No.:	21111				

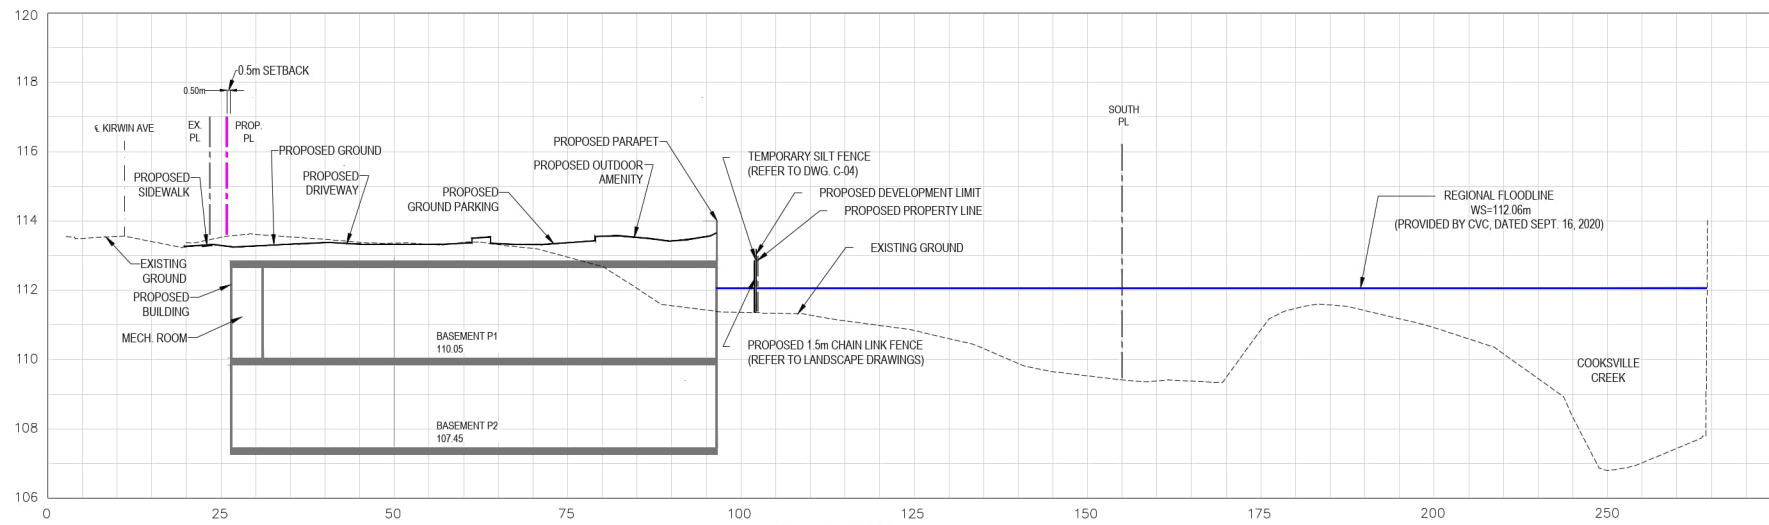



**SECTION K-K**  
SC 1:500

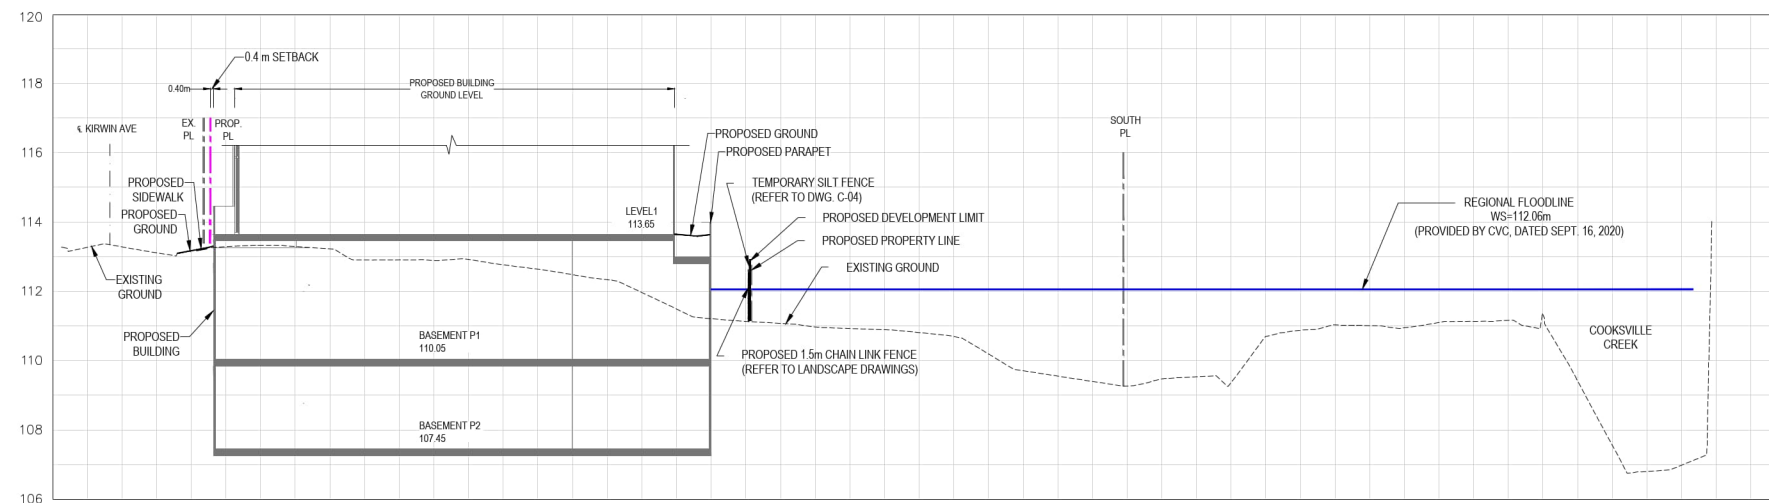

**SECTION L-L**  
SC 1:500

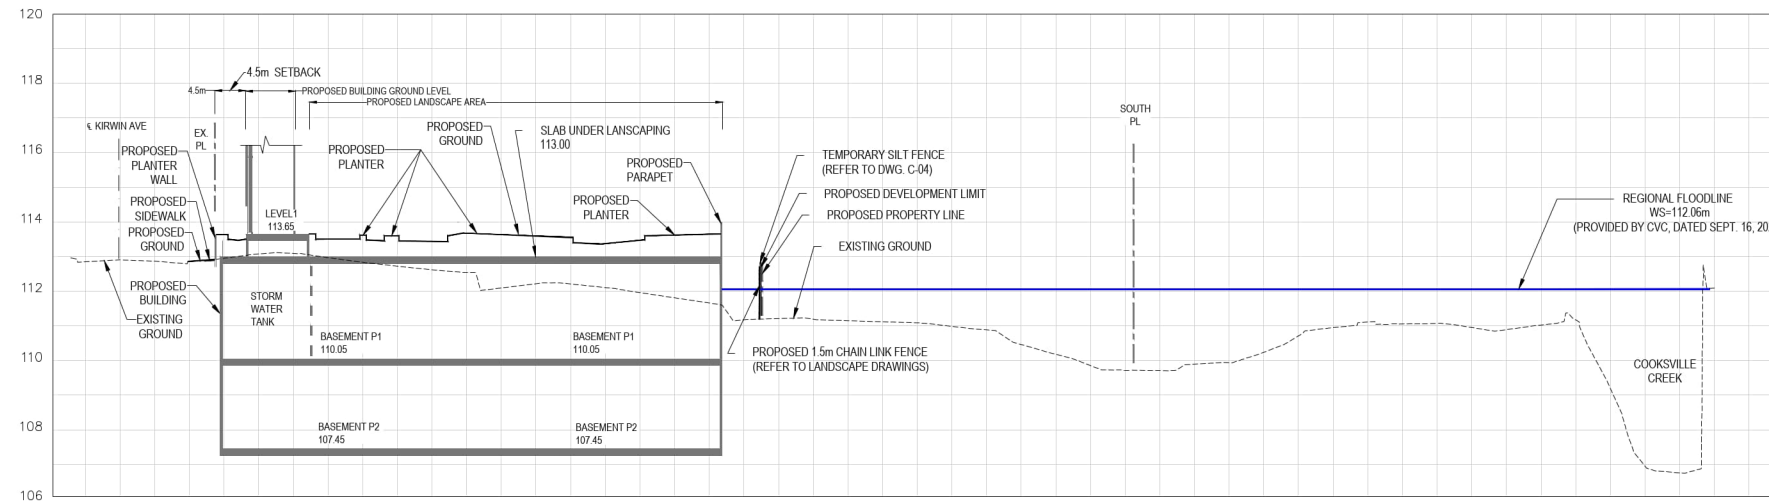

**SECTION M-M**  
SC 1:500

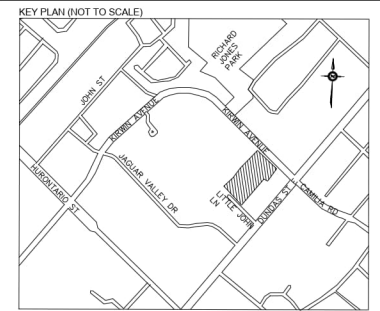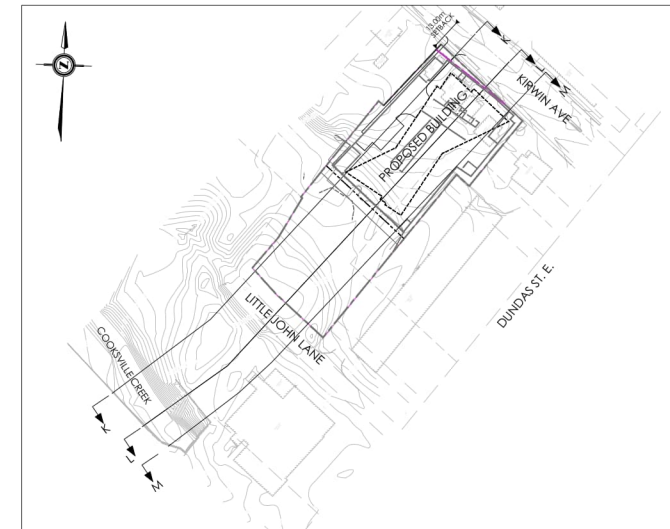

**LEGEND:**

- EX. PROPERTY LINE
- PROP. PROPERTY LINE
- REGIONAL FLOODLINE (PROVIDED BY CVC, DATED SEPT. 16, 2020)
- REGIONAL FLOODLINE (PROVIDES BY AMEC, DATED FEB. 11, 2011)
- EXISTING GROUND
- PROPOSED GROUND

No.	Revision	Date	By	App.
2	ISSUED FOR ZBA RE-SUBMISSION	2022-12-19	P.R.	F.M.
1	ISSUED FOR ZBA SUBMISSION	2021-03-19	F.M.	B.H.



625 Cochrane Drive, Suite 900  
Markham, Ontario  
L3R 9R9, Canada  
Tel: (905)470-0015  
Fax: (905)470-0030



Owner/Client:  
**DVB REAL ESTATE INVESTMENTS INC.**

Location:  
**3031 LITTLE JOHN & 3016-3032  
KIRWIN AVE DEVELOPMENT**

Title:  
**LONGITUDINAL CROSS SECTIONS**

Designed By: F.M.	Drawn By: J.W.	Checked By: F.M.
Scale: 1:500	Date: FEB., 2021	Drawing No.: C-06
Project No.: 21111		

**GENERAL NOTES**

- ALL SITE LAYOUT INFORMATION, INCLUDING BUILDING DIMENSIONS, SETBACKS, CURBS, DEPRESSED CURB LOCATIONS, SIDEWALKS, PARKING AND LANDSCAPE FEATURES MUST BE REFERENCED FROM THE ARCHITECT'S PLANS.
- PRIOR TO THE START OF CONSTRUCTION, THE CONTRACTOR MUST VERIFY ALL DIMENSIONS AND LAYOUT INFORMATION. ANY DISCREPANCIES MUST BE REPORTED TO THE CONSULTANT BEFORE RESUMING CONSTRUCTION OPERATIONS.
- ALL SERVICES MUST BE INSTALLED TO THE CURRENT CITY OF MISSISSAUGA STANDARDS, REGION OF PEEL STANDARDS, ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD), ONTARIO PROVINCIAL STANDARD SPECIFICATION (OPSS), AND ONTARIO BUILDING CODE (OBC) UNLESS OTHERWISE SPECIFIED, TO THE SPECIFICATION OF THE CITY AND CONSULTANT.
- THE REGION OF PEEL AND CITY OF MISSISSAUGA STANDARD DRAWINGS, MATERIAL SPECIFICATIONS AND CONSTRUCTION SPECIFICATIONS, ONTARIO PROVINCIAL STANDARD DRAWINGS (OPSD) AND ONTARIO PROVINCIAL STANDARD SPECIFICATION (OPSS) SHALL FORM PART OF THE CONTRACT DOCUMENTS.
- THE POSITION OF EXISTING POLE LINES, CONDUITS, WATERMANS, SEWERS AND OTHER UNDERGROUND AND ABOVEGROUND UTILITIES, STRUCTURES AND APPURTENANCES IS NOT NECESSARILY SHOWN ON THE DRAWING, AND WHERE SHOWN, THE ACCURACY OF THE POSITION OF SUCH UTILITIES AND STRUCTURES IS NOT GUARANTEED. PRIOR TO CONSTRUCTION, THE CONTRACTOR SHALL SATISFY HIMSELF OF THE EXACT LOCATION OF ALL SUCH UTILITIES AND STRUCTURES, AND SHALL ASSUME ALL LIABILITY FOR DAMAGE TO THEM DURING THE COURSE OF CONSTRUCTION. THIS MAY REQUIRE EXCAVATION TO EXPOSE UTILITIES AS REQUIRED BY CONTRACTORS.
- ALL TRENCHING TO BE IN ACCORDANCE WITH THE LATEST REVISIONS OF THE OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS.
- ALL TRENCHES SHALL BE BACKFILLED TO THE CITY'S OF STANDARDS AND IN ACCORDANCE WITH THE GEOTECHNICAL REPORT OR AS OTHERWISE NOTED ON THE DRAWINGS.
- ALL DIMENSIONS ARE IN METRES(m) AND ALL DIAMETERS ARE IN MILLIMETERS (mm) UNLESS OTHERWISE NOTED.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL TRAFFIC CONTROL AND SAFETY MEASURES DURING THE CONSTRUCTION PERIOD, INCLUDING THE SUPPLY, INSTALLATION AND REMOVAL OF ALL NECESSARY SIGNAGE, DELINEATORS, MARKERS AND BARRIERS. ALL SIGNS, ETC. SHALL CONFORM TO THE STANDARDS AND SPECIFICATIONS FOR THE CITY AND ONTARIO TRAFFIC MANUAL FOR TEMPORARY CONDITIONS AND MTO MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES.
- THE CONTRACTOR SHALL RECTIFY ALL DISTURBED AREAS TO THE ORIGINAL CONDITION OR BETTER AND TO THE SATISFACTION OF THE CITY.
- EXISTING STRUCTURES ARE NOT TO BE DISTURBED, NOR ENCROACHMENT ON ADJACENT PROPERTIES UNLESS INSTRUCTED BY THE ENGINEER.
- DEWATERING, IF REQUIRED, SHALL BE THE RESPONSIBILITY AND SOLE EXPENSE OF THE CONTRACTOR. REFER TO THE GEOTECHNICAL REPORT FOR EXISTING SITE CONDITIONS.
- CONTRACTOR TO EXPOSE AND VERIFY LOCATION, ELEVATION, AND SIZE OF ALL SERVICE CONNECTIONS PRIOR TO CONSTRUCTION. THE OWNER SHALL BE NOTIFIED IMMEDIATELY OF ANY CONFLICTS WITH EXISTING SERVICES
- CONTRACTOR SHALL RED-LINE ALL AS CONSTRUCTED INFORMATION ON A SET OF DRAWINGS AND PROVIDE TO THE OWNER AT THE END OF CONSTRUCTION, SEALED BY AN OLS OR P.ENG.
- CONTRACTOR SHALL SUPPORT AND PROTECT ALL EXISTING UTILITIES DURING CONSTRUCTION AS PER OPSD AND CITY OF MISSISSAUGA STANDARDS AND SPECIFICATIONS.
- THE APPROVAL OF THIS PLAN DOES NOT EXEMPT THE OWNERS CONTRACTOR FROM OBTAINING AND PAYING FOR, BUT NOT LIMITED TO THE FOLLOWING PERMITS, ROAD CUTS, SEWER PERMITS, RELOCATION OF SERVICES, ENCROACHMENT AGREEMENTS, APPROACH APPROVAL PERMITS, ETC. ALL RESTORATION AS PER CITY STANDARDS.
- THE CONTRACTOR SHALL ENDEAVOR TO PREVENT MUD TRACKING ONTO EXISTING RIGHT-OF-WAYS AND SHALL PROVIDE FOR CLEANUP AT HIS OWN EXPENSE AS DIRECTED BY THE CITY. THE CONTRACTOR SHALL ALSO BE RESPONSIBLE TO CONTROL DUST ON THE PROJECT AND HE SHALL PROVIDE AT HIS OWN EXPENSE, CONTROLLING MEASURES AS DIRECTED BY THE CITY.
- FOR ELECTRICAL, ARCHITECTURAL AND MECHANICAL DETAILS BY OTHERS, SEE RESPECTIVE DRAWINGS. WORKS SHOWN ON THESE DRAWINGS ARE TO BE READ IN CONJUNCTION WITH ALL OTHER PLANS.
- ALL EXISTING SERVICES ARE TO REMAIN IN SERVICE AT ALL TIMES DURING CONSTRUCTION.
- ITEMS DESIGNATED TO BE REMOVED SHALL BE DISPOSED OFF-SITE.
- CONSTRUCTION LAYOUT SHALL BE UNDERTAKEN BY CONTRACTOR'S SURVEYOR AT THE CONTRACTOR'S EXPENSE.
- CONTRACTOR SHALL REVIEW THE GEOTECHNICAL REPORT FOR THE SITE TO CONFIRM EXISTING SOIL CONDITIONS AND TO CONFIRM RECOMMENDED GEOTECHNICAL PROCEDURES FOR THE ADDITION.


**REGION OF PEEL STANDARD NOTES**

- ALL MATERIALS AND CONSTRUCTION METHODS MUST CORRESPOND TO THE CURRENT PEEL PUBLIC WORKS STANDARDS AND SPECIFICATIONS.
- WATERMAIN AND/OR WATER SERVICES MATERIALS 100MM (4") AND LARGER MUST BE DR18 P.V.C. PIPE MANUFACTURED TO A.W.W.A. SPEC. C900-16 SPEC COMPLETE WITH TRACER WIRE. SIZE 50MM (2") AND SMALLER MUST BE TYPE 'K' SOFT COPPER PIPE PER A.S.T.M. B88-49 SPECIFICATION.
- WATERMANS AND/OR WATER SERVICES ARE TO HAVE A MINIMUM COVER OF 1.7M (5'6") WITH A MINIMUM HORIZONTAL SPACING OF 1.2M (4') FROM THEMSELVES AND ALL OTHER UTILITIES.
- PROVISIONS FOR FLUSHING WATER LINE PRIOR TO TESTING, ETC. MUST BE PROVIDED WITH AT LEAST A 50MM (2") OUTLET ON 100MM (4") AND LARGER LINES. COPPER LINES ARE TO HAVE FLUSHING POINTS AT THE END, THE SAME SIZE AS THE LINE. THEY MUST ALSO BE HOSED OR PIPED TO ALLOW THE WATER TO DRAIN ONTO A PARKING LOT OR DOWN A DRAIN. ON FIRE LINES FLUSHING OUTLET TO BE 100MM (4") DIAMETER MINIMUM ON A HYDRANT.
- ALL CURB STOPS TO BE 3.0M OFF THE FACE OFF THE BUILDING UNLESS OTHERWISE NOTED.
- HYDRANT AND VALVE SET TO REGION STANDARDS 1-6-1 DIMENSION A AND B, 0.7M (2') AND 0.9M (3') AND TO HAVE PUMPER NOZZLE.
- WATERMANS TO BE INSTALLED TO GRADES AS SHOWN ON APPROVED SITE PLAN. COPY OF GRADE SHEET MUST BE SUPPLIED TO INSPECTOR PRIOR TO COMMENCEMENT OF WORK, WHERE REQUESTED BY INSPECTOR.
- WATERMANS MUST HAVE MINIMUM VERTICAL CLEARANCE OF 0.3M (12") OVER/0.5M (20") UNDER SEWERS AND ALL OTHER UTILITIES WHEN CROSSING.
- ALL PROPOSED WATER PIPING MUST BE ISOLATED FROM EXISTING LINES IN ORDER TO ALLOW INDEPENDENT PRESSURE TESTING AND CHLORINATING FROM EXISTING SYSTEMS.
- ALL LIVE TAPPING AND OPERATION OF REGION WATER VALVES SHALL BE ARRANGED THROUGH THE REGIONAL INSPECTOR ASSIGNED OR BY CONTACTING THE OPERATIONS AND MAINTENANCE DIVISION.
- LOCATION OF ALL EXISTING UTILITIES IN THE FIELD TO BE ESTABLISHED BY THE CONTRACTOR.
- THE CONTRACTOR(S) SHALL BE SOLELY RESPONSIBLE FOR LOCATES, EXPOSING, SUPPORTING AND PROTECTING OF ALL UNDERGROUND AND OVERHEAD UTILITIES AND STRUCTURES EXISTING AT THE TIME OF CONSTRUCTION IN THE AREA OF THEIR WORK WHETHER SHOWN ON THE PLANS OR NOT AND FOR ALL REPAIRS AND CONSEQUENCES RESULTING FROM DAMAGE TO SAME.
- THE CONTRACTORS(S) SHALL BE SOLELY RESPONSIBLE TO GIVE 72 HOURS WRITTEN NOTICE TO UTILITIES PRIOR TO CROSSING SUCH UTILITIES, FOR THE PURPOSE OF INSPECTION BY THE CONCERNED UTILITY. THIS INSPECTION WILL BE FOR THE DURATION OF THE CONSTRUCTION, WITH THE CONTRACTOR RESPONSIBLE FOR ALL COSTS ARISING FROM SUCH INSPECTIONS.
- ALL PROPOSED WATER PIPING MUST BE ISOLATED THROUGH A TEMPORARY CONNECTION THAT SHALL INCLUDE AN APPROPRIATE CROSS-CONNECTION CONTROL DEVICE, CONSISTENT WITH THE DEGREE OF HAZARD, FOR BACKFLOW PREVENTION OF THE ACTIVE DISTRIBUTION SYSTEM, CONFORMING TO REGION OF PEEL STANDARDS 1-7-7 OR 1-7-8.


**SANITARY, STORM AND WATERMAIN NOTES**

- FULL LENGTH PERFORATED SUB-DRAIN PIPES OF 150mm DIA. TO BE INSTALLED AROUND THE PERIMETER OF PARKING LOT.
- ALL UTILITY COMPANIES WILL BE NOTIFIED BY CONTRACTOR FOR LOCATES PRIOR TO THE INSTALLATION OF PROPOSED SERVICE CONNECTIONS.
- ALL PIPE MATERIALS SHALL BE IN ACCORDANCE WITH THE CURRENT MANUFACTURERS APPROVED PRODUCT LIST, SANITARY SEWER AND APPURTENANCES.
- ALL SANITARY MAINTENANCE HOLES SHALL CONFORM TO THE CURRENT MANUFACTURER'S APPROVED PRODUCT LIST, SANITARY SEWER AND APPURTENANCES, REGIONAL STANDARD DRAWING 2-1-1 WHICH MUST BE MODIFIED IN THE FIELD TO PREVENT INFLOW AND INFILTRATION.
- SANITARY SERVICE CONNECTION MATERIAL MUST BE PVC SDR28.
- STORM SERVICE CONNECTION MATERIAL MUST BE PVC DR35.
- ALL MAINTENANCE HOLE ARE TO BE SUPPLIED OR CONSTRUCTED IN ACCORDANCE WITH OPSD 701 SERIES.
- CATCH BASINS SHALL BE PRECAST AS PER OPSD 705 SERIES.
- SANITARY SEWERS SHALL BE INSTALLED WITH BEDDING AS PER REGIONAL STANDARD DRAWING 2-3-1.
- BEDDING FOR PVC STORM SEWER PIPE SHALL BE IN ACCORDANCE WITH CITY OF MISSISSAUGA STANDARD DRAWING NO. 2112.080.
- SEWER BEDDING SHALL CONFORM WITH OPSS 1010 FOR GRANULAR "A" OR CITY STANDARD DRAWING NO. 2112.100 OR 2112.140.

- ALL GRANULAR BEDDING AND BACKFILL MATERIAL SHALL CONFORM TO THE REQUIREMENTS OF OPSS 1010 AND MUST NOT CONTAIN RCM/RAP.
- ALL VALVE 300MM DIAMETER AND SMALLER SHALL BE EQUIPPED WITH VALVE BOXES AND RESTRAINED AND VALVE FITTING WRAPPED IN CORROSION PROTECTION TAPE.
- ALL APPROVED NATIVE MATERIAL SHALL BE FREE OF FROZEN LUMPS, CINDERS, ASHES, ASPHALT REFUSE, ORGANIC MATTER, ROCKS AND BOULDERS OR OTHER DELETERIOUS MATERIALS.
- ALL WATERMAIN FITTINGS SHALL BE MECHANICALLY RESTRAINED. DETAILS OF RESTRAINTS SHALL BE DESIGNED, STAMPED AND SIGNED BY A PROFESSIONAL ENGINEER AS PART OF SHOP DRAWINGS BY THE CONTRACTOR.
- THE CONTRACTOR SHALL RETAIN THE SERVICES OF A MOECC LICENSED CONTRACTOR SPECIALIZING IN THE PROVISION OF DISINFECTION SERVICES FOR ALL WATERMAIN TESTING REQUIRED IN THIS CONTRACT.
- TRACER WIRE IS TO BE INSTALLED ON ALL NEW PVC WATERMAIN PIPES.
- THE TOP OF VALVE BOX AND CHAMBER COVERS SHALL BE SET FLUSH WITH FINISHED GRADE AND REMAIN ACCESSIBLE AT ALL TIMES.
- WATER SERVICES, A 12-GAUGE TWJ STANDARD COPPER, LIGHT COLORED, PLASTIC COATED TRACER WIRE MUST BE INSTALLED WITH AND ALONG THE PIPE AND BROUGHT TO THE SURFACE AT EACH SERVICE BOX. TRACER WIRE IS TO BE ATTACHED TO THE PIPE AND OUTSIDE OF EACH SERVICE BOX BY MEANS OF TAPE OR RUBBER GROMMET.
- CHAMBER AS PER REGION STANDARD DRAWING NUMBER 1-1-5.
- DETECTOR CHECK VALVE AS PER REGION STANDARD DRAWING NUMBER 1-3-1.
- PROPOSED WATER CONNECTION AS PER REGION STANDARD NUMBER 1-6-4 AND 1-8-3
- FOR DETAILS OF THE PROPOSED TRENCH DRAIN, ROOF DRAIN, SERVICE CONNECTIONS, WATER METER AND BACKFLOW PREVENTER REFER TO MECHANICAL DRAWING.

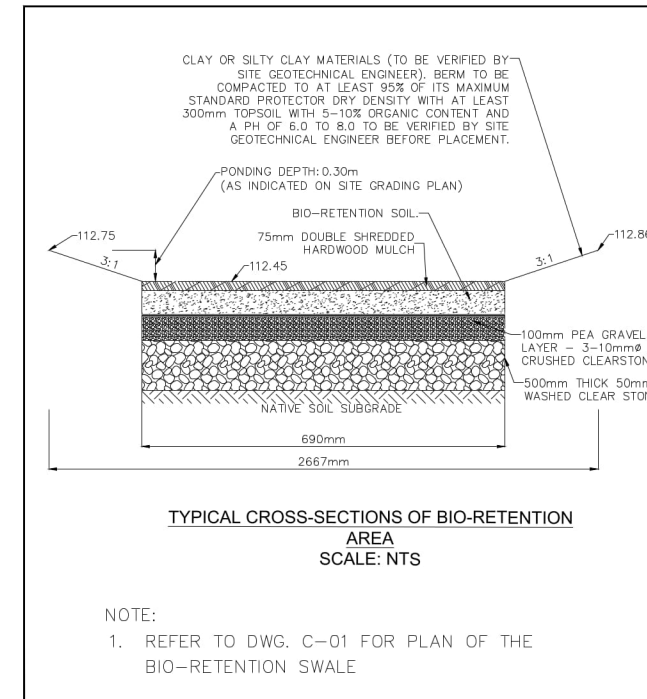

NOTE:  
1. REFER TO DWG. C-01 FOR PLAN OF THE BIO-RETENTION SWALE

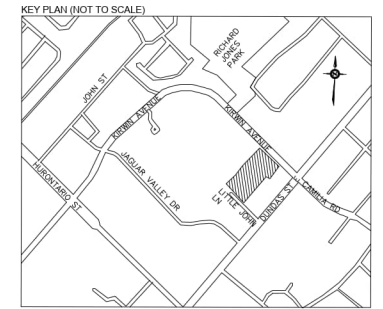

2	ISSUED FOR ZBA RE-SUBMISSION	2022-12-19	P.R.	F.J.L.
1	ISSUED FOR ZBA SUBMISSION	2021-03-19	F.J.L.	B.H.
No	Revision	Date	By	App



625 Cochrane Drive, Suite 900  
Markham, Ontario  
L3R 9R9, Canada  
Tel: (905)470-0015  
Fax: (905)470-0030



Owner/Client:  
**DVB REAL ESTATE INVESTMENTS INC.**

Location:  
**3031 LITTLE JOHN & 3016-3032  
KIRWIN AVE DEVELOPMENT**

Title:  
**GENERAL NOTES**

Designed By: F.M. Drawn By: J.W. Checked By: F.M.  
Scale: NTS Date: FEB, 2021 Drawing No.: C-07  
Project No.: 21111

# APPENDIX H

## Geotechnical and Hydrogeological Investigation





# APPENDIX H-01

## Watertight Foundation Letter



DVB Real Estate Investments Inc.  
4918 King St., P.O. Box 1194  
Beamsville Ont.  
L0R 1B0

29/Nov/2022

**Attention:** Executive Director, Engineering and Construction Services  
c/o Manager, Development Engineering

Dear Sir or Madam,


I Francesco Bertola, confirm and undertake that I will construct and maintain all building(s) on the subject lands at 3016, 3020, 3026, 3032 Kirwin Avenue & 3031 Little John Lane in Mississauga in a manner which shall be completely water-tight below grade and resistant to hydrostatic pressure without any necessity for Private Water Drainage System (subsurface drainage system) consisting but not limited to weeping tile(s), foundation drain(s), private water collection sumps(s), private water pump or any combination thereof for the disposal of private water on the surface of the ground or to a private sewer connection directly or indirectly or drainage system for disposal directly or indirectly in a municipal sewer.

A letter from a Professional Engineer confirming the design and implementation of a water-tight structure shall be provided as part of the site plan approval application.

Francesco Bertola - President  
Name (printed) and Title

[francescob@fbhgroup.ca](mailto:francescob@fbhgroup.ca)

Email

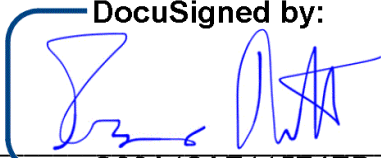**DocuSigned by:**  
  
Signature C00A12AE11574EB...

I Francesco Bertola, have the authority to bind the corporation

# APPENDIX H-02

## HYDROGEOLOGICAL ASSESSMENT





October 24, 2022

Project No. 2202-001

Page 1 of 2

Weston Consulting  
201 Millway Avenue #19, Concord  
ON, L4K 5K8

Attention: Mr. Kaveh Wahdat - Planner

**Re: Hydrogeological Assessment  
3016-3032 Kirwin Avenue & 3031 Little John Lane  
Mississauga, Ontario**

---

Dear Sir:

Azure Group Inc. (Azure) was retained by Weston Consulting (The Client) to conduct a Hydrogeological Assessment at the property located at 3016-3032 Kirwin Avenue & 3031 Little John Lane in Mississauga, Ontario (The Subject Property). Azure thereby retained in partnership Azimuth Environmental Consulting, Inc. (Azimuth) to complete the Hydrogeological Assessment. As indicated in the completed report, the purpose of the Hydrogeological Assessment was to characterize the existing hydrogeological conditions at and in the vicinity of the Site, assess the need for, and options for, groundwater control in association with the proposed construction, evaluate potential impacts to the local groundwater regime resulting from the proposed construction, and identify appropriate mitigative measures, as warranted.

At the time of the site visit(s), the Site was vacant land covered with bushes, shrubs and trees. Vehicular access to the Site was from a gravel paved driveway off of Kirwin Avenue and Little John Lane, located on the northern and southern boundaries of the property. The Site had a total area of approximately 6,609 m<sup>2</sup> (1.6 acres). Azure retained Altech Drilling & Investigative Services Ltd., Ontario to complete the drilling program and Azure's representatives were on-site from April 6th, 2022 to April 8th, 2022 to conduct the field work. The scope of work consisted of the drilling of ten (10) boreholes (BH1 to BH10) to a maximum depth of approximately 9.0 metres (m) below grade or until refusal. Boreholes BH1, BH2, BH3, BH101 and BH106 were completed as groundwater monitoring wells. Representative soil samples were retrieved from each borehole and submitted for analyses of moisture content and grain size analysis. All figures showing the approximate location of the boreholes are included in the following report completed by Azimuth.



## **CLOSURE**

This report has been prepared for the benefit of Weston Consulting (The Client), and their clients.

Any other person or entity without the express written consent of Azure Group Inc. (Azure) and the client may not rely upon the report. Any use that a party makes of this report, or any reliance on decisions made based on it, are the responsibility of such parties. Azure accepts no liability and no responsibility whatsoever for damages, if any, suffered by any party as a result of decisions made or actions based on this report.

An environmental site characterization is a limited sampling of a site. The conclusions given herein are based on information gathered at the specific locations and can only be extrapolated to an undefined limited area around these locations. The extent of the limited area depends on the soil and groundwater conditions, as well as the history of the subject property reflecting natural, construction, and other activities. In addition, analyses have been carried out for a limited number of chemical parameters, and it should not be inferred that other chemical species are not present.

Due to the nature of the investigation and the limited data available, Azure cannot warrant against undiscovered environmental liabilities. No other warranty or representation, either expressed or implied, is included or intended in this report. Should any conditions at the site be encountered, which differ from those at the sampling locations and/or additional site information become available, Azure requests that this information be brought to our attention so that we may re-assess the conclusions presented herein. It should also be noted that current environmental Regulations, Guidelines, Policies, Standards, Protocols and Objectives are subject to change, and such changes, when put into effect, could alter the conclusions and recommendations noted throughout this report.

We trust this is satisfactory. Should any queries arise, please feel free to contact this office.

Yours truly,

**AZURE GROUP INC.**



**Preliminary Hydrogeological Assessment**  
**3016 – 3032 Kirwin Ave., Mississauga, Ontario**

Prepared for:  
Azure Group

Prepared by:  
Azimuth Environmental  
Consulting, Inc.

October, 2022

AEC 22-056



Environmental Assessments & Approvals

October 24, 2022

AEC 22-056

Azure Group  
6751 Professional Court, Suite 201  
Mississauga, Ontario  
L4V 1Y3  
Attention: Samantha Desgrosseilliers

Re: **Preliminary Hydrogeological Assessment:  
3016 – 3032 Kirwin Ave., Mississauga, Ontario**


Dear Samantha,


Azimuth Environmental Consulting, Inc. (Azimuth) is pleased to provide our Preliminary Hydrogeological Assessment for the property 3016 – 3032 Kirwin Ave., within the City of Mississauga (the “Site”). This evaluation focused on the existing soil and ground water regime underlying the Site and the potential for the proposed eight (8) story residential building and associated parking development to impact the existing conditions.

Should you have any questions or wish to discuss the report in greater detail, please do not hesitate to contact the undersigned.

Yours truly,

AZIMUTH ENVIRONMENTAL CONSULTING, INC.

  
Brendan MacNaughton, B.Sc (Hons), EP.  
Environmental Scientist

  
Colin Ross, B.Sc, P.Geo.  
Senior Hydrogeologist

M:\Projects3\22 Projects\22-056 Kirwin Ave. Hydrog Assessment\05.0 - Reporting\05.2 - Draft\220406- 22-056- Kirwin Ave Hydrogeologic Report -FINAL.docx



## Table of Contents

	page
<b>1.0 INTRODUCTION.....</b>	<b>1</b>
1.1 Background .....	1
<b>2.0 ENVIRONMENTAL SETTING .....</b>	<b>1</b>
2.1 Soil .....	1
2.2 Physiography .....	2
2.3 Topography and Drainage .....	2
2.4 Bedrock Geology .....	2
2.5 Quaternary Geology .....	2
2.6 Hydrogeology.....	3
<b>3.0 SOURCE WATER PROTECTION.....</b>	<b>5</b>
<b>4.0 MONITORING .....</b>	<b>5</b>
4.1 Previous Site Investigations .....	5
4.1.1 Site Drilling & Monitoring Well Installations.....	5
4.2 Ground Water Level Monitoring .....	5
4.3 Hydraulic Conductivity Testing .....	6
4.4 Water Quality.....	7
<b>5.0 WATER BALANCE .....</b>	<b>7</b>
5.1 Land Use .....	8
5.1.1 Pre-Development .....	8
5.1.2 Post-Development .....	8
5.2 Infiltration .....	9
5.2.1 Pre-Development Infiltration.....	9
5.2.2 Post-Development Infiltration .....	10
5.3 Water Balance Summary .....	10
<b>6.0 DEWATERING ASSESSMENT.....</b>	<b>10</b>
6.1 Drawdown Conditions.....	10
6.2 Approximate Dewatering Volumes .....	11
6.3 Impact Assessment.....	13
<b>7.0 SUMMARY AND CONCLUSIONS .....</b>	<b>13</b>
<b>8.0 REFERENCES.....</b>	<b>16</b>





## **List of In-Text Tables**

	page
Table 1: MECP Water Well Database Summary (500 m radius from Site).....	4
Table 2: Ground Water Elevation Data .....	6
Table 3: Hydraulic Testing Results .....	7
Table 4: Pre-Development Area Classification .....	8
Table 5: Post-Development Area Classification.....	8
Table 6: Summary of Pervious Land Infiltration Factor.....	9

## **List of Figures**

Figure 1	Property Location
Figure 2	Site Layout
Figure 3	Natural Features and Surrounding Well Records
Figure 4	Monitoring Well Locations and Ground Water Flow

## **List of Appendices**

Appendix A:	Figures
Appendix B:	Proposed Development Plan
Appendix C:	MECP Well Records & Site Borehole Logs
Appendix D:	Water Balance Summary Tables
Appendix E:	Hydraulic Conductivity Testing
Appendix F:	Water Quality Data



## **1.0 INTRODUCTION**

Azimuth Environmental Consulting Inc. (Azimuth) has been retained by the Azure Group to conduct a Preliminary Hydrogeological Assessment for the property 3016-3032 Kirwin Avenue within the City of Mississauga (the “Site”) (Figure 1).

The purpose of this assessment is to characterize the existing hydrogeological conditions at the Site, and determine any potential constraints to the proposed development plan. This assessment also addresses Source Water Protection policies developed under the *Clean Water Act* as they pertain to water quantity and quality issues.

### **1.1 Background**

The Site is rectangular in shape, 6,385 m<sup>2</sup> (0.6 hectares (ha)) in size and is to be redeveloped as an 8 storey residential building with Underground parking. The Site is located on the south side of Kirwin Avenue; a small cleared area remains from the historical residential dwellings at the Site along the east of the site. As per the proposed development plans provided, the development will be accessed from Kirwin Avenue and will include two (2) below grade parking levels extending approximately 7 m below grade. The proposed Site development plans are provided in Appendix B.

The purpose of this assessment is to characterize the existing physical geological and hydrogeological conditions at the Site and the potential for the proposed development to impact the existing environmental / hydrogeological conditions. The report follows a standard format addressing typical requirements of both the City of Mississauga and Credit Valley Conservation Authority for hydrogeological submissions within the Credit Valley source water protection zone.

## **2.0 ENVIRONMENTAL SETTING**

### **2.1 Soil**

The Soil Map of Peel County (Report No. 18) (Hoffman, et al., 1953) defines the surficial soil for the Site as part of the Cooksville Series; however the Site sits just north of the divide between the Fox Series which uses the location of Dundas Street in the 1950’s as the divide. Based on the mapping, the region is also crosscut with Alluvial fans (Alluvial Series) spreading north from the Lake Ontario shoreline. For the purposes of this investigation we will assume that the location of Dundas Road has not significantly moved and the Site sits within the Cooksville Series. The Cooksville Series is described as shallow or very shallow surficial dark grey clay laden loams overtop of shallow grey shale. Cooksville clay Loams are classified within Soil Group D. Group D soils represent material with very high runoff potential and restricted to highly restrictive



infiltration rates. Of note Soils within Group D can have high shrink/swell potentials. This soils description is line with the physical investigation done onsite.

## **2.2 Physiography**

The Ontario Geologic Survey (Chapman and Putnam 1984) describes the Site area as being located within the Iroquois Plain physiographic region. This region extends from the Trent River approximately 300 km to the Niagara River. The Iroquois Plain is subdivided into 8 regions; the Subject Site sits within the Hamilton to Toronto region, a thin region defined by the current and ancient shoreline of Lake Iroquois. This section is represented by multiple sand and gravel alluvial outwash sections and the flat, smoothed historic fine grained bedding of Lake Iroquois.

## **2.3 Topography and Drainage**

The topographic relief at the Site is quite limited with elevations ranging from approximately 113 masl in the north along Kirwin Avenue to a low of 110 masl in the south west along Little John Lane. The current Site drainage is expected to follow the local topographic dip to the southwest towards Cooksville Creek, located approximately 70 m west of the Site, although any surface runoff exiting the Site is expected to be captured by the municipal drainage system in the area. Run on to the Site is not expected from the surrounding developments based on the topographic setting and curb and gutters present along the upslope side of the Site.

## **2.4 Bedrock Geology**

The underlying bedrock geology has been described by the Ontario Geologic Survey (OGS) as being composed of grey calcareous shale of the Georgian Bay Formation of (Ontario Geologic Survey , 2011). The formation is Upper Ordovician in age. Based on the thickness mapping surrounding the site the Site, bedrock can be expected somewhere between 3 and 8 mbgs (Gao, et al., 2006), which is in agreement with the results of the boreholes advanced on Site. Shallow bedrock was identified in BH1, 2 and 3, all having weathered shale identified within the soil samples in the lower section of each log.

## **2.5 Quaternary Geology**

The Quaternary Soil Map of Ontario (Onatrio Geological Survey, 2003) defines the local surficial soils in the vicinity of the Site as Paleozoic in age comprised of undifferentiated carbonate and clastic sedimentary rock, which is exposed at surface or covered by a discontinuous, thin layer of drift. This area also borders on an area characterized as the Halton Till, which consists predominantly of a silt to silty clay matrix. The Halton Till is texturally variable but is generally a sandy silt to clayey silt till interbedded with silt, clay, sand and gravel. In some areas it is very clay-rich where the Ontario Ice Lobe has



overridden glaciolacustrine deposits of the Lake Ontario basin. The Halton Till is typically 3 to 6 m thick but locally it can exceed 15 to 30 m in thickness in the western part of the study area.

Based on the Site specific soils data provided by the Azure Group subsurface investigation the Site is underlain by a thin topsoil layer (10 cm) overtop of a fill mixture consisting of sand, silt and clay of different compositional percentages to a depth of around 3.5 mbgs. Below this level the boreholes intersect a native Silty-Clay layer to the upper contact of the underlain Weathered Shale bedrock which was encountered in five (5) of the advanced boreholes below 7 mbgs, all of the boreholes all indicate a content of weathered Shale fragments below ~6.5 mbgs. The inclusion of the fragments indicate that the bedrock interface is very close to this depth, which is in agreement with both afore mentioned mapped Quaternary description and the drift thickness mapping results. Based on the observed Site soils, it is likely these material represent Halton Till.

For reference, the borehole locations are illustrated on Figure 2, while the borehole logs are provided in Appendix C.

## **2.6 Hydrogeology**

The Ontario Ministry of Environment, Conservation, and Parks (MECP) Water Well Records were referenced for any recorded well information within the vicinity of the Site (500 m) (MECP, 2021). The Site and surrounding area is likely to be serviced with water and sewer utilities; however well records can be used to gain subsurface information which can provide insight into shallow geological formation within the area. The well records found in the vicinity of the Site that are pertinent to this assessment are summarized in Table 1 and are shown on Figure 3. The thirty-six (36) surrounding wells in the MECP well record database indicate that one (1) was a decommission record, one was completed in 1952 and is the only record of a potable water supply well (No. 4902211). The remaining thirty-four (34) well records were for advanced as test holes in the area. The wells were drilled to depths between 3 and 15 m. Nine of the well records were not available online. The remaining records have been included in Appendix C. The well records indicate that the grey /blue shale bedrock surface is quite limited, between 2 and 5 mbgs in fourteen of the well records. The overburden soils identified in these records were primarily clay and silt with some sand and or gravel, which matches the geological literature outlined above, as well as the Site specific soils identified the drilling program. Given the age of the wells and the fact the area has been municipally serviced for many years, it is unlikely that the supply well is still in use.



**Table 1: MECP Water Well Database Summary (500 m radius from Site)**

Well ID	Date Completed	Depth (m)	Depth to Bedrock (m)	Distance to Site (m)	Direction to Site
4902211	1958-11-12	15.5	5.2	201	N
4909841	2005-06-30	7.6	7.6	201	NNE
7107988	2008-06-02	6.1		215	SW
7140001	2010-01-20	6.7	6.1	233	E
7144432	2010-03-22	3.7		201	E
7145320	2010-04-28	4.8	2.5	467	NE
7148379	2010-06-21	3.1		262	NW
7148380	2010-06-21	3.4		260	NW
7148381	2010-06-21	0		415	NW
7196498	2012-10-09	7.6		115	SW
7202168	2012-11-20	6.09		200	SE
7210777	2013-10-11	5.5		60	S
7210806	2013-10-11	4.9		61	S
7210807	2013-10-11	4.7		62	S
7263541	2016-04-11	5.2	4.3	260	W
7263542	2016-04-11	5.2	3.7	265	W
7263543	2016-04-11	5.2	4.3	280	W
7263544	2016-04-24	1.4		285	W
7277547	2016-11-18	3		290	W
7277548	2016-11-17	3	3.0	430	SW
7278591	2016-11-25	5.3	2.5	360	NW
7296547	2017-09-12	4		425	SSW
7296548	2017-09-12	4		430	SSW
7296549	2017-09-12	4.3	3.0	420	SSW
7306688	2017-09-13	7.6		0	Onsite
7330071	2018-12-17	4		445	S
7332231	2019-04-08	4.5	2.1	350	NW
7345861	2019-07-03	3.7		326	NW
7345862	2019-07-03	3.7		325	NW
7358771	2020-04-24	0		410	SW
7358772	2020-04-24	0		400	SW
7358773	2020-04-24	0		400	SSW
7361501	2020-03-12	0		351	NW
7378766	2020-12-09	6.7	4.6	0	Onsite
7378767	2020-12-09	6.7	4.6	0	Onsite
7378768	2020-12-09	6.7	4.6	0	Onsite



### **3.0 SOURCE WATER PROTECTION**

A review of the Source Water Protection Areas as identified on the MECP Source Protection Information Atlas website indicates the Site is contained within South Peel Drinking Water Intake Protection Zone (IPZ) 2, as well as within a Highly Vulnerable Aquifer Area (HVA). However, it is not within a Significant Ground Water Recharge Area (SGRA), Wellhead Protection Area (WHPA-D), WHPA-Q2, Issues Contributing Area (ICA). Given the IPZ, consideration may need to be given for stormwater control measures at the Site.

### **4.0 MONITORING**

#### **4.1 Previous Site Investigations**

Azure Group Inc. completed a geotechnical drilling program at the Site in 2022 and it is also understood that a previous Phase II Environmental Site Assessment (ESA) as completed which included drilling and installation of monitoring wells on Site. These reports were not available at the time of report issuance: however, the borehole logs for the current monitoring wells on Site were provided and utilized in this assessment. The details of which are summarized in subsequent sections.

##### **4.1.1 Site Drilling & Monitoring Well Installations**

A drilling program was undertaken by Azure as part of the above mentioned geotechnical between April 1<sup>st</sup> and April 8<sup>th</sup> 2022. Ten (10) boreholes were advanced across the site, three (3) were then completed as ground water monitoring wells for the Site as illustrated on Figure 4, with borehole logs and a location plan included in Appendix D. It is noted that a collection of 3 additional historic wells are present at the Site from an Azure site investigation in December 2020 as well as two (2) additional wells, the history and construction details are not known, these are assumed to be related to the wells installed in 2017 (Appendix C record number 7306688 ). The onsite wells are summarized Table 2 below.

#### **4.2 Ground Water Level Monitoring**

As part of assessment, ground water levels were monitored on the May 11<sup>th</sup> 2022 by Azimuth staff. The ground water measurements have been included within Table 2 below and used to create Figure 4 with the inferred groundwater flow direction.

Currently the base of the underground parking level has been established at 6.7 mbgs such that the building foundation will encroach into the water table by up to ~1.5 m. As such, these seasonally high ground water elevations need to be considered in the building design such that proper waterproofing is being incorporated within the basement level.



The inferred ground water flow direction is illustrated on Figure 4, which shows a south flow pattern, which matches the direction of a buried section of the Cooksville Creek.

**Table 2: Ground Water Elevation Data**

Ground Water Elevation Table												
Azimuth Project Number			22-056									
Project Site			Kirwin Ave									
Town/Region			Mississauga, Peel									
			GPS (Zone 17)									
Well ID	Easting	Northing	Elevation (MRD)	Stick Up	Elevation of Screen Bottom (mASL)	Elevation of Screen Top (mASL)	Date	Depth to Water (mBTOP)	Depth to Bottom (mBTOP)	Depth to Water (mBGS)	Depth to Bottom (mBGS)	Groundwater Elevation (mASL)
BH1	612103	4826454	113.31	0.85	106.69	109.74	05-11-2022	5.06	7.47	4.21	6.62	109.10
BH2	612080	4826562	112.56	0.65	104.97	108.02	05-11-2022	5.94	8.24	5.29	7.59	107.27
BH3	612091	4826465	113.31	1.10	106.68	109.73	05-11-2022	5.36	7.73	4.26	6.63	109.05
BH101	612090	4826483	113.39	1.04	107.11	110.16	05-11-2022	5.75	7.32	4.71	6.28	108.68
BH106	612033	4826412	110.78	0.92	105.28	108.33	05-11-2022	3.87	6.42	2.95	5.50	107.83
Unknown 1*	612108	4826460	113.0*	0.79	105.34	108.39	05-11-2022	4.96	8.45	4.17	7.66	108.83
Unknown 2*	612101	4826439	112.5*	0.68	104.97	108.02	05-11-2022	4.75	8.21	4.07	7.53	108.43

GPS Location based on hand held device and is not a Surveyed location.  
Elevations are in metres above sea level (mASL) Provided by Azure  
\*BH with unknown origin on site close to locations of BH 102 and 103, no known elevation was surveyed

### 4.3 Hydraulic Conductivity Testing

In order to understand the hydraulic characteristics of the underlying overburden, transient hydraulic tests were performed on the Site monitoring wells following the 2022 drilling program. The transient test involves the instantaneous injection or withdrawal of a volume or slug of water or solid cylinder of known volume. This is accomplished by adding or displacing a known volume to/from a well and measuring water level response time to return to equilibrium. Water level measurements were recorded both manually and with automatic dataloggers, which were programmed to record the pressure of water above the data logger every second. Data was analyzed using the Hvorslev Method (1976) for unconfined aquifers, which assumes a homogeneous, isotropic medium in which soil and water are incompressible. Hydraulic testing results are summarized in Table 3 (below).

The soil transmissivity for the Site is varied by an order of magnitude. Based on the local geology reported from both the borehole logs and from the surrounding water well records this is what was expected. The result of the slug test is included in Appendix E. The measured hydraulic conductivity is within the published range for a silty clay material (Freeze & Cherry, 1979).



**Table 3: Hydraulic Testing Results**

Hydraulic Test Results				
Azimuth Project Number		22-056		
Project Site		Kirwin Avenue		
Town/Region		Mississauga, Peel Region		
Well	Test Date	Screen Interval (MRD)	Screen Material	Hydraulic Conductivity (m/sec)
BH/MW106	2022-04-08	108.3-105.2	Clay/Silt	5.56E-09
BH/MW2	2022-04-08	108.2-104.9	Clay/Silt	2.28E-08
Site Average				1.42E-08
Site Max				2.28E-08

#### 4.4 Water Quality

A water quality sample was taken from one onsite well location to provide some insight to the requirements of dewatering water treatments. The results of which are included in Appendix F. The results are compared to the Provincial Water Quality Standards as the discharge point is unknown at this time; the City of Mississauga has both storm and sanitary sewers in the area, as well as a watercourse to the south (Cooksville Creek). The PWQO Standards were chosen as they are more stringent than that of the sewer bylaw standards. Of the tested parameters Total Phosphorous exceeded the PWQO standard. The total phosphorus concentrations are significantly elevated, but this along with the metal constituents are interpreted to be sourced from the elevated sediment load in the sample; this is evidenced by the elevated turbidity at these locations (181 NTU). The nutrient analysis was completed on water that was unfiltered, and therefore contained high concentration of sediment particles. The increased phosphorus is therefore likely attributed to the excess nutrients that are bound to the sediment grains in suspension and dissolved within the acidified nutrients bottle. As such, discharge of any potential dewatering effluent into storm sewer or natural environment would not likely represent any impact assuming proper sediment controls are in place for any dewatering discharge. To confirm the effluent discharge into the storm sewer system, a secondary sample meeting all of the requirements of The City By-Law would need to be collected, which can be confirmed ahead of any potential construction dewatering.

#### 5.0 WATER BALANCE

In order to determine the potential changes to the natural ground water recharge conditions, a pre- and post-development water balance assessment has been completed using the Thornthwaite and Mather method (1957). This method evaluates evapotranspiration based on precipitation and temperature. Residual soil saturation is a function of topography and soil type. Monthly data are tabulated from daily average





temperature and precipitation, and the water budget is a continuous calculation over the period of record. To clarify, the method and the approach used by many individuals in examining infiltration resets annual conditions (moisture deficit, snow storage, etc) over the winter months because of the general lack of infiltration during the frost period. However, we maintain those records and carry them forward from month to month during the entire period of record.

Values were determined on a monthly basis, compiled from daily Environment Canada meteorological data station located in Toronto Leaster B. Pearson International Airport (Station 6158733), Ontario between 1950 and 2021. The calculations are based on the average conditions during this period; the average precipitation was 779 mm, rainfall was 632 mm, evapotranspiration was 490 mm and the surplus was 289 mm.

## 5.1 Land Use

### 5.1.1 Pre-Development

The pre-development Site area was classified according to land use/vegetation type. Approximate pre-development land use classification areas are provided in Table 4.

**Table 4: Pre-Development Area Classification**

Land Use	Land Area (m <sup>2</sup> )
Forest	4,300
Landscaped Grass	2,085
<b>TOTAL</b>	<b>6,385</b>

Land within the pre-development scenario is considered 0% impervious

### 5.1.2 Post-Development

The land classification in the post-development scenario was classified based on the Site Development Plans (Appendix B). Post-development land use classification areas are provided in Table 5:

**Table 5: Post-Development Area Classification**

Land Use	Land Area (m <sup>2</sup> )
Impervious(building/driveway)	3,433
Pervious (landscaped/undeveloped)	502
<b>Parkland Dedication</b>	<b>2,450</b>
<b>TOTAL</b>	<b>6,385</b>

Land within the post-development scenario is considered 54% impervious. The post-development areas are illustrated in Appendix B.



It is noted that impervious areas included landscaped areas atop the below grade parking structure and any infiltration in these areas will likely be required to be drained to sewer or discharged to surface via a sump pump such that no infiltration would be expected.

## 5.2 Infiltration

Infiltration is generated one of two ways: (1) directly from rainfall impact or snowmelt on pervious surfaces; and (2) indirectly when runoff from impervious surfaces is diverted into adjacent naturalized areas.

Infiltration factors for the Site were estimated based on the underlying soil, local topography, and ground cover as per Table 2 of the Ministry of Environment and Energy (MOEE) Hydrogeological Technical Information Requirements for Land Development Applications (1995).

The soil variable factor was determined by taking into account information obtained from the regional geologic mapping and the field work programs completed for the Site. This information suggests that the surficial material at the Site is primarily composed of a silty clay. The infiltration factors utilized in the water balance assessment are summarized in Table 6 below.

**Table 6: Summary of Pervious Land Infiltration Factor**

Scenario	Land Use	Infiltration Factor	Assumption
Pre-Development	Landscaped Grass	0.4	Flat Land (0.2), Clay/silt (0.1), Maintained Grass Cover (0.1)
	Forest	0.5	Flat Land (0.2), Clay/silt (0.1), Woodland cover (0.2)
Post-Development	Landscaped Grass	0.4	Flat Land (0.2), Clay/silt (0.1), Maintained Grasses (0.1)
	Dedicated Parkland	0.5	Flat Land (0.2), Clay/Silt (0.1), Woodland Cover <sup>1</sup> (0.2)

1- Dedicated Parkland surficial cover is assumed to be a mix of treed space to match the John C. Price Parkland existing adjacent to the dedication lands.

### 5.2.1 Pre-Development Infiltration

Pre-development direct infiltration was determined by multiplying the annual average surplus amount, the area of each land use, and the infiltration factor for each land use. The pre-development annual infiltration is therefore 862 m<sup>3</sup>/year (Appendix D).



### 5.2.2 Post-Development Infiltration

Post-development infiltration (without mitigation) was determined by multiplying the annual average surplus amount, the area of each land use, and the infiltration factor for each land use. The post-development annual direct infiltration is therefore 412 m<sup>3</sup>/year. There is therefore a decrease in infiltration of 450 m<sup>3</sup>/year from pre- to post-development without mitigation measures employed.

## 5.3 Water Balance Summary

Using the climate model data and calculations mentioned above, the water balance was completed for pre-development and post-development without mitigation (Appendix D) as no stormwater drainage plans were available at the time of reporting.

The pre-development infiltration volume is 862 m<sup>3</sup>/year. This assumes the Site is vacant as it sits today. The post-development without mitigation infiltration volume is 412 m<sup>3</sup>/year, which is a deficit of 450 m<sup>3</sup>/year. This is based on the proposed development as described in Section 1.0 of this report and illustrated in Appendix B (Site Development Plans).

## 6.0 DEWATERING ASSESSMENT

As noted above, the proposed development and associated underground parking and servicing, have been shown to be positioned below the water table. In this area, ground water elevations are represented by the installed monitoring wells. Based on the monitoring completed on the wells, the high ground table sits at 109.10 mASL, and the estimated base of the two (2) level underground parking slab proposed to be at 6.7 mbgs (107.45 mASL). Given these elevations place the foundation approximately 3.6 m into the water table (approximately 2m below the slab), for a dry working area at the base of the excavation, a construction dewatering plan will be needed.

Since the required drawdown is greater than 1.5 m, the use of shallow well points or educator systems may be required. The exact dewatering methodology will depend on site-specific conditions and will be determined by the dewatering contractor.

Dewatering discharge is assumed to be handled on-site with discharge ultimately being into either the municipal stormwater or sanitary infrastructure assumed to run along Kirwin Avenue.

### 6.1 Drawdown Conditions

The details utilized for this assessment are derived from the KEA design drawings (Appendix B). These details including location, width, length and base elevations for the



proposed building were utilized to determine the maximum drawdown required for construction in relation to the water table conditions for the Site as illustrated in Figure 4 appended.

Although the water table contouring illustrated on Figure 4 shows a decline to the south, for the purposes of the dewatering assessment, it has been assumed a high water table elevation of 109.10 mASL (BH/MW1) extends across the entire site area. In reality, there is a likely decline as illustrated in the contours toward the southeast which could limit the drawdown requirements for the south section of the excavation; however, this conservancy is utilized to address the limited ground water elevation points in this area as monitoring well coverage is limited on the Site. Regardless, based on the measured high ground water table (109.10 mASL) and the excavation base elevations (105.45), ground water lowering during construction will be approximately 3.6 m. This is based on the following assumptions:

- Construction ground water lowering will target a depth of 2 m below the base of the P2 slab to ensure dry working conditions within the utility trenching needed below the slab and footings;
- To be conservative, the hydraulic conductivity value referenced ( $2.28 \times 10^{-7}$  m/sec) in this assessment has been increased from the high-end estimate of the overburden aquifer single well response testing (SWRT) included in Appendix G a order of magnitude. This was done to account for potential higher permeable horizons than what was tested;
- The most elevated ground water elevation / depth of ground water was assumed to apply to the area; and
- The entire proposed building is assumed to be constructed as single dewatering undertaking installed at one time. If the dewatering was done in sections, then the volumes and Zone of Influence would be reduced;

The actual drawdown will depend on construction timing.

## **6.2 Approximate Dewatering Volumes**

For the dewatering a rectangular configuration where the relationship of length/width is greater than 1.5, calculations for the dewatering rate / volume were completed using the steady state method from Powers, *et al.* (1992) for estimating radial flow to an excavation in an unconfined aquifer.



The following equation was used:

$$Q = \frac{\pi K(H^2 - h^2)}{\ln\left(\frac{R_o}{R_s}\right)} + 2\left(\frac{LK(H^2 - h^2)}{2L}\right)$$

Based on Equation 6.12 in systems where  $l/w > 1.5$  (Powers, P.E., 1992) Where:

Q (m<sup>3</sup>/Day)  
K - Hydraulic Conductivity (m/Day)  
H - Distance from Static water level to bottom of Aquifer (m)  
h - lowest water level needed from static (m)  
R<sub>o</sub>- Radius of conical depression (m) (Taken from Equation 6.14(Powers, P.E., 1992))

$$R_o = 3(H - h)\sqrt{k}$$

Where

K- Hydraulic Conductivity (m/Sec)  
R<sub>s</sub> - Equivalent Radius (m)

$$R_s = \frac{l + w}{\pi}$$

l- Length of excavation/trench  
w- width of trench  
in systems where  $l/w > 1.5$

The full dewatering assessment can be found in Appendix G

Based on the information provided, the dewatering required for construction is 27,720 L/day. A 3x safety factor can then be applied to each of the above volumes for a conservative estimate (83,160 L/day). These values are based on worst case spring season ground high ground water table depths. The dewatering volume could be lower during the summer and fall months.

Any construction dewatering between 50,000 L/day and 400,000 L/day can be completed after registration under the Environmental Activity and Sector Registry (EASR). Any active construction dewatering above 400,000 L/day requires a Permit To Take Water (PTTW). As noted above, the magnitude of dewatering required will vary on the timing of construction and less dewatering could be needed in the summer drought conditions. Peak ground water elevation typically occurs between mid April and the end of May. Based on the calculations, it is likely that construction dewatering would be above the 50,000 L/day but below the threshold of 400,000 L for a PTTW, as such an EASR will be required. Potential dewatering requirements can be minimized if work is completed during the drier summer months.

Not included in the calculations above is the influx of stormwater from single 24 hour storm events. These numbers are estimated based on the Ministry of Transportation (Ministry) Intensity Duration Frequency (IDF) curves. Using the numbers provided by the Ministry, if the Site experiences a five (5) year storm event (56 mm across 24 hours) during the excavation an additional 289 m<sup>3</sup> (219,000 L) into the excavation, in this event, pumping could continue under the registered EASR. Any of the larger less frequent (10



yr, 25 yr, 100 yr) storm events would require a staged approach where the excavation could be pumped at the 400,000 L/day over two (2) days to facilitate the removal of the storm water without exceeding the threshold of requiring a PTTW registration.

### **6.3 Post Construction Dewatering**

It is our understanding that although the finished floor elevation of the building foundation encroaches into the water table by approximately 1.6 m, the planned waterproofing of the foundation will limit potential concerns with respect to the ground water at the Site with regards to permanent dewatering of the Site.

However, if the foundation is not waterproofed and the same assumptions as above are used, substituting the final floor elevation would be utilized for the dewatering depth (107.45 mASL) establishing a dewatering requirement of approximately 18 m<sup>3</sup>/day. A 3x safety factor can then be applied to the above volumes for a conservative estimate of 54 m<sup>3</sup>/day (54,000 L/day). This volume will make the registration of PTTW required for the permanent dewatering of the foundation.

### **6.4 Impact Assessment**

Based on the information calculated, the largest zone of influence is 60 m from the edge of the dewatering zone; however this is the maximum distance where any measurable water table decline would be observed. However, more significant decline in ground water levels (2 m) will be contained within approximately 57 m of the Site

As the area is municipally serviced, there are not anticipated to be any private wells located within the radius of influence. There is a creek located approximately 70 m south west of the Site; however this is located at the very extent of the zone of influence, and is not expected to be affected by the dewatering process. Further to this if the creek was used as the discharge point, any minimal drawdown would be negated by the discharge.

The site is located within the Intake Protection Zone 2 for the South Peel Drinking Water intake which identifies that the site is within approximately two (2) hours surface water travel time to the point of the intake. This will have to be taken into account when considering the design of the dewatering discharge treatment.

## **7.0 SUMMARY AND CONCLUSIONS**

Azimuth was retained by the Azure Group to conduct a Preliminary Hydrogeological Assessment for the property located along Kirwin Avenue inclusive of 3016-3032 within the City of Mississauga. The purpose of this assessment is to characterize the existing preliminary hydrogeological conditions at the Site and the potential for the proposed



development to impact the existing environmental / hydrogeological conditions. The report also addresses many of the CVC and Source Water Protection policy requirements.

The Site is rectangular in shape, 6,385 m<sup>2</sup> (0.6 hectares (ha)) in size and is to be redeveloped as an 8 storey residential building with underground parking. The Site is located on the south side of Kirwin Avenue; a gravel driveway and small paved area in the south side of the property remain from historical residential dwellings at the Site. As per the proposed development plans, the development will be accessed from Kirwin Avenue and will include two (2) below grade parking levels extending approximately 7 m below grade.

The Site is found at an elevation ranging between approximately 110 masl to 113 masl at with a slight southern slope. The existing Site drains via overland flow towards the existing City of Mississauga infrastructure along Little John Lane. Site native soils are composed of mostly silts and clays.

The inferred ground water flow direction is shown to be in a southern direction, which matches the direction of a buried section of the Cooksville Creek. Water table conditions fluctuated across the area ranging between 2.9 and 5.2 mbgs, this fluctuation is assumed to be based on the elevation of the bedrock in the area, which consists of a shallow weathered shale.

Hydraulic conductivity testing was completed at a number of the Site monitoring wells indicating the hydraulic conductivity of the site is ranging between  $5 \times 10^{-9}$  to  $2 \times 10^{-8}$  m/s.

The pre-development infiltration volume is 862 m<sup>3</sup>/year. This assumes the Site is currently not landscaped and vacant. The post-development without mitigation infiltration volume is 412 m<sup>3</sup>/year, which is a deficit of 450 m<sup>3</sup>/year.

At the time of report issuance, no formal storm water plans were developed, such that it is uncertain as to whether any LID's will be included in the development plan to mitigate any of the ground water infiltration loss. However, given the limited size of the Site and presence of underground parking structure, there will not likely be sufficient area to implement such measures.

The overall deficit is considered large; however, the area is municipally serviced such that there is unlikely any private supply wells in the area, while surface water features are limited to a creek approximately 70 m southeast of the Site. The limited permeability of



the soils would also indicate that the Site likely has little ground water infiltration capacity such that influence on the adjacent creek will not likely be impacted.

The proposed development will include the construction underground car parking with associated underground servicing (water, sewer, storm water). It is assumed that new service connections to Kirwin Avenue will be established as part of the proposed development. Based on the current development plan, dewatering will be required across the entire site due to the underground parking area. The assessment is based on the measured water table depths during the May, 2022 monitoring event; however water table conditions could vary seasonally. However, it is noted that the dewatering volumes are quite low such that even an increase in water table will not have a significant impact on water taking volumes. Consideration needs to be given to the quality of the dewatering discharge, which may require treatment prior to discharge city's storm water network or the local surface water creek. It is assumed that this will require obtaining a discharge permit from the city prior to initiation of any dewatering activities at the Site. Additional water quality samples may be required to confirm dewatering discharge quality.

As per Ontario Regulation 903 requirements, all existing monitoring wells which are no longer utilized at the Site will need to be properly decommissioned as per O.Reg. 903 (Wells Regulation) prior to commencement of building construction.

As the building foundation encroaches well into the water table, the planned waterproofing of the foundation will limit potential concerns with respect to the ground water at the Site. Dewatering will be required to facilitate construction; however, the dewatering assessment would indicate that the radius of influence does not extend to the closest natural feature which is a creek located 60 m south east of the Site. Similarly, the area is municipally serviced for water such that there is no expectation that any private wells exist within the area of influence.





## 8.0 REFERENCES

**Barnett, P.J., Cowan, W.R. and Henry, A.P. 1991.** *Quaternary Geology of Ontario, Southern Sheet.* s.l. : Ontario Geological Survey, 1991. Map 2256.

**Chapman, L. J. and Putnam, D. F. 1984.** *Physiography of Southern Ontario.* Third Edition. s.l. : Ministry of Natural Resources, 1984.

**Gao, C., et al. 2006.** *Bedrock topography and overburden thickness mapping, southern Ontario.* s.l. : Ontario Geological Survey, 2006.

**Hoffman, D.W. and Richards, N.R. 1953.** *Soil Survey of Peel County; Report No. 18 of the Ontario Soil Survey.* s.l. : Experimental Farms Service, Canada Department of Agriculture, and the Ontario Agricultural College, 1953.

**Ministry of Transportation .** Ontario IDF Curve Look Up. [Online] [Cited: 04 28, 2022.]  
[http://www.eng.uwaterloo.ca/~dprincz/mto\\_site/results\\_out.shtml?coords=44.313317,-79.557158.](http://www.eng.uwaterloo.ca/~dprincz/mto_site/results_out.shtml?coords=44.313317,-79.557158)

**Ontario Geological Survey. 2003.** *1:50,000 Scale Surficial Geology of Southern Ontario.* s.l. : Queens Printer, 2003.

**Ontario Geologic Survey . 2011.** *1:250000 Scale Bedrock Geology of Ontario.* s.l. : Queens Printer, 2011.

**Toronto and Region Conservation Authority (TRCA) and Credit Valley Conservation (CVC). 2010.** *Low Impact Development Stormwater Management Planning and Design Guide Version 1.* 2010.



---

---

## APPENDICES

- Appendix A: Figures**
  - Appendix B: Proposed Development Plan**
  - Appendix C: MECP Well Records & Site Borehole Logs**
  - Appendix D: Water Balance Summary Tables**
  - Appendix E: Hydraulic Conductivity Testing**
  - Appendix F: Water Quality Data**
  - Appendix G: Dewatering Calculations**
- 
-



---

---


## **APPENDIX A**

### **Figures**

---

---

Plotted by: ALU on June 1, 2022 at 9:03am  
File: C:\22\_projects\22-056\_kirwin\_env\_hydro\_assessment\04.0 - draft\02-056\_Site\_Location.dwg - Layout - Site Location - PlotScale: 0.5

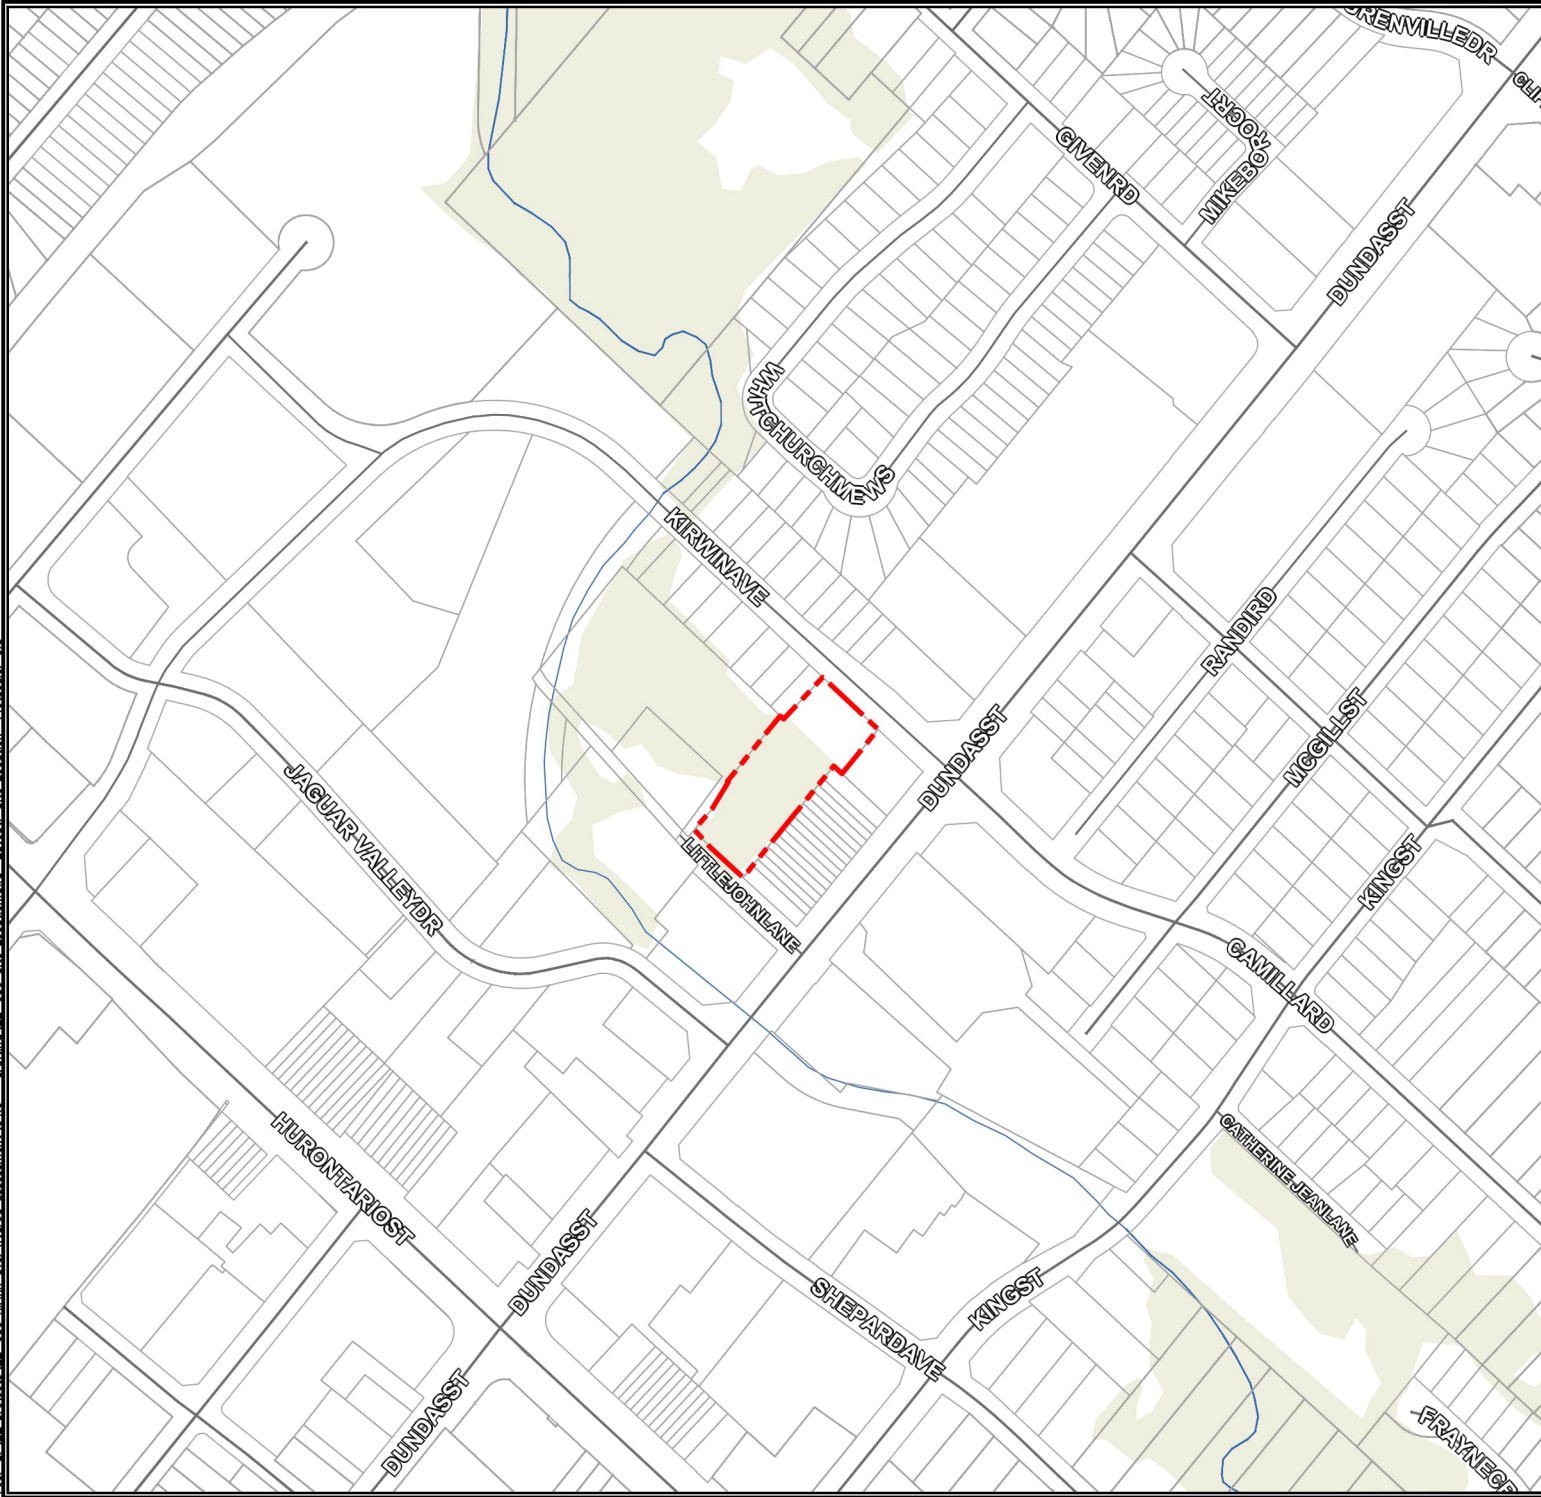

**LEGEND:**  
- - - - - APPROX. PROPERTY BOUNDARY

MISSISSAUGA VALLEY  
COOKSVILLE  
PORT CREDIT  
CREDIT RIVER  
LAKE ONTARIO  
QUEEN ELIZABETH WAY  
HWY 403

**REGIONAL MAP**  
SCALE 1:100000

0 125.0 250.0  
HORIZONTAL SCALE 1:5000

**AZIMUTH ENVIRONMENTAL CONSULTING, INC.**  
ENVIRONMENTAL ASSESSMENTS & APPROVALS

**SITE LOCATION**


3016-3032 KIRWIN AVE.  
MISSISSAUGA, ON

DATE ISSUED: JUNE 2022	Figure No.
CREATED BY: A.L.	
PROJECT NO.: 22-056	1
REFERENCE: CITY OF MISSISSAUGA	


Printed by A.L. on June 10, 2022 at 8:04am  
File: \\s:\projects\2022\22-056\environment\104.0 - airtouch\22-056\_Site Layout.dwg - Layout: Site Layout - PlotScale: 0.5



**LEGEND:**  
- - - - - APPROX. PROPERTY BOUNDARY  
— 100.00 — 0.5m CONTOURS (masl; GTA DEM 2002)

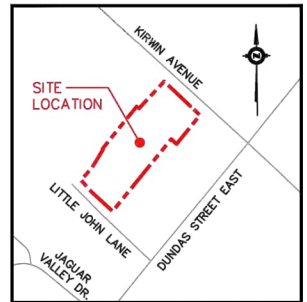

LOCATION PLAN




**AZIMUTH ENVIRONMENTAL CONSULTING, INC.**  
ENVIRONMENTAL ASSESSMENTS & APPROVALS


**SITE LAYOUT**

3016-3032 KIRWIN AVE.  
MISSISSAUGA, ON


DATE ISSUED: JUNE 2022	Figure No.
CREATED BY: A.L.	2
PROJECT NO.: 22-056	
REFERENCE: CITY OF MISSISSAUGA	

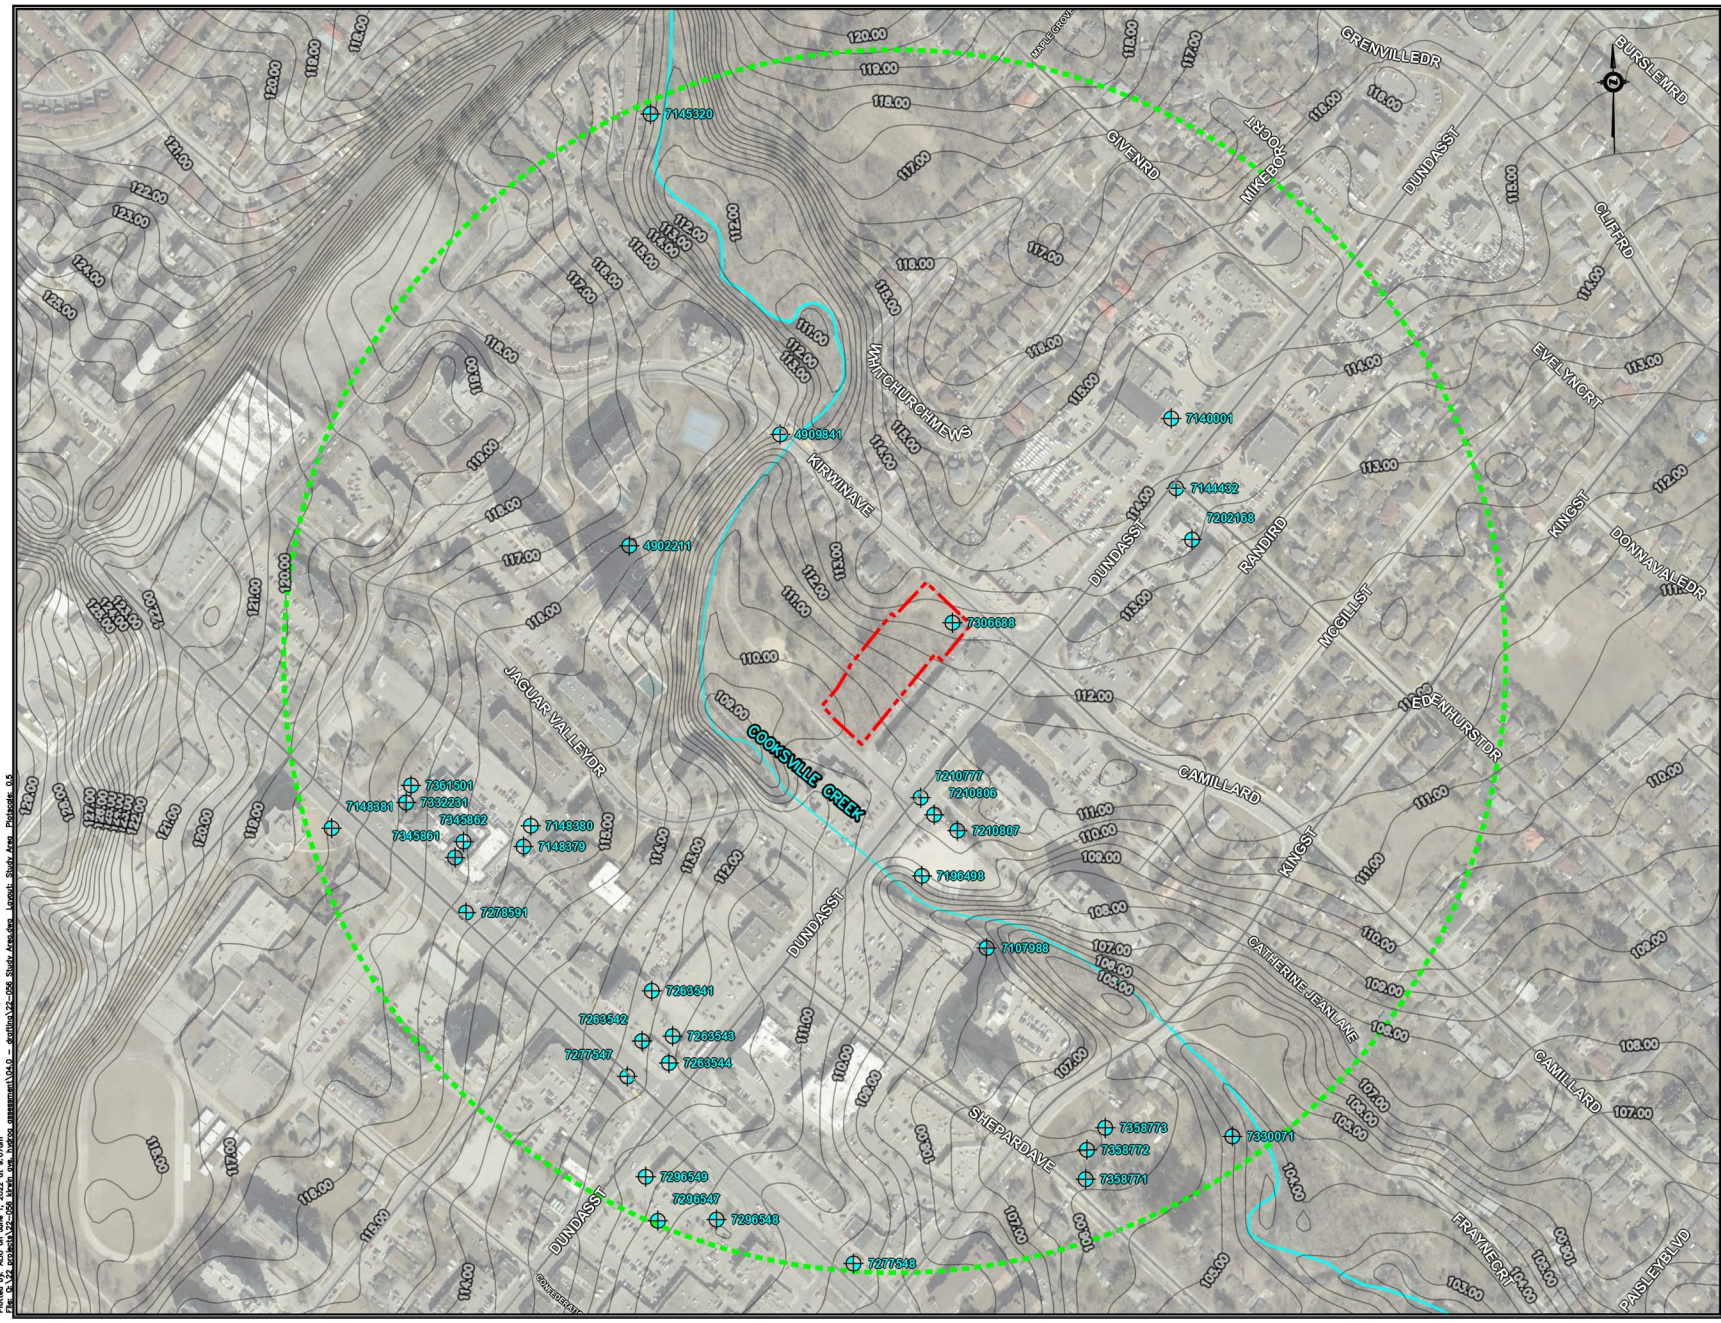

- LEGEND:**
- APPROX. PROPERTY BOUNDARY
  - 500m RADIUS STUDY AREA
  - WATERCOURSE (NDMNR, 2021)
  - 100.00 0.5m CONTOUR (most; GTA DEM 2002)
  - + WATER WELL LOCATIONS / I.D. (MECP, 2022)

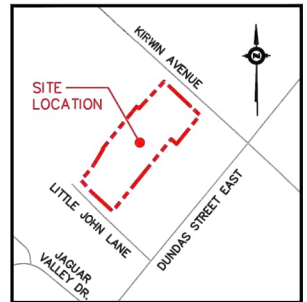

LOCATION PLAN




**NATURAL FEATURES AND SURROUNDING WELLS**

3016-3032 KIRWIN AVE.  
MISSISSAUGA, ON


DATE ISSUED:	JUNE 2022	Figure No.
CREATED BY:	A.L.	3
PROJECT NO.:	22-056	
REFERENCE:	CITY OF MISSISSAUGA	

Printed by AUL on June 15, 2022 at 8:07am.  
 File: \\AZI-ENV\Projects\2022\3016-3032\_Kirwin\3016-3032\_Kirwin\_Ave.dwg - Layout: Sheet\_Area\_Plot.dwg, 0.5


Printed by AUL on June 1, 2022 at 1:08pm  
Path: C:\GIS\Projects\3016-3032-Kirwin-Avenue\Map\04\_0 - Draft\04\_02-06\_Site\_Location\_Locate\_Ground\_Water\_Phase\_01

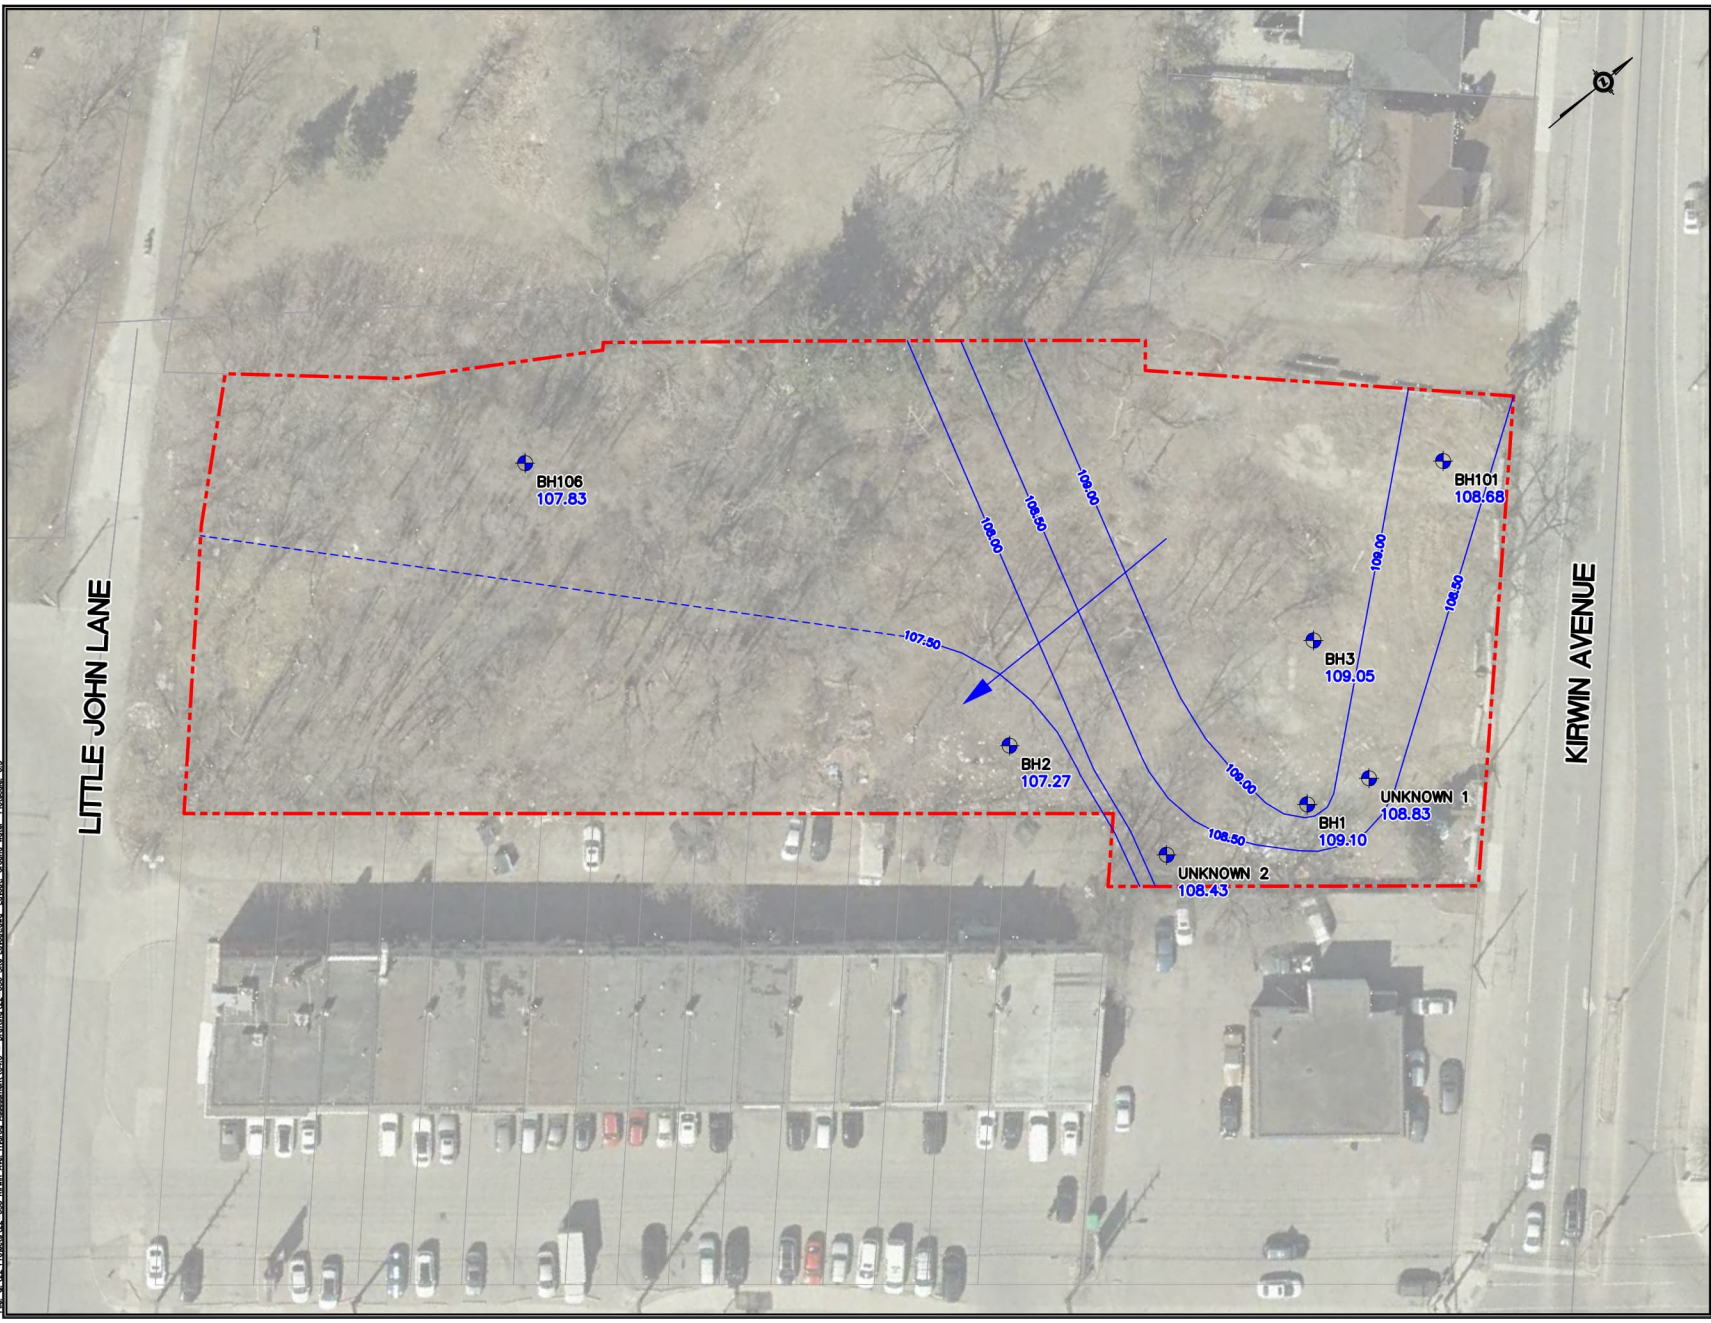

- LEGEND:**
- APPROX. PROPERTY BOUNDARY
  - 100.00 0.5m CONTOURS (masl)
  - INFERRED DIRECTION OF GROUND WATER FLOW

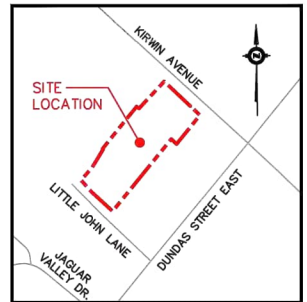

LOCATION PLAN



GROUND WATER CONTOURS

3016-3032 KIRWIN AVE.  
MISSISSAUGA, ON

DATE ISSUED: JUNE 2022	Figure No.
CREATED BY: A.L.	4
PROJECT NO.: 22-056	
REFERENCE: CITY OF MISSISSAUGA	



---

---

**APPENDIX B**

**Proposed Development Plan**

---

---



# PROPOSED 8 STOREY RENTAL BUILDING

3016 -3022 KIRWIN AVE, MISSISSAUGA, ON, CANADA


**3016  
KIRWIN AVE**

3016-3022 Kirwin Avenue  
Mississauga - ON - Canada

© Copyright KFA Architects and Planners Inc. All rights reserved. No part of this document whether printed form or supplied as digital data may be reproduced, stored in a retrieval system or transmitted in any form or by any means, mechanical photocopying, recording or otherwise without the prior written permission of KFA Architects and Planners Inc.  
All dimensions to be checked on site by the contractor. Drawings are not to be scaled. Any discrepancies are to be reported to the Architect before proceeding with the work.

## DRAWING LIST:

Sheet Number	Sheet Name
A000	COVER PAGE
A001	SITE PLAN & STATS
A101	PARKING GARAGE LEVEL 2
A102	PARKING GARAGE LEVEL 1
A103	GROUND FLOOR
A104	2ND FLOOR PLAN
A105	3RD FLOOR PLAN
A106	4TH FLOOR PLAN
A107	5TH FLOOR PLAN
A108	6TH FLOOR PLAN
A109	7TH FLOOR PLAN
A110	8TH FLOOR PLAN
A111	MECHANICAL FLOOR PLAN
A112	ROOF PLAN
A201	EAST ELEVATION
A202	WEST ELEVATION
A203	NORTH ELEVATION
A204	SOUTH ELEVATION
A205	SECTION 1 E/W
A206	SECTION 2 N/S



CLIENT

DVB Real Estate  
Investments Inc.



PROJECT NO: 2009  
SCALE:  
DATE: Feb. 04, 2020  
DRAWN BY: FC, LF  
DRAWING TITLE

## CONSULTANTS:

### ARCHITECT:

#### KFA ARCHITECTS + PLANNERS INC.

197 SPADINA AVENUE, SUITE 500  
TORONTO, ON  
M5T 2C8

TEL: 416 633 8226

### PLANNING:

#### WESTON CONSULTING

268 BERKELEY ST  
TORONTO, ON  
M5A 2X5

TEL: 905-738-8080

### ACOUSTIC:

#### VALCOUSTICS

30 WERTHEIM CT  
RICHMOND HILL, ON  
L4B 1B9

TEL: 416-633-6226 EXT. 222

### LANDSCAPE:

#### MSLA

170 THE DONWAY WEST, SUITE 206  
NORTH YORK, ON  
M3C 2G3

TEL: 416-492-9966 EXT. 26

### ARBORIST / ENVI.

#### BEACON ENVIRONMENTAL

80 MAH ST N  
MARKHAM, ON  
L3P 1X5

TEL: 519-835-6455

### WIND:

#### THEAKSON ENVIRONMENTAL

GLENGARRY CRESCENT  
FERGUS, ON  
N1M 3E2

TEL: 519-787-2910

### TRANSPORTATION:

#### LEA CONSULTING

425 UNIVERSITY AVENUE, SUITE 400  
TORONTO, ON  
M5G 1T8

TEL: 905-470-0015 ext. 245

### CIVIL ENGINEER:

#### LEA CONSULTING

425 UNIVERSITY AVENUE, SUITE 400  
TORONTO, ON  
M5G 1T8

TEL: 905-470-0015 ext. 328

COVER PAGE

DRAWING NO

**A000**






1. SATELLITE AERIAL VIEW



2. TOPOGRAPHIC AERIAL VIEW

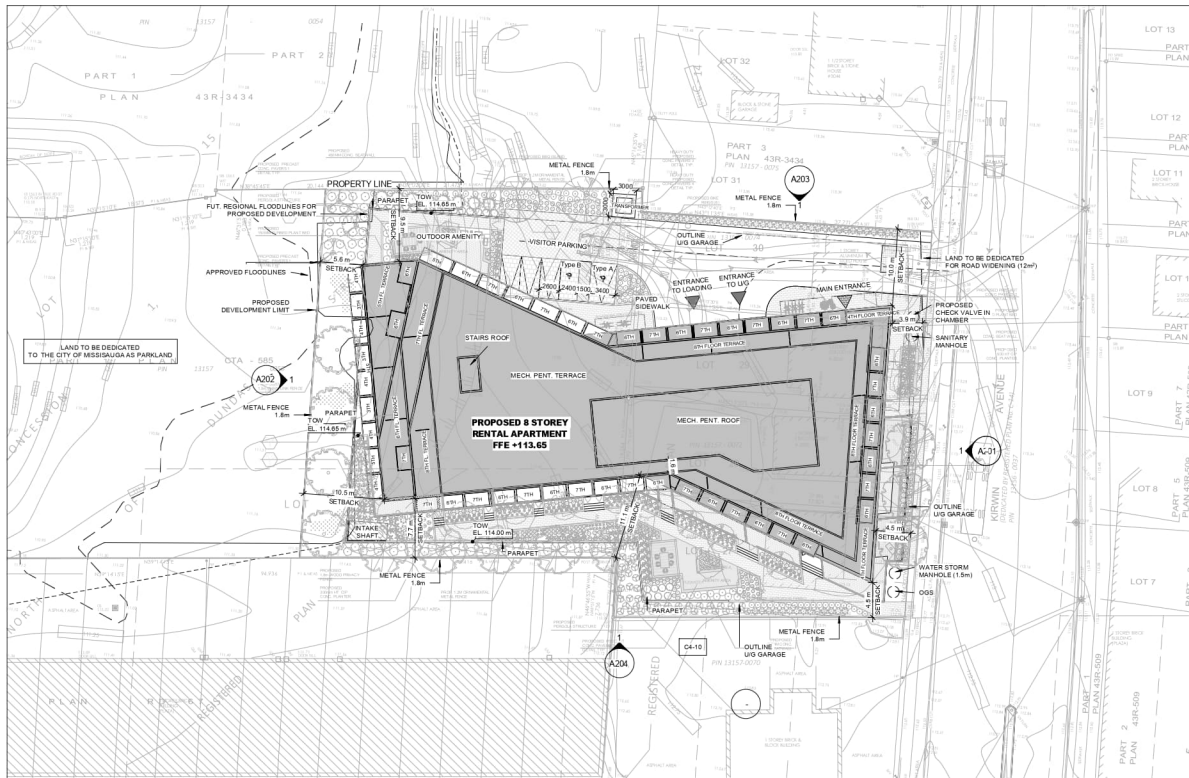

3. SITE PLAN / 1:300

**3016-3022 Kirwin Ave**

Review: February 04th, 2021

**Legal Description**  
 ALL OF LOT 13 OF THE SUBDIVISION OF 111x17m FOOT OF LOT 11 (RESERVED) PLAN 10R-13 AND PART OF LOT 18 CONCESSION 1, NORTH OF CAMILLA STREET CITY OF MISSISSAUGA REGIONAL MUNICIPALITY OF PEEL.

Site		6,288.0 m <sup>2</sup>		66,730 sf	
Gross Site Area	6,288.0 m <sup>2</sup>			66,730 sf	
Paved Circulation	2,650.0 m <sup>2</sup>			28,372 sf	
Road Widening Area	12.0 m <sup>2</sup>			129 sf	
Net Site Area	<b>3,626.0 m<sup>2</sup></b>			<b>42,229 sf</b>	
Lot Frontage	60.3 m				
Lot Depth	131.4 m				

Building Proposal		1,703.0 m <sup>2</sup>		18,307 sq ft	
Building Footprint	1,703.0 m <sup>2</sup>			18,307 sq ft	
Building Height	28.5 m				*Max. Pent. Excluded
Gross Floor Area (Based on GFA - Apartment Zone)	11,120.0 m <sup>2</sup>				
Lot Coverage (%) (Based on Gross Site Area)	27%				
Lot Coverage (%) (Based on Net Site Area)	42%				
FBI (GFA / Gross Site Area)	<b>1.74</b>				
FBI (GFA / Net Site Area)	<b>2.85</b>				

Proposed Areas	Floor	GCA** (m <sup>2</sup> )	GFA* (m <sup>2</sup> )	Floor (m)
Ground Floor	1,683.0	930.0	10,011	
7th 2nd Floor	600.0	600.0	6,450	
2nd Floor	1,683.0	1,529.0	16,415	
3rd Floor	1,103.0	1,628.0	17,204	
4th Floor	1,098.0	1,448.0	15,587	
5th Floor	1,427.0	1,367.0	14,715	
6th Floor	1,370.0	1,291.0	13,867	
7th Floor	1,311.0	1,260.0	13,617	
8th Floor	1,086.0	1,060.0	11,410	
Total GFA	12,193.0	11,120.0	119,699	

**Total Proposed GFA** 11,120.0 m<sup>2</sup> 119,699 sq ft  
 \*Gross Floor Area (GFA) - Represents floor area covered by floor-slabs or other levels or part of the building under normal conditions, including circulation, stairs, ramps, balconies, etc. It does not include areas reserved for future use or areas reserved for other purposes.  
 \*\*Gross Circulation Area (GCA) - The total enclosed area of a floor building measured to the outside surface of the permanent exterior walls of the building or addition to the permanent surface, or over a pile in the case of overhangs and projections to the outside surface of the building.

Unit Count	Units	1 Bed	2 Bed	3 Bed
Ground Floor	10			
2nd Floor	29			
3rd Floor	23			
4th Floor	22			
5th Floor	20			
6th Floor	19			
7th Floor	18			
8th Floor	16			
<b>Total Units</b>	<b>148</b>	<b>113</b>	<b>30</b>	<b>5</b>
		76.4%	21.6%	2.0%

Parking Required	Units	Permitted	Ratio		
Rental 1 Bed @ 1.8 per unit	113	133	1.18		
Rental 2 Bed @ 1.8 per unit	32	44	1.36		
Rental 3 Bed @ 1.5 per unit	5	5	1.00		
<b>Total</b>	<b>150</b>	<b>182</b>	<b>1.21</b>		
Rental Visitors @ 0.15 per unit		22	0.15		
<b>Total Vehicular Parking Required</b>	<b>148</b>	<b>204</b>	<b>1.38</b>		
<b>Parking Provided (estimated)</b>					
At Grade	P1 Level	P2 Level	Sub Total	Ratio	
Residential	10	64	98	157	1.08
Residential Visitor	5	16	9	21	0.14
	5	80	92	178	1.20
<b>Total Vehicular Parking Provided</b>			<b>178</b>	<b>1.20</b>	

Bicycle Parking	Units	Permitted	Ratio
Short Term Residential	0.88 x unit		13
Long Term Residential	0.7 x unit		104
<b>Provided (estimated)</b>			<b>118</b>
Short Term Residential	At Grade	P1 Level	0
Long Term Residential	0	101	
<b>Total</b>			<b>101</b>

Landscaped Area	Area (m <sup>2</sup> )	Area (sq ft)
Soft Landscaping	912.0	9,816
Hard Landscaping	760.0	8,240
Green Roof	466.0	5,024
<b>Total Landscaping</b>	<b>2,138.0</b>	<b>23,080</b>

Amenity Area		829.8 m <sup>2</sup>	
<b>Amenity Area Required</b>		829.8 m <sup>2</sup>	
5.6 m <sup>2</sup> per unit		829.8 m <sup>2</sup>	
<b>Total Amenities Required</b>		<b>829.8 m<sup>2</sup></b>	
<b>Amenity Area Provided (estimated)</b>		829.8 m <sup>2</sup>	
1) Indoor	Ground Floor	330.0 m <sup>2</sup>	
2) Outdoor	Ground Floor	100.0 m <sup>2</sup>	
	Roof	400.0 m <sup>2</sup>	
<b>Total Amenities</b>		<b>830.0 m<sup>2</sup></b>	5.9 sqm x unit


**3016 KIRWIN AVE**

3016-3022 Kirwin Avenue  
 Mississauga - ON - Canada

© Copyright KFA Architects and Planners Inc., all rights reserved. No part of this document whether printed form or digital data may be reproduced, stored in a retrieval system or transmitted in any form or by any means, mechanical, photocopying, recording or otherwise without the prior written permission of KFA Architects and Planners Inc. All dimensions to be checked on site by the contractor. Drawings are not to be scaled, and any discrepancies are to be reported to the Architect before proceeding with the work.


No.	Description	Date
1	Issued for Review	2020/07/27
2	Issued for Review	2020/08/20
3	Issued for Review	2020/12/17
4	Issued for Review	2021/02/04
5	ISSUED FOR CPAZ/BA	2021/03/10

**11x17 FORMAT HALF SCALE**



Project No: 20009  
 Scale: 1 : 300  
 Date: Feb. 04, 2020  
 Drawn by: FC  
 Drawing Title: SITE PLAN & STATS

Drawing Number: A001

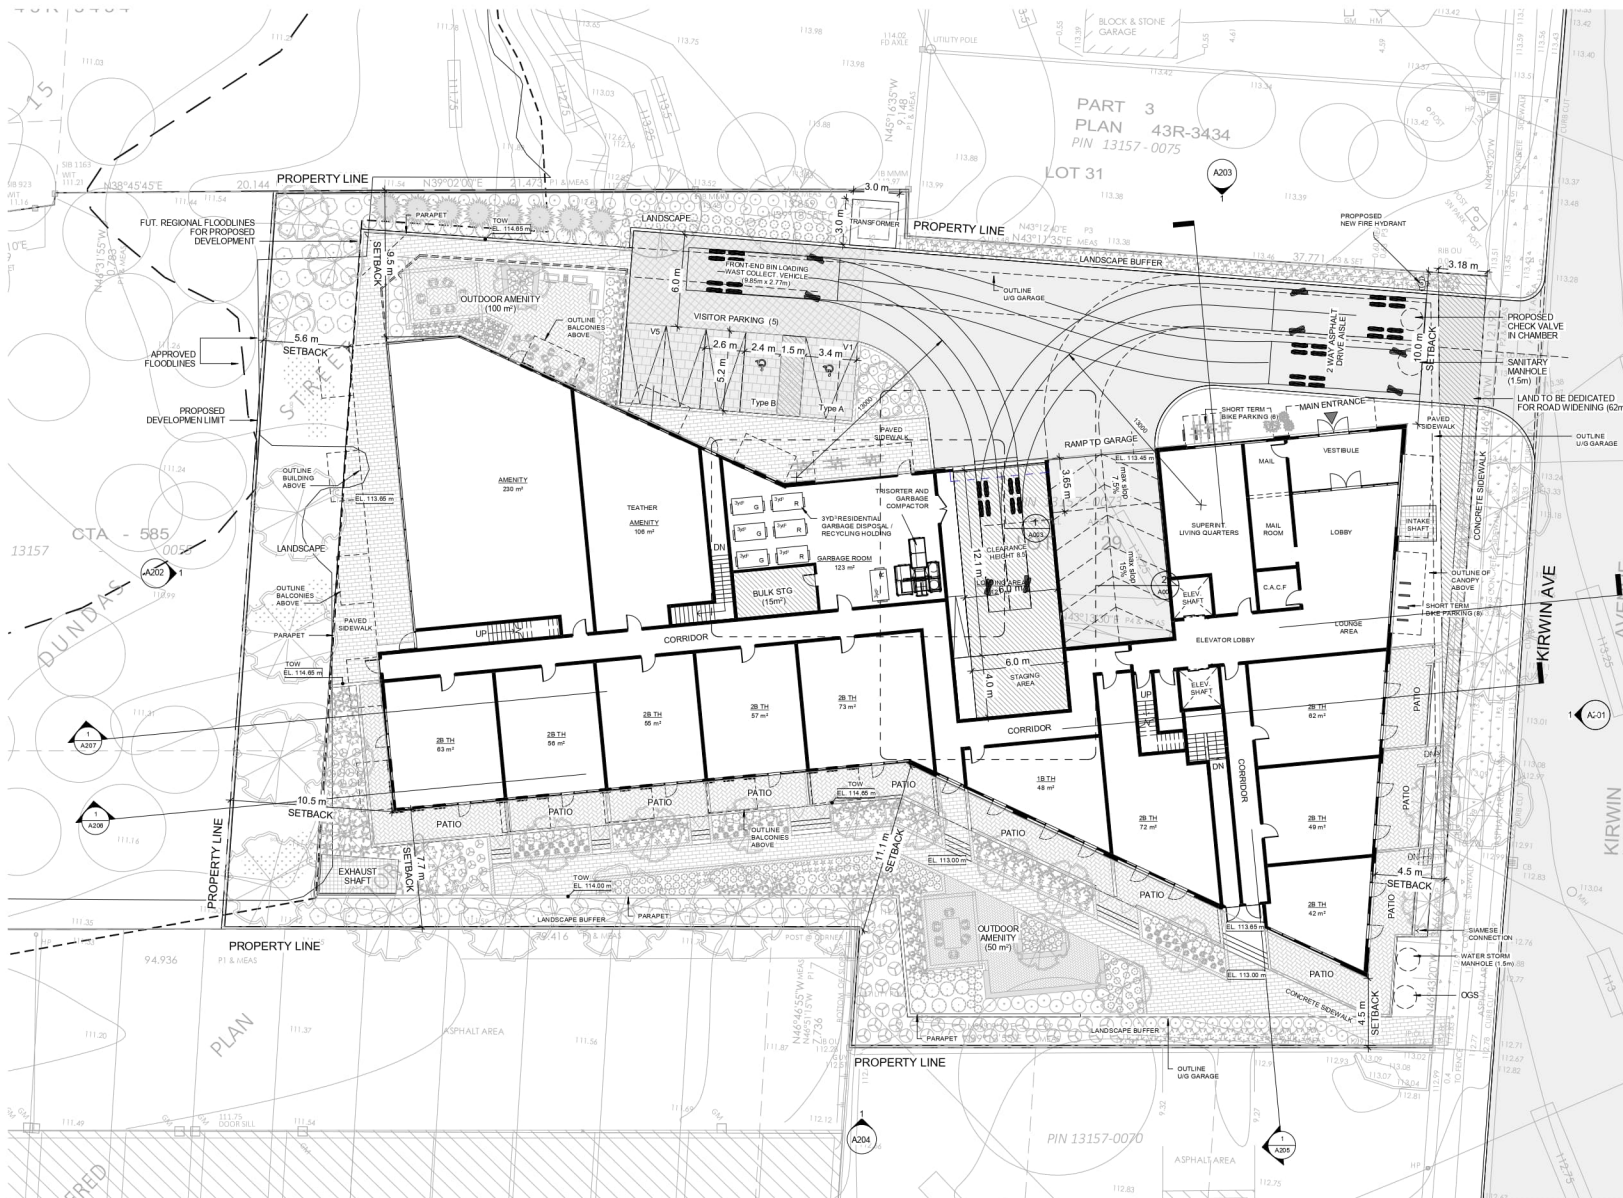


# 3016 KIRWIN AVE

3016-3022 Kirwin Avenue  
Mississauga - ON - Canada

© Copyright KFA Architects and Planners Inc., all rights reserved. No part of this document whether printed form or supplied as digital data may be reproduced, stored in a retrieval system or transmitted in any form or by any means, mechanical, photocopying, recording or otherwise without the prior written permission of KFA Architects and Planners Inc. All dimensions to be checked on site by the contractor. Drawings are not to be scaled, and any discrepancies are to be reported to the architect before proceeding with the work.

No.	Description	Date
1	ISSUED FOR DP/23A	2021/01/19
2	ISSUED FOR DP/23A	2022/01/21
3	Issued for Coordination	2022/07/27
4	Issued for Coordination	2022/08/22



Project No: 20009  
 Scale: 1 : 150  
 Date: Feb. 04, 2020  
 Drawn by: FC  
 Drawing Title: GROUND FLOOR


Drawing Number: A103

# 3016 KIRWIN AVE

3016-3022 Kirwin Avenue  
Mississauga - ON - Canada

© Copyright KFA Architects and Planners Inc., all rights reserved. No part of this document whether printed form or supplied as digital data may be reproduced, stored in a retrieval system or transmitted in any form or by any means, mechanical, photocopying, recording or otherwise without the prior written permission of KFA Architects and Planners Inc. All dimensions to be checked on site by the contractor. Drawings are not to be scaled, and any discrepancies are to be reported to the Architect before proceeding with the work.

No.	Description	Date
1	ISSUED FOR OPA/20A	2021/01/19
2	ISSUED FOR OPA/20A	2022/01/21
3	Issued for Coordination	2022/07/27
4	Issued for Coordination	2022/08/22

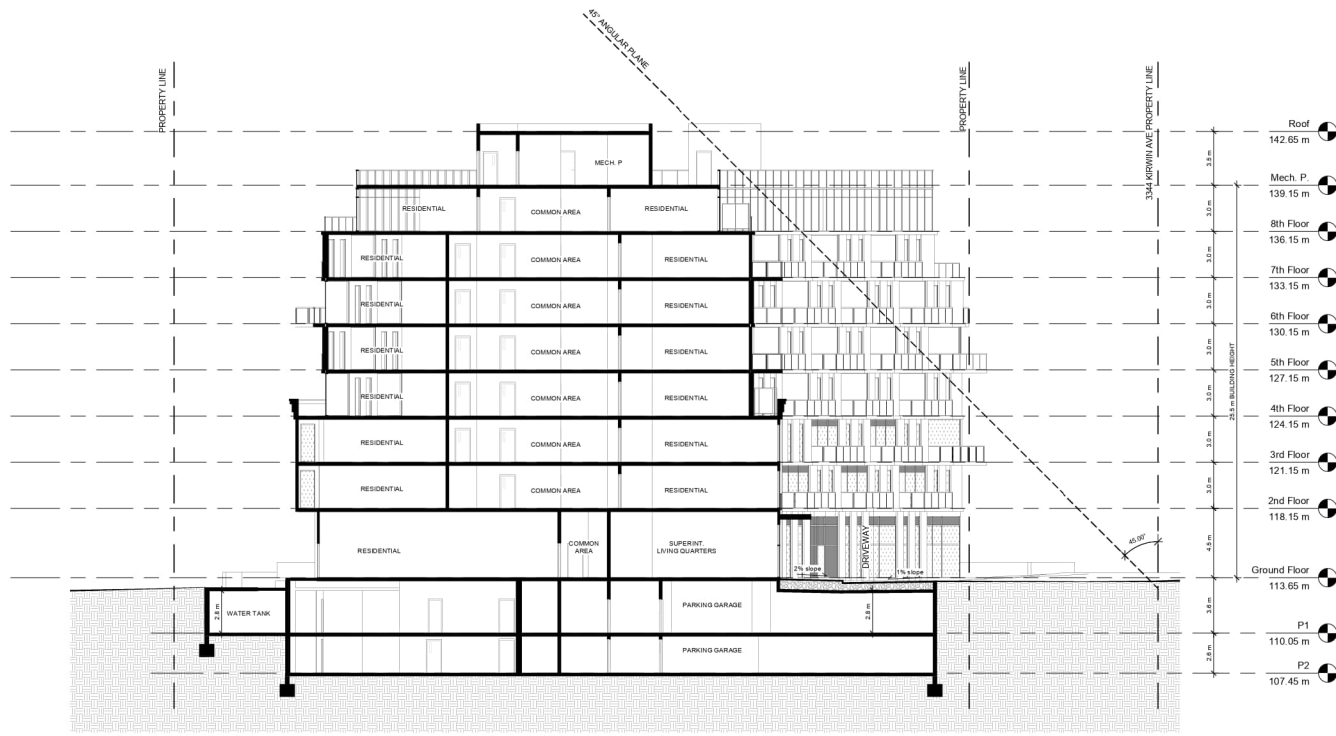

107 GERRARD AVE. - SUITE 100  
MISSISSAUGA, ON - M5T 1Z8  
#1683A228  
www.kfaarchitects.com

Project No: 20009  
Scale: 1 : 150  
Date: Feb. 04, 2020  
Drawn by: FC  
Drawing Title: SECTION 1 E/W


Drawing Number: A205

# 3016 KIRWIN AVE

3016-3022 Kirwin Avenue  
Mississauga - ON - Canada

© Copyright KFA Architects and Planners Inc., all rights reserved. No part of this document whether printed form or supplied as digital data may be reproduced, stored in a retrieval system or transmitted in any form or by any means, mechanical, photographing, recording or otherwise without the prior written permission of KFA Architects and Planners Inc. All dimensions to be checked on site by the contractor. Drawings are not to be scaled, and any discrepancies are to be reported to the Architect before proceeding with the work.

No.	Description	Date
1	ISSUED FOR OPA/20A	2021/03/19
2	ISSUED FOR OPA/20A	2022/01/21
3	Issued for Coordination	2022/07/27
4	Issued for Coordination	2022/08/22

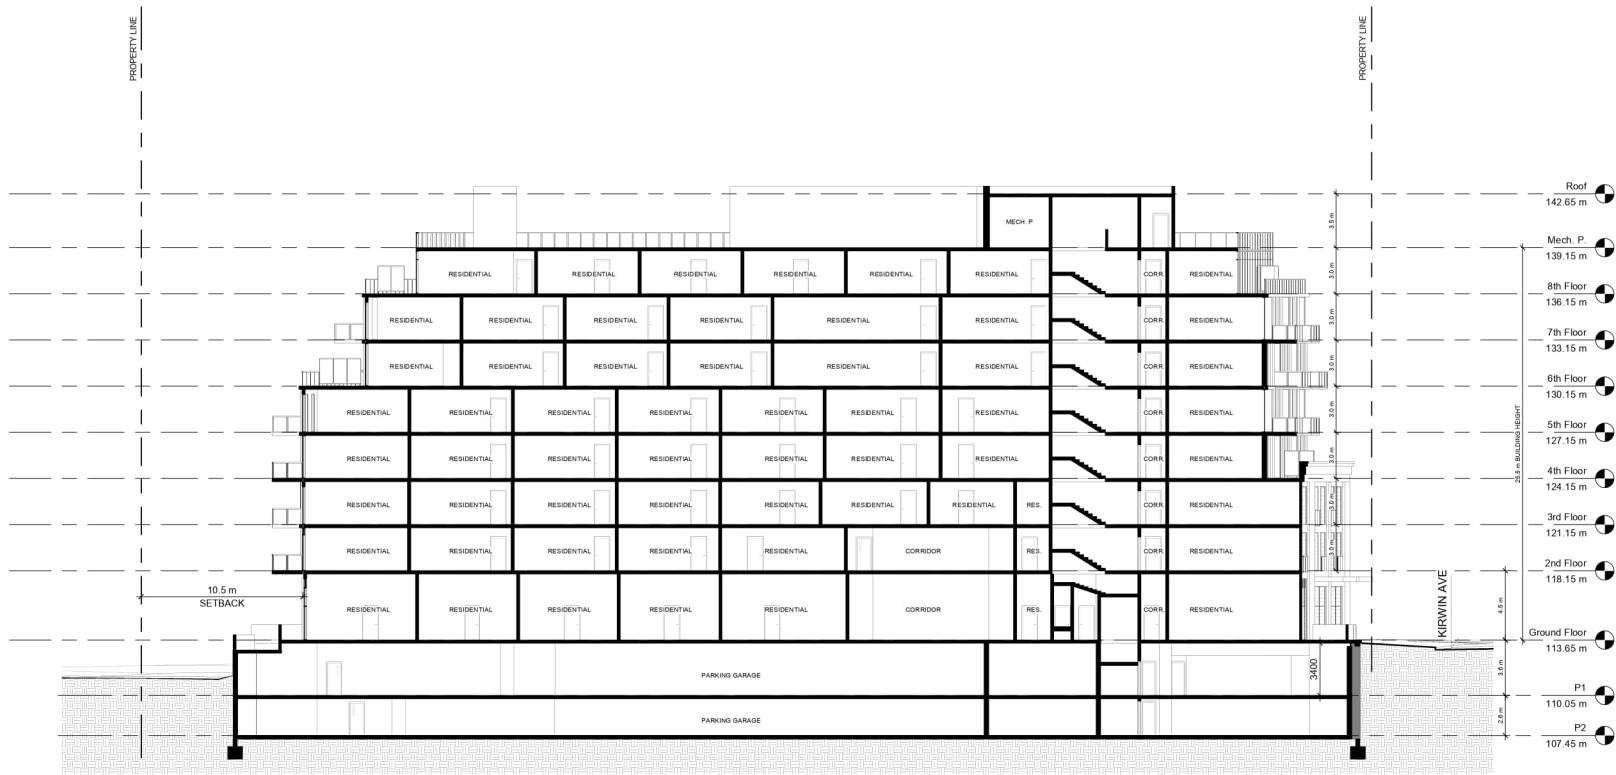

- Roof 142.65 m
- Mech. P. 139.15 m
- 8th Floor 136.15 m
- 7th Floor 133.15 m
- 6th Floor 130.15 m
- 5th Floor 127.15 m
- 4th Floor 124.15 m
- 3rd Floor 121.15 m
- 2nd Floor 118.15 m
- Ground Floor 113.65 m
- P1 110.05 m
- P2 107.45 m



Project No: 20009  
Scale: 1 : 150  
Date: Feb. 04, 2020  
Drawn by: FC  
Drawing Title

## SECTION 2 N/S

Drawing Number

A206



---


---

**APPENDIX C**

**MECP Well Records & Site Borehole Logs**

---

---

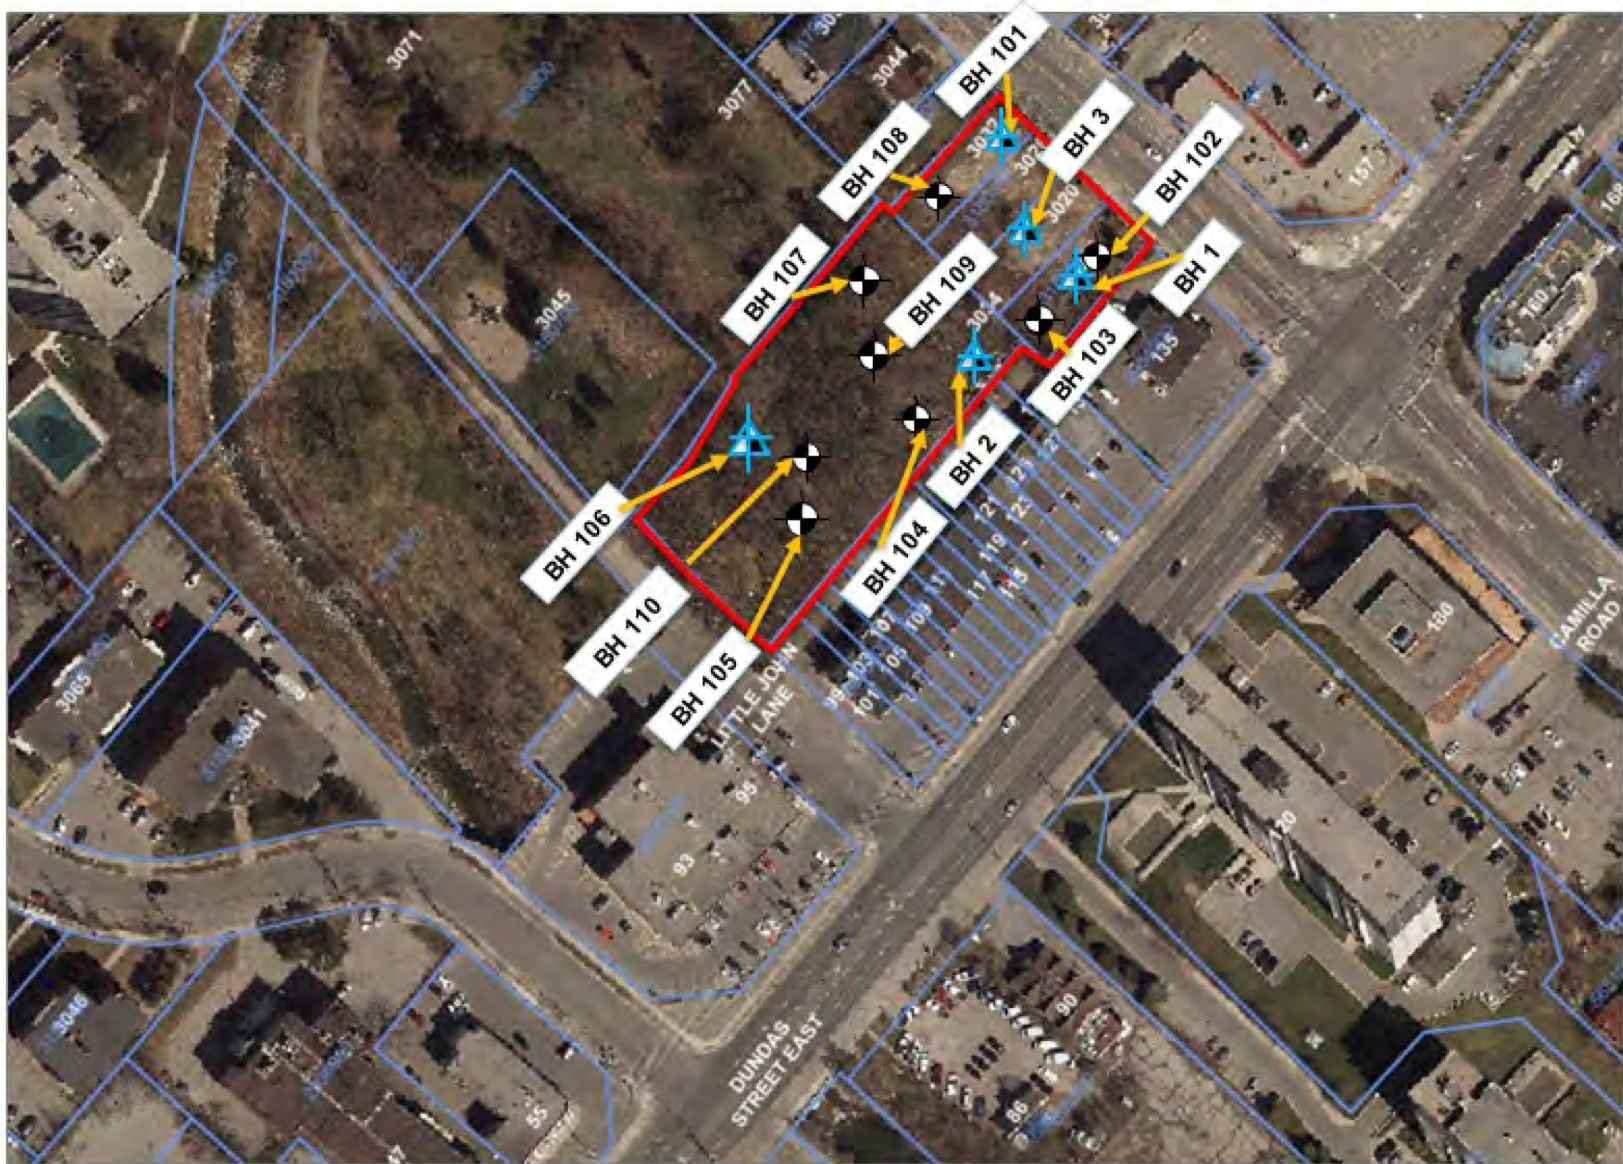

Approximate location  
Subject Property



Approximate Location of Monitoring Well



Approximate location of  
Boreholes

Source: City of Mississauga Interactive Maps  
© 2022 City of Mississauga

Title	Borehole Location Plan	Project: 3016, 3020, 3026 & 3032 Kirwin Avenue and 3031 Littlejohn Lane City of Mississauga, Ontario	Project No.	2202-001	Scale:	As drawn	Date:	April, 2022	Figure No.	4
-------	------------------------	---	-------------	----------	--------	----------	-------	-------------	------------	---





# BH1

**PROJECT NUMBER:** 2012-001      **UTM COORD. (m)** 17 T611938 m E 4826562 m N      **TOTAL WELL DEPTH:** 6.8 mbgs  
**PROJECT NAME:** Phase Two ESA      **HOLE SIZE/SAMPLING METHOD:** 50 mm /SS      **SURFACE ELEVATION:** 113.13 masl  
**CLIENT:** DBV Real Estate Investments Inc.      **RIG MODEL:** Diedrich D-120      **WELL SCREEN:** 3.05 m; #10 Slot Screen  
**ADDRESS:** 3031 Littlejohn Ln and 3016, 3020, 3026, 3032 & 3034 Kirwin Av, Mississauga      **DRILLING METHOD:** Spilt Spoon, Hollow Stem A      **WATER LEVEL:** 4.46 mbgs  
**SAMPLING LENGTH:** 0.762 m

**COMMENTS** : masl: meter above sea level - SS: Split-Spoon

**LOGGED BY** ST  
**CHECKED BY** AT

Elevation (masl)	Depth (m)	Soil Sample ID	Sample Type	% Recovery	Soil Lab Analyses	Graphic Log	Material Description	HSVC as Isobutylene (ppm)	HSVC as Hexane (ppm)	Well Diagram
113	0	1	SS	100			100 mm Topsoil	0	0.0	
112.5	0.5						SILTY CLAY FILL, brown, some gravel, moist-wet, no odours & stains	0	0.0	
112	1	2	SS		PAHs, M&I			0	0.0	
111.5	1.5	3	SS				SILTY SAND FILL, brown, some gravel & cobbles, dry, no odours & stains	0	0.0	
111	2							0	0.0	
110.5	2.5	4	SS					0	0.0	
110	3	5	SS					0	0.0	
109.5	3.5							0	0.0	
109	4	6	SS		PHC, VOC, DUP-S1		SILTY CLAY, brown-grey, moist, some gravel & rocks, firm - stiff	0	0.0	
108.5	4.5	7A	SS					0	0.0	
108	5	7B	SS				- grey, stiff to hard, weathered shale fragments	0	0.0	
107.5	5.5	8	SS					0	0.0	
107	6	9	SS					0	0.0	
106.5	6.5							0	0.0	
106	7							0	0.0	



# BH2

**PROJECT NUMBER:** 2012-001      **UTM COORD. (m)** 17 T611938 m E 4826562 m N      **TOTAL WELL DEPTH:** 6.06 mbgs  
**PROJECT NAME:** Phase Two ESA      **HOLE SIZE/SAMPLING METHOD:** 50 mm /SS      **SURFACE ELEVATION:** 112.56 masl  
**CLIENT:** DBV Real Estate Investments Inc.      **RIG MODEL:** Diedrich D-120      **WELL SCREEN:** 3.05 m; #10 Slot Screen  
**ADDRESS:** 3031 Littlejohn Ln and 3016, 3020, 3026, 3032 & 3034 Kirwin Av, Mississauga      **DRILLING METHOD:** Spilt Spoon, Hollow Stem A      **WATER LEVEL:** 4.86 mbgs  
**SAMPLING LENGTH:** 0.762 m

**COMMENTS** : masl: meter above sea level - SS: Split-Spoon

**LOGGED BY** ST  
**CHECKED BY** AT

Elevation (masl)	Depth (m)	Soil Sample ID	Sample Type	% Recovery	Soil Lab Analyses	Graphic Log	Material Description	HSVC as Isobutylene (ppm)	HSVC as Hexane (ppm)	Well Diagram
112.5	0	1	SS				Topsoil and Asphalt	0	0.0	
112	0.5						SILTY SAND FILL, brown, some gravel & cobbles, dry, no odours & stains	0	0.0	
111.5	1	2	SS		M&I			0	0.0	
111	1.5	3	SS					0	0.0	
110.5	2							0	0.0	
110	2.5	4	SS					0	0.0	
109.5	3	5A	SS					0	0.0	
109	3.5	5B	SS					0	0.0	
108.5	4	6	SS		PHC, VOC		SILTY CLAY, grey, some organic, moist, soft-firm	0	0.0	
108	4.5	7	SS				- stiff to hard - weathered shale fragments	0	0.0	
107.5	5							0	0.0	
107	5.5	8	SS					0	0.0	
106.5	6							0	0.0	
106	6.5							0	0.0	
105.5	7							0	0.0	



# BH3

**PROJECT NUMBER:** 2012-001      **UTM COORD. (m)** 17 T611938 m E 4826562 m N      **TOTAL WELL DEPTH:** 6.57 mbgs  
**PROJECT NAME:** Phase Two ESA      **HOLE SIZE/SAMPLING METHOD:** 50 mm /SS      **SURFACE ELEVATION:** 113.31 masl  
**CLIENT:** DBV Real Estate Investments Inc.      **RIG MODEL:** Diedrich D-120      **WELL SCREEN:** 3.05 m; #10 Slot Screen  
**ADDRESS:** 3031 Littlejohn Ln and 3016, 3020, 3026, 3032 & 3034 Kirwin Av, Mississauga      **DRILLING METHOD:** Spilt Spoon, Hollow Stem A      **WATER LEVEL:** 4.48 mbgs  
**SAMPLING LENGTH:** 0.762 m

**COMMENTS** : masl: meter above sea level - SS: Split-Spoon      **LOGGED BY** ST  
**CHECKED BY** AT

Elevation (masl)	Depth (m)	Soil Sample ID	Sample Type	% Recovery	Soil Lab Analyses	Graphic Log	Material Description	HSVC as Isobutylene (ppm)	HSVC as Hexane (ppm)	Well Diagram
113	0.5	1	SS				100 mm Topsoil	0	0.0	
112.5	1	2	SS		M&I		SILTY SAND FILL, brown, some gravel & cobbles, dry, no odours & stains	0	0.0	
112	1.5	3	SS					0	0.0	
111.5	2	4	SS					0	0.0	
111	2.5	5	SS					0	0.0	
110.5	3	6	SS					0	0.0	
110	3.5	7A	SS				SILTY CLAY, brown-grey, moist, some gravel & rocks, firm - stiff	0	0.0	
109.5	4	7B	SS				- grey	0	0.0	
109	4.5	8	SS				- weathered shale fragments	0	0.0	
108.5	5	9	SS					0	0.0	
108	5.5							0	0.0	
107.5	6							0	0.0	
107	6.5							0	0.0	
106.5	7							0	0.0	
106										

# AZURE GROUP DRAWING NO. 2

## JOB NUMBER 2202-001BH101

PROJECT LOCATION: 3016 – 3032 Kirwin Avenue & 3031 Little John Lane, Mississauga, Ontario

Client: Black Creek Group

$C_u$  = Shear Strength (kPa) | G% = Gravel, S% = Sand, F% = Fines (Silt and Clay), M = Moisture Content

Temperature: 5°C

Started/Date April 1, 2022 Time: 8:55 am Sheet 1 of 1

Finished/Date April 1, 2022 Time: 5:30 pm

Azure Rep: Amit Pal Auger Type: 150 mm Open

G. S. El: 113.399 m G.W. Depth: 5.4 m G.W. Elevation: 107.13 m April 13, 2022 Time: 1 pm

Depth/Elev. (m)	Soil Description	Type/No	N	$C_u$ (kPa)	G.W.T	Remark
0	113.4	250 mm Topsoil Soft to firm dark brown silty clay/clayey silt trace sand, gravel, and organics	SS 1	6		
.75	112.7		SS 2	5		
1.5	111.9		SS 3	5		
2.25	111.2	Compact SILTY SAND/SANDY SILT trace gravel, moist below 2.2 m	SS 4	37		
3.0	110.4	Loose below 3.0 m, wet	SS 5	36		
4.6	108.8	Stiff to very grayish brown stiff SILTY CLAY/CLAYEY SILT trace sand and gravel, wet below 4.0 m	SS 6	19	5.4 m	
6.1	107.9	Hard grey CLAYEY SILT trace to some shale fragments below 6.0 m	SS 7	55		
7.6	105.8		SS 8	>80		
8.2	105.2	Refusal at 8.2 m		>80		

EOB

# AZURE GROUP DRAWING NO. 3

## JOB NUMBER 2202-001BH102

PROJECT LOCATION: 3016 – 3032 Kirwin Avenue & 3031 Little John Lane, Mississauga, Ontario

Client: Black Creek Group

$C_u$  = Shear Strength (kPa) | G% = Gravel, S% = Sand, F% = Fines (Silt and Clay), M = Moisture Content

Temperature: 5°C

Started/Date April 8, 2022 Time: 8:55 am Sheet 1 of 1

Finished/Date April 8, 2022 Time: 5:30 pm

Azure Rep: Amit Pal Auger Type: 150 mm Open

G. S. El: 113.094 m G.W. Depth: G.W. Elevation: Time:

Depth/Elev. (m)	Soil Description	Type/No	N	$C_u$ (kPa)	G.W.T	Remark
0	113.1	250 mm Topsoil Soft to firm dark brown silty clay/clayey silt trace sand, gravel, and organics, moist	SS 1	8		
.75	112.4	Trace gravel, possible cobbles, moist below 0.7 m	SS 2	8		
1.5	111.6	Compact SILTY SAND/SANDY SILT trace gravel, moist below 1.8 m	SS 3	15		
2.25	110.9	Very dense SAND & GRAVEL below 2.2 m, moist (possible boulder)	SS 4	>80		
3.0	110.1	Very dense SAND & GRAVEL, moist below 3.0 m, possible cobbles	SS 5	66		
4.6	108.5	Compact SAND & GRAVEL trace clay, wet below 4.0 m	SS 6	22		
6.1	105.5	Hard grey SILTY CLAY/CLAYEY SILT trace shale fragments, wet below 6.0 m	SS 7	52		
7.6	105.5	Hard grey SILTY CLAY/CLAYEY SILT with SHALE fragments below 7.0 m	SS 8	>80		
		Hard weathered shale Below 9.0 M				
9.8	103.3	Refusal at 9.8 m	SS 9.8	>80		

EOB

# AZURE GROUP DRAWING NO. 4

## JOB NUMBER 2202-001BH103

PROJECT LOCATION: 3016 – 3032 Kirwin Avenue & 3031 Little John Lane, Mississauga, Ontario

Client: Black Creek Group

$C_u$  = Shear Strength (kPa) | G% = Gravel, S% = Sand, F% = Fines (Silt and Clay), M = Moisture Content

Temperature: 5°C

Started/Date April 8, 2022 Time: 4:45 am Sheet 1 of 1

Finished/Date April 8, 2022 Time: 6:30 pm

Azure Rep: Amit Pal Auger Type: 150 mm Open

G. S. El: 112.5 m G.W. Depth: G.W. Elevation: Time:

Depth/Elev. (m)		Soil Description	Type/No	N	$C_u$ (kPa)	G.W.T	Remark
0	112.5	250 mm Topsoil Dark brown silty clay/clayey silt trace sand, gravel, and organics	AS 1				
.75	111.8		AS 2				
1.5	111.0		AS 3				
2.25	110.3	SILTY SAND/SANDY SILT trace gravel, moist below 2.2 m	AS 4				
3.0	109.5		AS 5				
4.6	107.9	Stiff to very stiff SILTY CLAY/CLAYEY SILT trace sand and gravel, wet below 4.0 m	SS 6				
6.1	106.4	Hard CLAYEY SILT/SILTY CLAY trace gravel, wet below 6.0 m	SS 7	50			
7.6	104.9	Hard CLAYEY SILT/SILT below 7.0 m	SS 8	>80			
9.2	103.3	Refusal at 8.2 m	SS 9	>80			

EOB

# AZURE GROUP DRAWING NO. 5

## JOB NUMBER 2202-001BH104

PROJECT LOCATION: 3016 – 3032 Kirwin Avenue & 3031 Little John Lane, Mississauga, Ontario

Client: Black Creek Group

$C_u$  = Shear Strength (kPa) | G% = Gravel, S% = Sand, F% = Fines (Silt and Clay), M = Moisture Content

Temperature: 5°C

Started/Date April 7, 2022 Time: 3.10 am Sheet 1 of 1

Finished/Date April 7, 2022 Time: 6:30 pm

Azure Rep: Amit Pal Auger Type: 150 mm Open

G. S. El: 112.1 m G.W. Depth: G.W. Elevation: Time:

Depth/Elev. (m)	Soil Description	Type/No	N	$C_u$ (kPa)	G.W.T	Remark
0	112.1	250 mm Topsoil Dark brown silty sand/sandy silt trace clay, gravel, and organics	AS	1		
.75	111.4	Dark brown SILTY CLAY trace gravel and organics below 0.7 m	AS	2		
1.5	110.6	Light brown CLAYEY SILT trace gravel below 1.5 m	AS	3		
2.25	109.9	SILTY CLAY/CLAYEY SILT, trace gravel, wet below 2.2 m	AS	4		
3.0	109.1	Hard CLAYEY SILT/SILTY CLAY below 3.0 m	AS	5		
4.6	107.5		AS	6		
6.1	106.0	Hard grey CLAYEY SILT/SILTY trace sand and gravel, wet below 6.0 m	SS	7	>80	
7.6	104.5		SS	7	>80	
9.2	102.9	Hard CLAYEY SILT with SHALE trace gravel	SS	8	>80	
9.8	102.3	below 9. M Refusal at 9.8 m	SS	9	>80	

EOB

# AZURE GROUP DRAWING NO. 6

## JOB NUMBER 2202-001BH105

PROJECT LOCATION: 3016 – 3032 Kirwin Avenue & 3031 Little John Lane, Mississauga, Ontario

Client: Black Creek Group

$C_u$  = Shear Strength (kPa) | G% = Gravel, S% = Sand, F% = Fines (Silt and Clay), M = Moisture Content

Temperature: 5°C

Started/Date April 8, 2022 Time: Sheet 1 of 1

Finished/Date April 8, 2022 Time:

Azure Rep: Amit Pal Auger Type: 150 mm Open

G. S. El: 110.8 m G.W. Depth: G.W. Elevation: Time:

Depth/Elev. (m)	Soil Description	Type/No	$C_u$ (kPa)	G.W.T	Remark
0	110.8	250 mm Topsoil Dark brown silty sand/sandy silt trace clay, gravel, and organics	AS 1		
.75	110.1	Sand trace clay and gravel below 0.75 m, moist to wet	AS 2		
1.5	109.3	SAND/SILTY SAND trace clay & GRAVEL, Wet below 1.5 m	AS 3		
2.25	108.6		AS 4		
3.0	107.8		AS 5		
4.6	106.2	Grey CLAYEY SILT, SILT trace sands below 4.6 m, wet	AS 6		
6.1	104.7	Very dense SILTY SAND/SANDY SILT trace Gravel and clay, wet below 6.0 m	SS 7	>80	
7.6	103.2		SS 8	>80	
9.2	101.6	Hard CLAYEY SILT with weathered SHALE below 9.0 m	SS 9	>80	
9.8	101.0	Refusal at 9.8 m	SS 10	>80	

EOB



# AZURE GROUP DRAWING NO. 7

## JOB NUMBER 2202-001BH(MW)106

PROJECT LOCATION: 3016 – 3032 Kirwin Avenue & 3031 Little John Lane, Mississauga, Ontario

Client: Black Creek Group

$C_u$  = Shear Strength (kPa) | G% = Gravel, S% = Sand, F% = Fines (Silt and Clay), M = Moisture Content

Temperature: 5°C

Started/Date April 8, 2022 Time: Sheet 1 of 1

Finished/Date April 8, 2022 Time:

Azure Rep: Amit Pal Auger Type: 150 mm Open

G. S. El: 110.78 m G.W. Depth: 2.69 m G.W. Elevation: 108.09 m Time:

Depth/Elev. (m)	Soil Description	Type/No	N	$C_u$ (kPa)	G.W.T	Remark
0	110.8	250 mm Topsoil Dark brown SILTY SAND/SANDY SILT trace clay, gravel, and organics	SS 1			
.75	110.1		SS 2			
1.5	109.3	CLAYEY SILT trace clay & GRAVEL, Wet below 1.5 m	SS 3			
2.25	108.6		SS 4			
3.0	107.8		SS 5		2.7 m	
4.6	106.2	Grey CLAYEY SILT trace gravel below, wet below 4.6 m	SS 6	225.0		
6.1	104.7	Hard grey CLAYEY SILT trace to some shale fragments, wet below 6.0 m	SS 7	>80	225.0	
7.6	103.2		SS 8	>80	225.0	
9.2	101.6	Hard grey CLAYEY SILT with weathered SHALE below 9.0 m, wet	SS 9	>80		
9.8	101.0	Refusal at 9.8 m	SS 10	>80		

EOB

# AZURE GROUP DRAWING NO. 8

## JOB NUMBER 2202-001BH(MW)107

PROJECT LOCATION: 3016 – 3032 Kirwin Avenue & 3031 Little John Lane, Mississauga, Ontario

Client: Black Creek Group

$C_u$  = Shear Strength (kPa) | G% = Gravel, S% = Sand, F% = Fines (Silt and Clay), M = Moisture Content

Temperature: 5°C

Started/Date April 8, 2022 Time: 11:45 Sheet 1 of 1

Finished/Date April 8, 2022 Time:

Azure Rep: Amit Pal Auger Type: 150 mm Open

G. S. El: 113.26 m G.W. Depth: G.W. Elevation: Time:

Depth/Elev. (m)	Soil Description	Type/No	N	$C_u$ (kPa)	G.W.T	Remark	
0	113.3	50 mm Asphalt	SS	1	5		
		Loose to very loose dark brown silty sand/sandy silt trace to some organics, gravel, and clay, moist					
.75	112.6		SS	2	7		
1.5	111.8	Compact below 1.5 m	SS	3	18		
2.25	111.1	Very dense below 2.2 m, possible boulders	SS	4	80		
3.0	110.3	Dense below 3.0 m, wet	SS	5	43		
4.6	108.7	Dense SILTY SAND/SAND possible boulders, wet below 4.0 m	SS	6	47		
6.1	107.2	Hard grey SILTY CLAY/CLAYEY SILT trace gravel, wet below 5.0 m	SS	7	47		
7.6	105.7	Hard grey weathered SHALE with hard SILTY CLAY	SS	8	>80		
9.2	104.1	Grey Weathered SHALE below 9.2 m	SS	9	>80		
10.7	102.6		SS	10	>80		
11.0	102.3	Refusal at 7.8 m	SS	11	>80		

EOB

# AZURE GROUP DRAWING NO. 9

## JOB NUMBER 2202-001BH108

PROJECT LOCATION: 3016 – 3032 Kirwin Avenue & 3031 Little John Lane, Mississauga, Ontario

Client: Black Creek Group

$C_u$  = Shear Strength (kPa) | G% = Gravel, S% = Sand, F% = Fines (Silt and Clay), M = Moisture Content

Temperature: 5°C

Started/Date April 8, 2022 Time: 8:00 am Sheet 1 of 1

Finished/Date April 8, 2022 Time:

Azure Rep: Amit Pal Auger Type: 150 mm Open

G. S. El: 113.28 m G.W. Depth: G.W. Elevation: Time:

Depth/Elev. (m)	Soil Description	Type/No	N	$C_u$ (kPa)	G.W.T	Remark
0	113.3	250 mm Topsoil Dark brown SILTY SAND/SANDY SILT trace clay, gravel, and organics	AS 1			
.75	112.6		AS 2			
1.5	111.8	Light brown SILTY SAND, trace clay and gravel, moist below 1.5 m,	AS 3	7		
2.25	111.1		AS 4			
3.0	110.3	Brown SILTY SAND with GRAVEL, moist below 3.0 m	AS 5	28		
4.6	108.7	Light brown SILTY SANDY/SANDY SILT trace to some clay and gravel, moist below 4.0 m	AS 6	25		
6.1	107.2	Hard CLAYEY SILT/SILTY CLAY trace to some shale fragments, wet below 6.0 m	SS 7	45		
7.6	105.7	Grey weathered SHALE with SILTY CLAY trace gravel, moist below 7.0 m	SS 8	75		
9.2	104.1	Grey weathered SHALE with SILTY CLAY trace gravel, moist below 9.0 m	SS 9	>80		
10.7	102.6		SS 10	>80		
11.3	102.0	Refusal at 11.3 m	SS 11	>80		

EOB

# AZURE GROUP DRAWING NO. 10

## JOB NUMBER 2202-001BH109

PROJECT LOCATION: 3016 – 3032 Kirwin Avenue & 3031 Little John Lane, Mississauga, Ontario

Client: Black Creek Group

$C_u$  = Shear Strength (kPa) | G% = Gravel, S% = Sand, F% = Fines (Silt and Clay), M = Moisture Content

Temperature: 5°C

Started/Date April 8, 2022 Time: 8:50 am Sheet 1 of 1

Finished/Date April 8, 2022 Time:

Azure Rep: Amit Pal Auger Type: 150 mm Open

G. S. El: 112.5 m G.W. Depth: G.W. Elevation: Time:

Depth/Elev. (m)	Soil Description	Type/No	N	$C_u$ (kPa)	G.W.T	Remark
0	112.5	250 mm Topsoil Dark brown SILTY SAND/SANDY SILT trace clay, gravel, and organics	AS			
.75	111.8		AS			
1.5	111.0	CLAYEY SILT trace clay & gravel, wet below 1.5 m	AS			
2.25	110.3		AS			
3.0	109.5		AS			
4.6	109.5	Grey CLAYEY SILT trace gravel below 4.6 m, wet below 4.0 m	AS			
6.1	106.4	Hard CLAYEY SILT/SILTY CLAY trace shale fragments, wet below 6.0 m	SS	>80		
7.6	104.9		SS	>80		
9.2	103.3	Hard CLAYEY SILT with weathered SHALE below 9.0 m, wet	SS	>80		
9.8	102.7	Refusal at 9.8 m	SS	>80		

EOB

# AZURE GROUP DRAWING NO. 11

## JOB NUMBER 2202-001BH110

PROJECT LOCATION: 3016 – 3032 Kirwin Avenue & 3031 Little John Lane, Mississauga, Ontario

Client: Black Creek Group

$C_u$  = Shear Strength (kPa) | G% = Gravel, S% = Sand, F% = Fines (Silt and Clay), M = Moisture Content

Temperature: 5°C

Started/Date April 8, 2022 Time: Sheet 1 of 1

Finished/Date April 8, 2022 Time:

Azure Rep: Amit Pal Auger Type: 150 mm Open

G. S. El: 110.88 m G.W. Depth: G.W. Elevation: Time:

Depth/Elev. (m)		Soil Description	Type/No	N	$C_u$ (kPa)	G.W.T	Remark
0	110.9	250 mm Topsoil Dark brown SILTY SAND/SANDY SILT trace clay, gravel, and organics	AS 1				
.75	110.2		AS 2				
1.5	109.4	CLAYEY SILT trace sand & gravel, wet below 1.5 m	AS 3				
2.25	108.7		AS 4				
3.0	107.9	SILTY SAND/SANDY SILT, wet below 3.0 m	AS 5				
4.6	106.3	Grey CLAYEY SILT trace gravel below 4.6 m, wet below 4.0 m	AS 6		225.0		
6.1	104.8	Hard CLAYEY SILT trace to some gravels, wet below 6.0 m	SS 7	>80	225.0		
7.6	103.3	Hard grey CLAYEY SILT trace shale fragments below 7.5 m	SS 8	>80			
9.2	101.7	Hard grey CLAYEY SILT with weathered SHALE below 9.0 m, wet	SS 9	>80			
9.8	101.1	Refusal at 9.8 m	SS 10	>80			

EOB



A199313 A199313  
Tag#: A199313

Measurements recorded in:  Metric  Imperial

S-20827 Page of

ROYAL BANK OF CANADA

Address of Well Location (Street Number/Name) 2 Dundas Street West  
 Township Mississauga Lot Concession  
 City/Town/Village Mississauga Province Ontario Postal Code  
 UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other WKQ-010354  
 NAD 83 17 11 09 24 8 26 12 7 A 0 - A 02

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft) From	Depth (m/ft) To
Blk	asphalt			0	3"
Brown	clay	silt		3"	10'
Grey	shale			10'	14'

**Annular Space**

Depth Set at (m/ft) From	Depth Set at (m/ft) To	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
0	6"	Concrete	
6"	3'	Bentonite	
3'	14'	Sand	

**Results of Well Yield Testing**

After test of well yield, water was: <input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
if pumping discontinued, give reason: Static Level	1		1	
	2		2	
	3		3	
	4		4	
	5		5	
	10		10	
if flowing give rate (l/min / GPM)	15		15	
	20		20	
	25		25	
	30		30	
	40		40	
	50		50	
Recommended pump depth (m/ft)	60		60	
Recommended pump rate (l/min / GPM)				
Well production (l/min / GPM)				
Disinfected? <input type="checkbox"/> Yes <input type="checkbox"/> No				

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  
 Other, specify Direct Push  Other, specify

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
2"	PVC	2.25	0	4'	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input checked="" type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
2.25	PVC	10	4'	14'	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input checked="" type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested	Depth (m/ft) From	Depth (m/ft) To	Diameter (cm/in)
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	0	14'	6"
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify			
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify			

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: Strata Soil Sampling Inc.  
 Well Contractor's Licence No.: 7 2 4 1  
 Business Address (Street Number/Name): 165 Shields Court  
 Municipality: Markham  
 Province: Ontario Postal Code: L3R 8V2 Business E-mail Address: wrecords@stratasoil.com

**Map of Well Location**

Please provide a map below following instructions on the back.

See Map  
"C"

Comments: General contractor: Pinchin Environmental

Bus. Telephone No. (inc. area code): 905-764-9304  
 Name of Well Technician (Last Name, First Name): Vanderhoor, Andrew  
 Well Technician's Licence No.: 36124  
 Signature of Technician and/or Contractor: [Signature]  
 Date Submitted: 20170929

**Ministry Use Only**

Audit No.: 2270105  
 Date Package Delivered: [Date]  
 Date Work Completed: 20170912  
 Received: [Signature]  
 OCT 15 2017

S - 20827



\*03-C "WP03-C"  
 added  
 17 T 611692 4826127  
 43.57974°N -79.61661°E  
 Elevation= 112.4m

\*02-B "WP02-B"  
 added  
 17 T 611750 4826092  
 43.57942°N -79.61590°E  
 Elevation= 111.1m

\*01-A "WP01-A"  
 added  
 17 T 611702 4826091  
 43.57942°N -79.61650°E  
 Elevation= 112.0m

\*\*all waypoints removed...

*C-7241*  
*7270105*

OCT 05 2017

Map data ©2017 Google Imagery ©2017, DigitalGlobe, First Base Solutions

Measurements recorded in:  Metric  Imperial

Well Owner's Information

First Name: \_\_\_\_\_ Last Name / Organization: **NYX CAPITAL CORP.** E-mail Address: \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name): **1131A LESLIE ST., SRE. 201** Municipality: **TORONTO** Province: **ONTARIO** Postal Code: **M3C3L8** Telephone No. (inc. area code): **416 548 5590**

Well Location

Address of Well Location (Street Number/Name): **3032 KIRWIN DR.** Township: \_\_\_\_\_ Lot: \_\_\_\_\_ Concession: \_\_\_\_\_

County/District/Municipality: \_\_\_\_\_ City/Town/Village: **MISSISSAUGA** Province: **Ontario** Postal Code: \_\_\_\_\_

UTM Coordinates Zone: \_\_\_\_\_ Easting: **NAD 83 17 61 11 9 43** Northing: **48 26 58 0** Municipal Plan and Sublot Number: \_\_\_\_\_ Other: \_\_\_\_\_

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft) From	Depth (m/ft) To
Brown	Earth Fill, silty clay and sand	Some silt	Loose - Compact	0	12.5
Brown	Fine-Medium Sand	Tr. silt, some gravel	Compact	12.5	15
Grey	Silty Clay, Till	Some sand, Tr. Gravel, Occ. silt layers, cobbles/Boulders	Hard	15	25

**Annular Space**

Depth Set at (m/ft) From: **0** To: **13** Type of Sealant Used (Material and Type): **Bentonite** Volume Placed (m<sup>3</sup>/ft<sup>3</sup>): **2.31**

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used

Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering

Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring

Boring  Digging  Irrigation  Cooling & Air Conditioning

Air percussion  Industrial

Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
<b>2</b>	<b>PVC</b>	<b>1/8</b>	<b>0</b>	<b>15</b>	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input checked="" type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input checked="" type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
<b>2 1/8</b>	<b>PVC</b>	<b>10</b>	<b>15</b>	<b>25</b>	<input type="checkbox"/> Other, specify _____

**Water Details**

Water found at Depth **12.5 (m/ft)** Kind of Water:  Fresh  Untested  Gas  Other, specify \_\_\_\_\_

Water found at Depth \_\_\_\_\_ Kind of Water:  Fresh  Untested  Gas  Other, specify \_\_\_\_\_

Water found at Depth \_\_\_\_\_ Kind of Water:  Fresh  Untested  Gas  Other, specify \_\_\_\_\_

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **STRONG SOIL SEARCH INC.** Well Contractor's Licence No.: **71247**

Business Address (Street Number/Name): **5265 SIOUXE 16** Municipality: **CLAREMONT**

Province: **ONTARIO** Postal Code: **L1Y1A1** Business E-mail Address: **strongsoilsearchinc@bell.net.ca**

Bus. Telephone No. (inc. area code): **905 649 1115** Name of Well Technician (Last Name, First Name): **NETO, NELSON**

Well Technician's Licence No.: **3174** Signature of Technician and/or Contractor: *[Signature]* Date Submitted: **20170802**

**Results of Well Yield Testing**

After test of well yield, water was:  Clear and sand free  Other, specify \_\_\_\_\_

If pumping discontinued, give reason: \_\_\_\_\_

Pump intake set at (m/ft)	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
1			1	
2			2	
3			3	
4			4	
5			5	
10			10	
15			15	
20			20	
25			25	
30			30	
40			40	
50			50	
60			60	

Recommended pump depth (m/ft): \_\_\_\_\_

Recommended pump rate (l/min / GPM): \_\_\_\_\_

Well production (l/min / GPM): \_\_\_\_\_

Disinfected?  Yes  No

**Map of Well Location**

Please provide a map below following instructions on the back.

Comments: **3 WELL CLUSTERS**

Well owner's information package delivered:  Yes  No

Date Package Delivered: **20170905** Date Work Completed: **20170905**

**Ministry Use Only**

Audit No.: **2272465**

**MAR 02 2018**

Received: \_\_\_\_\_





A252016

Measurements recorded in:  Metric  Imperial

8-23002

Page \_\_\_\_ of \_\_\_\_

CITY OF MISSISSAUGA

County/District/Municipality: Mississauga City/Town/Village: Mississauga Province: Ontario Postal Code: \_\_\_\_\_

UTM Coordinates: Zone: 18 Easting: 3176121724826160 Northing: \_\_\_\_\_ Municipal Plan and Sublot Number: \_\_\_\_\_ Other: \_\_\_\_\_

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft) From	Depth (m/ft) To
Brown	Top Soil			0	2'
Brown	clay	Silt		2'	5'
Grey	Silt	clay		5'	13'

**Annular Space**

Depth Set at (m/ft) From	Depth Set at (m/ft) To	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
0	0.5'	concrete	
0.5'	2'	Holeplug	
2'	13'	Sand	

**Results of Well Yield Testing**

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
Static Level				
1			1	
2			2	
3			3	
4			4	
5			5	
10			10	
15			15	
20			20	
25			25	
30			30	
40			40	
50			50	
60			60	

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used

Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering

Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring

Boring  Digging  Irrigation  Cooling & Air Conditioning

Air percussion  Other, specify: Direct Push  Industrial  Other, specify

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
2"	PVC	0.125"	0	13'	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input checked="" type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned <input type="checkbox"/> Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
2.25"	PVC	10	3'	13'	<input type="checkbox"/> Abandoned, other, specify

**Water Details**

Water found at Depth (m/ft)	Kind of Water:	Depth (m/ft)	Hole Diameter
	<input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	From To	Diameter (cm/in)
		0 13'	6"

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: Strata Soil Sampling Well Contractor's Licence No.: 12141

Business Address (Street Number/Name): 165 Shields Court Municipality: Markham

Province: \_\_\_\_\_ Postal Code: \_\_\_\_\_ Business E-mail Address: wrrecords@stratasoil.com

Bus. Telephone No. (inc. area code): 905-883-1119 Name of Well Technician (Last Name, First Name): Walker, Jonathan

Well Technician's Licence No.: 518313 Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: 10/19/08

0506E (2014/11) Ministry's Copy

**Map of Well Location**

Please provide a map below following instructions on the back.

See Map

MW1

Comments: \_\_\_\_\_

Well owner's information package delivered:  Yes  No

Date Package Delivered: 2018 MAR 21

Date Work Completed: \_\_\_\_\_

Ministry Use Only

Audit No. Z304914

Received: MAR 15 2009

© Queen's Printer for Ontario, 2014

S 23002

Geoplaner V2.8 - (in English | auf Deutsch)  
dit.didd.de



## Notice of Collection of Personal Information

Personal information contained on this form is collected pursuant to sections 35-50 and 75(2) of the *Ontario Water Resources Act* and section 16.3 of the Wells Regulation. This information will be used for the purpose of maintaining a public record of wells in Ontario. This form and the information contained on the form will be stored in the Ministry's well record database and made publicly available. Questions about this collection should be directed to the Water Well Customer Service Representative at the Wells Help Desk, 125 Resources Road, Toronto Ontario M9P 3V6, at 1-888-396-9355 or [wellshelpdesk@ontario.ca](mailto:wellshelpdesk@ontario.ca).

Fields marked with an asterisk (\*) are mandatory.

Well Tag Number \*

A246265

### Type \*

Construction  Abandonment

### Measurement recorded in: \*

Metric  Imperial

## 1. Well Owner's Information

Last Name and First Name, or Organization is mandatory. \*

Last Name

First Name

Organization

EQUITY THREE HOLDINGS INC./EOB LTD.

Email Address

### Current Address

Unit Number

Street Number \*

Street Name \*

City/Town/Village

Country

CANADA

Province

ONTARIO

Postal Code

Telephone Number

## 2. Well Location

### Address of Well Location

Unit Number

Street Number \*

Street Name \*

Township

3085

HURONTARIO ST.

Lot

Concession

County/District/Municipality

PEEL

City/Town

MISSISSAUGA

Province

Ontario

Postal Code

L5A 4E4

UTM Coordinates

Zone \*

Easting \*

Northing \*

Municipal Plan and Sublot Number

NAD 83

17

611496

4826433

[Test UTM in Map](#)

Other

BH 2

## 3. Overburden and Bedrock Material \*

Well Depth \*

4.5

(m)

General Colour	Most Common Material	Other Materials	General Description	Depth From (m)	Depth To (m)
Black		Asphalt		0	0.1
Grey	Gravel			0.1	0.3

Brown	Sand			0.3	1.5
Brown	Silt	Clay		1.5	2.1
Grey	Shale		Weathered	2.1	4.5

#### 4. Annular Space \*

Depth From (m)	Depth To (m)	Type of Sealant Used (Material and Type)	Volume Placed (cubic metres)
0	0.3	CONCRETE	0.01
0.3	2.7	BENTONITE CHIPS	0.08

#### 5. Method of Construction \*

- Cable Tool     Rotary (Conventional)     Rotary (Reverse)     Boring     Air percussion     Diamond  
 Jetting     Driving     Digging     Rotary (Air)     Augering     Direct Push  
 Other (specify) \_\_\_\_\_

#### 6. Well Use \*

- Public     Industrial     Cooling & Air Conditioning  
 Domestic     Commercial     Not Used  
 Livestock     Municipal     Monitoring  
 Irrigation     Test Hole     Dewatering  
 Other (specify) \_\_\_\_\_

#### 7. Status of Well \*

- Water Supply     Replacement Well     Test Hole  
 Recharge Well     Dewatering Well     Observation and/or Monitoring Hole  
 Alteration (Construction)     Abandoned, Insufficient Supply     Abandoned, Poor Water Quality  
 Abandoned, other (specify) \_\_\_\_\_  
 Other (specify) \_\_\_\_\_

#### 8. Construction Record - Casing \* (use negative number(s) to indicate depth above ground surface)

Inside Diameter (cm)	Open Hole or Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness	Depth From (m)	Depth To (m)
5.1	Plastic	0.65	0	3

#### 9. Construction Record - Screen

Outside Diameter (cm)	Material (Plastic, Galvanized, Steel)	Slot Number	Depth From (m)	Depth To (m)
6.4	Plastic	10	3	4.5

## 10. Water Details

Water found at Depth (m)  Gas Kind of Water  Fresh  Untested  Other (specify)

## 11. Hole Diameter

Depth From (m)	Depth To (m)	Diameter (cm)
0	4.5	21

## 12. Results of Well Yield Testing

Pumping Discontinued

Explain \_\_\_\_\_

If flowing give rate

Flowing \_\_\_\_\_ (L/min)

Draw down \*

Time (min)	Static Level	1	2	3	4	5	10	15	20	25	30	40	50	60
Water Level (m)														

Recovery \*

Time (min)	1	2	3	4	5	10	15	20	25	30	40	50	60
Water Level (m)													


After test of well yield, water was

Clear and sand free  Other (specify)

Pump intake set at (m)	Pumping rate (L/min)	Duration of pumping hrs + min	Final water level end of pumping (m)	Disinfected? * <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
Recommended pump depth (m)	Recommended pump rate (L/min)	Well production (L/min)		


## 13. Map of Well Location \*

Map 1. Please Click the map area below to import an image file to use as the map.  Make map area bigger

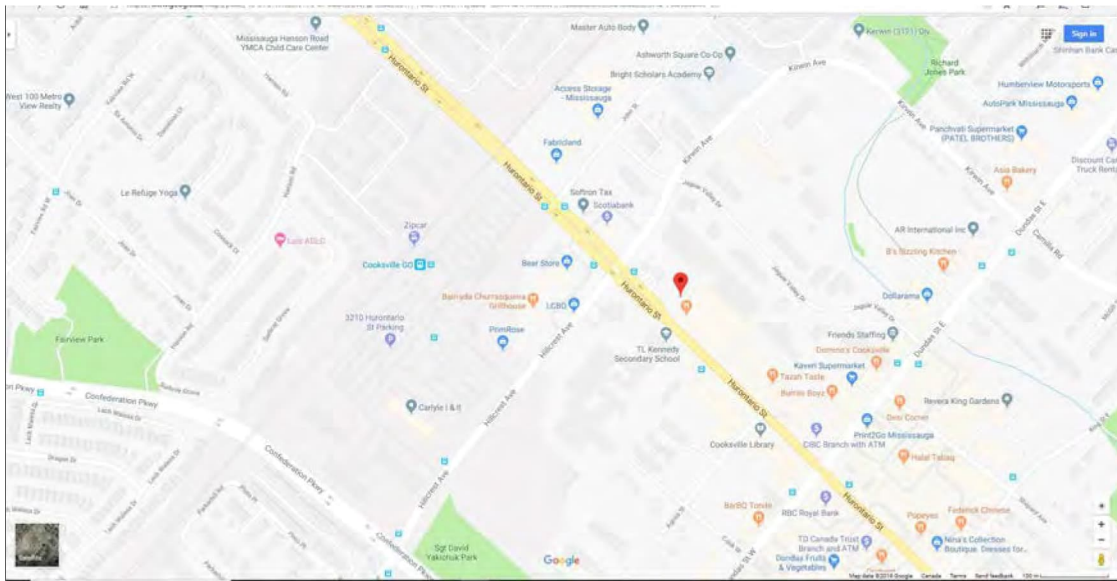

14. Information		
Well owner's information package delivered <input type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered (yyyy/mm/dd)	Date Work Completed (yyyy/mm/dd) *
		2019/04/08
Comments		

15. Well Contractor and Well Technician Information			
Business Name of Well Contractor *		Well Contractor's License Number *	
Geo-Environmental Drilling Inc.		6607	
Business Address			
Unit Number	Street Number	Street Name *	
	1	Mansewood Court	
City/Town/Village *		Province	Postal Code *
Halton Hills		Ontario	L7J 0A1
Business Telephone Number		Business Email Address	
905-876-3388		dgunn@geo-environmentaldrilling.com	
Last Name of Well Technician *		First Name of Well Technician *	Well Technician's License Number *
PAQUETTE		JEFF	2386

16. Declaration *		
<input checked="" type="checkbox"/> I hereby confirm that I am the person who constructed the well and I hereby confirm that the information on the form is correct and accurate.		
Last Name	First Name	Email Address
PAQUETTE	JEFF	romana@geo-environmentaldrilling.com
Signature		Date Submitted (yyyy/mm/dd)
 Digitally signed by Jeff Paquette Date: 2019.05.09 14:56:02 -04'00'		2019/05/09

17. Ministry Use Only	
Audit Number	
BALY VF8S	



Measurements recorded in:  Metric  Imperial

A291838 Tag#: A291838

ion 903 Ontario Water Resources Act Page of

**Well Owner's Information**

First Name: \_\_\_\_\_ Last Name / Organization: City of Mississauga E-mail Address: \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name): 300 City Centre Dr Municipality: Miss Province: ON Postal Code: L5B3C1 Telephone No. (inc. area code): \_\_\_\_\_

**Well Location**

Address of Well Location (Street Number/Name): 2515 Shepard Ave Township: \_\_\_\_\_ Lot: \_\_\_\_\_ Concession: \_\_\_\_\_

County/District/Municipality: \_\_\_\_\_ City/Town/Village: Mississauga Province: Ontario Postal Code: L5B2H7

UTM Coordinates Zone: \_\_\_\_\_ Easting: \_\_\_\_\_ Northing: \_\_\_\_\_ Municipal Plan and Sublot Number: \_\_\_\_\_ Other: \_\_\_\_\_

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	Snd			0	3
Brown	Silt	Snd		3	14
Grey	Silt	Snd		14	18

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
0 - 5'	concrete	
5' - 7'	no plug	
7' - 18'	Sand	

**Results of Well Yield Testing**

After test of well yield, water was: <input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason: _____	Static Level			
	1		1	
	2		2	
	3		3	
	4		4	
	5		5	
Pump intake set at (m/ft)				
Pumping rate (l/min / GPM)				
Duration of pumping hrs + min				
Final water level end of pumping (m/ft)	10		10	
If flowing give rate (l/min / GPM)				
Recommended pump depth (m/ft)	15		15	
	20		20	
	25		25	
Recommended pump rate (l/min / GPM)	30		30	
	40		40	
Well production (l/min / GPM)	50		50	
	60		60	
Disinfected? <input type="checkbox"/> Yes <input type="checkbox"/> No				

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  
 Other, specify Diat Rock  Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
2"	PVC	1.25	0	8'	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input checked="" type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input checked="" type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To
2.25"	PVC	10	8'	18'

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	Hole Diameter	
		Depth (m/ft)	Diameter (cm/in)
		0	18' 6"

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: Strata Soil Sampling Well Contractor's Licence No.: 7271

Business Address (Street Number/Name): 129 Ringwood Drive Stouffville

Province: ON Postal Code: L4A8C1 Business E-mail Address: wrecord@stratasoil.com

Bus. Telephone No. (no area code): 9059407919 Name of Well Technician (Last Name, First Name): Kyle R. H.

Well Technician's Licence No.: 3459 Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: 20200930

**Map of Well Location**

Please provide a map below following instructions on the back.

See Map  
MWC

**Ministry Use Only**

Well owner's information package delivered:  Yes  No


Date Package Delivered: 20200429

Date Work Completed: \_\_\_\_\_

Audit No.: 2334740

Received: MAY 20 2020

Google Maps 2515 Shepard Ave

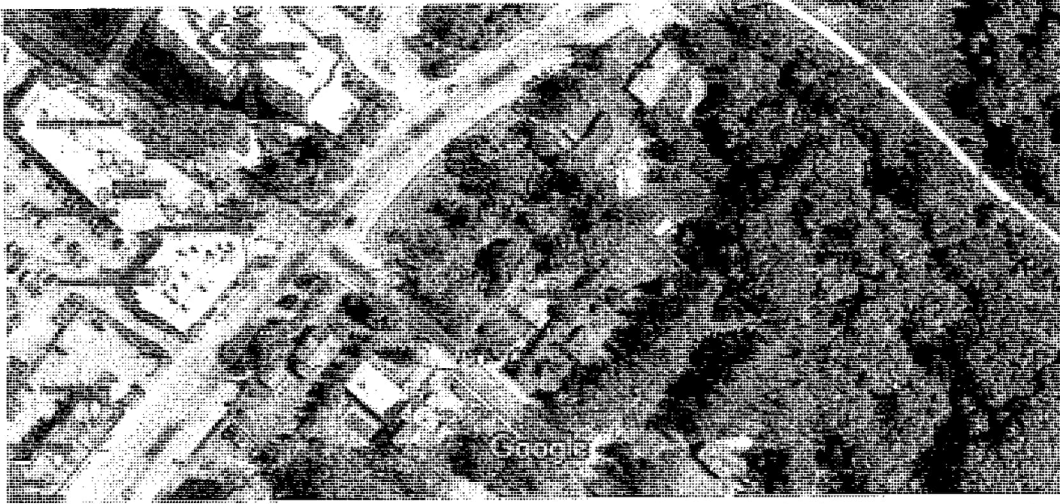

Imagery ©2020 First Base Solutions, Maxar Technologies, Map data ©2020 20 m

C-7241  
7334740

MAY 20 2020

<https://www.google.ca/maps/place/2515+Shepard+Ave,+Mississauga,+ON+L5A+2H7/@...> 29/04/2020

---



### Notice of Collection of Personal Information

Personal information contained on this form is collected pursuant to sections 35-50 and 75(2) of the *Ontario Water Resources Act* and section 16.3 of the Wells Regulation. This information will be used for the purpose of maintaining a public record of wells in Ontario. This form and the information contained on the form will be stored in the Ministry's well record database and made publicly available. Questions about this collection should be directed to the Water Well Customer Service Representative at the Wells Help Desk, 125 Resources Road, Toronto Ontario M9P 3V6, at 1-888-396-9355 or [wellshelpdesk@ontario.ca](mailto:wellshelpdesk@ontario.ca).

Fields marked with an asterisk (\*) are mandatory.

Well Tag Number *
A308294

#### Type \*

Construction       Abandonment

#### Measurement recorded in: \*

Metric       Imperial

### 1. Well Owner's Information

Last Name and First Name, or Organization is mandatory. \*

Last Name	First Name
[Redacted]	[Redacted]
Organization	Email Address
<a href="#">Emblem Developments</a>	[Redacted]

#### Current Address

Unit Number	Street Number *	Street Name *	City/Town/Village
[Redacted]	[Redacted]	[Redacted]	[Redacted]
Country	Province	Postal Code	Telephone Number
[Redacted]	[Redacted]	[Redacted]	[Redacted]

### 2. Well Location

#### Address of Well Location

Unit Number	Street Number *	Street Name *	Township
	90	<a href="#">Dundas Street East</a>	
Lot	Concession	County/District/Municipality	
City/Town	Province	Postal Code	
<a href="#">Mississauga</a>	Ontario		
UTM Coordinates	Zone *	Easting *	Northing *
NAD 83	17	611907	4826370
			<a href="#">Test UTM in Map</a>
Municipal Plan and Sublot Number			
Other			

### 3. Overburden and Bedrock Material \*

Well Depth *	20	(ft)			
General Colour	Most Common Material	Other Materials	General Description	Depth From	Depth To

				(ft)	(ft)
Brown	Fill		Loose	0	15
Grey	Clay	Till	Packed	15	20

#### 4. Annular Space \*

Depth From (ft)	Depth To (ft)	Type of Sealant Used (Material and Type)	Volume Placed (cubic feet)
0	9	Bentonite	1.5
9	20	Sand Pack	1.8

#### 5. Method of Construction \*

- Cable Tool     Rotary (Conventional)     Rotary (Reverse)     Boring     Air percussion     Diamond  
 Jetting     Driving     Digging     Rotary (Air)     Augering     Direct Push  
 Other (specify) \_\_\_\_\_

#### 6. Well Use \*

- Public     Industrial     Cooling & Air Conditioning  
 Domestic     Commercial     Not Used  
 Livestock     Municipal     Monitoring  
 Irrigation     Test Hole     Dewatering  
 Other (specify) \_\_\_\_\_

#### 7. Status of Well \*

- Water Supply     Replacement Well     Test Hole  
 Recharge Well     Dewatering Well     Observation and/or Monitoring Hole  
 Alteration (Construction)     Abandoned, Insufficient Supply     Abandoned, Poor Water Quality  
 Abandoned, other (specify) \_\_\_\_\_  
 Other (specify) \_\_\_\_\_

#### 8. Construction Record - Casing \* (use negative number(s) to indicate depth above ground surface)

Inside Diameter (in)	Open Hole or Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness	Depth From (ft)	Depth To (ft)
2	Plastic	0.2	0	10

#### 9. Construction Record - Screen

Outside Diameter (in)	Material (Plastic, Galvanized, Steel)	Slot Number	Depth From (ft)	Depth To (ft)
2.5	Plastic	10	10	20

## 10. Water Details

Water found at Depth (ft)  Gas Kind of water  Fresh  Untested  Other

## 11. Hole Diameter

Depth From (ft)	Depth To (ft)	Diameter (in)
0	20	7.5

## 12. Results of Well Yield Testing

Pumping Discontinued

Explain \_\_\_\_\_

If flowing give rate

Flowing \_\_\_\_\_ (GPM)

Draw down

Time (min)	Static Level	1	2	3	4	5	10	15	20	25	30	40	50	60
Water Level (ft)														

Recovery

Time (min)	1	2	3	4	5	10	15	20	25	30	40	50	60
Water Level (ft)													

After test of well yield, water was


Clear and sand free  Other (specify)

Pump intake set at (ft)	Pumping rate (GPM)	Duration of pumping hrs + min	Final water level end of pumping (ft)	Disinfected? * <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
-------------------------	--------------------	-------------------------------	---------------------------------------	---

Recommended pump depth (ft)	Recommended pump rate (GPM)	Well production (GPM)
-----------------------------	-----------------------------	-----------------------

## 13. Map of Well Location \*

Map 1. Please Click the map area below to import an image file to use as the map.  Make map area bigger

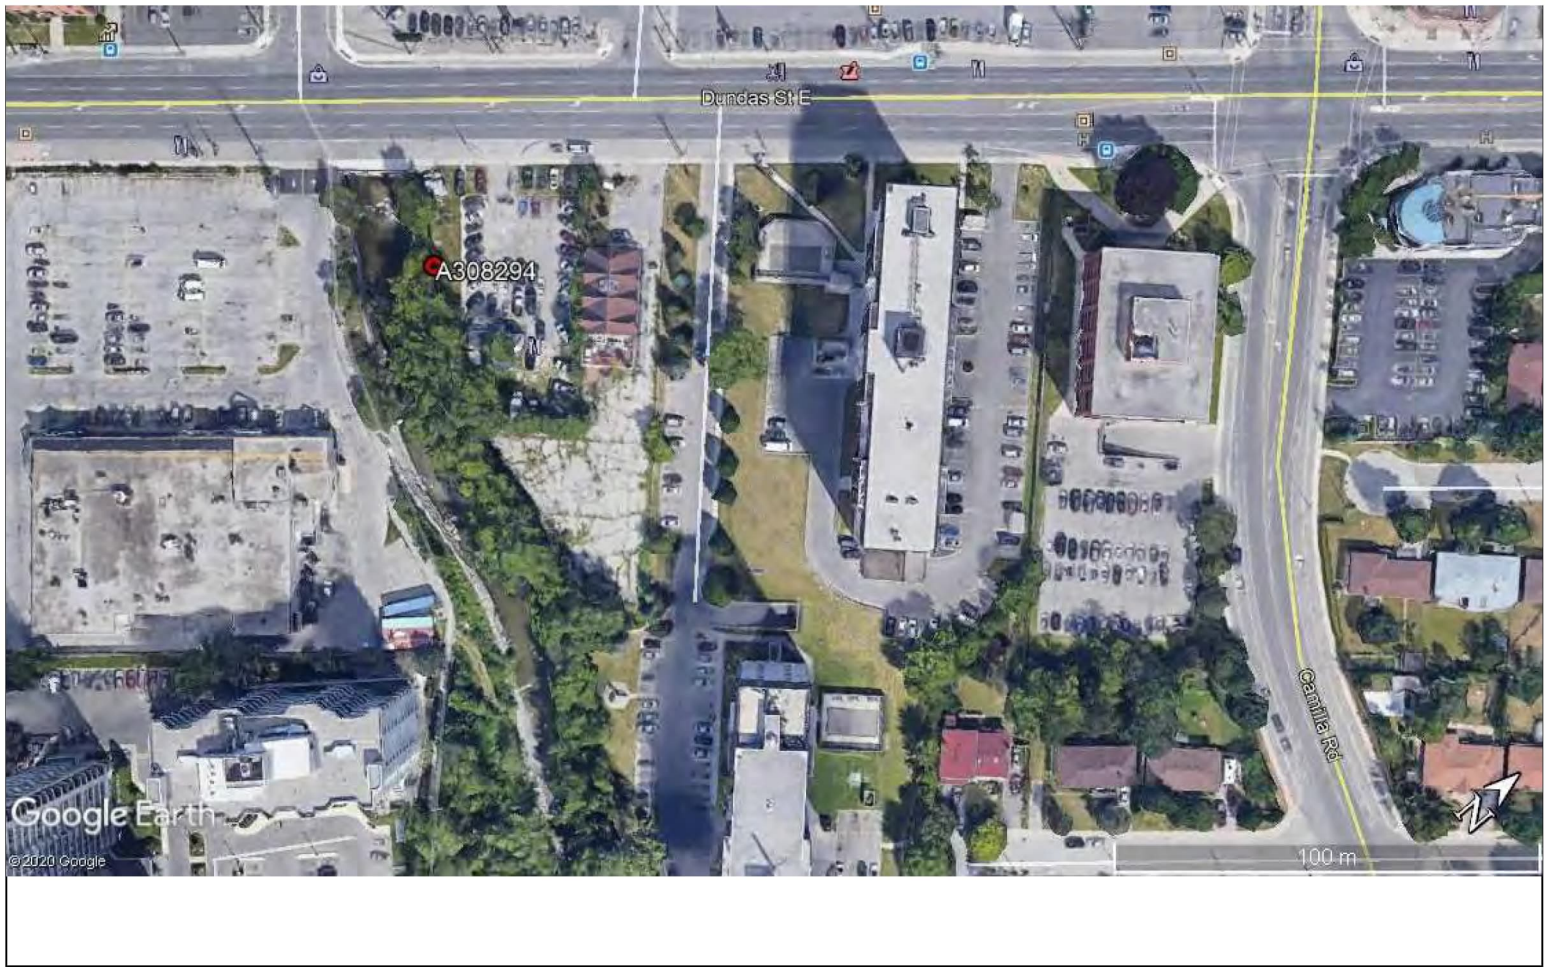

**14. Information**

Well owner's information package delivered <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Date Package Delivered (yyyy/mm/dd)	Date Work Completed (yyyy/mm/dd) * 2020/10/22
Comments		

**15. Well Contractor and Well Technician Information**

Business Name of Well Contractor * Davis Drilling Ltd		Well Contractor's License Number * 7472	
<b>Business Address</b>			
Unit Number	Street Number 873	Street Name * Nipissing Rd	
City/Town/Village * Milton		Province ON	Postal Code * L9T 4Z4
Business Telephone Number 905-299-6915		Business Email Address davisdrilling@bellnet.ca	
Last Name of Well Technician * Borsellino		First Name of Well Technician * Nicholas	Well Technician's License Number * 3579

**16. Declaration \***

I hereby confirm that I am the person who constructed the well and I hereby confirm that the information on the form is correct and accurate.

Last Name Borsellino	First Name Nicholas	Email Address davisdrilling@bellnet.ca
Signature <b>Nicholas Borsellino</b>	Digitally signed by Nicholas Borsellino Date: 2020.11.23 08:27:50 -05'00'	Date Submitted (yyyy/mm/dd) 2020/11/23

**17. Ministry Use Only**

Audit Number  
OTWW PHOK

**Notice of Collection of Personal Information**

Personal information contained on this form is collected pursuant to sections 35-50 and 75(2) of the *Ontario Water Resources Act* and section 16.3 of the Wells Regulation. This information will be used for the purpose of maintaining a public record of wells in Ontario. This form and the information contained on the form will be stored in the Ministry's well record database and made publicly available. Questions about this collection should be directed to the Water Well Customer Service Representative at the Wells Help Desk, 125 Resources Road, Toronto Ontario M9P 3V6, at 1-888-396-9355 or [wellshelpdesk@ontario.ca](mailto:wellshelpdesk@ontario.ca).

Fields marked with an asterisk (\*) are mandatory.

Well Tag Number *
A307705

**Type \***

Construction       Abandonment

**Measurement recorded in: \***

Metric       Imperial

**1. Well Owner's Information**

Last Name and First Name, or Organization is mandatory. \*

Last Name	First Name
[Redacted]	[Redacted]
Organization	Email Address
DBV Real Estate Investments Inc.	[Redacted]

**Current Address**

Unit Number	Street Number *	Street Name *	City/Town/Village
[Redacted]	[Redacted]	[Redacted]	[Redacted]
Country	Province	Postal Code	Telephone Number
	Ontario	[Redacted]	[Redacted]

**2. Well Location**

**Address of Well Location**

Unit Number	Street Number *	Street Name *	Township
	3026	Kirwin Ave	
Lot	Concession	County/District/Municipality	
City/Town	Province	Postal Code	
Mississauga	Ontario		
UTM Coordinates	Zone *	Easting *	Northing *
NAD 83	17	611938	4826579
			<a href="#">Test UTM in Map</a>
Municipal Plan and Sublot Number			
Other			

**3. Overburden and Bedrock Material \***

Well Depth *	22	(ft)			
General Colour	Most Common Material	Other Materials	General Description	Depth From	Depth To

				(ft)	(ft)
Brown	Gravel	Sand		0	15
Blue	Shale		Weathered	15	22

#### 4. Annular Space \*

Depth From (ft)	Depth To (ft)	Type of Sealant Used (Material and Type)	Volume Placed (cubic feet)
0	11	Bentonite Chip	3.52
11	22	No. 2 Sand	3.52

#### 5. Method of Construction \*

- Cable Tool     Rotary (Conventional)     Rotary (Reverse)     Boring     Air percussion     Diamond  
 Jetting     Driving     Digging     Rotary (Air)     Augering     Direct Push  
 Other (specify) \_\_\_\_\_

#### 6. Well Use \*

- Public     Industrial     Cooling & Air Conditioning  
 Domestic     Commercial     Not Used  
 Livestock     Municipal     Monitoring  
 Irrigation     Test Hole     Dewatering  
 Other (specify) \_\_\_\_\_

#### 7. Status of Well \*

- Water Supply     Replacement Well     Test Hole  
 Recharge Well     Dewatering Well     Observation and/or Monitoring Hole  
 Alteration (Construction)     Abandoned, Insufficient Supply     Abandoned, Poor Water Quality  
 Abandoned, other (specify) \_\_\_\_\_  
 Other (specify) \_\_\_\_\_

#### 8. Construction Record - Casing \* (use negative number(s) to indicate depth above ground surface)

Inside Diameter (in)	Open Hole or Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness	Depth From (ft)	Depth To (ft)
2	Plastic	0.15	0	12

#### 9. Construction Record - Screen

Outside Diameter (in)	Material (Plastic, Galvanized, Steel)	Slot Number	Depth From (ft)	Depth To (ft)
2.3	Plastic	10	12	22

## 10. Water Details

Water found at Depth 17.5 (ft)  Gas Kind of water  Fresh  Untested  Other

## 11. Hole Diameter

Depth From (ft)	Depth To (ft)	Diameter (in)
0	22	8

## 12. Results of Well Yield Testing

Pumping Discontinued

Explain \_\_\_\_\_

If flowing give rate

Flowing \_\_\_\_\_ (GPM)

Draw down

Time (min)	Static Level	1	2	3	4	5	10	15	20	25	30	40	50	60
Water Level (ft)														

Recovery

Time (min)	1	2	3	4	5	10	15	20	25	30	40	50	60
Water Level (ft)													

After test of well yield, water was

Clear and sand free  Other (specify)


Pump intake set at (ft)	Pumping rate (GPM)	Duration of pumping hrs + min	Final water level end of pumping (ft)	Disinfected? * <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
-------------------------	--------------------	-------------------------------	---------------------------------------	---

Recommended pump depth (ft)	Recommended pump rate (GPM)	Well production (GPM)
-----------------------------	-----------------------------	-----------------------

## 13. Map of Well Location \*

Map 1. Please Click the map area below to import an image file to use as the map.  Make map area bigger



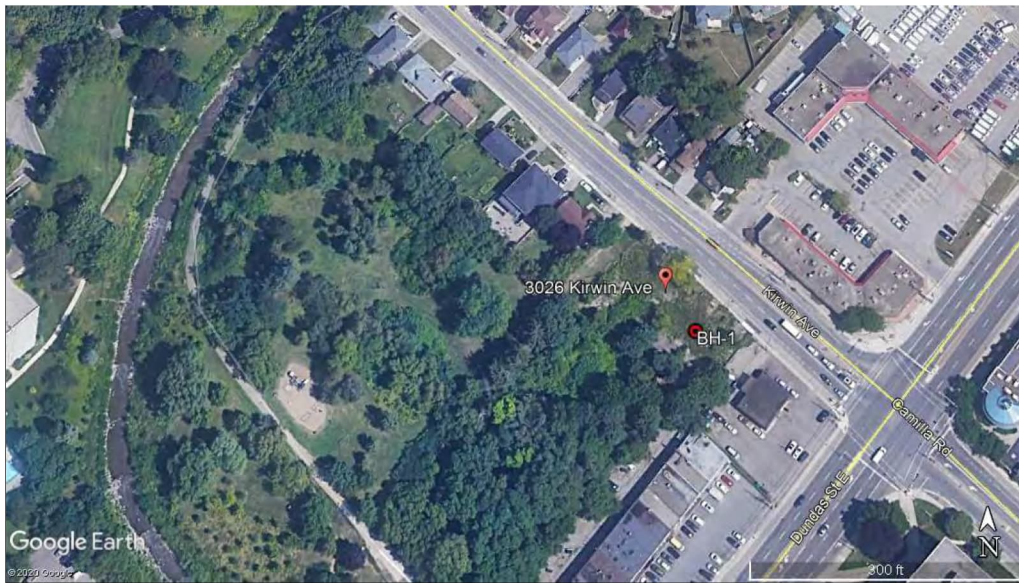

**14. Information**

Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered (yyyy/mm/dd) 2021/01/25	Date Work Completed (yyyy/mm/dd) * 2020/12/09
---	---	--

Comments  
56946-bh1

**15. Well Contractor and Well Technician Information**

Business Name of Well Contractor * Altech Drilling & Investigative Services	Well Contractor's License Number * 7282
--	--

**Business Address**

Unit Number	Street Number 410	Street Name * Pinebush Road
City/Town/Village * Cambridge	Province Ontario	Postal Code * N1T 1Z6

Business Telephone Number 519-650-5557	Business Email Address
---	------------------------

Last Name of Well Technician * Stranz	First Name of Well Technician * Brandon	Well Technician's License Number * 4021
--	--	--

**16. Declaration \***

I hereby confirm that I am the person who constructed the well and I hereby confirm that the information on the form is correct and accurate.

Last Name Stranz	First Name Brandon	Email Address bstranz@altechworld.com
---------------------	-----------------------	--

Signature <b>Brandon Stranz</b>	Digitally signed by Brandon Stranz Date: 2021.01.25 08:12:40 -05'00'	Date Submitted (yyyy/mm/dd) 2021/01/25
------------------------------------	---	---

**17. Ministry Use Only**

Audit Number KCE2 XI4N
---------------------------

**Notice of Collection of Personal Information**

Personal information contained on this form is collected pursuant to sections 35-50 and 75(2) of the *Ontario Water Resources Act* and section 16.3 of the Wells Regulation. This information will be used for the purpose of maintaining a public record of wells in Ontario. This form and the information contained on the form will be stored in the Ministry's well record database and made publicly available. Questions about this collection should be directed to the Water Well Customer Service Representative at the Wells Help Desk, 125 Resources Road, Toronto Ontario M9P 3V6, at 1-888-396-9355 or [wellshelpdesk@ontario.ca](mailto:wellshelpdesk@ontario.ca).

Fields marked with an asterisk (\*) are mandatory.

Well Tag Number *
A307718

**Type \***

Construction       Abandonment

**Measurement recorded in: \***

Metric       Imperial

**1. Well Owner's Information**

Last Name and First Name, or Organization is mandatory. \*

Last Name	First Name
[Redacted]	[Redacted]
Organization	Email Address
DBV Real Estate Investments Inc.	[Redacted]

**Current Address**

Unit Number	Street Number *	Street Name *	City/Town/Village
[Redacted]	[Redacted]	[Redacted]	[Redacted]
Country	Province	Postal Code	Telephone Number
	Ontario	[Redacted]	[Redacted]

**2. Well Location**

**Address of Well Location**

Unit Number	Street Number *	Street Name *	Township
	3026	Kirwin Ave	
Lot	Concession	County/District/Municipality	
City/Town	Province	Postal Code	
Mississauga	Ontario		
UTM Coordinates	Zone *	Easting *	Northing *
NAD 83	17	611926	4826559
			<a href="#">Test UTM in Map</a>
Municipal Plan and Sublot Number			
Other			

**3. Overburden and Bedrock Material \***

Well Depth *	19	(ft)			
General Colour	Most Common Material	Other Materials	General Description	Depth From	Depth To

				(ft)	(ft)
Brown	Gravel	Sand		0	15
Blue	Shale		Weathered	15	19

#### 4. Annular Space \*

Depth From (ft)	Depth To (ft)	Type of Sealant Used (Material and Type)	Volume Placed (cubic feet)
0	8	Bentonite Chip	2.56
8	19	No. 2 Sand	3.52

#### 5. Method of Construction \*

- Cable Tool     Rotary (Conventional)     Rotary (Reverse)     Boring     Air percussion     Diamond  
 Jetting     Driving     Digging     Rotary (Air)     Augering     Direct Push  
 Other (specify) \_\_\_\_\_

#### 6. Well Use \*

- Public     Industrial     Cooling & Air Conditioning  
 Domestic     Commercial     Not Used  
 Livestock     Municipal     Monitoring  
 Irrigation     Test Hole     Dewatering  
 Other (specify) \_\_\_\_\_

#### 7. Status of Well \*

- Water Supply     Replacement Well     Test Hole  
 Recharge Well     Dewatering Well     Observation and/or Monitoring Hole  
 Alteration (Construction)     Abandoned, Insufficient Supply     Abandoned, Poor Water Quality  
 Abandoned, other (specify) \_\_\_\_\_  
 Other (specify) \_\_\_\_\_

#### 8. Construction Record - Casing \* (use negative number(s) to indicate depth above ground surface)

Inside Diameter (in)	Open Hole or Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness	Depth From (ft)	Depth To (ft)
2	Plastic	0.15	0	9

#### 9. Construction Record - Screen

Outside Diameter (in)	Material (Plastic, Galvanized, Steel)	Slot Number	Depth From (ft)	Depth To (ft)
2.3	Plastic	10	9	19

## 10. Water Details

Water found at Depth (ft)  Gas Kind of water  Fresh  Untested  Other

## 11. Hole Diameter

Depth From (ft)	Depth To (ft)	Diameter (in)
0	19	8

## 12. Results of Well Yield Testing

Pumping Discontinued

Explain \_\_\_\_\_

If flowing give rate

Flowing \_\_\_\_\_ (GPM)

Draw down

Time (min)	Static Level	1	2	3	4	5	10	15	20	25	30	40	50	60
Water Level (ft)														

Recovery

Time (min)	1	2	3	4	5	10	15	20	25	30	40	50	60
Water Level (ft)													

After test of well yield, water was

Clear and sand free  Other (specify)

Pump intake set at (ft)	Pumping rate (GPM)	Duration of pumping hrs + min	Final water level end of pumping (ft)	Disinfected? * <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
-------------------------	--------------------	-------------------------------	---------------------------------------	---

Recommended pump depth (ft)	Recommended pump rate (GPM)	Well production (GPM)
-----------------------------	-----------------------------	-----------------------

## 13. Map of Well Location \*

Map 1. Please Click the map area below to import an image file to use as the map.  Make map area bigger



**14. Information**

Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered (yyyy/mm/dd) 2021/01/25	Date Work Completed (yyyy/mm/dd) * 2020/12/09
---	---	--

Comments  
56946-bh2

**15. Well Contractor and Well Technician Information**

Business Name of Well Contractor * Altech Drilling & Investigative Services	Well Contractor's License Number * 7282
--	--

**Business Address**

Unit Number	Street Number 410	Street Name * Pinebush Road
City/Town/Village * Cambridge	Province Ontario	Postal Code * N1T 1Z6

Business Telephone Number 519-650-5557	Business Email Address
---	------------------------

Last Name of Well Technician * Stranz	First Name of Well Technician * Brandon	Well Technician's License Number * 4021
--	--	--

**16. Declaration \***

I hereby confirm that I am the person who constructed the well and I hereby confirm that the information on the form is correct and accurate.

Last Name Stranz	First Name Brandon	Email Address bstranz@altechworld.com
---------------------	-----------------------	--

Signature <b>Brandon Stranz</b>	Digitally signed by Brandon Stranz Date: 2021.01.25 08:11:31 -05'00'	Date Submitted (yyyy/mm/dd) 2021/01/25
------------------------------------	---	---

**17. Ministry Use Only**

Audit Number 22K9 P6LU
---------------------------

**Notice of Collection of Personal Information**

Personal information contained on this form is collected pursuant to sections 35-50 and 75(2) of the *Ontario Water Resources Act* and section 16.3 of the Wells Regulation. This information will be used for the purpose of maintaining a public record of wells in Ontario. This form and the information contained on the form will be stored in the Ministry's well record database and made publicly available. Questions about this collection should be directed to the Water Well Customer Service Representative at the Wells Help Desk, 125 Resources Road, Toronto Ontario M9P 3V6, at 1-888-396-9355 or [wellshelpdesk@ontario.ca](mailto:wellshelpdesk@ontario.ca).

Fields marked with an asterisk (\*) are mandatory.

Well Tag Number *
A307719

**Type \***

Construction       Abandonment

**Measurement recorded in: \***

Metric       Imperial

**1. Well Owner's Information**

Last Name and First Name, or Organization is mandatory. \*

Last Name	First Name
[Redacted]	[Redacted]
Organization	Email Address
DBV Real Estate Investments Inc.	[Redacted]

**Current Address**

Unit Number	Street Number *	Street Name *	City/Town/Village
[Redacted]	[Redacted]	[Redacted]	[Redacted]
Country	Province	Postal Code	Telephone Number
	Ontario	[Redacted]	[Redacted]

**2. Well Location**

**Address of Well Location**

Unit Number	Street Number *	Street Name *	Township
	3026	Kirwin Ave	
Lot	Concession	County/District/Municipality	
City/Town	Province	Postal Code	
Mississauga	Ontario		
UTM Coordinates	Zone *	Easting *	Northing *
NAD 83	17	611933	4826568
			<a href="#">Test UTM in Map</a>
Municipal Plan and Sublot Number			
Other			

**3. Overburden and Bedrock Material \***

Well Depth *	22	(ft)			
General Colour	Most Common Material	Other Materials	General Description	Depth From	Depth To

				(ft)	(ft)
Brown	Gravel	Sand		0	15
Blue	Shale		Weathered	15	22

#### 4. Annular Space \*

Depth From (ft)	Depth To (ft)	Type of Sealant Used (Material and Type)	Volume Placed (cubic feet)
0	11	Bentonite Chip	3.52
11	19	No. 2 Sand	3.52

#### 5. Method of Construction \*

- Cable Tool     Rotary (Conventional)     Rotary (Reverse)     Boring     Air percussion     Diamond  
 Jetting     Driving     Digging     Rotary (Air)     Augering     Direct Push  
 Other (specify) \_\_\_\_\_

#### 6. Well Use \*

- Public     Industrial     Cooling & Air Conditioning  
 Domestic     Commercial     Not Used  
 Livestock     Municipal     Monitoring  
 Irrigation     Test Hole     Dewatering  
 Other (specify) \_\_\_\_\_

#### 7. Status of Well \*

- Water Supply     Replacement Well     Test Hole  
 Recharge Well     Dewatering Well     Observation and/or Monitoring Hole  
 Alteration (Construction)     Abandoned, Insufficient Supply     Abandoned, Poor Water Quality  
 Abandoned, other (specify) \_\_\_\_\_  
 Other (specify) \_\_\_\_\_

#### 8. Construction Record - Casing \* (use negative number(s) to indicate depth above ground surface)

Inside Diameter (in)	Open Hole or Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness	Depth From (ft)	Depth To (ft)
2	Plastic	0.15	0	12

#### 9. Construction Record - Screen

Outside Diameter (in)	Material (Plastic, Galvanized, Steel)	Slot Number	Depth From (ft)	Depth To (ft)
2.3	Plastic	10	12	22

## 10. Water Details

Water found at Depth (ft)  Gas Kind of water  Fresh  Untested  Other

## 11. Hole Diameter

Depth From (ft)	Depth To (ft)	Diameter (in)
0	22	8

## 12. Results of Well Yield Testing

Pumping Discontinued

Explain \_\_\_\_\_

If flowing give rate

Flowing \_\_\_\_\_ (GPM)

Draw down

Time (min)	Static Level	1	2	3	4	5	10	15	20	25	30	40	50	60
Water Level (ft)														

Recovery

Time (min)	1	2	3	4	5	10	15	20	25	30	40	50	60
Water Level (ft)													

After test of well yield, water was

Clear and sand free  Other (specify)


Pump intake set at (ft)	Pumping rate (GPM)	Duration of pumping hrs + min	Final water level end of pumping (ft)	Disinfected? * <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No
-------------------------	--------------------	-------------------------------	---------------------------------------	---

Recommended pump depth (ft)	Recommended pump rate (GPM)	Well production (GPM)
-----------------------------	-----------------------------	-----------------------

## 13. Map of Well Location \*

Map 1. Please Click the map area below to import an image file to use as the map.  Make map area bigger



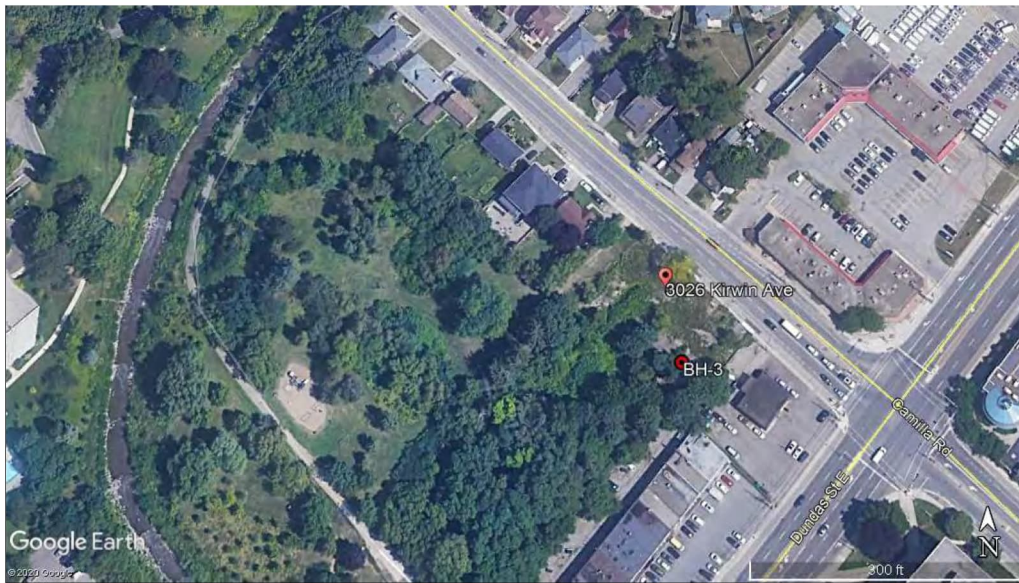

**14. Information**

Well owner's information package delivered <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered (yyyy/mm/dd) 2021/01/25	Date Work Completed (yyyy/mm/dd) * 2020/12/09
---	---	--

Comments  
56946-bh3

**15. Well Contractor and Well Technician Information**

Business Name of Well Contractor * Altech Drilling & Investigative Services	Well Contractor's License Number * 7282
--	--

**Business Address**

Unit Number	Street Number 410	Street Name * Pinebush Road
City/Town/Village * Cambridge	Province Ontario	Postal Code * N1T 1Z6

Business Telephone Number 519-650-5557	Business Email Address
---	------------------------

Last Name of Well Technician * Stranz	First Name of Well Technician * Brandon	Well Technician's License Number * 4021
--	--	--

**16. Declaration \***

I hereby confirm that I am the person who constructed the well and I hereby confirm that the information on the form is correct and accurate.

Last Name Stranz	First Name Brandon	Email Address bstranz@altechworld.com
---------------------	-----------------------	--

Signature <b>Brandon Stranz</b>	Digitally signed by Brandon Stranz Date: 2021.01.25 08:07:21 -05'00'	Date Submitted (yyyy/mm/dd) 2021/01/25
------------------------------------	---	---

**17. Ministry Use Only**


Audit Number  
KK5G 2P5X

CFM 17Z 611 664E

5R 4826420N

Elev. DUNDAS ST N.

Basin C24E LOT 15

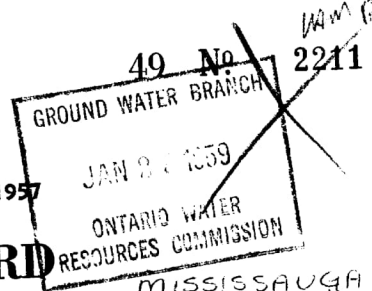

The Ontario Water Resources Commission Act, 1957

# WATER WELL RECORD

County or District PEEL Township, Village, (Town) or City (Toronto)  
completed 12 NOV 58  
(day) (month) (year)



Casing and Screen Record	Pumping Test
Inside diameter of casing <u>6"</u>	Static level <u>10 FT</u>
Total length of casing <u>22 FT</u>	Test-pumping rate <u>10</u> G.P.M.
Type of screen <u>        </u>	Pumping level <u>10</u>
Length of screen <u>        </u>	Duration of test pumping <u>4 HRS</u>
Depth to top of screen <u>        </u>	Water clear or cloudy at end of test <u>CLEAR</u>
Diameter of finished hole <u>6"</u>	Recommended pumping rate <u>10</u> G.P.M.
	with pumping level of <u>10</u>

Well Log	Water Record				
Overburden and Bedrock Record	From ft.	To ft.	Depth(s) at which water(s) found	No. of feet water rises	Kind of water (fresh, salty, sulphur)
<u>BROWN SAND &amp; GRAVEL</u>	<u>0</u>	<u>17</u>	<u>        </u>	<u>        </u>	<u>        </u>
<u>BLUE SHALE</u>	<u>17</u>	<u>51</u>	<u>40</u>	<u>41</u>	<u>FRESH</u>

For what purpose(s) is the water to be used?  
HOUSE

Is well on upland, in valley, or on hillside?  
UPLAND

Drilling Firm B. HYFMAN & SONS

Address 494 LAKESHORE RD  
MIMICO


Licence Number 113

Name of Driller J.P. McNamee

Address         

Date JAN 20 1959

J. P. McNamee  
(Signature of Licensed Drilling Contractor)

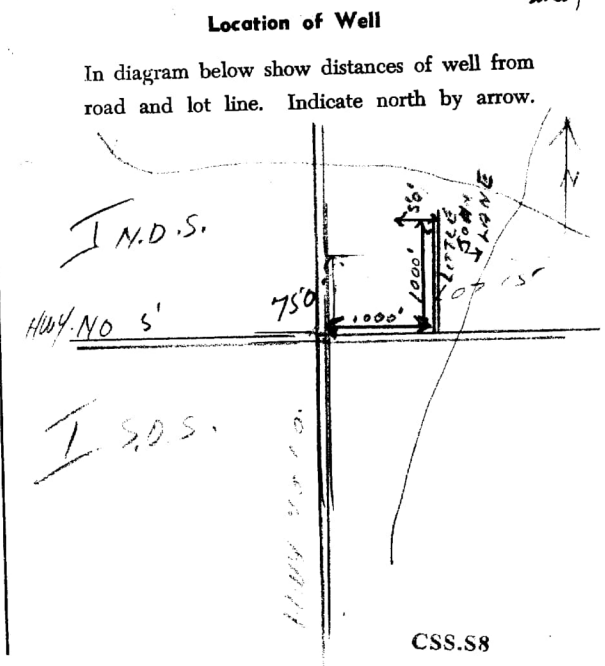

**Instructions for Completing Form**

- For use in the Province of Ontario only. This document is a permanent legal document. Please retain for future reference.
- All Sections must be completed in full to avoid delays in processing. Further instructions and explanations are available on the back of this form.
- Questions regarding completing this application can be directed to the Water Well Management Coordinator at 416-235-6203.
- All metre measurements shall be reported to 1/10<sup>th</sup> of a metre.
- Please print clearly in blue or black ink only.

Well Owner's Information and Location of Well Information							Ministry Use Only								
MUN		CON		LOT											
First Name	CITY OF MISSISSAUGA		Mailing Address (Street Number/Name, RR, Lot, Concession)												
County/District/Municipality	PEEL		Township/City/Town/Village		MISSISSAUGA		Province	Ontario		Postal Code	LSB 3C1		Telephone Number (include area code)	905-896-5136	
Address of Well Location (County/District/Municipality)				Township		Lot		Concession							
RR#/Street Number/Name				City/Town/Village		Site/Compartment/Block/Tract etc.									
KIRWIN AVE				MISSISSAUGA											
GPS Reading	NAD	Zone	Easting	Northing	Unit Make/Model		Mode of Operation:			<input type="checkbox"/> Undifferentiated		<input checked="" type="checkbox"/> Averaged			
	83	17	617802	4826734	MAGELLAN					<input type="checkbox"/> Differentiated, specify					

**Log of Overburden and Bedrock Materials (see instructions)**

General Colour	Most common material	Other Materials	General Description	Depth From	Metres To
GREY	SILT		CLAY SHALE FRAGMENTS	0	7.6

Hole Diameter			Construction Record				Test of Well Yield					
Depth From	Metres To	Diameter Centimetres	Inside diam centimetres	Material	Wall thickness centimetres	Depth From	Metres To	Pumping test method	Draw Down Time min	Water Level Metres	Recovery Time min	Water Level Metres
0	7.6	15						Pump intake set at - (metres)	1		1	
Water Record			Casing				Duration of pumping					
Water found at 4.5 Metres			1.9				2					
Kind of Water			Material				Final water level end of pumping					
4.5 m Fresh Sulphur			Plastic Concrete				3					
Gas Salty Minerals			Galvanized				Recommended pump type					
Other:			Steel Fibreglass				4					
			Plastic Concrete				Recommended pump depth					
			Galvanized				5					
			Steel Fibreglass				Recommended pump rate					
			Plastic Concrete				10					
			Galvanized				15					
After test of well yield, water was			Screen				If flowing give rate -					
Clear and sediment free			Outside diam				20					
Other, specify			Slot No.				25					
			2.7				30					
Chlorinated <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No			No Casing or Screen				40					
			Open hole				50					
							60					

Plugging and Sealing Record			<input checked="" type="checkbox"/> Annular space	<input type="checkbox"/> Abandonment
Depth set at - Metres From	To	Material and type (bentonite slurry, neat cement slurry) etc.	Volume Placed (cubic metres)	
0	3	CONCRETE		
3	4.0	BENTONITE		

Method of Construction			
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Rotary (air)	<input type="checkbox"/> Diamond	<input type="checkbox"/> Digging
<input type="checkbox"/> Rotary (conventional)	<input type="checkbox"/> Air percussion	<input type="checkbox"/> Jetting	<input type="checkbox"/> Other
<input type="checkbox"/> Rotary (reverse)	<input checked="" type="checkbox"/> Boring	<input type="checkbox"/> Driving	
Water Use			
<input type="checkbox"/> Domestic	<input type="checkbox"/> Industrial	<input type="checkbox"/> Public Supply	<input checked="" type="checkbox"/> Test
<input type="checkbox"/> Stock	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used	
<input type="checkbox"/> Irrigation	<input type="checkbox"/> Municipal	<input type="checkbox"/> Cooling & air conditioning	
Final Status of Well			
<input type="checkbox"/> Water Supply	<input type="checkbox"/> Recharge well	<input type="checkbox"/> Unfinished	<input type="checkbox"/> Abandoned, (Other)
<input checked="" type="checkbox"/> Observation well	<input type="checkbox"/> Abandoned, insufficient supply	<input type="checkbox"/> Dewatering	
<input type="checkbox"/> Test Hole	<input type="checkbox"/> Abandoned, poor quality	<input type="checkbox"/> Replacement well	

Location of Well	
In diagram below show distances of well from road, lot line, and building. Indicate north by arrow.	
Audit No.	2 32255
Date Well Completed	05 06 05
Was the well owner's information package delivered?	<input type="checkbox"/> Yes <input type="checkbox"/> No

Well Contractor/Technician Information	
Name of Well Contractor	Well Contractor's Licence No.
GEO ENVIRONMENTAL DRILLING	6607
Business Address (street name, number, city etc.)	
340 MARKET DR. MILTON ON	
Name of Well Technician (last name, first name)	Well Technician's Licence No.
BAILEY, JAY	7-311
Signature of Technician/Contractor	Date Submitted
<i>Jay Bailey</i>	05 06 05

Ministry Use Only	
Data Source	Contractor
	8607
Date Received	Date of Inspection
JUL 22 2005	
Remarks	Well Record Number

Well Owner's Information

60 DUNDAS STREET  
County/District/Municipality: Peel  
Mississauga  
City/Town/Village: Mississauga  
Province: Ontario  
Postal Code: L5A1W4  
UTM Coordinates: Zone 17, Easting 19714826314, Northing 4826314  
GPS Unit Make: GARMIN, Model: ETREX  
Mode of Operation:  Undifferentiated,  Averaged  
 Differentiated, specify

Overburden and Bedrock Materials (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (Metres) From	Depth (Metres) To
black	asphalt		Packed	0	.05
brown	gravel	medium, coarse sand	Packed	.05	.25
grey	silt	fine sand, gravel	Dense	.25	6.10
wells GPS 2) 17/611981/4826271 3) 17/612170/4826252					
Consultant Construction Control					

**Annular Space/Abandonment Sealing Record**

Depth Set at (Metres) From	To	Type of Sealant Used (Material and Type)	Volume Placed (Cubic Metres)
0	.30	concrete	
.30	1.50	bentonite	

**Method of Construction**

Cable Tool  Diamond  Rotary (Conventional)  Jetting  Rotary (Reverse)  Driving  Rotary (Air)  Digging  Air percussion  Boring  Other, specify

**Water Use**

Public  Commercial  Not used  Domestic  Municipal  Dewatering  Livestock  Test Hole  Monitoring  Irrigation  Cooling & Air Conditioning  Industrial  Other, specify

**Status of Well**

Water Supply  Dewatering Well  Observation and/or Monitoring Hole  Replacement Well  Abandoned, Insufficient Supply  Alteration (Construction)  Test Hole  Abandoned, Poor Water Quality  Other, specify  Recharge Well  Abandoned, other, specify

**Location of Well**

Please provide a map below showing:  
- all property boundaries, and measurements sufficient to locate the well in relation to fixed points  
- an arrow indicating the North direction  
- detailed drawings can be provided as attachments no larger than legal size (8.5" by 14")  
- digital pictures of inside of well can also be provided

Well Tag: 60 Dundas St. East

Dundas St. East

**Results of Well Yield Testing**

Check box if after test of well yield, water was:  
 Clear and sand free  
 Cannot develop to sand-free state

If pumping discontinued, give reason:

Time (Min)	Draw Down		Recovery	
	Water Level (Metres)	Time (Min)	Water Level (Metres)	Time (Min)
1		1		
2		2		
3		3		
4		4		
5		5		
10		10		
15		15		
20		20		
25		25		
30		30		
40		40		
50		50		
60		60		

Pumping test method: \_\_\_\_\_  
Pump intake set at (Metres): \_\_\_\_\_  
Pumping rate (Litres/min): \_\_\_\_\_  
Duration of pumping: \_\_\_\_\_ hrs + \_\_\_\_\_ min  
Final water level end of pumping (Metres): \_\_\_\_\_  
Recommended pump type:  Shallow  Deep  
Recommended pump depth: \_\_\_\_\_ Metres  
Recommended pump rate (Litres/min): \_\_\_\_\_  
If flowing give rate (Litres/min): \_\_\_\_\_

**Water Details**

Water found at Depth (Metres)	Kind of Water
	<input type="checkbox"/> Gas <input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals
	<input type="checkbox"/> Gas <input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals
	<input type="checkbox"/> Gas <input type="checkbox"/> Fresh <input type="checkbox"/> Salty <input type="checkbox"/> Sulphur <input type="checkbox"/> Minerals

Casing Used	Screen Used	Casing and Well Details
<input type="checkbox"/> Galvanized <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input checked="" type="checkbox"/> Plastic <input type="checkbox"/> Concrete	<input type="checkbox"/> Galvanized <input type="checkbox"/> Steel <input type="checkbox"/> Fibreglass <input checked="" type="checkbox"/> Plastic <input type="checkbox"/> Concrete	Diameter of the Hole (Centimetres): 10 Depth of the Hole (Metres): 6.10 Wall Thickness (Metres): Sch 40
No Casing and Screen Used		Inside Diameter of the Casing (Metres): .05 Depth of the Casing (Metres): 2.13

Date Well Completed (yyyy/mm/dd): 2008/06/02  
Was the well owner's information package delivered?  Yes  No  
Date the Well Record and Package Delivered to Well Owner (yyyy/mm/dd):

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: Atcast Soil Drilling  
Business Address (Street No./Name, number, RR): 2160 Hwy 7  
Province: Ont, Postal Code: L4K1W6  
Business E-mail Address:  
Bus. Telephone No. (inc. area code): 9056691253  
Name of Well Technician (Last Name, First Name): Green Wayne  
Well Technician's Licence No.:  
Signature of Technician: Wayne Green  
Date Submitted (yyyy/mm/dd): 2008/06/09

**Ministry Use Only**

Audit No.: 269137  
Date Received (yyyy/mm/dd): JUL 11 2008  
Well Contractor No.:  
Date of Inspection (yyyy/mm/dd):  
Remarks:



A046214

**Well Location**

Address of Well Location (Street Number/Name) 225 Dundas St. E. Township \_\_\_\_\_ Lot \_\_\_\_\_ Concession \_\_\_\_\_

County/District/Municipality \_\_\_\_\_ City/Town/Village MISSISSAUGA. Province **Ontario** Postal Code \_\_\_\_\_

UTM Coordinates Zone 18 Easting 1176112112124182617417 Northing \_\_\_\_\_ Municipal Plan and Sublot Number \_\_\_\_\_ Other \_\_\_\_\_

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	Fill	Rock, sand	moist	0'	5'
Brown	silt	sand	moist-dry	5'	18'
Gray	silt		moist	18'	20'
Gray	weathered shale		moist	20'	22'

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
22' 11'	Sand	
11' 1'	Bentonite	
1' 0'	Sand casing, concrete	

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify \_\_\_\_\_

If pumping discontinued, give reason:  
 Static Level \_\_\_\_\_

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
1				1
2				2
3				3
4				4
5				5
10				10
15				15
20				20
25				25
30				30
40				40
50				50
60				60

Pump intake set at (m/ft) \_\_\_\_\_

Pumping rate (l/min / GPM) \_\_\_\_\_

Duration of pumping \_\_\_\_\_ hrs + \_\_\_\_\_ min

Final water level end of pumping (m/ft) \_\_\_\_\_

If flowing give rate (l/min / GPM) \_\_\_\_\_

Recommended pump depth (m/ft) \_\_\_\_\_

Recommended pump rate (l/min / GPM) \_\_\_\_\_

Well production (l/min / GPM) \_\_\_\_\_

Disinfected?  Yes  No

**Method of Construction**

Cable Tool  Diamond  
 Rotary (Conventional)  Jetting  
 Rotary (Reverse)  Driving  
 Boring  Digging  
 Air percussion  
 Other, specify \_\_\_\_\_

**Well Use**

Public  Commercial  Not used  
 Domestic  Municipal  Dewatering  
 Livestock  Test Hole  Monitoring  
 Irrigation  Cooling & Air Conditioning  
 Industrial  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Well Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
2"	Plastic	Sd.40	12'	0'	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input checked="" type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
2"	Plastic	10	22'	12'	<input type="checkbox"/> Other, specify _____

**Water Details**

Water found at Depth (m/ft)  Gas  Other, specify \_\_\_\_\_ Kind of Water:  Fresh  Untested

Water found at Depth (m/ft)  Gas  Other, specify \_\_\_\_\_ Kind of Water:  Fresh  Untested

Water found at Depth (m/ft)  Gas  Other, specify \_\_\_\_\_ Kind of Water:  Fresh  Untested

**Hole Diameter**

Depth (m/ft)	Diameter (cm/in)	
	From	To
22'	0'	9"

**Well Contractor and Well Technician Information**

Business Name of Well Contractor Profile Drilling Inc. Well Contractor's Licence No. 712115

Business Address (Street Number/Name) 149 North Finch Dr. Municipality North York

Province Ont. Postal Code M3W1Y2 Business E-mail Address jason@profiledrilling.com

Bus. Telephone No. (inc. area code) 4166150644 Name of Well Technician (Last Name, First Name) Slack, Jason

Well Technician's Licence No. 219718 Signature of Technician and/or Contractor [Signature] Date Submitted 20100201

**Map of Well Location**

Please provide a map below following instructions on the back.

See Attached.

Comments: \_\_\_\_\_

Well owner's information package delivered  Yes  No

Date Package Delivered 20100120

Date Work Completed \_\_\_\_\_


**Ministry Use Only**

Audit No. 2110049

**FEB 16 2010**

Shed 10' for ...  
Sample 6-9 for hydro ...  
@ .15'

5725  
211049

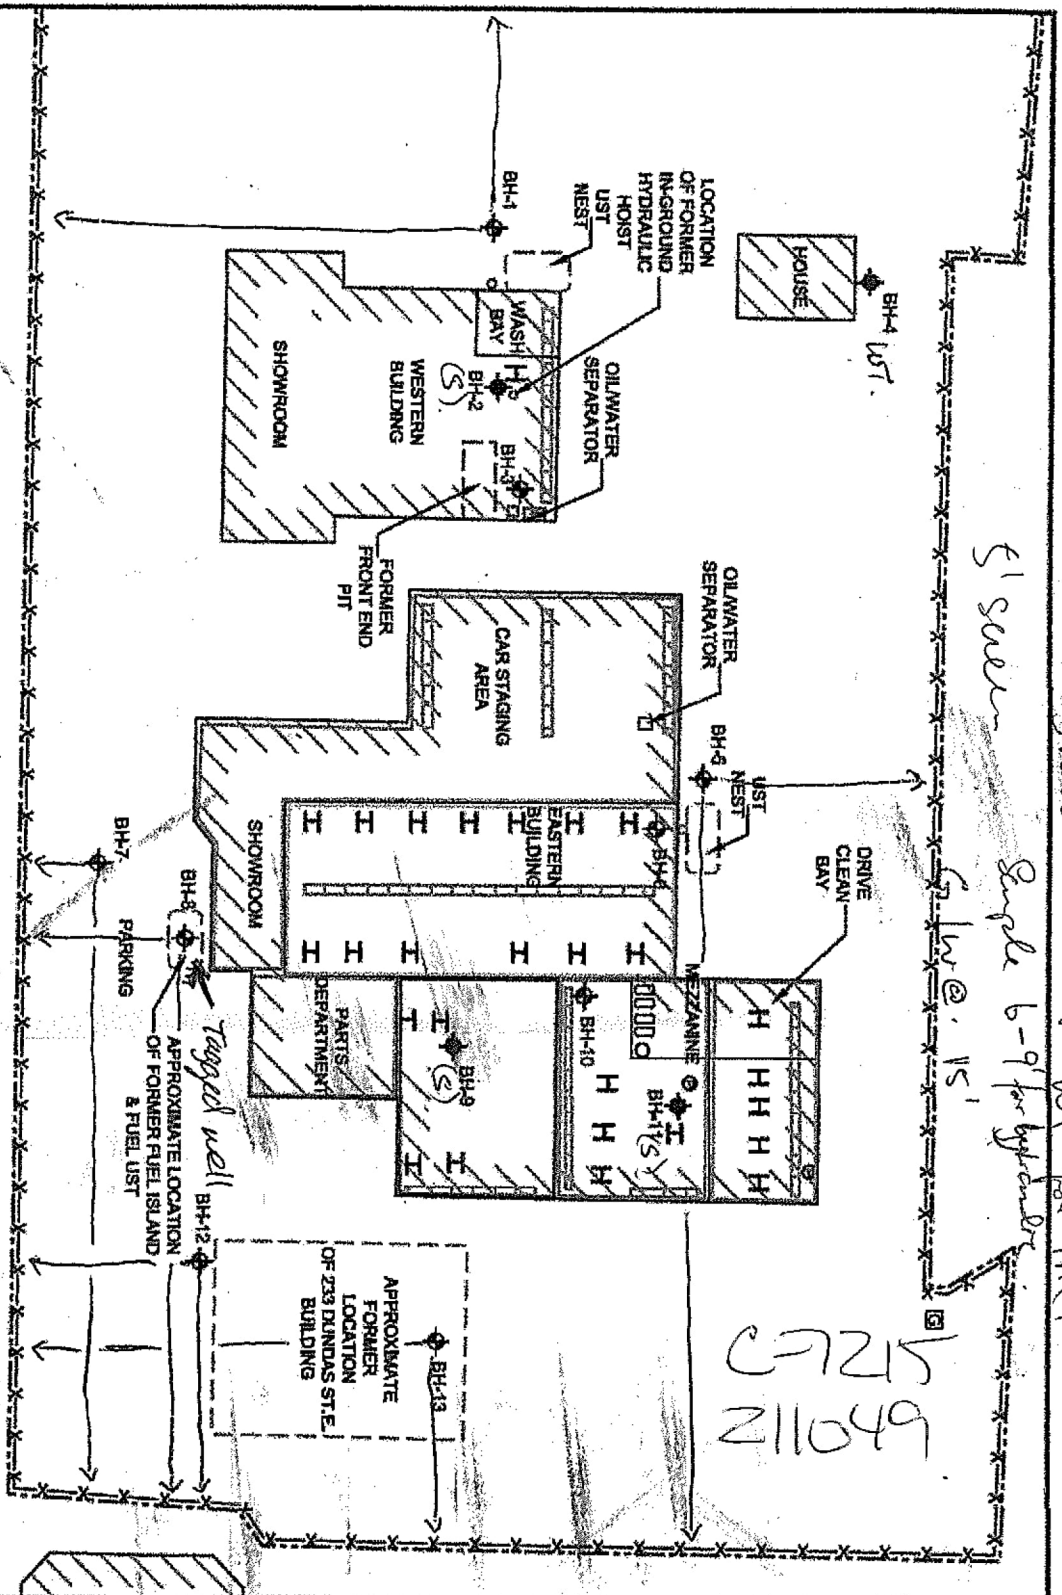

LEGEND:

- PROPOSED BOREHOLE WITH MONITORING WELL
- PROPOSED BOREHOLE
- ORIGINAL 1949 BUILDING
- EARLY 1980 ADDITION
- 1991 ADDITION
- 2006 ADDITION
- SITE BOUNDARY
- FENCE
- BUILDINGS
- WATER COLLECTION TRENCH
- HYDRAULIC HOIST
- GARBAGE BIN
- PARTS WASH
- ABOVEGROUND STORAGE TANK (AST)
- VENT PIPE

DEC 16 2010



CLIENT LOGO	CLIENT	HAWLEY PONTIAC BUICK CADILLAC LTD.	
	DWNT BY:	MM	PROJECT
AMEC Earth & Environmental 180 Tredars Boulevard East Mississauga, Ontario L4Z 3K7	CHK'D BY:	MR	PHASE II ESA
	DATE:	MM	225 DUNDAS STREET EAST MISSISSAUGA, ONTARIO
amec	PROJECTOR:	MM	PROPOSED BOREHOLE LOCATION PLAN
	SCALE:	AS SHOWN	225 DUNDAS STREET EAST MISSISSAUGA, ONTARIO
P:\DEC09\Proposals\2009\1216 Hawley Pontiac 225 Dundas St W, Mississauga Phase II ESA\PI ESA\1091059-Figure 3-Detailed Site Plan.dwg - Layout - Dec. 14, 2009 1:40pm - mitchell.umc@amec.com	REV. NO.:	A	DATE:
	PROJECT NO.:	PROPOSAL 1216	FIGURE NO.:
			FIGURE 1

A 095349

Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

Address of Well Location (Street Number/Name) **225 Dundas St E** Township \_\_\_\_\_ Lot \_\_\_\_\_ Concession \_\_\_\_\_  
 County/District/Municipality \_\_\_\_\_ City/Town/Village **Mississauga** Province **Ontario** Postal Code **L5A 1W8**  
 UTM Coordinates Zone **18** Easting **176121264926690** Northing \_\_\_\_\_ Municipal Plan and Sublot Number \_\_\_\_\_ Other \_\_\_\_\_

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
	<b>Grout</b>			<b>0'</b>	<b>12'</b>

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
From _____ To _____		

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  Other, specify \_\_\_\_\_  
 Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
					<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input checked="" type="checkbox"/> Other, specify <b>Decommission</b>

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
					<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input checked="" type="checkbox"/> Other, specify <b>Decommission</b>

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	Hole Diameter	
		Depth (m/ft)	Diameter (cm/in)
		From _____ To _____	
		<b>12' 0'</b>	<b>4"</b>

**Well Contractor and Well Technician Information**

Business Name of Well Contractor **Profile Drilling** Well Contractor's Licence No. **7215**  
 Business Address (Street Number/Name) **144 Northch DR Units 4-8** Municipality **North York**  
 Province **ON** Postal Code **M3M 1Y2** Business E-mail Address **Jason@ProfileDrilling**  
 Bus. Telephone No. (inc. area code) **4166506444** Name of Well Technician (Last Name, First Name) **Stocker, Jason**  
 Well Technician's Licence No. **2978** Signature of Technician and/or Contractor *[Signature]* Date Submitted **20100409**

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify \_\_\_\_\_

If pumping discontinued, give reason: \_\_\_\_\_

Pump intake set at (m/ft) \_\_\_\_\_

Pumping rate (l/min / GPM) \_\_\_\_\_

Duration of pumping \_\_\_\_\_ hrs + \_\_\_\_\_ min

Final water level end of pumping (m/ft) \_\_\_\_\_

If flowing give rate (l/min / GPM) \_\_\_\_\_

Recommended pump depth (m/ft) \_\_\_\_\_

Recommended pump rate (l/min / GPM) \_\_\_\_\_

Well production (l/min / GPM) \_\_\_\_\_

Disinfected?  Yes  No

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
1		1		
2		2		
3		3		
4		4		
5		5		
10		10		
15		15		
20		20		
25		25		
30		30		
40		40		
50		50		
60		60		


**Map of Well Location**

Please provide a map below following instructions on the back.

See map

Comments: \_\_\_\_\_

Well owner's information package delivered <input type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered	Ministry Use Only Audit No. <b>z112536</b> <b>MAY 12 2010</b> Received
	Date Work Completed	
	<b>20100322</b>	

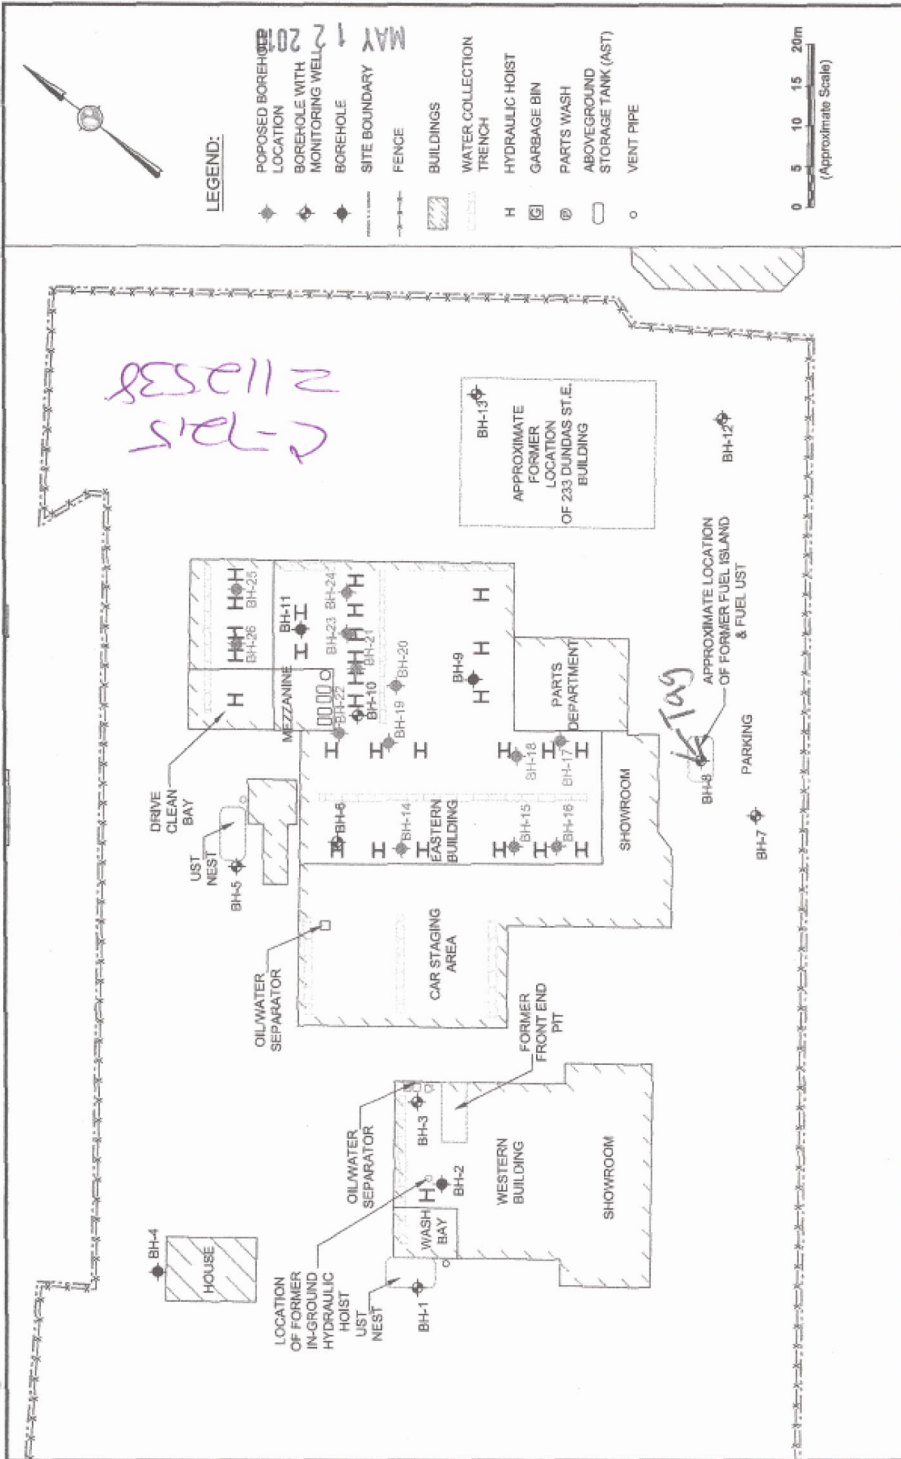

CLIENT	HAWLEY PONTIAC BUICK CADILLAC LTD.		REV. NO.:	A
	DATE:	FEBRUARY 2010	PROJECT:	PHASE II ESA
AMEC Earth & Environmental 3190 Steeles Avenue East, Unit #905, Markham, Ontario L3R 1G9	SCALE:	AS SHOWN	PROJECT NO.:	TC91017
	TITLE:	PROPOSED BOREHOLE LOCATION PLAN 225 DUNDAS STREET EAST MISSISSAUGA, ONTARIO	FIGURE NO.:	FIGURE 1



Address of Well Location (Street Number/Name) ~~18-40 Dundas St. West~~ Township Lot Concession  
 County/District/Municipality **18-40 Dundas St. West** City/Town/Village **Leamington** Province **Ontario** Postal Code  
 UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other **WKQ-002528**  
 NAD | 8 | 3 | 17 | 6 | 11 | 6 | 9 | 6 | 4 | 8 | 2 | 6 | 9 | 9 | 6 | A 0 - A 02

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
				From To
black	Asphalt		soft	0 .1
brown	sand		soft	.1 2.7
grey	Shale	3:7	hard	2.7 4.8

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
From To		
0 .31	Concrete	.0036
.31 3	Bentonite	.0126
3 4.8	Silica Sand	.0084

**Results of Well Yield Testing**

After test of well yield, water was:	Draw Down	Recovery
<input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify	Time (min) Water Level (m/ft)	Time (min) Water Level (m/ft)
If pumping discontinued, give reason:	Static Level	
	1	1
Pump intake set at (m/ft)	2	2
Pumping rate (l/min / GPM)	3	3
Duration of pumping	4	4
hrs + min	5	5
Final water level end of pumping (m/ft)	10	10
If flowing give rate (l/min / GPM)	15	15
	20	20
Recommended pump depth (m/ft)	25	25
Recommended pump rate (l/min / GPM)	30	30
Well production (l/min / GPM)	40	40
Disinfected?	50	50
<input type="checkbox"/> Yes <input type="checkbox"/> No	60	60

**Method of Construction**  Direct Push

**Well Use**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  
 Other, specify

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Well Thickness (cm/in)	Depth (m/ft)
			From To
4.03	PVC	.36	0 3.3

**Status of Well**

Water Supply  Replacement Well  
 Test Hole  Recharge Well  Dewatering Well  
 Observation and/or Monitoring Hole  
 Alteration (Construction)  
 Abandoned, Insufficient Supply  
 Abandoned, Poor Water Quality  
 Abandoned, other, specify  
 Other, specify

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)
			From To
4.82	PVC	10	3.3 4.8

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested	Depth (m/ft)	Diameter (cm/in)
		From To	
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	0 4.8	10.9
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify		
	<input type="checkbox"/> Gas <input type="checkbox"/> Other, specify		

**Well Contractor and Well Technician Information**


Business Name of Well Contractor: **Strata Soil Sampling Inc.** Well Contractor's Licence No.: **7 2 4 1**

Business Address (Street Number/Name): **147-2 West Beaver Creek Road** Municipality: **Richmond Hill**

Province: **Ontario** Postal Code: **L4B 1C6** Business E-mail Address: **wrecords@stratasoil.com**

Telephone No. (inc. area code): **905-764-9304** Name of Well Technician (Last Name, First Name): **Robinson Tracy**

Well Technician's Licence No.: **31154** Signature of Technician and/or Contractor: *[Signature]* Date Submitted: **20100430**

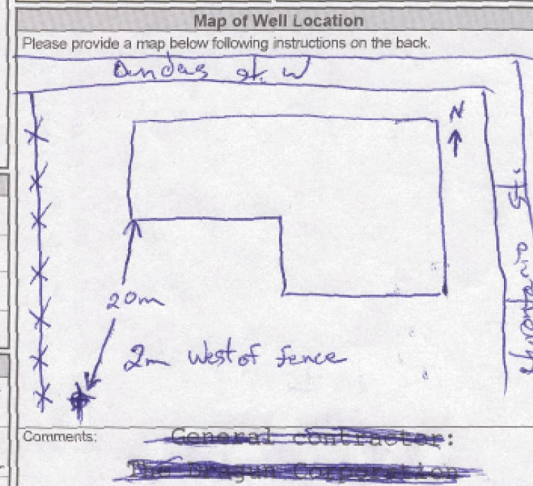

**Ministry Use Only**

Audit No.: **z114336**

Date Package Delivered: **20100428**

Date Work Completed: **20100428**

Received: **MAY 21 2010**

Address of Well Location (Street Number/Name) 120 Dundas street east Township \_\_\_\_\_ Lot \_\_\_\_\_ Concession \_\_\_\_\_  
 County/District/Municipality \_\_\_\_\_ City/Town/Village Mississauga Province **Ontario** Postal Code \_\_\_\_\_  
 UTM Coordinates Zone \_\_\_\_\_ Easting \_\_\_\_\_ Northing \_\_\_\_\_ Municipal Plan and Sublot Number \_\_\_\_\_ Other \_\_\_\_\_  
 NAD 83 116115924006597

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	Sand	gravel	loose	0	1.83
Brown	clay	soil	dense	1.85	3.1

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
0 to 0.31	concrete	0.0005
0.31 to 1.5	Bentonite	0.0025
1.5 to 3.1	Sand	0.0825

**Results of Well Yield Testing**

After test of well yield, water was: <input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason: Static Level	1		1	
	2		2	
	3		3	
	4		4	
	5		5	
	10		10	
If flowing give rate (l/min / GPM)	15		15	
	20		20	
	25		25	
	30		30	
	40		40	
	50		50	
Recommended pump depth (m/ft)	60		60	
	50		50	
	40		40	
	30		30	
	25		25	
	20		20	
Recommended pump rate (l/min / GPM)	15		15	
	10		10	
	5		5	
	4		4	
	3		3	
	2		2	
Well production (l/min / GPM)	1		1	
	2		2	
	3		3	
	4		4	
	5		5	
	10		10	
Disinfected? <input type="checkbox"/> Yes <input type="checkbox"/> No				

**Method of Construction**

<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input type="checkbox"/> Commercial	<input type="checkbox"/> Not used
<input type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input type="checkbox"/> Domestic	<input type="checkbox"/> Municipal	<input type="checkbox"/> Dewatering
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Livestock	<input checked="" type="checkbox"/> Test Hole	<input type="checkbox"/> Monitoring
<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	<input type="checkbox"/> Irrigation	<input type="checkbox"/> Cooling & Air Conditioning	
<input type="checkbox"/> Air percussion		<input type="checkbox"/> Industrial		
<input type="checkbox"/> Other, specify <u>Direct Drift</u>		<input type="checkbox"/> Other, specify _____		

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
3.45	Plastic	0.356	0	1.5	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input checked="" type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
4.21	Plastic	10	1.5	3.1	<input type="checkbox"/> Other, specify _____

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	Hole Diameter
0		Depth (m/ft) From 0 To 3.1 Diameter (cm/in) 5.71

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: State Soil Sampling Well Contractor's Licence No.: 7241  
 Business Address (Street Number/Name): 2-147 West Beaver Creek Dr Richmond Hill Municipality: \_\_\_\_\_  
 Province: ON Business E-mail Address: rhbick@records@state-soil.com

Bus. Telephone No. (inc. area code): 9057649304 Name of Well Technician (Last Name, First Name): Matt, Mike  
 Well Technician's Licence No.: 3448 Signature of Technician and/or Contractor: [Signature] Date Submitted: 20100630

**Map of Well Location**

Please provide a map below following instructions on the back.

See attached map A103044

Comments: \_\_\_\_\_

Well owner's information package delivered <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No	Date Package Delivered <u>20100624</u>	Ministry Use Only
	Date Work Completed	Audit No. <b>z119050</b>
		Received <b>JUL 16 2010</b>

Address of Well Location (Street Number/Name): **120 Dundas Street East**  
 Township: \_\_\_\_\_ Lot: \_\_\_\_\_ Concession: \_\_\_\_\_  
 County/District/Municipality: \_\_\_\_\_ City/Town/Village: **MISSISSAUGA** Province: **Ontario** Postal Code: \_\_\_\_\_  
 UTM Coordinates: Zone: \_\_\_\_\_ Easting: \_\_\_\_\_ Northing: \_\_\_\_\_  
 NAD: **83 17 41 59 8 43 2 6 4 1 4** Municipal Plan and Sublot Number: \_\_\_\_\_

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To
Brown	Sand	gravel	loose	0	1.83
Grey	Clay	silt	dense	1.83	3.35

**Annular Space**

Depth Set at (m/ft)		Type of Sealant Used (Material and Type)	Volume Placed (m³/ft³)
From	To		
0	0.31	Concrete	0.0005
0.31	1.83	Bentonite	0.003
1.83	3.35	Sand	0.0025

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  
 Other, specify: **Direct Rsk**  Other, specify: \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
3.45	Direct Rsk	0.345	0	1.83	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input checked="" type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input checked="" type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To
4.21	Direct Rsk	10	1.83	3.35

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	Hole Diameter
		Depth (m/ft) From To Diameter (cm/in)
		0 3.35 5.71

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: **Stata Soil Sampling** Well Contractor's Licence No.: **722411**  
 Business Address (Street Number/Name): **2-147 West Beaver Creek Dr Richmond Hill** Municipality: \_\_\_\_\_  
 Province: **ON** Postal Code: \_\_\_\_\_ Business E-mail Address: **lhb1c6@wrecords@statasoil.com**

Bus. Telephone No. (inc. area code): **9057649304** Name of Well Technician (Last Name, First Name): **Magd, Mike**  
 Well Technician's Licence No.: **3448** Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: **20100631**

**Results of Well Yield Testing**

After test of well yield, water was: <input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason: 	Static Level			
	1		1	
	Pump intake set at (m/ft)		2	
	2			
	Pumping rate (l/min / GPM)		3	
	3			
Duration of pumping hrs + min		4		
Final water level end of pumping (m/ft)		5		
10		10		
If flowing give rate (l/min / GPM)		15		
15				
Recommended pump depth (m/ft)		20		
20				
Recommended pump rate (l/min / GPM)		25		
25				
Recommended pump rate (l/min / GPM)		30		
30				
Well production (l/min / GPM)		40		
40				
50				
50				
Disinfected? <input type="checkbox"/> Yes <input type="checkbox"/> No		60		
60				

**Map of Well Location**

Please provide a map below following instructions on the back.

*see attached m.w. A103036.*

Comments: \_\_\_\_\_

Well owner's information package delivered <input type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered Y Y Y Y M M D D 29 10 06 2 10	Ministry Use Only Audit No. <b>z119051</b> Date Work Completed JUL 16 2010
--	--	--

Address of Well Location (Street Number/Name) 170 Dundas Street E Township \_\_\_\_\_ Lot \_\_\_\_\_ Concession \_\_\_\_\_

County/District/Municipality \_\_\_\_\_ City/Town/Village Mississauga Province **Ontario** Postal Code \_\_\_\_\_

UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other

NAD 83 17 211 435 4826 412

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)	
				From	To

Annular Space		
Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
0' 0.5'	Cement	
0.5' 5'	Bentonite	
5' 16'	Sand	

Results of Well Yield Testing				
After test of well yield, water was: <input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason:	Static Level			
	1		1	
Pump intake set at (m/ft)	2		2	
Pumping rate (l/min / GPM)	3		3	
Duration of pumping hrs + min	4		4	
Final water level end of pumping (m/ft)	5		5	
If flowing give rate (l/min / GPM)	10		10	
Recommended pump depth (m/ft)	15		15	
Recommended pump rate (l/min / GPM)	20		20	
Well production (l/min / GPM)	25		25	
Disinfected? <input type="checkbox"/> Yes <input type="checkbox"/> No	30		30	
	40		40	
	50		50	
	60		60	

Method of Construction		Well Use	
<input type="checkbox"/> Cable Tool	<input type="checkbox"/> Diamond	<input type="checkbox"/> Public	<input type="checkbox"/> Commercial
<input checked="" type="checkbox"/> Rotary (Conventional)	<input type="checkbox"/> Jetting	<input type="checkbox"/> Domestic	<input type="checkbox"/> Municipal
<input type="checkbox"/> Rotary (Reverse)	<input type="checkbox"/> Driving	<input type="checkbox"/> Livestock	<input type="checkbox"/> Test Hole
<input type="checkbox"/> Boring	<input type="checkbox"/> Digging	<input type="checkbox"/> Irrigation	<input type="checkbox"/> Cooling & Air Conditioning
<input type="checkbox"/> Air percussion		<input type="checkbox"/> Industrial	<input checked="" type="checkbox"/> Monitoring
<input type="checkbox"/> Other, specify _____		<input type="checkbox"/> Other, specify _____	

Construction Record - Casing				Status of Well	
Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input checked="" type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____
			From	To	
1.5"	Plastic	0.25"	0'	6'	

Construction Record - Screen				
Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To
1.75"	Plastic	10	6'	16'

Map of Well Location

Please provide a map below following instructions on the back.  
  
see Map  
MW3-1

Water Details		Hole Diameter	
Water found at Depth (m/ft) <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested	Depth (m/ft) From To	Diameter (cm/in)
Water found at Depth (m/ft) <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested	0' 16'	4.5"
Water found at Depth (m/ft) <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested		

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: Stata Soil Sampling Well Contractor's Licence No.: 7241

Business Address (Street Number/Name): 2-147 West Beaver Creek Richmond Hill Municipality: \_\_\_\_\_

Province: ON Postal Code: \_\_\_\_\_ Business E-mail Address: LHB1c6wread@statasoil.com

Bus. Telephone No. (inc. area code): 9057649304 Name of Well Technician (Last Name, First Name): Murd, Mike

Well Technician's Licence No.: 3448 Signature of Technician and/or Contractor: \_\_\_\_\_ Date Submitted: 20100631

Comments: \_\_\_\_\_

Well owner's information package delivered <input type="checkbox"/> Yes <input type="checkbox"/> No	Date Package Delivered Y Y Y Y M M D D <u>20100621</u>	<b>Ministry Use Only</b> Audit No. <b>z119052</b> Date Work Completed <u>JUL 16 2010</u>
--	--	---



Measurements recorded in:  Metric  Imperial

Page 1 of 1

Well Owner's Information

First Name: MATAS HOMES, Last Name: [REDACTED], E-mail Address: [REDACTED], Mailing Address: 109 THOMAS ST, Municipality: OAKVILLE, Province: ON, Postal Code: L6L 3A7

Well Location

Address of Well Location: 80 DUNDAS ST E, Township: MISSISSAUGA, City/Town/Village: MISSISSAUGA, Province: Ontario, Postal Code: L5A 4G8, UTM Coordinates: NAD 83 17 61 19 18 48 26 37 3

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Includes handwritten entries: Browns GREY SILT, DENSE, 0 4.6, 4.6 6.2, 6.2 7.6.

MW2 OPS 17 61966 4826355

Annular Space table with columns: Depth Set at (m/ft) From, To, Type of Sealant Used, Volume Placed (m³/ft³). Includes handwritten entries: 0 0.3 CEMENT, 0.3 2.8 BENTONITE CHIPS.

Method of Construction and Well Use section with checkboxes for Cable Tool, Rotary, Boring, etc.

Construction Record - Casing table with columns: Inside Diameter, Open Hole OR Material, Wall Thickness, Depth (m/ft) From, To. Includes handwritten entries: 5 PLASTIC, 0.3, 0 3.0.

Construction Record - Screen table with columns: Outside Diameter, Material, Slot No., Depth (m/ft) From, To. Includes handwritten entries: 6 PLASTIC, 100, 3.0 7.6.


Water Details and Hole Diameter section with checkboxes for Fresh, Untested, Gas, etc.

Well Contractor and Well Technician information section with fields for Business Name, Address, Licence No., etc.

Well owner's information package delivered section with fields for Date Package Delivered, Date Work Completed, etc.

Results of Well Yield Testing table with columns: Draw Down (Time, Water Level), Recovery (Time, Water Level). Includes a graph showing water level recovery over time.

Map of Well Location

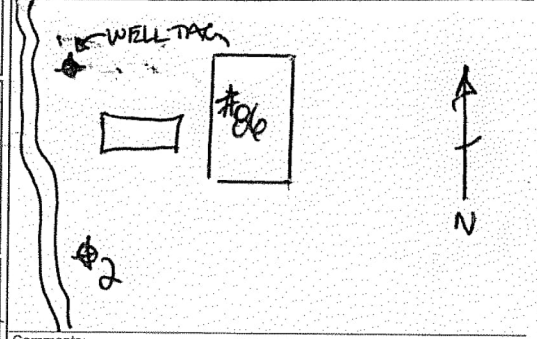

Comments: 12-A 187



Ministry of the Environment

**Well Record for Well Cluster - Part 1 of 3**  
 (Only for Multiple Test Holes or Dewatering Wells)  
 Regulation 903 Ontario Water Resources Act

Well Tag No. of Deef Tag#: **A139584**

All measurements recorded in:  Metric  Imperial

Follow instructions on the front and back of this form. Print or Type

Page \_\_\_\_\_ of \_\_\_\_\_


Well Cluster Location Information				Geographic Township				County/District/Upper Tier Municipality					
Address of Well Location (Street Number(s)/Name(s), RR, if available)				Concession(s)				Municipality					
206 Dundas St E Mississauga				Garmin ETrex				Averaged					
City, Town, Village or Hamlet				Province				Unit Mode of Operation					
Mississauga				Ontario				<input checked="" type="checkbox"/> Undifferentiated <input type="checkbox"/> Averaged					
Well Details				Method of Construction		Screen Interval (m/ft)		Annular Space Material (m/ft)		Overburden/Bedrock or Abandonment Filling Material Intervals (m/ft)		Date of Completion (yyyy/mm/dd)	
Well # on Drawing	Zone	Easting	Northing	Hole Depth (m/ft)	Hole Diameter (cm/in)	Casing Material, Diameter (cm/in)	Casing (m/ft) From To	From To	From To	Material	Static Water Level (m/ft)	Date (yyyy/mm/dd)	
MW1176121394826648				20'	6"	2" PVC	0' 10'	10' 20'	20' 9'	SAND		2012/11/20	
MW2176121444826658				19'	6"	2" PVC	0' 9'	9' 19'	19' 8'	SAND Bentonite		2012/11/20	
Well Contractor and Well Technician Information										Mandatory Attachments/Additional Information			
Business Name of Well Contractor: Profile Drilling Inc										<input checked="" type="checkbox"/> Land Owner Consent Form must be attached. <input checked="" type="checkbox"/> Detailed Drawing of All Well Locations must be attached.			
Business Address: 6525 Northam Dr										I, the person constructing the well, will promptly submit to the Director, on request, any additional information in my custody or control related to any well in the well cluster that I have constructed.			
Postal Code: L4V 1T2										Signature of Technician/Contractor: <i>[Signature]</i>			
Bus. Telephone No: 416-650-6444										Date (yyyy/mm/dd): 2013/05/17			
Name of Well Technician (First Name, Last Name): Mike Stockly										Overburden/Bedrock or Abandonment Filling Material Intervals (m/ft): Date First Well in Cluster Constructed or Abandoned (yyyy/mm/dd): 2012/11/20 Date Last Well in Cluster Completed (yyyy/mm/dd): 2012/11/20 Ministry Use Only: Date Received (yyyy/mm/dd): MAY 28 2013, Audit No: C 20417			
Well Contractor's Licence No: 7215										Comments:			
Well Technician's Licence No: 3571										Person Abandoning the Wells: Well Abandonment			
Signature of Well Technician: <i>[Signature]</i>										Name (Print or Type): - See instruction 11 on the back of this form			

**Note:** This Well Record for Well Cluster Part 3 - Detailed Drawing of all Well Locations, must be attached to Parts 1 and 2. The drawing must include all property boundaries, an arrow indicating the North direction, all named roads and sufficient measurements to locate all wells in the cluster in relation to fixed points. The drawing must show the location of each well and each well must be numbered on the drawing to match number used for that well on the Well Record for Well Cluster Parts 1 and 2. The well with the well tag must be clearly identified on the Drawing.

UTM coordinates should appear beside each well, if space permits. Additional comments on wells can be included on the drawing

Well Tag Number: # A139584

"Well Record for Well Cluster" Form Audit Number: # C 20417

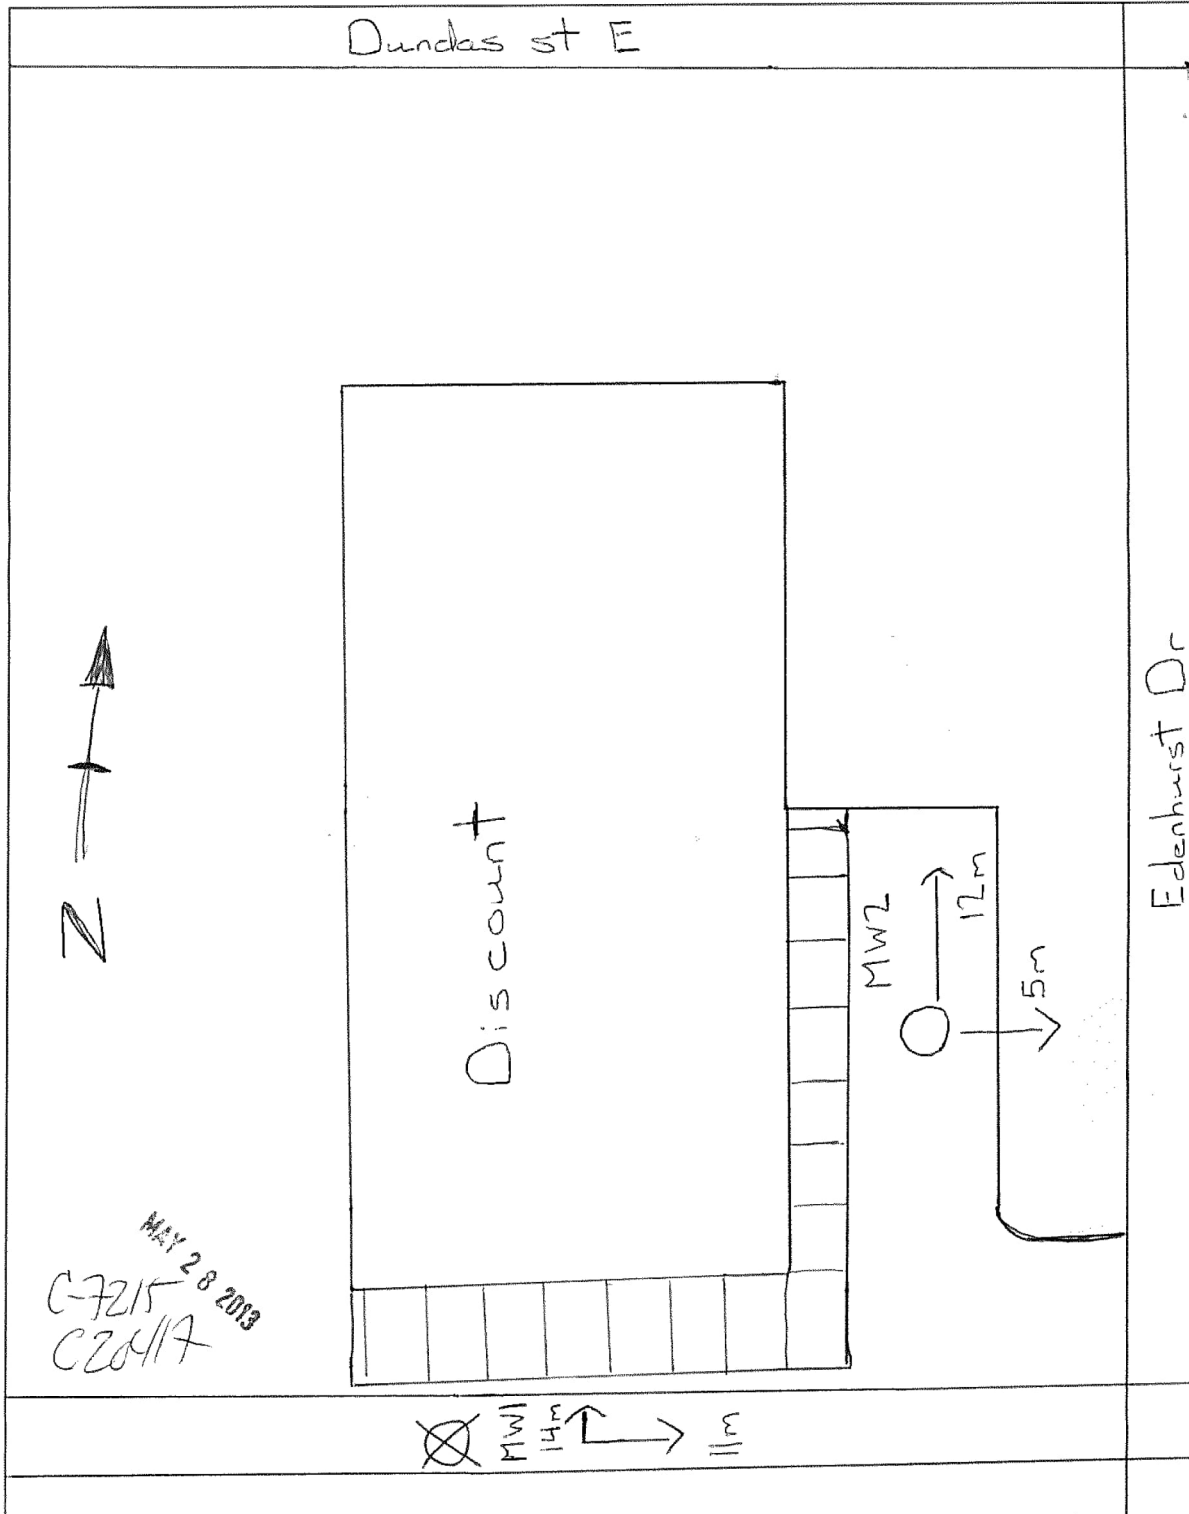



Ministry of the Environment

Well Tag No. (Place Sticker and/or Print Below)

Tag#: A156353 A156353

S-14660

Well Record

Regulation 903 Ontario Water Resources Act

Measurements recorded in:  Metric  Imperial

Page \_\_\_ of \_\_\_

Well Owner's Information

First Name, Last Name / Organization, E-mail Address, Mailing Address, Municipality, Province, Postal Code, Telephone No.

Well Location

Address of Well Location, Township, Lot, Concession, County/District/Municipality, City/Town/Village, Province, Postal Code, UTM Coordinates, Zone, Easting, Northing, Municipal Plan and Sublot Number, Other

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To

Annular Space table with columns: Depth Set at (m/ft) From, To, Type of Sealant Used, Volume Placed

Method of Construction and Well Use checkboxes

Construction Record - Casing table with columns: Inside Diameter, Open Hole OR Material, Wall Thickness, Depth, Status of Well

Construction Record - Screen table with columns: Outside Diameter, Material, Slot No., Depth

Water Details and Hole Diameter tables

Well Contractor and Well Technician Information fields

Results of Well Yield Testing table with columns: Draw Down, Recovery, Time, Water Level

Map of Well Location


Please provide a map below following instructions on the back. See map MW-1

Comments: General contractor: Pinchin Environmental

Ministry Use Only section with fields for Date Package Delivered, Date Work Completed, Audit No., and Signatures



S-14660

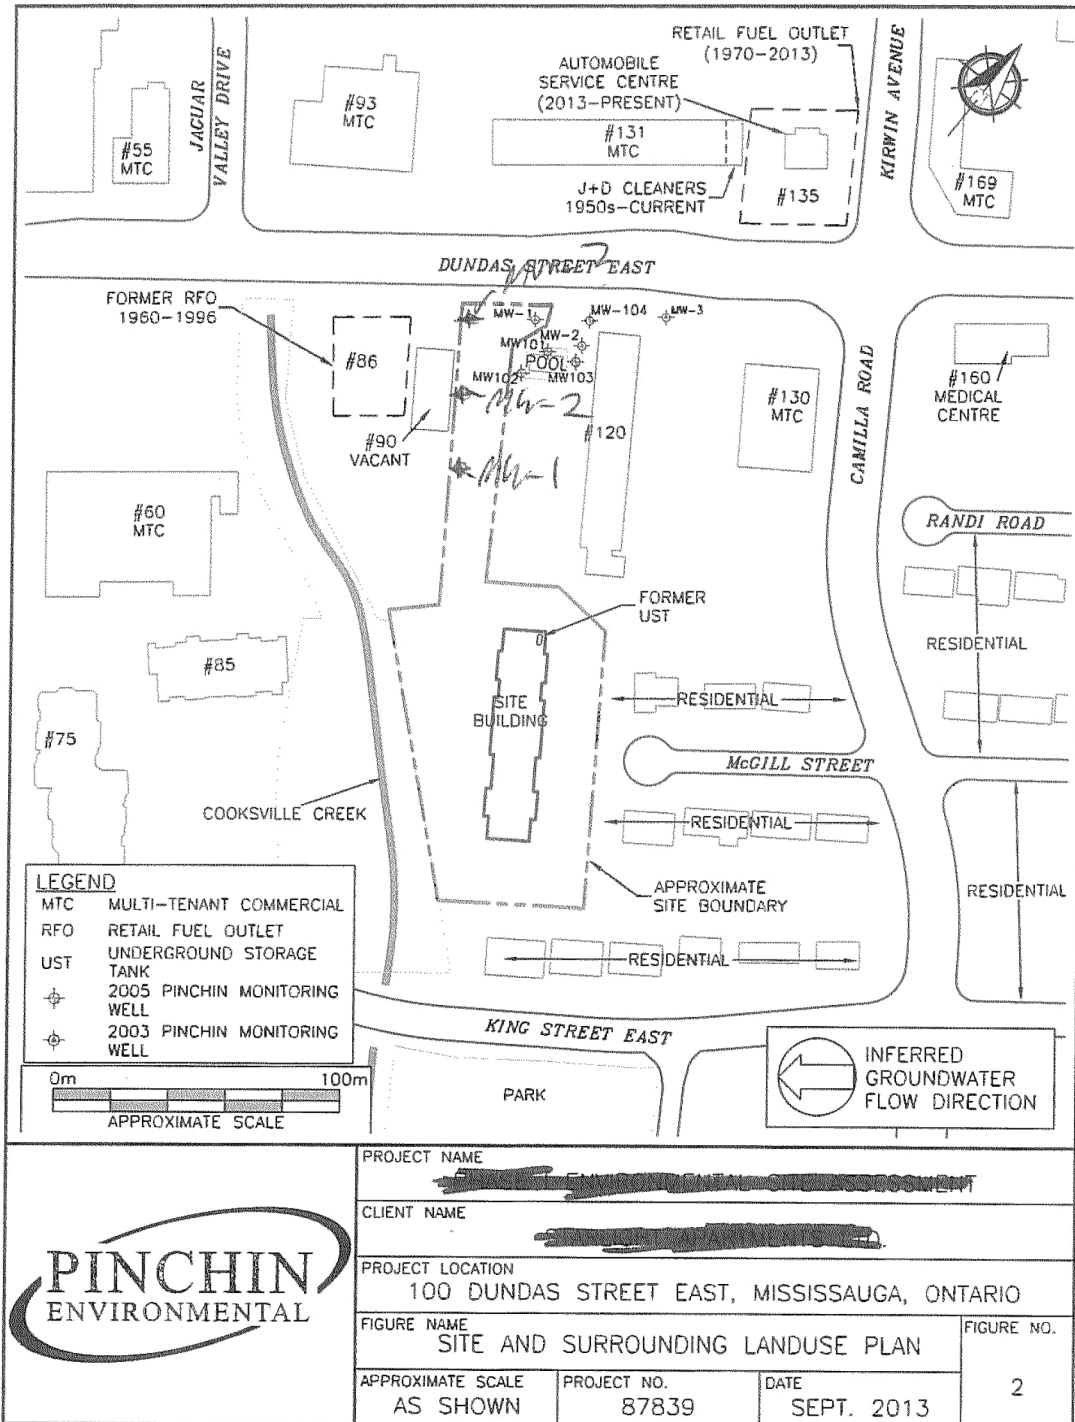

NOV 12 2013

C-7241 2179768



Ministry of the Environment

Well Tag No. (Place Sticker and/or Print Below)

Tag#: A156350

5-14660 A156350

Well Record

Regulation 903 Ontario Water Resources Act

Measurements recorded in:  Metric  Imperial

Page of

STARLIGHT APARTMENTS LTD.

Well Location

Address of Well Location (Street Number/Name) 100 Dundas Street East Township Mississauga Lot Concession

County/District/Municipality City/Town/Village Mississauga Province Ontario Postal Code Other WKQ-006380 A 0 - A 02

UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number

NAD 83 1761192443 26423

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft) From	Depth (m/ft) To
Black	Asphalt			0	4"
Brown	Silty	sand		4"	8'
Grey	Silty	clay		8'	16'

**Annular Space**

Depth Set at (m/ft) From	Depth Set at (m/ft) To	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
0	0.5'	Flushment/concrete.	
0.5'	5'	Water plug	
5'	10'	Sand	

**Method of Construction**

Cable Tool  Rotary (Conventional)  Rotary (Reverse)  Boring  Air percussion  Other, specify  Direct Push

**Well Use**

Public  Commercial  Not used  Domestic  Municipal  Dewatering  Livestock  Test Hole  Monitoring  Irrigation  Cooling & Air Conditioning  Industrial  Other, specify

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify

Static Level	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
1			1	
2			2	
3			3	
4			4	
5			5	
10			10	
15			15	
20			20	
25			25	
30			30	
40			40	
50			50	
60			60	

Pump intake set at (m/ft)

Pumping rate (l/min / GPM)

Duration of pumping hrs + min

Final water level end of pumping (m/ft)

If flowing give rate (l/min / GPM)

Recommended pump depth (m/ft)

Recommended pump rate (l/min / GPM)

Well production (l/min / GPM)

Disinfected?  Yes  No

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Well Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
2"	PVC	0.25"	0	6'	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)	
			From	To
2.25"	PVC	10	6'	10"

**Water Details**

Water found at Depth (m/ft) Kind of Water:  Fresh  Untested  Gas  Other, specify

Water found at Depth (m/ft) Kind of Water:  Fresh  Untested  Gas  Other, specify

Water found at Depth (m/ft) Kind of Water:  Fresh  Untested  Gas  Other, specify

**Hole Diameter**

Depth (m/ft) From	Depth (m/ft) To	Diameter (cm/in)

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: Strata Soil Sampling Inc. Well Contractor's Licence No.: 7241

Business Address (Street Number/Name): 147-2 West Beaver Creek Road Municipality: Richmond Hill

Province: Ontario Postal Code: L4B 1G6 Business E-mail Address: wrecords@stratasoil.com

**Map of Well Location**

Please provide a map below following instructions on the back.

See map  
 MW-3

Comments: General contractor: Pinchin Environmental

Bus. Telephone No. (inc. area code): 905-764-9304 Name of Well Technician (Last Name, First Name): [Signature]

Well Technician's Licence No.: 3708 Signature of Technician and/or Contractor Date Submitted: [Signature] 11/01

Well owner's information package delivered:  Yes  No

Date Package Delivered: 2013/10/11


Date Work Completed: 2013/10/11

**Ministry Use Only**

Audit No.: Z 179767

Received: NOV 2 2013

S-14660

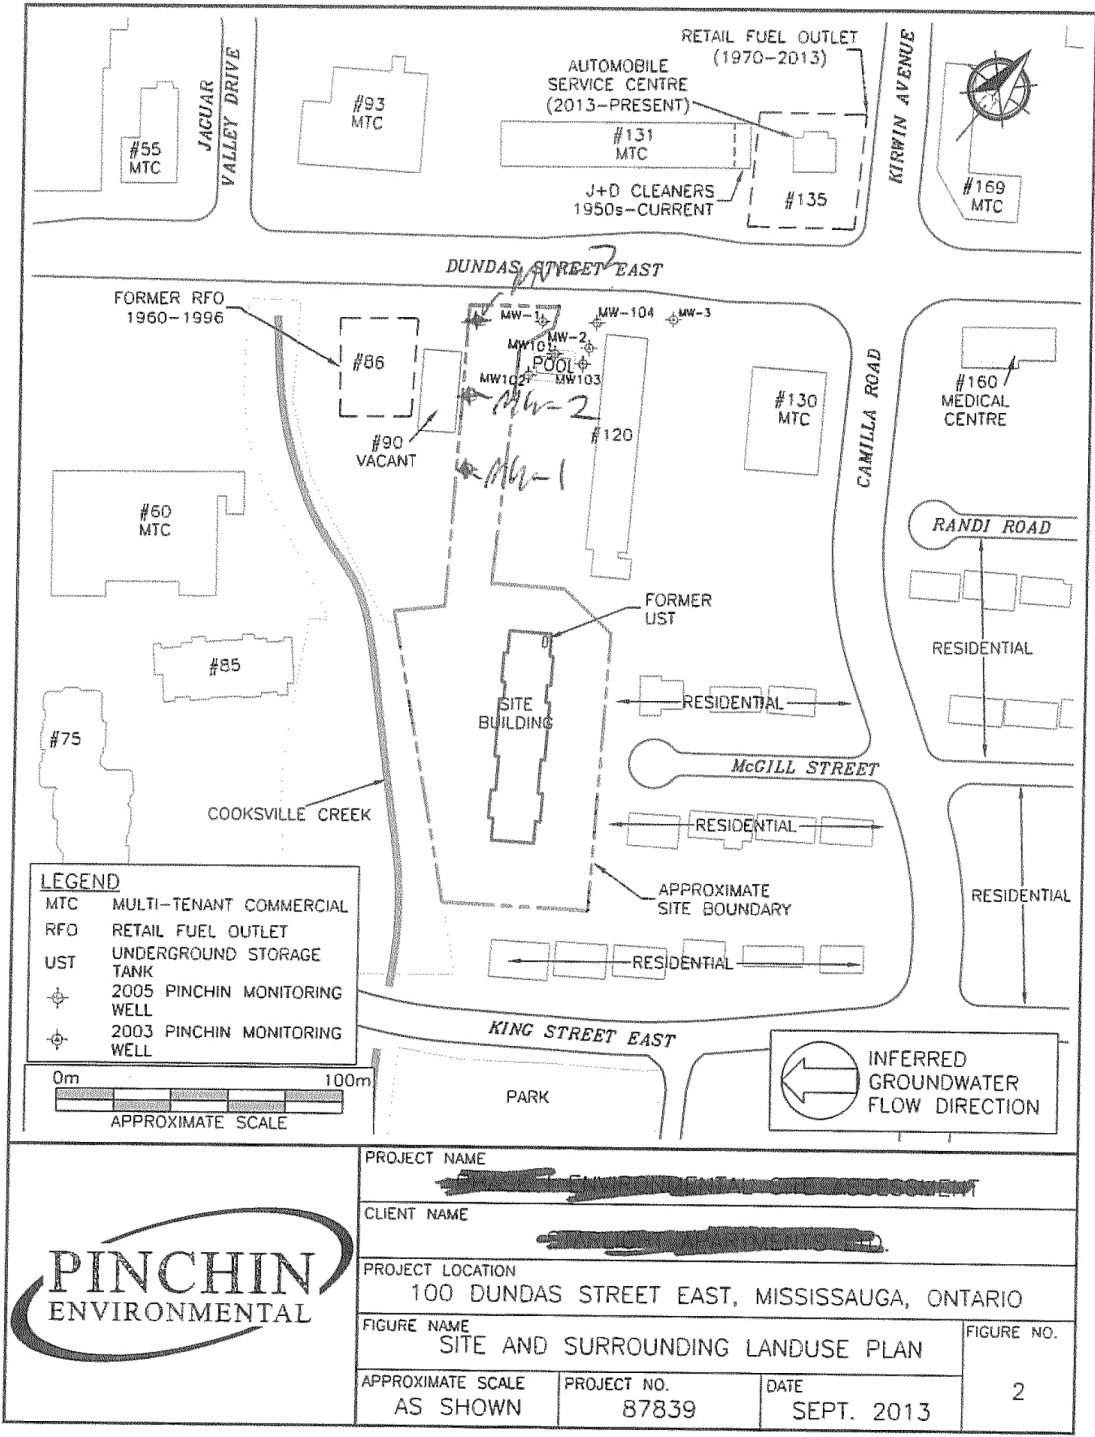

**LEGEND**  
MTC MULTI-TENANT COMMERCIAL  
RFO RETAIL FUEL OUTLET  
UST UNDERGROUND STORAGE TANK  
MW 2005 PINCHIN MONITORING WELL  
MW 2003 PINCHIN MONITORING WELL

0m 100m  
APPROXIMATE SCALE

← INFERRED GROUNDWATER FLOW DIRECTION



PROJECT NAME [REDACTED]		
CLIENT NAME [REDACTED]		
PROJECT LOCATION 100 DUNDAS STREET EAST, MISSISSAUGA, ONTARIO		
FIGURE NAME SITE AND SURROUNDING LANDUSE PLAN		FIGURE NO. 2
APPROXIMATE SCALE AS SHOWN	PROJECT NO. 87839	DATE SEPT. 2013

NOV 1 2013

C-2204 2179767



5-14660

Measurements recorded in:  Metric  Imperial

Tag#: A156352 A156352

STARLIGHT APARTMENTS LTD.

Well Location

Address of Well Location (Street Number/Name) 100 Dundas Street East Township Lot Concession

County/District/Municipality City/Town/Village Mississauga Province Ontario Postal Code

UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other WKQ-006380

NAD 83 17 01 1947 48 26410

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
				From To
Brown	Fill			0 3'
Brown	Silty	Sand		3' 8'
Gray	Silty	Clay		8' 15.5'

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
From To		
0 0.5'	Flashed mortar/Concrete	
0.5' 4.5'	Hole Rag	
4.5' 15.5'	Sand	

**Results of Well Yield Testing**

After test of well yield, water was:  
 Clear and sand free  
 Other, specify

Time (min)	Draw Down		Recovery	
	Water Level (m/ft)	Time (min)	Water Level (m/ft)	Time (min)
1		1		
2		2		
3		3		
4		4		
5		5		
10		10		
15		15		
20		20		
25		25		
30		30		
40		40		
50		50		
60		60		

Static Level

Pump intake set at (m/ft)

Pumping rate (l/min / GPM)

Duration of pumping  
hrs + min

Final water level end of pumping (m/ft)

If flowing give rate (l/min / GPM)

Recommended pump depth (m/ft)

Recommended pump rate (l/min / GPM)

Well production (l/min / GPM)

Disinfected?  
 Yes  No

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  
 Other, specify Direct Push

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)	Status of Well
			From To	
2"	PVC	0.25"	0 5.5'	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify <input type="checkbox"/> Other, specify

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)
			From To
2.25"	PVC	10	5.5' 15.5'

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify	Hole Diameter
		Depth (m/ft) Diameter (cm/in)
		From To
		0 15.5' 6"

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: Strata Soil Sampling Inc. Well Contractor's Licence No.: 7 2 4 1

Business Address (Street Number/Name): 147-2 West Beaver Creek Road Municipality: Richmond Hill

Province: Ontario Postal Code: L4B 1G6 Business E-mail Address: wrecords@stratasoil.co

Bus. Telephone No. (inc. area code): 905-764-9304 Name of Well Technician (Last Name, First Name): CAPTAIN MARK

Well Technician's Licence No.: 3708 Signature of Technician and/or Contractor Date Submitted: Feb 13 11 01

Map of Well Location

Please provide a map below following instructions on the back.

See Map MW-2

Comments: General contractor: Pinchin Environmental

**Ministry Use Only**

Audit No. 2 179766

Date Package Delivered: 2013/01/10

Date Work Completed: 2013/01/10

Well owner's information package delivered:  Yes  No





Measurements recorded in:  Metric  Imperial

A197898

Page \_\_\_ of \_\_\_

Well Owner's Information

First Name, Last Name / Organization, E-mail Address, Mailing Address (Street Number/Name), Municipality, Province, Postal Code, Telephone No. (inc. area code)

Well Location

Address of Well Location (Street Number/Name), Township, Lot, Concession, County/District/Municipality, City/Town/Village, Province, Postal Code, UTM Coordinates, Zone, Easting, Northing, Municipal Plan and Sublot Number, Other

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To

Annular Space: Depth Set at (m/ft) From, To; Type of Sealant Used (Material and Type); Volume Placed (m³/ft³)

Results of Well Yield Testing: After test of well yield, water was; Draw Down, Recovery; Pumping rate (l/min / GPM); Duration of pumping; Final water level end of pumping (m/ft); If flowing give rate (l/min / GPM); Recommended pump depth (m/ft); Recommended pump rate (l/min / GPM); Well production (l/min / GPM); Disinfected?

Method of Construction: Cable Tool, Rotary (Conventional), Rotary (Reverse), Boring, Air percussion, Other; Well Use: Public, Commercial, Domestic, Municipal, Livestock, Test Hole, Irrigation, Cooling & Air Conditioning, Industrial, Other

Construction Record - Casing: Inside Diameter (cm/in), Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel), Wall Thickness (cm/in), Depth (m/ft) From, To; Status of Well: Water Supply, Replacement Well, Test Hole, Recharge Well, Dewatering Well, Observation and/or Monitoring Hole, Alteration (Construction), Abandoned, Insufficient Supply, Abandoned, Poor Water Quality, Abandoned, other, specify

Construction Record - Screen: Outside Diameter (cm/in), Material (Plastic, Galvanized, Steel), Slot No., Depth (m/ft) From, To

Water Details: Water found at Depth (m/ft), Kind of Water: Fresh, Untested, Gas, Other; Hole Diameter: Depth (m/ft) From, To, Diameter (cm/in)

Well Contractor and Well Technician Information


Business Name of Well Contractor, Well Contractor's Licence No., Business Address (Street Number/Name), Municipality, Province, Postal Code, Business E-mail Address

Map of Well Location: Please provide a map below following instructions on the back. Comments: General contractor: Pinchin Environmental

Bus. Telephone No. (inc. area code), Name of Well Technician (Last Name, First Name), Well Technician's License No., Signature of Technician and/or Contractor, Date Submitted

Well owner's information package delivered, Date Package Delivered, Date Work Completed, Ministry Use Only: Audit No., Date Completed, Received

5-18471

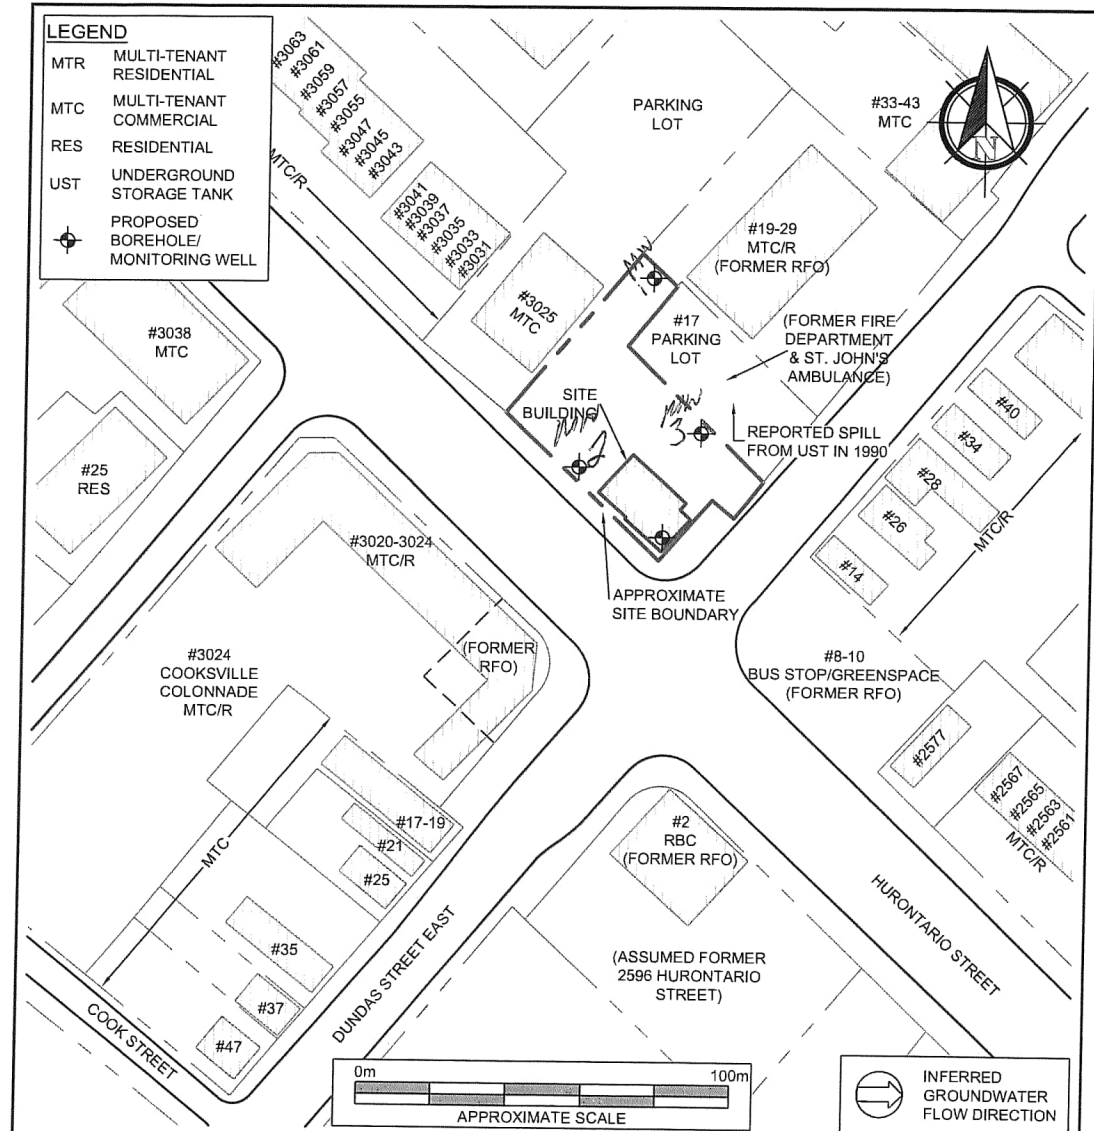

PROJECT NAME			PHASE II ENVIRONMENTAL SITE ASSESSMENT
CLIENT NAME			CIBC CORPORATE REAL ESTATE
PROJECT LOCATION			5 DUNDAS STREET EAST, MISSISSAUGA, ONTARIO
FIGURE NAME		PROPOSE BOREHOLE/ MONITORING WELL LOCATION PLAN	FIGURE NO.
APPROXIMATE SCALE	PROJECT NO.	DATE	2
AS SHOWN	111021.002	MAR. 2016	

MAY 27 2016

C-724 2231580

Measurements recorded in:  Metric  Imperial

Page \_\_\_\_\_ of \_\_\_\_\_

**Well Owner's Information**

First Name \_\_\_\_\_ Last Name / Organization CIBC Corporate Real Estate E-mail Address \_\_\_\_\_  Well Constructed by Well Owner

Mailing Address (Street Number/Name) 55 Yonge St 4<sup>th</sup> floor Municipality Toronto Province ON Postal Code M5E 1S4 Telephone No. (inc. area code) \_\_\_\_\_

**Well Location**

Address of Well Location (Street Number/Name) 5 Dundas Street East Township \_\_\_\_\_ Lot \_\_\_\_\_ Concession \_\_\_\_\_

County/District/Municipality \_\_\_\_\_ City/Town/Village Mississauga Province Ontario Postal Code \_\_\_\_\_

UTM Coordinates Zone 18 Easting 611689 Northing 4826238 Municipal Plan and Sublot Number \_\_\_\_\_ Other WKQ-008852  
A 0 - A 03

**Overburden and Bedrock Materials/Abandonment Sealing Record** (see instructions on the back of this form)

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
				From To
<u>BLK</u>	<u>Asphalt</u>			0 3'
<u>BRN</u>	<u>Sand</u>	<u>S.H</u>		3" 5'
<u>BRN/GRY</u>	<u>S.H</u>	<u>Sand/Clay</u>		5' 12 1/2'
<u>GRY</u>	<u>Shale</u>		<u>Weathered</u>	12 1/2 17'

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used (Material and Type)	Volume Placed (m <sup>3</sup> /ft <sup>3</sup> )
From To		
<u>17' 6"</u>	<u>Sand</u>	
<u>6' 0"</u>	<u>Hotepoxy</u>	
	<u>Fluoromant</u>	

**Results of Well Yield Testing**

After test of well yield, water was:	Draw Down		Recovery	
<input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason:	Static Level			
	1		1	
Pump intake set at (m/ft)	2		2	
Pumping rate (l/min / GPM)	3		3	
Duration of pumping _____ hrs + _____ min	4		4	
Final water level end of pumping (m/ft)	5		5	
If flowing give rate (l/min / GPM)	10		10	
	15		15	
Recommended pump depth (m/ft)	20		20	
	25		25	
Recommended pump rate (l/min / GPM)	30		30	
Well production (l/min / GPM)	40		40	
Disinfected? <input type="checkbox"/> Yes <input type="checkbox"/> No	50		50	
	60		60	

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  
 Other, specify Direct Push  Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fibreglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)		Status of Well
			From	To	
<u>2"</u>	<u>PVC</u>	<u>.25</u>	<u>0</u>	<u>7'</u>	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input checked="" type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)		Status of Well
			From	To	
<u>225</u>	<u>PVC</u>	<u>110</u>	<u>7'</u>	<u>14'</u>	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input checked="" type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	Hole Diameter	
		Depth (m/ft)	Diameter (cm/in)
From	To		
		<u>0</u>	<u>17' 6"</u>

**Well Contractor and Well Technician Information**

Business Name of Well Contractor Strata Soil Sampling Inc. Well Contractor's Licence No. 7 2 4 1

Business Address (Street Number/Name) 165 Shields Court Municipality Markham

Province Ontario Postal Code L3R 8V2 Business E-mail Address wrecords@stratasoil.com

**Map of Well Location**

Please provide a map below following instructions on the back.  
M/W 2

Comments: General contractor: Pinchin Environmental

Bus. Telephone No. (inc. area code) 905-764-9304 Name of Well Technician (Last Name, First Name) Leccese M

Well Technician's Licence No. 13016 Signature of Technician and/or Contractor [Signature] Date Submitted 20150911


Well owner's information package delivered  Yes  No

Date Package Delivered 20150911 Date Work Completed 20150911

Ministry Use Only  
Audit No. 231549  
Received AY 27 2016



5-18471

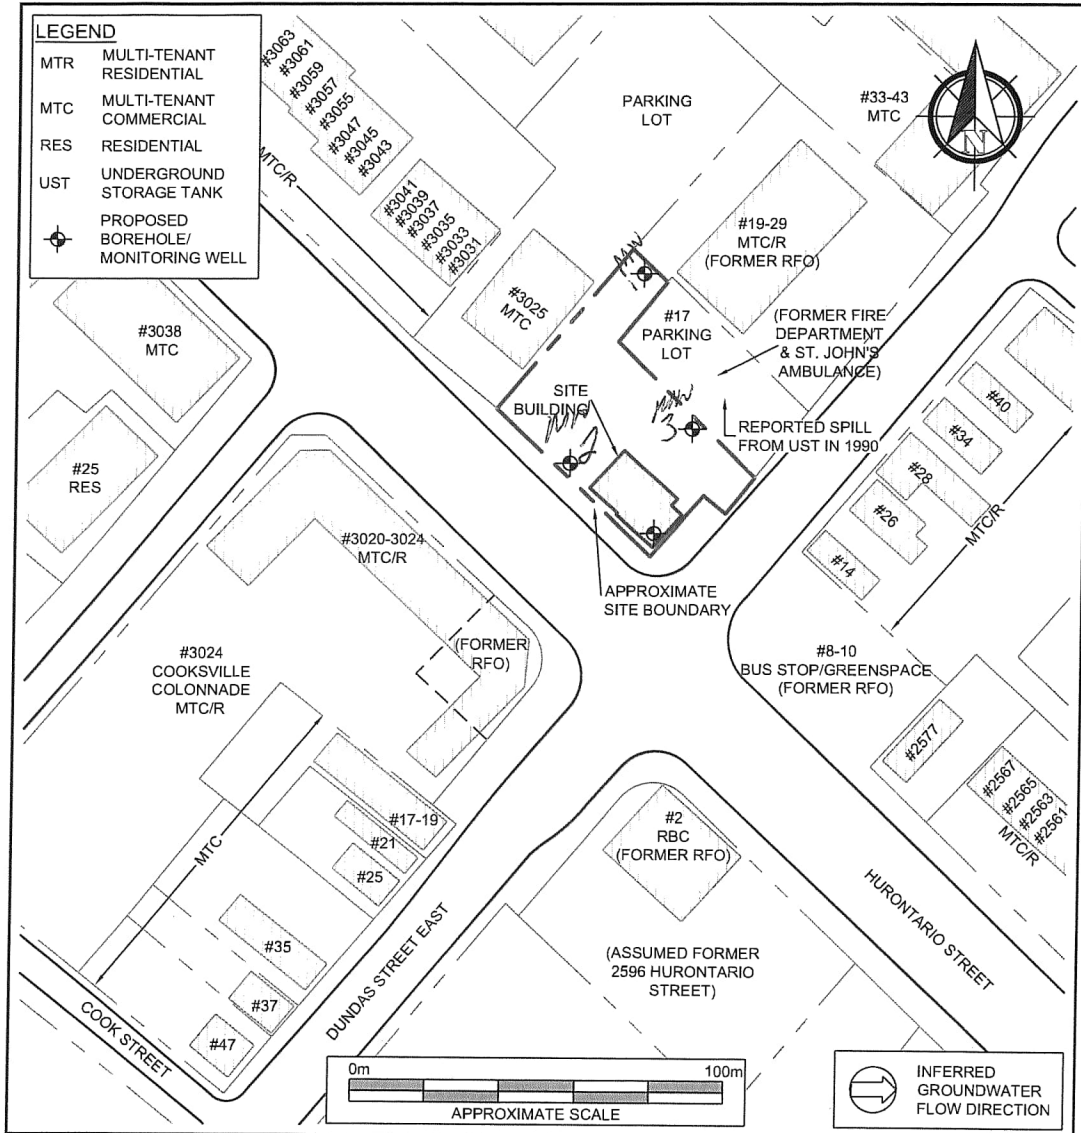

	PROJECT NAME			PHASE II ENVIRONMENTAL SITE ASSESSMENT
	CLIENT NAME			CIBC CORPORATE REAL ESTATE
	PROJECT LOCATION			5 DUNDAS STREET EAST, MISSISSAUGA, ONTARIO
	FIGURE NAME		PROPOSE BOREHOLE/ MONITORING WELL LOCATION PLAN	FIGURE NO.
	APPROXIMATE SCALE	PROJECT NO.	DATE	2
AS SHOWN	111021.002	MAR. 2016		

MAY 27 2016

C-7211 7231549



S-18471

Measurements recorded in: Metric Imperial

Well Owner's Information

First Name, Last Name / Organization (CIBC Corporate Real Estate), E-mail Address, Mailing Address (55 Yonge St 4th Floor), Municipality (Toronto), Province (ON), Postal Code (M5E 1S4), Telephone No.

Well Location

Address of Well Location (5 Dundas Street East), Township, Lot, Concession, City/Town/Village (Mississauga), Province (Ontario), Postal Code, UTM Coordinates, Municipal Plan and Sublot Number (Other NKQ-008852 A 0 - A 03)

Overburden and Bedrock Materials/Abandonment Sealing Record

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Includes handwritten entries for Asphalts, Sand, Silt, Clay, and Weathered.

Annular Space table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used; Volume Placed (m³/ft³). Includes handwritten entries for Sand, Hoop Luff, and Holmarb.

Method of Construction and Well Use checkboxes. Includes options like Cable Tool, Rotary, Boring, etc.

Construction Record - Casing table with columns: Inside Diameter, Open Hole OR Material, Wall Thickness, Depth (m/ft) From, To. Includes handwritten entries for 2" PVC casing.

Construction Record - Screen table with columns: Outside Diameter, Material, Slot No., Depth (m/ft) From, To. Includes handwritten entries for 2.25" PVC screen.

Water Details and Hole Diameter table. Includes fields for Water found at Depth and Hole Diameter (0.176").

Well Contractor and Well Technician Information. Includes Business Name (Strata Soil Sampling Inc.), Address (165 Shields Court), and Technician Name (Lecese, Nik).


Results of Well Yield Testing table. Includes Draw Down and Recovery columns with handwritten data points for Time, Water Level, and Static Level.

Map of Well Location section with handwritten note 'MWS' and instructions to provide a map.

Comments section with handwritten text: 'General contractor: Pinchin Environmental'.

Bottom section containing Well Contractor's Licence No., Business E-mail Address, Date Package Delivered, Date Work Completed, and Ministry Use Only Audit No. (2231548) dated MAY 27 2016.

S-18471

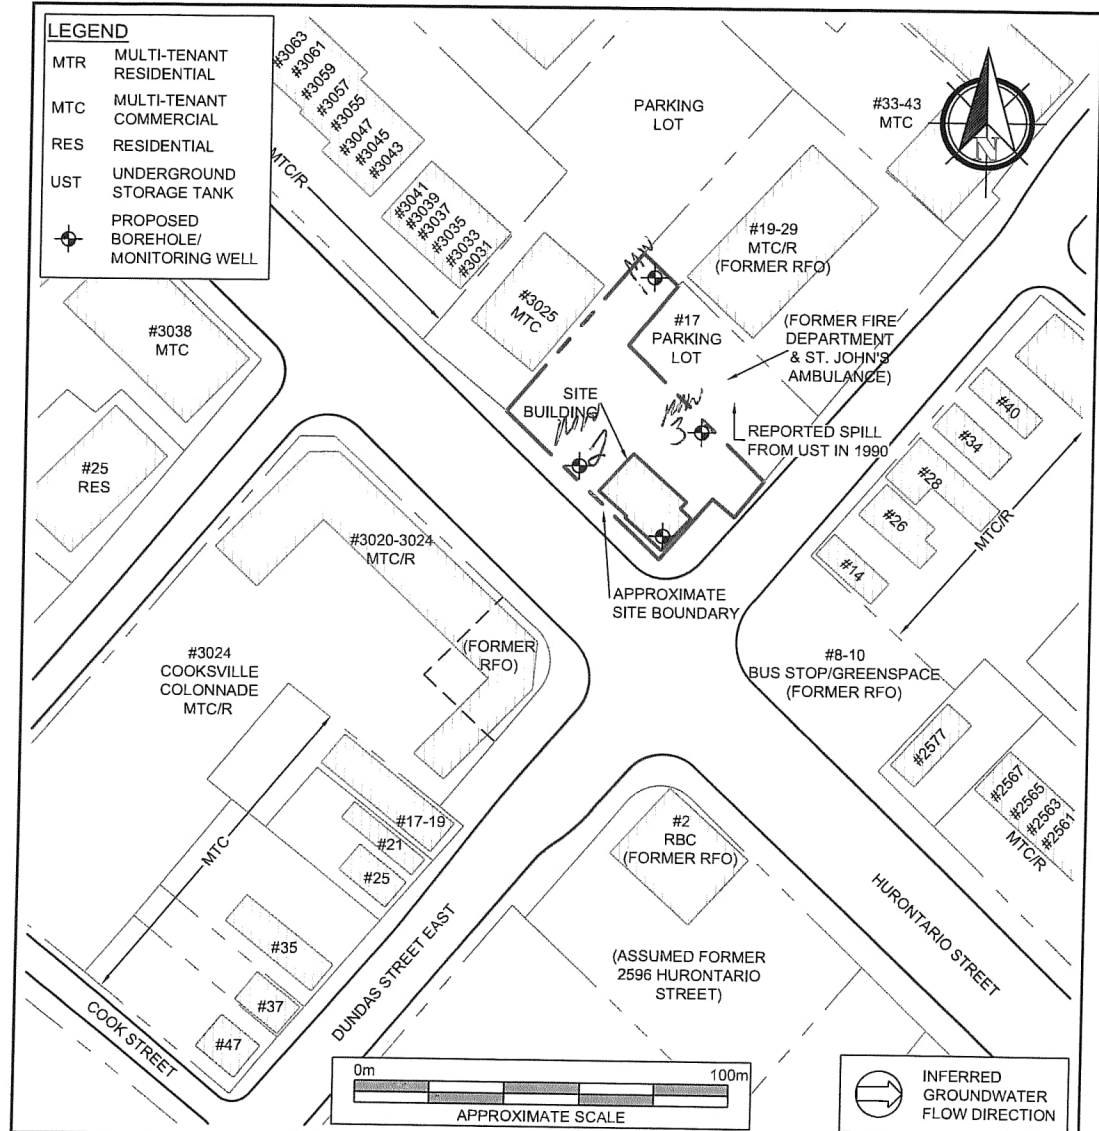

PROJECT NAME PHASE II ENVIRONMENTAL SITE ASSESSMENT		
CLIENT NAME CIBC CORPORATE REAL ESTATE		
PROJECT LOCATION 5 DUNDAS STREET EAST, MISSISSAUGA, ONTARIO		
FIGURE NAME PROPOSE BOREHOLE/ MONITORING WELL LOCATION PLAN		FIGURE NO. 2
APPROXIMATE SCALE AS SHOWN	PROJECT NO. 111021.002	DATE MAR. 2016

MAY 27 2016

C-741 7231548



S-18471

Measurements recorded in:  Metric  Imperial

Page \_\_\_ of \_\_\_

A197985

Well Owner's Information

First Name, Last Name / Organization (CIBC Corporate Real Estate), E-mail Address, Mailing Address (55 Yonge St, 4th floor), Municipality (Toronto), Province (ON), Postal Code (M5E1N9), Telephone No.

Well Location

Address of Well Location (5 Dundas Street East), Township, Lot, Concession, City/Town/Village (Mississauga), Province (Ontario), Postal Code (W6K-0G8), UTM Coordinates (NAD 83 1761171114826220)

Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)

Table with columns: General Colour, Most Common Material, Other Materials, General Description, Depth (m/ft) From, To. Includes entries for Concrete, Fill, and clay.

Annular Space table with columns: Depth Set at (m/ft) From, To; Type of Sealant Used (Material and Type); Volume Placed (m³/ft³). Includes entries for concrete/flashmount, Benseal, and Sand.

Method of Construction and Well Use checkboxes. Includes options like Cable Tool, Rotary, Boring, etc.

Construction Record - Casing table with columns: Inside Diameter (cm/in), Open Hole OR Material, Well Thickness (cm/in), Depth (m/ft) From, To. Includes entry for PVC casing.

Construction Record - Screen table with columns: Outside Diameter (cm/in), Material, Slot No., Depth (m/ft) From, To. Includes entry for PVC screen.

Water Details and Hole Diameter table. Includes columns for Water found at Depth, Kind of Water, and Hole Diameter.

Well Contractor and Well Technician Information. Includes Business Name (Strata Soil Sampling Inc.), Business Address (165 Shields Court), and Technician Name (Walker Jonathan).

Results of Well Yield Testing table. Includes columns for Draw Down (Time, Water Level) and Recovery (Time, Water Level). Includes a table for Pumping rate and Final water level end of pumping.

Map of Well Location section. Includes text: 'Please provide a map below following instructions on the back.' and handwritten note: 'See Map mwl'.

Well Contractor and Well Technician Information (continued). Includes Province (Ontario), Postal Code (L3R 8V2), Business E-mail Address (wrecords@stratasoil.com), and Bus. Telephone No. (905-764-9304).

Ministry Use Only section. Includes Date Package Delivered, Date Work Completed, and Audit No. (231466).

ROYAL BANK OF CANADA

Address of Well Location (Street Number/Name) 2 Dundas Street West  
 Township \_\_\_\_\_ Lot \_\_\_\_\_ Concession \_\_\_\_\_  
 County/District/Municipality Mississauga Province Ontario Postal Code \_\_\_\_\_  
 UTM Coordinates Zone Easting Northing Municipal Plan and Sublot Number Other WKQ-010354  
 NAD 83 17 6111750 4826092 A 0 - A 02

**Overburden and Bedrock Materials/Abandonment Sealing Record (see instructions on the back of this form)**

General Colour	Most Common Material	Other Materials	General Description	Depth (m/ft)
				From To
Blk	Asphalt			0 3"
Brown	silt	clay		3" 10'
Grey	Shale			10' 13'

**Annular Space**

Depth Set at (m/ft)	Type of Sealant Used	Volume Placed
From To	(Material and Type)	(m³/ft³)
0 6"	Concrete	
6" 2'	Bentonite	
2' 13'	Sand	

**Results of Well Yield Testing**

After test of well yield, water was: <input type="checkbox"/> Clear and sand free <input type="checkbox"/> Other, specify _____	Draw Down		Recovery	
	Time (min)	Water Level (m/ft)	Time (min)	Water Level (m/ft)
If pumping discontinued, give reason: Static Level	1		1	
	2		2	
	3		3	
	4		4	
	5		5	
	10		10	
Pump intake set at (m/ft)	15		15	
	20		20	
	25		25	
	30		30	
	40		40	
	50		50	
Pumping rate (l/min / GPM)	60		60	
Duration of pumping ____ hrs + ____ min				
Final water level end of pumping (m/ft)				
If flowing give rate (l/min / GPM)				
Recommended pump depth (m/ft)				
Recommended pump rate (l/min / GPM)				
Well production (l/min / GPM)				
Disinfected? <input type="checkbox"/> Yes <input type="checkbox"/> No				

**Method of Construction**

Cable Tool  Diamond  Public  Commercial  Not used  
 Rotary (Conventional)  Jetting  Domestic  Municipal  Dewatering  
 Rotary (Reverse)  Driving  Livestock  Test Hole  Monitoring  
 Boring  Digging  Irrigation  Cooling & Air Conditioning  
 Air percussion  Industrial  
 Other, specify \_\_\_\_\_  Direct Push  Other, specify \_\_\_\_\_

**Construction Record - Casing**

Inside Diameter (cm/in)	Open Hole OR Material (Galvanized, Fiberglass, Concrete, Plastic, Steel)	Wall Thickness (cm/in)	Depth (m/ft)	Status of Well
			From To	
2"	PVC	.225	0 3'	<input type="checkbox"/> Water Supply <input type="checkbox"/> Replacement Well <input type="checkbox"/> Test Hole <input type="checkbox"/> Recharge Well <input type="checkbox"/> Dewatering Well <input type="checkbox"/> Observation and/or Monitoring Hole <input type="checkbox"/> Alteration (Construction) <input type="checkbox"/> Abandoned, Insufficient Supply <input type="checkbox"/> Abandoned, Poor Water Quality <input type="checkbox"/> Abandoned, other, specify _____ <input type="checkbox"/> Other, specify _____

**Construction Record - Screen**

Outside Diameter (cm/in)	Material (Plastic, Galvanized, Steel)	Slot No.	Depth (m/ft)
			From To
2.25	PVC	10	3' 13'

**Water Details**

Water found at Depth (m/ft)	Kind of Water: <input type="checkbox"/> Fresh <input type="checkbox"/> Untested <input type="checkbox"/> Gas <input type="checkbox"/> Other, specify _____	Depth (m/ft)	Diameter (cm/in)
		From To	
		0 13'	6"

**Well Contractor and Well Technician Information**

Business Name of Well Contractor: Strata Soil Sampling Inc.  
 Well Contractor's Licence No.: 17 21 4 1  
 Business Address (Street Number/Name): 165 Shields Court  
 Municipality: Markham  
 Province: Ontario Postal Code: L3R 8V2 Business E-mail Address: wrecords@stratasoil.com

**Map of Well Location**

Please provide a map below following instructions on the back.

See Map

B"

Comments: General contractor: Pinchin Environmental

Bus. Telephone No. (inc. area code): 905-764-9304  
 Name of Well Technician (Last Name, First Name): Vanderboor, Andrew  
 Well Technician's Licence No.: 3616  
 Signature of Technician and/or Contractor: Andrew Vanderboor  
 Date Submitted: 2017 09 29

**Ministry Use Only**

Audit No.: 2270104  
 Date Package Delivered: \_\_\_\_\_  
 Date Work Completed: 24 17 2017  
 Received: \_\_\_\_\_  
 OCT 15 2017



---

---

**APPENDIX D**

**Water Balance Summary Tables**

---

---

**Table C: Water Balance Summary Table**

Characteristic	Site			
	Pre-Development	Post-Development	Change (Pre to Post)	
<b>Inputs (Volume)</b>				
Precipitation (m <sup>3</sup> /yr)	4,974	4,974	0	0%
Run-On (m <sup>3</sup> /yr)	0	0	0	NA
Other Inputs (m <sup>3</sup> /yr)	0	0	0	NA
<b>Total Inputs (m<sup>3</sup>/yr)</b>	<b>4,974</b>	<b>4,974</b>	<b>0</b>	<b>0%</b>
<b>Outputs (Volume)</b>				
Precipitation Surplus (m <sup>3</sup> /yr)	1,845	2,993	1,147	62%
Net Surplus (m <sup>3</sup> /yr)	1,845	2,993	1,147	62%
Evapotranspiration (m <sup>3</sup> /yr)	3,129	1,981	-1,147	-37%
Infiltration (m <sup>3</sup> /yr)	862	412	-450	-52%
Rooftop Infiltration (m <sup>3</sup> /yr)	0	0	0	NA
<b>Total Infiltration (m<sup>3</sup>/yr)</b>	<b>862</b>	<b>412</b>	<b>-450</b>	<b>-52%</b>
Run-Off Pervious Areas (m <sup>3</sup> /yr)	983	441	-542	-55%
Run-Off Impervious Areas (m <sup>3</sup> /yr)	0	2,139	2,139	NA
Total Run-Off (m <sup>3</sup> /yr)	983	2,581	1,598	163%
<b>Total Outputs (m<sup>3</sup>/yr)</b>	<b>4,974</b>	<b>4,974</b>	<b>0</b>	<b>0%</b>

**Table A: Pre-Development**

Catchment Designation	Forest	Landscaped Grass	Total
Area (m <sup>2</sup> )	4,300	2,085	6,385
Pervious Area (m <sup>2</sup> )	4,300	2,085	6,385
Impervious Area (m <sup>2</sup> )	0	0	0
<b>Infiltration Factors</b>			
Topography Infiltration Factor	0.2	0.2	
Soil Infiltration Factor	0.1	0.1	
Land Cover Infiltration Factor	0.2	0.1	
Infiltration Factor	0.5	0.4	
Run-Off Coefficient	0.5	0.6	
Run-Off From Impervious Surfaces	0.8	0.8	
<b>Inputs (Per Unit Area)</b>			
Precipitation (mm/yr)	779	779	779
Rainfall (mm/yr)	632	632	632
Run-On (mm/yr)	0	0	0
Other Inputs (mm/yr)	0	0	0
<b>Total Inputs (mm/yr)</b>	<b>779</b>	<b>779</b>	<b>779</b>
<b>Outputs (Per Unit Area)</b>			
Precipitation Surplus (mm/yr)	289	289	289
Net Surplus (mm/yr)	289	289	289
Evapotranspiration (mm/yr)	490	490	490
Infiltration (mm/yr)	145	116	135
Surplus Infiltration (mm/yr)	0	0	0
Total Infiltration (mm/yr)	145	116	135
Run-Off Pervious Areas (mm/yr)	145	173	154
Run-Off Impervious Areas (mm/yr)	0	0	0
Total Run-Off (mm/yr)	145	173	154
<b>Total Outputs (mm/yr)</b>	<b>779</b>	<b>779</b>	<b>779</b>
<b>Difference (Inputs - Outputs)</b>	<b>0</b>	<b>0</b>	<b>0</b>
<b>Inputs (Volumes)</b>			
Precipitation (m <sup>3</sup> /yr)	3,350	1,624	4,974
Run-On (m <sup>3</sup> /yr)	0	0	0
Other Inputs (m <sup>3</sup> /yr)	0	0	0
<b>Total Inputs (m<sup>3</sup>/yr)</b>	<b>3,350</b>	<b>1,624</b>	<b>4,974</b>
<b>Outputs (Volumes)</b>			
Precipitation Surplus (m <sup>3</sup> /yr)	1,243	603	1,845
Net Surplus (m <sup>3</sup> /yr)	1,243	603	1,845
Evapotranspiration (m <sup>3</sup> /yr)	2,107	1,022	3,129
Infiltration (m <sup>3</sup> /yr)	621	241	862
Surplus Infiltration (m <sup>3</sup> /yr)	0	0	0
<b>Total Infiltration (m<sup>3</sup>/yr)</b>	<b>621</b>	<b>241</b>	<b>862</b>
Run-Off Pervious Areas (m <sup>3</sup> /yr)	621	362	983
Run-Off Impervious Areas (m <sup>3</sup> /yr)	0	0	0
Total Run-Off (m <sup>3</sup> /yr)	621	362	983
<b>Total Outputs (m<sup>3</sup>/yr)</b>	<b>3,350</b>	<b>1,624</b>	<b>4,974</b>
<b>Difference (Inputs - Outputs)</b>	<b>0</b>	<b>0</b>	<b>0</b>



**Table B: Post-Development (no mit)**

Catchment Designation	Parkland Dedication	Landscaped Grass	Structure	Total
Area (m <sup>2</sup> )	2,450	502	3,433	6,385
Pervious Area (m <sup>2</sup> )	2,450	502	0	2,952
Impervious Area (m <sup>2</sup> )	0	0	3,433	3,433
<b>Infiltration Factors</b>				
Topography Infiltration Factor	0.2	0.2	0	
Soil Infiltration Factor	0.1	0.1	0	
Land Cover Infiltration Factor	0.2	0.1	0	
Infiltration Factor	0.5	0.4	0	
Run-Off Coefficient	0.5	0.6	1	
Run-Off From Impervious Surfaces	0.8	0.8	0.8	
<b>Inputs (Per Unit Area)</b>				
Precipitation (mm/yr)	779	779	779	779
Rainfall (mm/yr)	632	632	632	632
Run-On (mm/yr)	0	0	0	0
Other Inputs (mm/yr)	0	0	0	0
<b>Total Inputs (mm/yr)</b>	<b>779</b>	<b>779</b>	<b>779</b>	<b>779</b>
<b>Outputs (Per Unit Area)</b>				
Precipitation Surplus (mm/yr)	289	289	623	469
Net Surplus (mm/yr)	289	289	623	469
Evapotranspiration (mm/yr)	490	490	156	310
Infiltration (mm/yr)	145	116	0	65
Surplus Infiltration (mm/yr)	0	0	0	0
Total Infiltration (mm/yr)	145	116	0	65
Run-Off Pervious Areas (mm/yr)	145	173	0	69
Run-Off Impervious Areas (mm/yr)	0	0	623	335
Total Run-Off (mm/yr)	145	173	623	404
<b>Total Outputs (mm/yr)</b>	<b>779</b>	<b>779</b>	<b>779</b>	<b>779</b>
<b>Difference (Inputs - Outputs)</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>
<b>Inputs (Volumes)</b>				
Precipitation (m <sup>3</sup> /yr)	1,909	391	2,674	4,974
Run-On (m <sup>3</sup> /yr)	0	0	0	0
Other Inputs (m <sup>3</sup> /yr)	0	0	0	0
<b>Total Inputs (m<sup>3</sup>/yr)</b>	<b>1,909</b>	<b>391</b>	<b>2,674</b>	<b>4,974</b>
<b>Outputs (Volumes)</b>				
Precipitation Surplus (m <sup>3</sup> /yr)	708	145	2,139	2,993
Net Surplus (m <sup>3</sup> /yr)	708	145	2,139	2,993
Evapotranspiration (m <sup>3</sup> /yr)	1,201	246	535	1,981
Infiltration (m <sup>3</sup> /yr)	354	58	0	412
Surplus Infiltration (m <sup>3</sup> /yr)	0	0	0	0
<b>Total Infiltration (m<sup>3</sup>/yr)</b>	<b>354</b>	<b>58</b>	<b>0</b>	<b>412</b>
Run-Off Pervious Areas (m <sup>3</sup> /yr)	354	87	0	441
Run-Off Impervious Areas (m <sup>3</sup> /yr)	0	0	2,139	2,139
Total Run-Off (m <sup>3</sup> /yr)	354	87	2,139	2,581
<b>Total Outputs (m<sup>3</sup>/yr)</b>	<b>1,909</b>	<b>391</b>	<b>2,674</b>	<b>4,974</b>
<b>Difference (Inputs - Outputs)</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>



---


---

**APPENDIX E**


**Hydraulic Conductivity Testing**

---

---

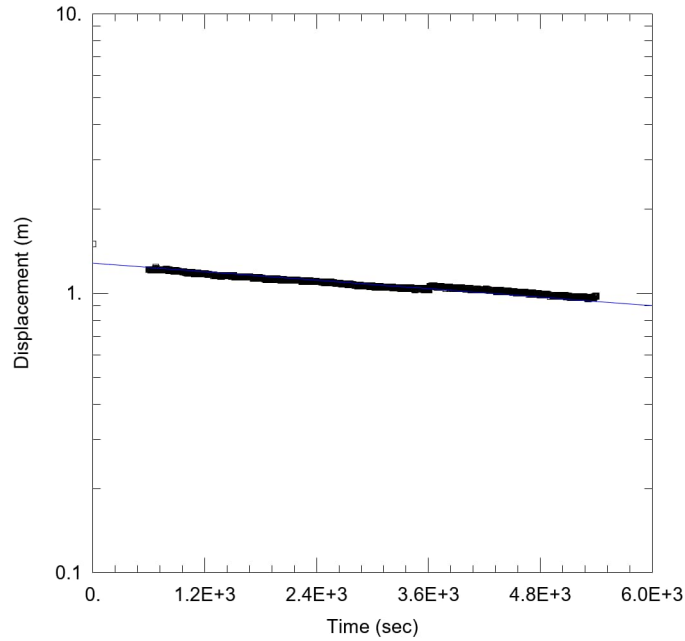

<u>WELL TEST ANALYSIS</u>	
Data Set: <u>X:\...\BH2 Logger.aqt</u>	Time: <u>17:50:09</u>
Date: <u>06/02/22</u>	
<u>PROJECT INFORMATION</u>	
Company: <u>Azimuth Environmental</u>	
Client: <u>Azure Group</u>	
Project: <u>22-056</u>	
Location: <u>Mississauga</u>	
Test Date: <u>May 11th 2022</u>	
<u>AQUIFER DATA</u>	
Saturated Thickness: <u>3.34</u> m	Anisotropy Ratio (Kz/Kr): <u>1.</u>
<u>WELL DATA (BH2)</u>	
Initial Displacement: <u>1.5</u> m	Static Water Column Height: <u>4.9</u> m
Total Well Penetration Depth: <u>3.34</u> m	Screen Length: <u>3.05</u> m
Casing Radius: <u>0.0254</u> m	Wellbore Radius: <u>0.1524</u> m
<u>SOLUTION</u>	
Aquifer Model: <u>Unconfined</u>	Solution Method: <u>Hvorslev</u>
K = <u>2.278E-8</u> m/sec	y0 = <u>1.28</u> m

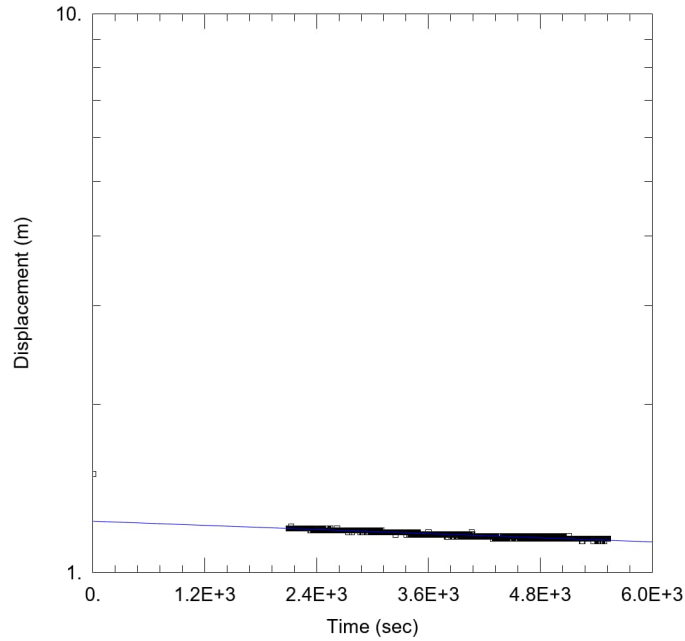

<u>WELL TEST ANALYSIS</u>	
Data Set: <u>X:\...\BH106 Logger.aqt</u>	Time: <u>17:49:51</u>
Date: <u>06/02/22</u>	
<u>PROJECT INFORMATION</u>	
Company: <u>Azimuth Environmental</u>	
<u>AQUIFER DATA</u>	
Saturated Thickness: <u>3.58 m</u>	Anisotropy Ratio (Kz/Kr): <u>1.</u>
<u>WELL DATA (BH106)</u>	
Initial Displacement: <u>1.5 m</u>	Static Water Column Height: <u>3.84 m</u>
Total Well Penetration Depth: <u>3.58 m</u>	Screen Length: <u>3.05 m</u>
Casing Radius: <u>0.0254 m</u>	Wellbore Radius: <u>0.1524 m</u>
<u>SOLUTION</u>	
Aquifer Model: <u>Unconfined</u>	Solution Method: <u>Hvorslev</u>
K = <u>5.564E-9 m/sec</u>	y0 = <u>1.236 m</u>



---

---

**APPENDIX F**

**Water Quality Data**

---

---

## Results of Surface Water Chemical Analyses

			Provincial Water Quality Objectives (1994)	BH-3
				Sampled on: 2022-05-11
			Objective	Sampled by: Azimuth
Parameter	Symbol	Units		Caduceon
Saturation pH		N/A	-	6.73
pH		N/A	6.5-8.5	7.51
Langlier Index		N/A	-	0.777
Alkalinity (as CaCO <sub>3</sub> )		mg/L	262	244
Bicarbonate (as CaCO <sub>3</sub> )	HCO <sub>3</sub> <sup>-</sup>	mg/L	-	244
Carbonate (as CaCO <sub>3</sub> )	CO <sub>3</sub> <sup>-2</sup>	mg/L	-	< 5
Hydroxide		mg/L	-	< 5
Electrical Conductivity		uS/cm	-	3380
Fluoride	F <sup>-</sup>	mg/L	-	< 1
Chloride	Cl <sup>-</sup>	mg/L	-	777
Nitrate as N	NO <sub>3</sub> -N	mg/L	-	5.47
Nitrite as N	NO <sub>2</sub> -N	mg/L	-	< 0.5
Bromide	Br <sup>-</sup>	mg/L	-	< 4
Sulphate	SO <sub>4</sub> <sup>-2</sup>	mg/L	-	83
Calcium	Ca	mg/L	-	247
Magnesium	Mg	mg/L	-	26.7
Sodium	Na	mg/L	-	393
Potassium	K	mg/L	-	4.9
Ammonia as N	NH <sub>3</sub> -N	mg/L	-	0.02
Phosphate as P	PO <sub>4</sub> <sup>-3</sup>	mg/L	-	0.005
Total Phosphorus	P	mg/L	0.03	<b>2.89</b>
Reactive Silica	Si	mg/L	-	9.33
Total Organic Carbon	TOC	mg/L	-	1.1
Colour		Colour Units	-	< 2
Turbidity		NTU	-	181
Aluminum	Al	mg/L	0.075	0.29
Antimony	Sb	mg/L	0.02	0.0002
Arsenic	As	mg/L	0.005	< 0.0003
Barium	Ba	mg/L	-	0.265
Boron	B	mg/L	0.2	0.04
Cadmium	Cd	mg/L	0.0002	< 0.000029
Chromium	Cr	mg/L	0.0089	0.001
Copper	Cu	mg/L	0.005	0.0009
Iron	Fe	mg/L	0.3	0.259
Lead	Pb	mg/L	0.001	0.00024
Manganese	Mn	mg/L	-	0.032
Mercury	Hg	mg/L	0.0002	< 0.00002
Molybdenum	Mo	mg/L	0.04	0.0003
Nickel	Ni	mg/L	0.025	< 0.01
Selenium	Se	mg/L	0.1	0.004
Silver	Ag	mg/L	0.0001	0.0003
Strontium	Sr	mg/L	-	0.623
Thallium	Tl	mg/L	0.0003	< 0.00005
Tin	Sn	mg/L	-	< 0.05
Titanium	Ti	mg/L	-	0.008
Uranium	U	mg/L	0.005	0.0006
Vanadium	V	mg/L	0.006	0.0005
Zinc	Zn	mg/L	0.03	< 0.005
Total Dissolved Solids	TDS	mg/L	-	1678
Total Hardness (as CaCO <sub>3</sub> )		mg/L	-	727
% Difference/Ion Balance		%	-	4.69
Biochemical Oxygen Demand	BOD	mg/L	-	< 3
Total Kjeldahl Nitrogen	TKN	mg/L	-	5.9
Chemical Oxygen Demand	COD	mg/L	-	31
Phenols		mg/L	0.001	< 0.001
Total Suspended Solids	TSS	mg/L	-	
Conductivity (field)		µS/cm	-	
Temperature (field)		°C	-	
pH (field)			-	
Redox		mV	-	
Dissolved Oxygen		mg/L	-	

Bold and highlighted indicates PWQO exceedance  
 INS - Insufficient sample quantity to analyze for parameter



---

---

## **APPENDIX G**

### **Dewatering Calculations**

---

---

Pumping Rates Calculations

Project: Kirwin Ave Construction Phase  
 Project Number: 22-056

Open Cut Calculations (Rectangular Excavation)

$$\ell / \omega > 1.5$$

$$Q = \frac{\pi K(H^2 - h^2)}{\ln(\frac{R_o}{R_s})} + 2\left(\frac{LK(H^2 - h^2)}{2L}\right)$$

Based on Equation 6.12 in systems where  $\ell/\omega > 1.5$  (Powers, P.E., 1992) Where:  
 Q (m³/Day)  
 K - Hydraulic Conductivity (m/Day)  
 H - Distance from Static water level to bottom of Aquifer (m)  
 h - lowest water level needed from static (m)  
 R<sub>o</sub> - Radius of conical depression (m) (Taken from Equation 6.14 (Powers, P.E., 1992))

$$R_o = 3(H - h)\sqrt{k}$$

Where  
 K - Hydraulic Conductivity (m/Sec)  
 R<sub>s</sub> - Equivalent Radius (m)

$$R_s = \frac{\ell + w}{\pi}$$

ℓ - Length of excavation/trench  
 w - width of trench  
 in systems where  $\ell/\omega > 1.5$

ω - excavation width  
 ℓ - excavation length

Development footprint requiring dewatering

W	L	L/W
47	83	1.765957

Note: Width and length of the excavation is assuming PL to PL

K Max used 2.28E-07 m/sec

Ground Surface from: Finished Floor (Drawing) 113.65 mRD

High Water Table 109.10  
 Bottom of excavation (mbgs) 8.7  
 Bottom of lowest screen 104.90  
 Dewatering Target (Construction) 105.45  
 Dewatering Target (Operations) 105.45  
 Aquifer depth 102.00

mASL	Water Column	
109.10		BH/MW1
105.45		Set to 2 mb finished P2 Slab
104.90		Based on the lowest elevation of known screens
105.45	3.65	
102.00	7.10	Based on assumed bedrock elevation in the area

K m/sec 2.28E-07  
 K m/d calc 1.97E-02

Legend:  
 Fill in  
 Leave alone  
 calculated number

Parameter	Units	Value	Q <sub>R</sub>
K	m/d	0.01968192	21.06 m³/d
H	m	7.10	2.44E-04 m³/Sec
h	m	3.65	
R	m	46.3	
ω		47	
ℓ		83	
R <sub>s</sub>	m	41	
ln(R <sub>o</sub> /R <sub>s</sub> )		0.113	
Limit	400 m³/d		
EASR	50 m³/d		

Q <sub>r</sub>	Value
Q <sub>r</sub>	21.06 m³/d
Q <sub>r</sub>	63.19 m³/d
Expected Pumping Rate with contingency	63,194

300.0% Contingency for the variability in hydraulic conductivity that could be experienced and to provide flexibility to address additional drainage needed as a result of precipitation events.

50.00% Porosity Table from Freeze and Cherry 1979

Table 2.4 Range of Values of Porosity

	n (%)
<b>Unconsolidated deposits</b>	
Gravel	25-40
Sand	25-50
Silt	35-50
Clay	40-70
<b>Rocks</b>	
Fractured basalt	5-50
Karst limestone	5-50
Sandstone	5-30
Limestone, dolomite	0-20
Shale	0-10
Fractured crystalline rock	0-10
Dense crystalline rock	0-5

	Storage Volume				
	Thickness (m)	m³	L	30 day (m³)	60 Day (m³)
Clayey Silt	3.6	7119	7.12E+06	79	40
		0	0	0	0
Total	3.6	7119	7119325	79	40

Storm Event	Precipitation Event into excavation				
	(mm)	Depth (m)	Area m2	(m3)	(L)
2-yr 24-hr.	56.2	0.0562	3901	219	219236
5-yr 24-hr.	74.2	0.0742	3901	289	289454
25-yr 24-hr.	101.2	0.1012	3901	395	394781
100-yr 24-hr.	123.6	0.1236	3901	482	482164
Climate Normals (/Yr)	709	0.709	3901	2766	2765809
Climate Normals (/Day Average 6 months)				17	16762

Time	Pumping Rates		
	m³/day	m³/hour	L/Min
Storage (30 day pre excavation)	142.3	6	99
Storage (60 day pre excavation)	102.7	4	71
Construction	63.19	2.6	44

EASR Required  
 EASR Required  
 EASR Required



Pumping Rates Calculations

Project: Kirwin Ave. Development Post Construction  
 Project Number: 22-056

Legend:  
 Fill in  
 Leave alone  
 calculated number

Open Cut Calculations (Rectangular Excavation)

$l/w > 1.5$

$$Q = \frac{\pi K(H^2 - h^2)}{\ln(\frac{R_o}{R_s})} + 2\left(\frac{LK(H^2 - h^2)}{2L}\right)$$

Based on Equation 6.12 in systems where  $l/w > 1.5$  (Powers, P.E., 1992) Where:

Q (m<sup>3</sup>/Day)

K - Hydraulic Conductivity (m/Day)

H - Distance from Static water level to bottom of Aquifer (m)

h - lowest water level needed from static (m)

R<sub>o</sub> - Radius of conical depression (m) (Taken from Equation 6.14 (Powers, P.E., 1992))

$$R_o = 3(H - h)\sqrt{k}$$

Where

K- Hydraulic Conductivity (m/Sec)

R<sub>s</sub> - Equivalent Radius (m)

$$R_s = \frac{l + w}{\pi}$$

l- Length of excavation/trench

w- width of trench

in systems where  $l/w > 1.5$

Parameter	Units	
K	m/d	0.01968192
H	m	7.10
h	m	1.65
R	m	49.2
	w	47
	l	83
R <sub>s</sub>	m	41
ln(R <sub>o</sub> /R <sub>s</sub> )		0.173

Q <sub>R</sub>
18.01 m <sup>3</sup> /d
2.08E-04 m <sup>3</sup> /Sec

Q <sub>T</sub>	
18.01 m <sup>3</sup> /d	18,006

Q <sub>T</sub>	
54.02 m <sup>3</sup> /d	54,019
<b>Expected Pumping Rate with contingency</b>	
<b>EASR Required</b>	

Limit	400 m <sup>3</sup> /d
EASR	50 m <sup>3</sup> /d

300.0% Contingency for the variability in hydraulic conductivity that could be experienced and to provide flexibility to address additional drainage needed as a result of precipitation events.

w - excavation width

l - excavation length

Development footprint requiring dewatering

W	L	L/W
47	83	1.765957

Note: Width and length of the excavation is assuming PL to PL

K Max used  2.28E-07 m/sec

Ground Surface from:  Finished Floor (Drawing)  113.65 mASL

	mASL	Water Column	
High Water Table	109.10		BH/MW1
Bottom of excavation (mbgs)	107.45		Set to 2 mb finished P2 Slab
Bottom of lowest screen	104.90		Based on the lowest elevation of known screens
Dewatering Target (Construction)	107.45	1.65	
Dewatering Target (Operations)	107.45	1.65	
Aquifer depth	102.00	7.10	Based on assumed bedrock elevation in the area

