

Kingridge Developments

1786 Polaris Way, City of Mississauga

**Functional Servicing and Stormwater Management Report
(FSR/SWM)**

December 18, 2024

1786 Polaris Way, City of Mississauga

Functional Servicing and Stormwater Management Report (FSR/SWM)

December 18, 2024

Prepared By:

Arcadis Professional Services (Canada) Inc.
8133 Warden Ave, Unit 300
Markham, ON L6G 1B3
Canada
Phone: 1 905 763 2322
www.arcadis.com

Our Ref:

#145121

Prepared For:

Kingridge Developments
1660 North Service Road East
Suite 109-B
Oakville, ON L6H 7G3
Phone: 1 416 277 7466
Email: info@Kingridgedevelopments.ca



Benny Hon, P.Eng.
Sr. Project Manager
Land Engineering

A handwritten signature in blue ink, appearing to read "Saul Rodriguez".

Saul Rodriguez, C.E.T.
Associate – Manager
Land Engineering

A handwritten signature in blue ink, appearing to read "Andy Kroess".

Andy Kroess, M.Eng., P.Eng.
Senior Water Resources Engineer
Water & Environmental Resources

A handwritten signature in blue ink, appearing to read "Jerry Fiorini".

Jerry Fiorini
Senior Designer
Land Engineering

A handwritten signature in blue ink, appearing to read "Michael Li".

Michael Li
Project Designer
Land Engineering

This document is intended only for the use of the individual or entity for which it was prepared and may contain information that is privileged, confidential and exempt from disclosure under applicable law. Any dissemination, distribution or copying of this document is strictly prohibited.

Version Control

Issue	Revision No.	Date Issued	Description	Reviewed By
First Submission	1	Feb. 23, 2024	Submitted for OPA/Zoning/SPA	Saul Rodriguez Benny Hon
Second Submission	2	Dec. 18, 2024	Submitted for OPA/Zoning/SPA	Saul Rodriguez Benny Hon

Contents

1 Introduction 1

2 Existing Conditions 2

 2.1 Roads 2

 2.2 Sidewalks 2

 2.3 Topography and Drainage 2

 2.4 Storm Sewers 2

 2.5 Sanitary Infrastructure 2

 2.6 Water Supply and Distribution 3

 2.7 Utilities 3

3 Proposed Conditions 4

 3.1 Roads 4

 3.2 Grading 4

 3.3 Sanitary Infrastructure 5

 3.4 Stormwater Management 6

 3.5 Water Supply and Distribution 6

 3.6 Utilities 7

4 Erosion & Sediment Control 8

5 Summary 9

Tables

Table 3-1 Population Densities – Known Lot Configuration..... 5

Table 3-2 Proposed System Head and Pressure..... 7

Figures

Figure 1 Location Plan Appendix A

Figure 2 Site Plan..... Appendix A

Figure 3 Private Road Cross Section for a Common Element Condo Appendix A

SS-01 Site Water and Sanitary Servicing Plan..... Appendix A

STM-01 Site Storm Servicing Plan Appendix A

SG-01 Site Grading Plan..... Appendix A

Appendices

Appendix A Figures

Appendix B Sanitary Calculations

Appendix C Storm Calculations

Appendix D Water Demand Calculations

Appendix E Stormwater Management Report

Appendix F References

1 Introduction

Arcadis Professional Services (Canada) Inc. (Arcadis) was retained by “Kingridge Developments” (the “Owner”) to prepare a site-specific Functional Servicing and Stormwater Management Report (FSR/SWM) for a proposed development of six (6) 3-Storey Townhouse blocks and two (2) Semi-detached homes. The subject site is part of Blocks 1 and 2, Registered Plan 43M-2076 in the City of Mississauga, Regional Municipality of Peel. The site is located on the east side of Mississauga Road, approximately 200m south of Eglinton Avenue West.

This property was previously owned by 2462357 Ontario Inc. (Pace Developments), who obtained site plan approval for 11 Single Detached Homes and was able to construct the road and services, including laterals. (Refer to The Archways, Cole#UD15-0347, City File# OZ 09/004 W8, Peel File# T-M09002 M)

This report addresses how the existing infrastructure can be utilized to service the proposed development with full municipal services according to current design requirements of applicable agencies and the municipality.

The total site area is approximately 1.09 ha with a developable area of approximately 0.649 ha (Site Plan) and located near the intersection of Eglinton Avenue West and Mississauga Road. Refer to **Plate 1** for an aerial view of the site.



PLATE 1: Site Aerial Photo (Source: maps.google.ca)

This report will document the functional grading, servicing, and stormwater management controls for the subject lands in order to demonstrate the feasibility of the proposed development in accordance with local and municipal regulatory agencies development criteria from a site civil engineering perspective.

2 Existing Conditions

The subject lands are located within the Central Erin Mills Neighbourhood Character Area and has an area of approximately 1.09 ha comprised of partially developed area, vegetation, and forested areas. The lands are bounded by existing residential homes to the south and west side of Mississauga Road, the existing Church of Croatian Martyrs to the north, and the Croatian park to the east. Approximately 0.649 ha of the entire area was previously approved for development and was partially constructed. The nearest intersection to the subject lands is Eglinton Avenue West and Mississauga Road.

2.1 Roads

The site is bound by an arterial road being Eglinton Avenue West running east and west, approximately 200m to the north of the site and major collector road being Mississauga Road running north and south. Currently, the site is only accessible from Mississauga Road, which is an urbanized road.

2.2 Sidewalks

There are existing municipal sidewalks along the west side and partially on the east along Mississauga Road and on both sides along Eglinton Avenue West.

2.3 Topography and Drainage

The subject land varies in slope intensity and topographic elevation varies about 3.5m. The site was partially constructed by the previous Developer (Pace Developments) under the project The Archways. The site road, Polaris Way, was constructed to base asphalt, along with all services, and the lots were graded to pregrade depths. There is a stone/soil stockpile that covers the majority of Polaris Way and a soil pile located in the north east side of the site. Under the existing conditions, the site generally slopes to the north and south of the site towards the existing rear lot catchbasins. The flows are then captured and conveyed to the existing storm sewer on Polaris Way and then north on Mississauga Road. See Figure **SWM-01** in **Appendix B** of the SWM Design Report (**Appendix E** of FSR) for pervious design, which shows the existing catchment boundary and drainage flow directions of the subject land.

2.4 Storm Sewers

Based on the available plan and profile data, prepared by Cole Engineering for The Archway Development, there are existing storm sewers on Polaris Way, ranging from 300mm dia. to 450mm dia. The flows from the site will be conveyed by an existing storm sewer, ranging from 525mm dia to 750mm dia., that drains north on Mississauga Road, east through Thorny-Brae Place and then south-east connecting to the existing headwall from the Church of Croatian Martyrs, which outlets to the Credit River. The storm laterals and rear lot catchbasins were installed on Polaris Way for the previously proposed Single Detached homes.

2.5 Sanitary Infrastructure

Based on the available plan and profile data prepared by Cole Engineering for The Archway Development, there is an existing 200mm diameter sanitary sewer located on Polaris Way, which conveys flows south on Mississauga Road. The sanitary laterals were installed on Polaris Way for the previously proposed Single Detached homes.

2.6 Water Supply and Distribution

The proposed site is to be serviced by the pressure district Zone 3 water distribution system, in Regional Municipality of Peel. The top water level of the storage facilities is 205.7m and the Hydraulic Grade Line (HGL) is 213.4m.

There is an existing 150mm diameter watermain connection on Polaris Way, servicing the subject site, which was installed by the previous Developer (Pace Developments) for The Archway development.

There is an existing 300mm diameter watermain located on the east side of Mississauga Road and an existing fire hydrant on the east side of Mississauga Road just north of Polaris Way entrance. As well as another existing fire hydrant on Polaris Way approximately 80m east of Mississauga Road.

A fire hydrant flow test was conducted at nearby hydrants in 2018 for the previous development. Subsequently, a recent hydrant test was performed along Mississauga Road. A new hydrant test (flowing at the hydrant within the subject site) will be done to re-visit capacity during the building construction stages. The recent flow test location and results can be found in **Appendix D.1**.

The detected static system pressures were found to be approximately 90psi (622kPa) corresponding to system head at 209.4m. The estimated system head was slightly lower than the typical HGL 213.4 m in Zone 3 distribution system. The available flow is 319L/s (at 20 psi) along Mississauga Road near the subject site – see **Appendix D.2** for details.

2.7 Utilities

The subject site abuts Mississauga Road and it is expected that utilities will be available in the area along Mississauga Road. The use of these utilities will be verified and confirmed at the detail design stage.

3 Proposed Conditions

The proposed residential development will consist of six (6) 3-storey Townhouse blocks (32 units), two (2) Semi-Detached Homes (4 units), and five (5) visitor parking spaces.

Refer to **Figure 2-Site Plan** in **Appendix A** for a proposed concept plan of the development.

3.1 Roads

Access to the proposed development will be provided via the existing Polaris Way entrance from Mississauga Road.

3.2 Grading

The grading strategy for the proposed development will respect the previously approved design for The Archways by Pace Developments. The design will match existing grades along the property lines except on the north side where we will be matching to top of existing curb in the parking lot of the Church of Croatian Martyrs. Alternatively, a proposed retaining wall is shown running along the north side of the proposed development limit on drawing **SG-1**, for the scenario in which the landowner to the north does not allow for grading beyond the property boundary. The proposed site grading for the site will match the existing perimeter grades where possible. Split lots and walkout grading of the townhomes and semi-detached blocks will be used to minimize the cut/fill requirements. The proposed grading will direct runoff to the existing road, proposed rear lot swales and rear-lot catchbasins, and ultimately into the existing storm sewers on Polaris Way. There will be an area on the east side of the development that will drain uncontrolled to the existing Greenlands.

Refer to Figure **SG-01** in **Appendix A** where a preliminary site grading plan shows the proposed grading approach.

As a general guideline for the proposed site grading, the following City standards have been observed:

- Minimum – maximum road grading of 0.5% - 5%;
- Lot surfaces shall be constructed to a minimum grading of 2%;
- Maximum grade of 3:1 for slope,
- Minimum – maximum driveway entrance grade of 2% to 8%; and
- Minimum swales of 2% and min. depth of 150mm (exception for Block1).

The proposed site grading is constrained by the existing grades along the site perimeter and Mississauga Road. We will however ensure smooth transitions between proposed and existing ground. Any drainage alteration will not have negative effect on the neighbouring properties. The overland flows from the proposed site development will be conveyed towards Mississauga Road and existing greenlands.

Grading of the site and building accesses will ensure barrier free walkways to main entrances. Pedestrians will have access throughout the development via sidewalks to the various building entrances. Also, during detail design the grading will be further refined for transitioning between blocks with any sloping/terracing where required.

3.3 Sanitary Infrastructure

The total design flow from the proposed development is 1.9 L/s as per the Regional Municipality of Peel Linear Wastewater Standards.

The existing sanitary sewer network consists of 200mm diameter pipe, which collects and conveys sewage towards Mississauga Road with approximate cover of 3.0m and a slope of 0.5%.

The existing sanitary sewer on Polaris Way and Mississauga Road was designed and constructed by the previous developer, Pace Developments for The Archways. It is our intent to utilize the existing service connections where possible and propose new connections where required.

Based on the proposed usage of the building, we anticipate that the peak sanitary flow from the site will be 1.9 L/s. Given that the existing sanitary sewer is a 200mm diameter at 0.50%, with a full flow capacity of 23.3 L/s, we do not have concerns with respect to sanitary capacity for the proposed development.

The existing sewer layout and inverts have been shown in the Figure **SS-01** in **Appendix A**.

As part of detailed design submissions, the sanitary servicing will be further refined.

In accordance with the Region Standards, residential sewage flows shall be calculated on the basis of the following for residential areas:

- Residential Average Daily Domestic Flow – 290 litres/person/day (lpcd);
- Infiltration Allowance for new subdivision – 0.26 litres/sec/hectare;
- Peaking factor – minimum 2.0 and maximum 4.0; and,
- Velocity – minimum 0.60 m/s and maximum 3.0 m/s.

All sanitary sewers have been sized to handle the theoretical daily peak flow per the Region requirement, the sanitary sewage flows have been estimated using the following formula:

$$Q = \frac{PqM}{86.4} + IA$$

The subject lands are zoned for specific residential use, the following population density has been used and as shown in the following **Table 3.1**, along with the calculated sanitary flow values for the subject lands.

Table 3-1 Population Densities – Known Lot Configuration

Type of Housing	Persons/Unit	Population	Peak Factor	Design Flow (L/s)	Infiltration (L/s)	Total Sanitary Flow (L/s)
Townhouses/Semi-detached	3.49 (weighted avg.)	126	4.00	1.69	0.21	1.90

Refer to the **Sanitary Design Sheet**, in **Appendix B**.

3.4 Stormwater Management

The subject site is located within the Credit River Watershed. The site must therefore meet the local City of Mississauga Development Requirements, Credit Valley Conservation Authority, and Ministry of the Environment, Conservation and Parks (MECP) stormwater standards. The following design criteria will be required:

- Storm sewers are to be designed to the City of Mississauga – 10 Year Intensity Duration Frequency (IDF) storm event;
- No quantity storage is required by the CVC and agreed upon by the City due to the close proximity to the Credit River;
- The storm runoff on Polaris Way, Mississauga Road, and Thorny-Brae Place are to be collected in the new storm sewer and discharged to the existing headwall which outlets into the valley depression and ultimately into the Credit River;
- For the Archways, Low Impact Development (LID) measures such as infiltration galleries at all rear lot catch basins and a 300mm deep topsoil layer will be implemented to reduce surface runoff and promote infiltration; and
- For The Archways, rooftop rainwater leaders of the rear-draining building areas will be collectively directed to rear yard infiltration trenches.

The proposed stormwater management plan meets criteria outlined by the City of Mississauga, CVC, and the MECP. Due to the close proximity to the Credit River quantity controls are not required, and the site will discharge via the recently constructed storm sewer on Mississauga Road and Thorny-Brae Place to the existing drainage feature from the top of slope to the Credit River. Since the total asphalt area of the site is comparable to the existing conditions, and the proposed rooftop is considered to generate “clean” runoff, the overall water quality of the site will remain comparable to existing conditions. The design also includes an oil-grit separator unit (Stormceptor model STC 2000), which was previously installed. Effective use of LIDs will promote infiltration and provide additional water quality measures for the development site.

The proposed 1786 Polaris Way development installed 300mm to 450mm diameter storm sewers in 2019, which connects to an existing 525 mm to 600 mm diameter storm sewer on Mississauga Road and a 675 mm to 750 mm diameter storm sewer on Thorny-Brae Place. The sewer connects to the recently constructed wingwall on the existing headwall which is the outlet for the Church storm sewer system that outlets into the valley depression and ultimately into the Credit River. Major flows from Polaris Drive at the 1786 Polaris Way development will be directed to Mississauga Road

Detailed discussions and calculations are included in the Stormwater Management Report (Arcadis, December 18, 2024) included in **Appendix E**.

3.5 Water Supply and Distribution

The proposed development is to be serviced by Zone 3 water distribution system in the Regional Municipality of Peel.

The proposed development will receive water supply from the existing 150mm diameter along Polaris Way, which connects to the existing municipal 300mm diameter watermain located along the east side of Mississauga Road. A 150mm diameter watermain was installed on the north side of Polaris Way with a 50mm diameter copper loop at the hammerhead, under the previous project, The Archways by Pace Developments. It is our intent to use the existing water services installed on Polaris Way.

Approximately 32 Townhouse units and 4 Semi-Detached units are to be developed within the subject land with the ground elevations ranging from 143.31 to 146.90 m.

The estimated water consumption for the proposed residential development is anticipated to be approximately 0.4 L/s, 0.8 L/s and 1.1 L/s for the Average Day Demand (ADD), Maximum Day Demand (MDD) and Peak Hour Demand (PHD) condition, respectively. **Appendix D.2** showed the water demand estimations and based on the Region of Peel and City of Mississauga Watermain Guidelines.

As per Region's design criteria, the required fire flow was determined in accordance with the calculations from the FUS. The following assumptions have been made for the fire flow estimations:

- Consist of wood frame construction.
- A fire wall (2-hour rating) or equivalent to be provided every two (2) units in each townhouse block.
- A 15% reduction for the Occupancy and Contents Adjustment Factor.
- Based on the above assumptions, the required fire flow using the FUS method (see **Appendix D.4** for details) is approximately 167 L/s (2647USGPM) for the subject development.

As shown in **Table 3-2**, there are no significant pressure reductions with the proposed development under the normal operation conditions (ADD, MDD and PHD). The proposed system head and pressure within the subject site is approximately 209.4m and 622kPa (90psi), respectively. (see **Appendices D.2** and **D.5** for details).

Table 3-2 Proposed System Head and Pressure

Design Condition	System Head (m)	System Pressure (kPa)
Normal Operations (ADD, MDD and PHD)	209.4	622 (90psi)
Maximum Day + Fire Flow 167L/s (via two existing hydrants – on Mississauga Rd and Polaris Way)	198.8	518 (75psi)

As shown in **Table 3-2**, the projected system pressure is approximately 518kPa (75psi) at the two existing hydrant locations (on Mississauga Rd and Polaris Way) for the fire flow (167L/s) under the MDD demand conditions - see **Appendices D.2** and **D.5** for details.

3.6 Utilities

The various utility services (i.e., Hydro, Gas, Cable and Telephone) will facilitate the proposed development by extending their respective existing infrastructure from Mississauga Road west of the subject site.

We anticipate that each of these utilities will identify their specific requirements through the standard application circulation, review, and design process.

It should be mentioned that utility designs were prepared and coordinated previously by Pace Developments for The Archways. The existing designs will need to be reviewed with the proposed concept plan and coordinated with the respective utilities.

4 Erosion & Sediment Control

During construction, erosion and sediment control measures will be required in accordance with the City of Mississauga, Peel Region, and Credit Valley Conservation Authority. Details of these controls will be provided during the detailed engineering design and will include as a minimum the following:

- Silt fences and protective hoarding to be erected around the site perimeter before any grading or topsoil stripping begins on the site to protect adjacent areas from migration of sediment in runoff and protection of identified trees.
- Installation of a “mud mat” at the construction entrance(s) to the site to minimize the amount of sediment transported off site by construction vehicles.
- Stabilization of all disturbed areas to minimize the opportunity for erosion.
- Stabilization of slopes greater than 5:1 using suitable methods (e.g. erosion control mats, tackifier and seed, etc.) as soon as practical.
- Existing ESC measures to be repaired and maintained subject to site inspections.

5 Summary

This report demonstrates that the proposed 1780 Polaris Way Development is feasible from a civil engineering perspective in accordance with the City of Mississauga, Regional Municipality of Peel, and Credit Valley Conservation Authority design criteria.


The following summarizes key aspects of the design:

- The proposed site grading will achieve compliant site gradients and match into the existing grades at its limits. The site grading will endeavour to follow the previous approved grading for The Archways.
- The proposed site development will outlet sanitary sewage into the existing 200mm sanitary sewer on Mississauga Road.
- Stormwater quantity controls are not required by the CVC and agreed upon by the City due to the close proximity of the site to the Credit River. The stormwater management design also includes a previously installed oil-grit separator unit (Stormceptor model STC 2000) and infiltration LIDs, which will promote recharge and provide additional water quality measures for the development site.
- The proposed site development will connect to the to the existing 150mm watermain along existing Polaris Way and 300mm watermain on Mississauga Road. Sufficient capacity is available for the proposed development. A new hydrant test will be performed (e.g., flowing at existing hydrant on Polaris Way) to re-confirm capacity prior to building construction.

We trust the foregoing in conjunction with the functional engineering drawings are satisfactory to demonstrate the development's feasibility from a municipal engineering perspective to support the rezoning application for the development. Should there be any questions or if further information required, please do not hesitate to contact Arcadis

Appendix A

Figures

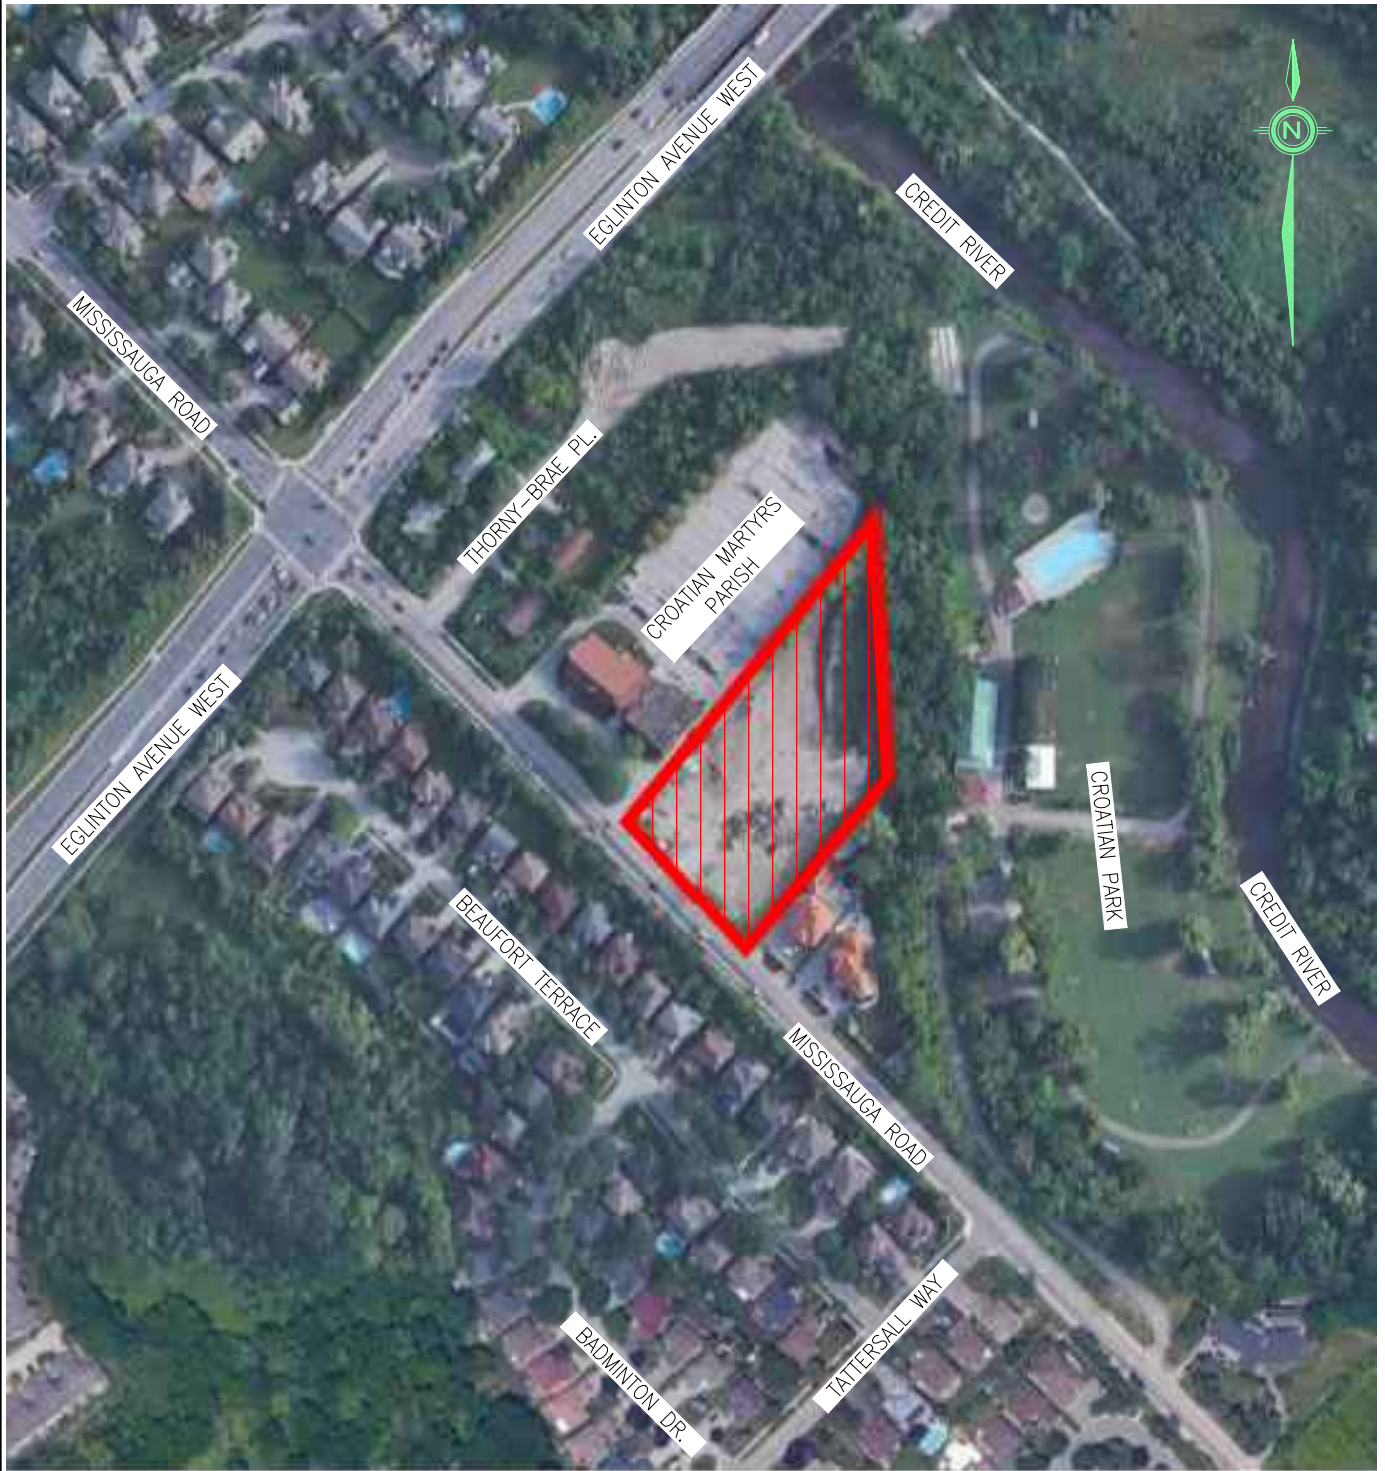

LOCATION PLAN

1765 POLARIS WAY,
CITY OF MISSISSAUGA, ONTARIO

DATE: DECEMBER 2024

PROJECT No.: 145121

SCALE: N.T.S.

FIGURE No.: 1





THESE DRAWINGS ARE NOT TO BE SCALED:
ALL DIMENSIONS MUST BE VERIFIED BY CONTRACTOR PRIOR TO
COMMENCEMENT OF ANY WORK. ANY DISCREPANCIES MUST BE
REPORTED DIRECTLY TO SRN ARCHITECTS INC.


PROJECT CONSULTANTS:

[illegible]

ISSUED OR REVISION COMMENTS				
NO.	DESCRIPTION	DATE	DWN	CHK
1	ISSUED FOR REVIEW	17-MAR-23	RP	
2	ISSUED FOR REVIEW	22-MAR-23	DA	
3	PARKING STATS ADDED	31-MAR-23	DA	
4	ISSUED FOR DARC SUBMISSION	24-JUL-23	AG	RP
5	ISSUED FOR REVIEW	27-SEP-23	AG	RP
6	ISSUED FOR COORDINATION	26-OCT-23	AG	RP
7	ISSUED FOR COORDINATION	13-FEB-24	PP	
8	ISSUED FOR COORDINATION	29-FEB-24	MSA	
9	ISSUED FOR COORDINATION	11-JUN-24	PP	
10	ISSUED FOR COORDINATION	13-SEP-24	PP	
11	ISSUED FOR COORDINATION	17-OCT-24	PP	
12	ISSUED FOR COORDINATION	18-OCT-24	PP	



WWW.RNDESIGN.COM
T:905-738-3177
WWW.THEPLUSGROUP.CA



JENT

KINGRIDGE DEVELOPMENTS


PROJECT/LOCATION

MISSISSAUGA RD PROPERTIES
SOUTH SITE

DRAWING

CONCEPT PLAN

DATE 27-SEP-23	SCALE 1:300
DRAWN BY RP	CHECKED BY RP
PROJECT NUMBER 22070	DRAWING NUMBER A100

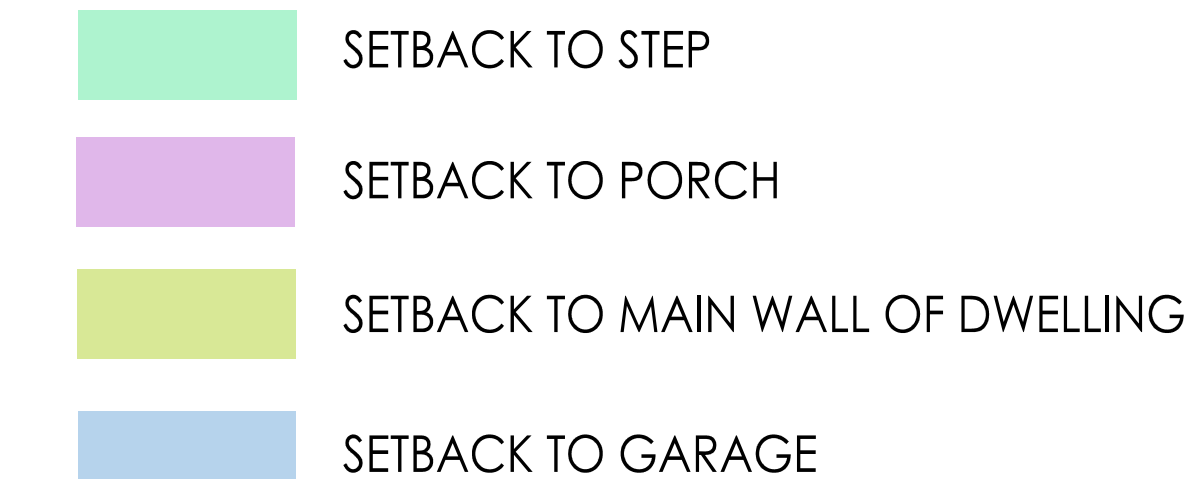


SITE STATISTICS

LOT AREA	0.79 Ha	7950.56m2
BUILDING AREA	2711.4 m2	
LOT COVERAGE	34.10%	
TOTAL GFA	6373.82 m2	
SEMI DETACHED	4	
3 ST. - FL TOWNS	32	
TOTAL NO. OF UNITS	36	
DENSITY	46 UPH	

PARKING STATISTICS

	REQUIRED	PROPOSED	TOTAL SPACES
RESIDENCE SPACES	72 (2 SPACES PER UNIT)	72 (2 SPACES PER UNIT)	72
VISITOR SPACES	9 (0.25 SPACES PER UNIT)	5 (0.14 SPACES PER UNIT)	5
TOTAL:			77

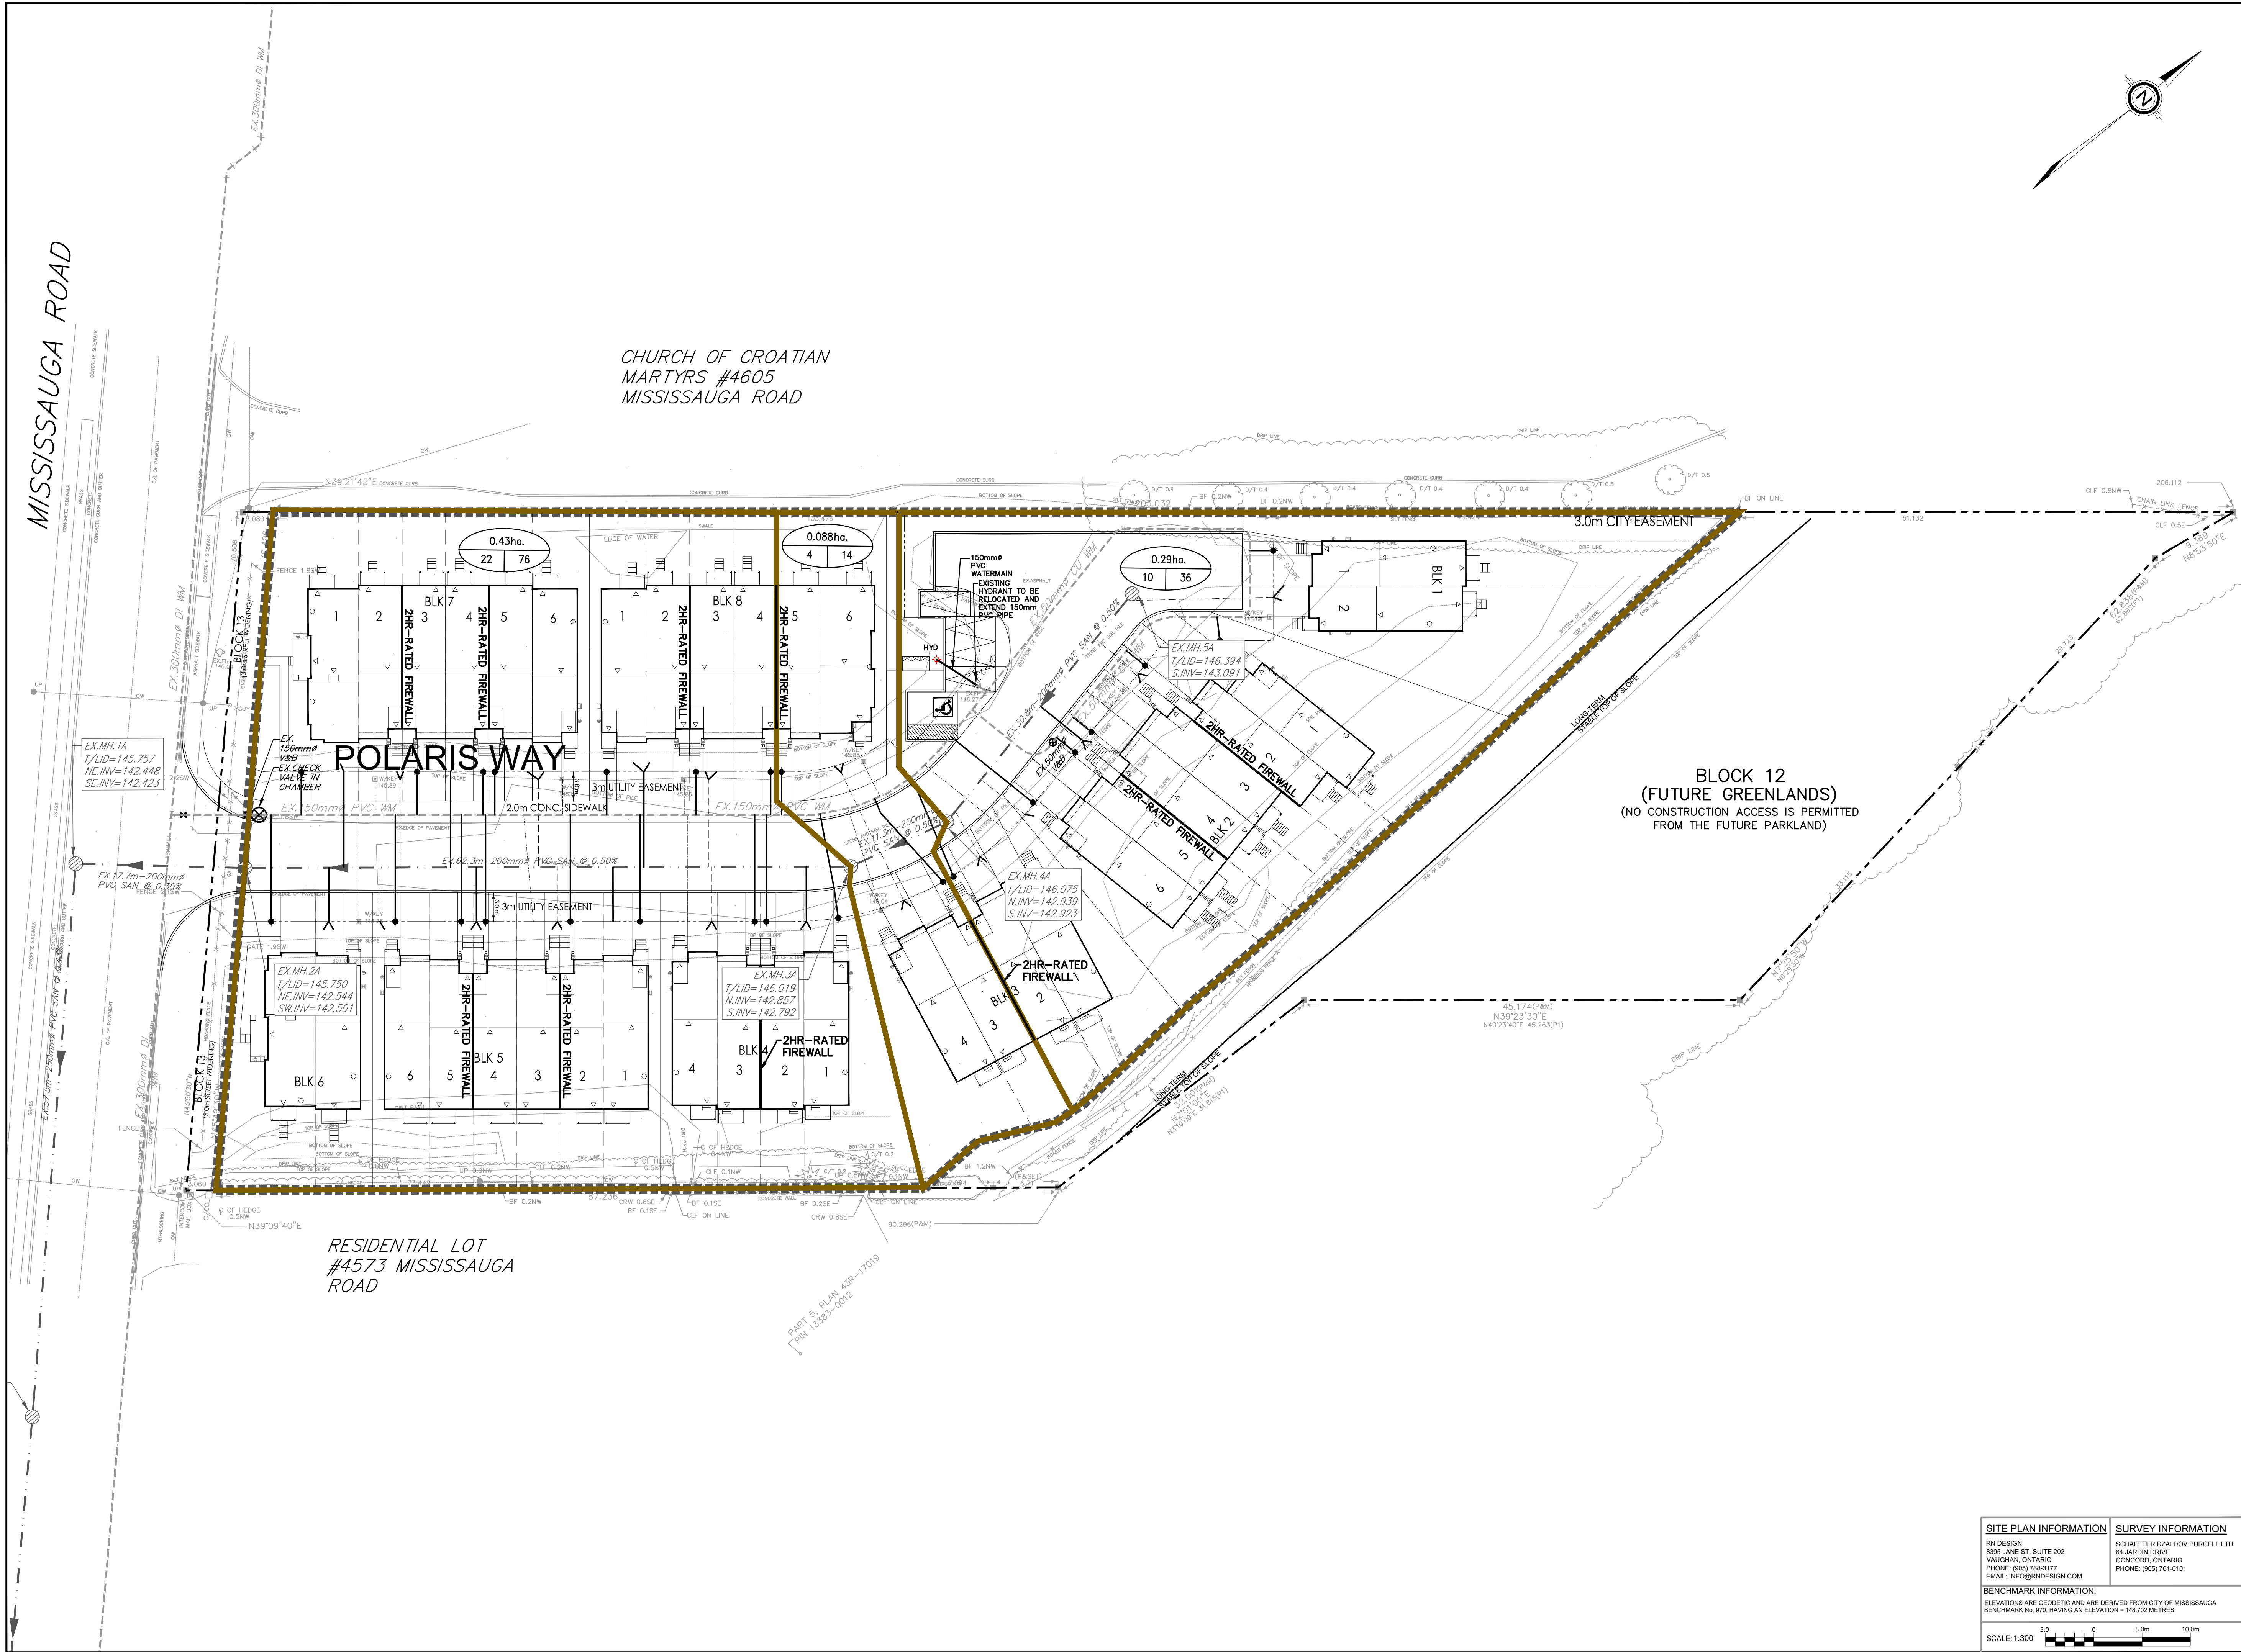


CLIENT
KINGRIDGE DEVELOPMENTS
1660 NORTH SERVICE ROAD EAST
SUITE 109-B
OAKVILLE ON. L6H 7G3
PHONE: (416) 277-7466
EMAIL: INFO@KINGRIDGEDEVELOPMENTS.CA

COPYRIGHT
This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by ARCADIS is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and ARCADIS shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to ARCADIS for general conformance before proceeding with fabrication.
ARCADIS PROFESSIONAL SERVICES (CANADA) INC.
is a member of ARCADIS Group of companies

ISSUES		
No.	DESCRIPTION	DATE
1.	SUBMITTED FOR OPA/ZONING/SPA	FEB. 23, 2024
2.	RE-SUBMITTED FOR OPA/ZONING/SPA	DEC. 18, 2024

LEGEND

- PROPERTY LINE
- LIMIT OF DEVELOPMENT
- OUTLINE OF BUILDING AT GROUND LEVEL
- DRAINAGE AREA BOUNDARY
- AREA 0.40ha.
- UNITS (PERSON PER TOWN HOUSE 3.4)
- POPULATION (PERSON)
- EXISTING SANITARY MANHOLE
- EXISTING SANITARY PIPE
- EXISTING SANITARY LATERALS
- PROPOSED SANITARY LATERALS
- EXISTING SANITARY LATERALS WITH PROPOSED WYE SERVICE CONNECTIONS
- EXISTING WATERMAIN
- EXISTING HYDRANT
- EXISTING CURB STOP AND SERVICE CONNECTION (25mm COPPER TYPE "K")
- PROPOSED WATERMAIN
- PROPOSED HYDRANT
- PROPOSED CURB STOP AND SERVICE CONNECTION (25mm COPPER TYPE "K")

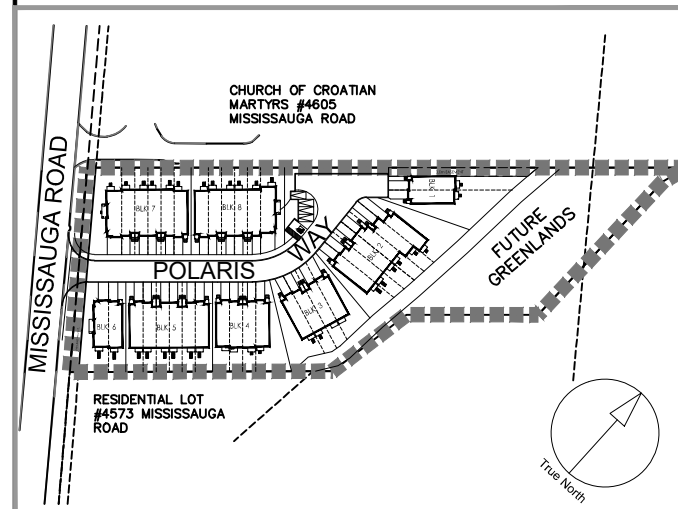

KEY PLAN (N.T.S.)

LICENSED PROFESSIONAL ENGINEER
B.Y. HON
100137997
18-12-2024
PROVINCE OF ONTARIO



PROJECT
1786 POLARIS WAY
CITY OF MISSISSAUGA


PROJECT NO. 145121
DRAWN BY: JF
CHECKED BY: BH
PROJECT MGR: SR
APPROVED BY: SR

SHEET TITLE
SITE WATER AND SANITARY SERVICING PLAN

SHEET NUMBER
SS-01
ISSUE
01

SITE PLAN INFORMATION	SURVEY INFORMATION
RD DESIGN 6395 JANE ST. SUITE 202 VAUGHAN, ONTARIO PHONE: (905) 738-3177 EMAIL: INFO@RDDESIGN.COM	SCHAEFFER DZALDOV PURCELL LTD. 64 JARDIN DRIVE CONCORD, ONTARIO PHONE: (905) 761-0101
BENCHMARK INFORMATION: ELEVATIONS ARE GEOMETRIC AND ARE DERIVED FROM CITY OF MISSISSAUGA BENCHMARK No. 970, HAVING AN ELEVATION = 148.702 METRES.	
SCALE: 1:300 0 5.0m 10.0m	

Printed: December 18, 2024 3:08:07 PM by L. Mihalj

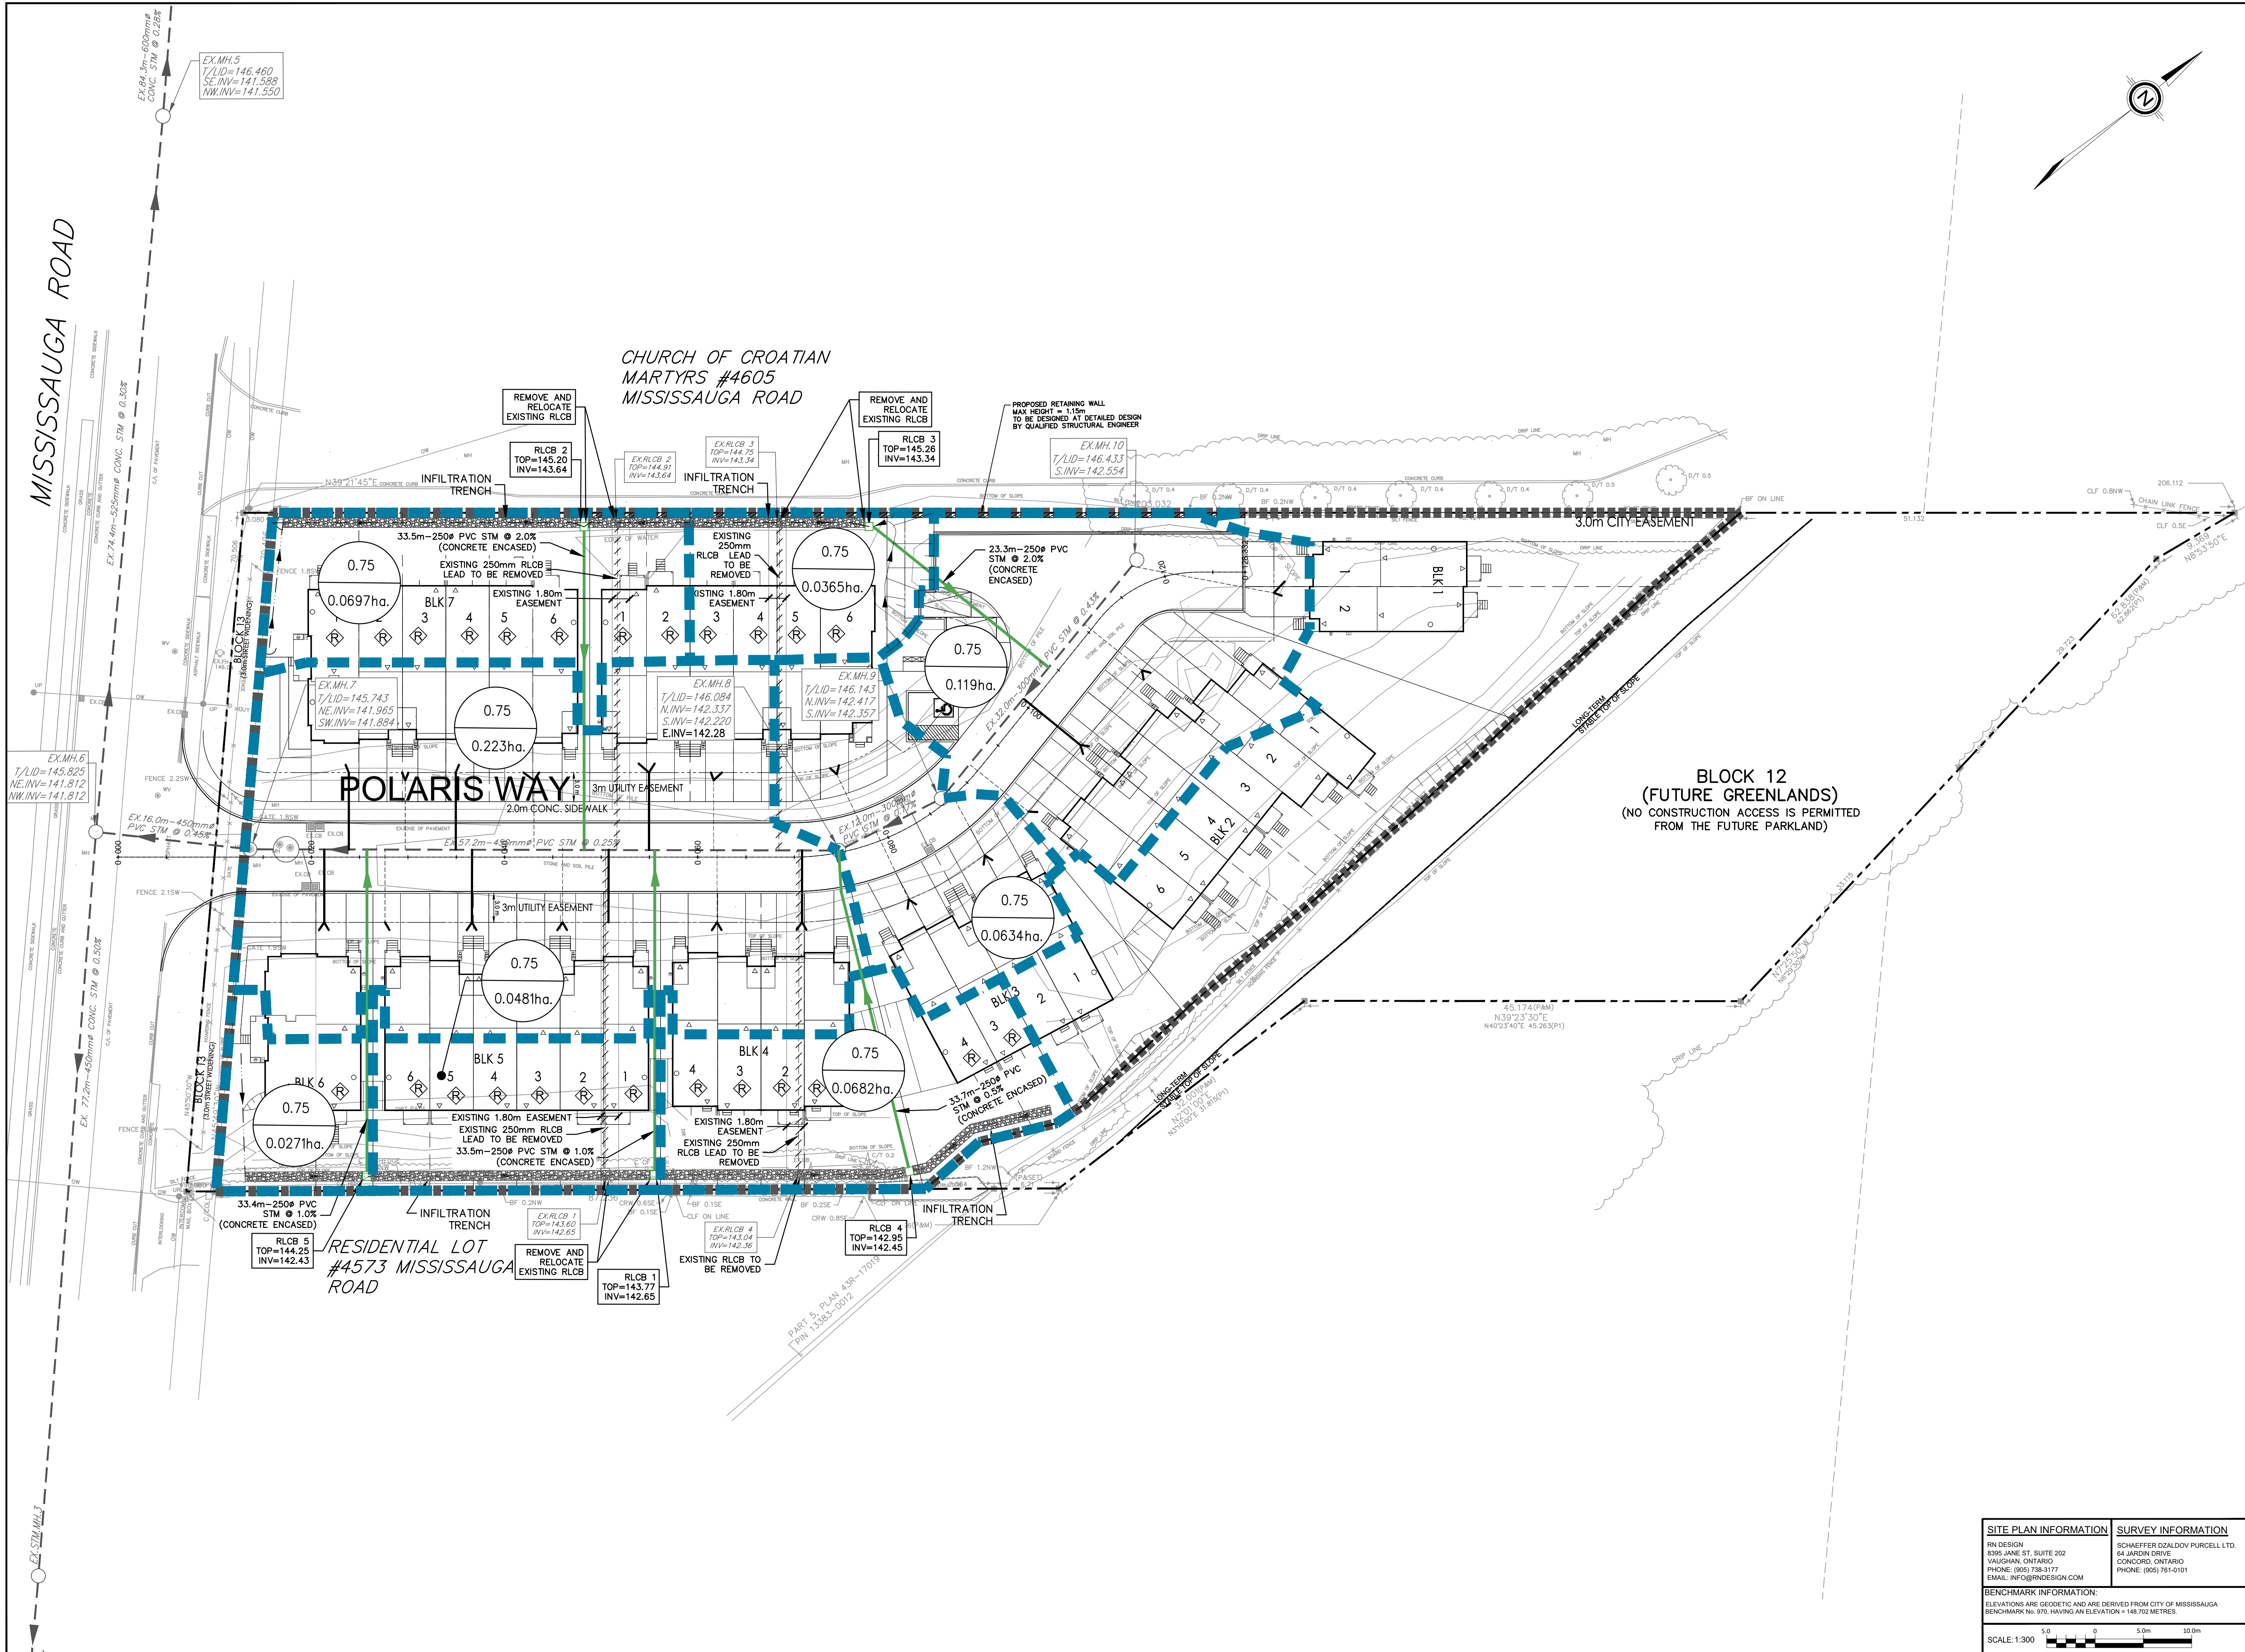



CLIENT
KINGRIDGE DEVELOPMENTS
1660 NORTH SERVICE ROAD EAST
SUITE 109-B
OAKVILLE ON. L6H 7G3
PHONE: (416) 277-7466
EMAIL: INFO@KINGRIDGEDEVELOPMENTS.CA

COPYRIGHT
This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by ARCADIS is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and ARCADIS shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to ARCADIS for general conformance before proceeding with fabrication.
ARCADIS PROFESSIONAL SERVICES (CANADA) INC.
is a member of ARCADIS Group of companies

ISSUES		
No.	DESCRIPTION	DATE
1.	SUBMITTED FOR OPAZONING/SPA	FEB. 23, 2024
2.	RE-SUBMITTED FOR OPAZONING/SPA	DEC. 18, 2024

LEGEND


PROPERTY LINE
LIMIT OF DEVELOPMENT
OUTLINE OF BUILDING AT GROUND LEVEL
PROP. MAIN ENTRANCE / DOOR / ON DOOR
PROP. SWALE
REAR DOWNSPOUTS TO CONNECT TO INFILTRATION TRENCH
EXISTING STORM MANHOLE
EXISTING STORM SEWER
EXISTING CATCH BASIN
INFILTRATION TRENCH
RUN-OFF COEFFICIENT
AREA
DRAINAGE AREA BOUNDARY
EXISTING STORM LATERALS
PROPOSED STORM LATERALS
EXISTING STORM LATERALS WITH PROPOSED WYE SERVICE CONNECTIONS

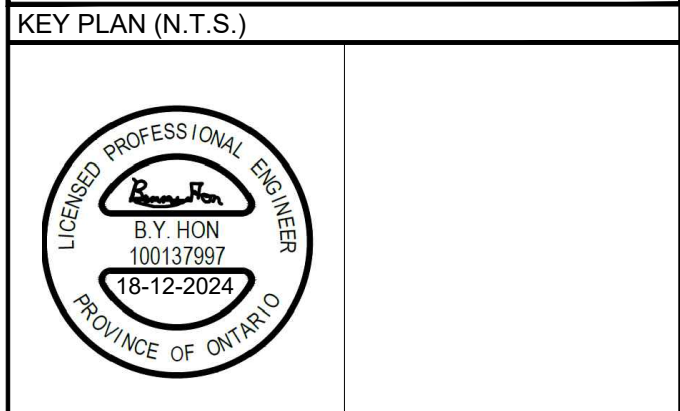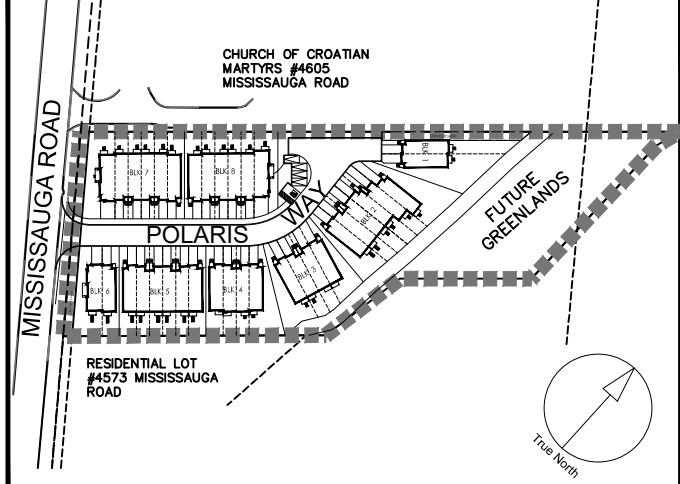

PROJECT
1786 POLARIS WAY
CITY OF MISSISSAUGA
PROJECT NO.: 145121
DRAWN BY: JF
PROJECT MGR: SR
CHECKED BY: BH
APPROVED BY: SR

SHEET TITLE
SITE STORM PLAN
SHEET NUMBER
STM-01
ISSUE
01

SITE PLAN INFORMATION	SURVEY INFORMATION
RN DESIGN 6395 JANE ST. SUITE 202 VAUGHAN, ONTARIO PHONE: (905) 738-3177 EMAIL: INFO@RNDESIGN.COM	SCHAEFFER DZALDOV PURCELL LTD. 64 JARDIN DRIVE CONCORD, ONTARIO PHONE: (905) 761-0101
BENCHMARK INFORMATION: ELEVATIONS ARE GEOMETRIC AND ARE DERIVED FROM CITY OF MISSISSAUGA BENCHMARK No. 970, HAVING AN ELEVATION = 148.702 METRES.	
SCALE: 1:300	

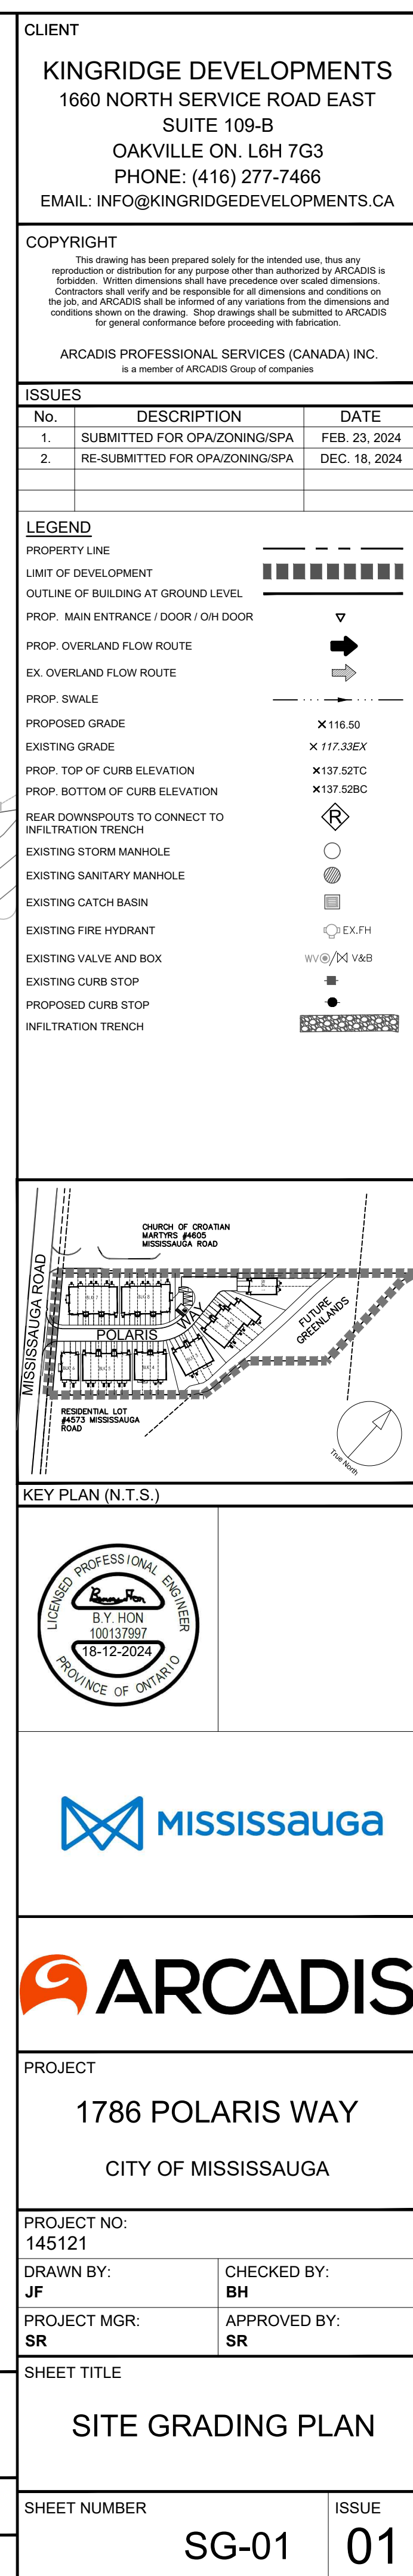

Appendix B

Sanitary Calculations

<div><div><div>Minimum Dia. =200mm</div><div>Mannings "n"=0.013</div><div>Minimum Velocity =0.60m/s</div><div>Minimum Grade =0.5%</div><div>Avg. Domestic Flow =290l/c/d</div><div>Infiltration =0.26l/s/ha</div><div>Max. Peaking Factor=4.0</div><div>Min. Peaking Factor=2.0</div><div>Maximum Velocity =3m/s</div></div><div><div>SANITARY SEWER DESIGN SHEET</div><div>City of Mississauga</div><div>Region of Peel</div><div>T-M09002 W8</div></div><div><div>Project:</div><div>Project No:</div><div>Date:</div><div>Designed by:</div><div>NOMINAL PIPE SIZE USED</div></div><div><div>1768 Polaris Way</div><div>145121 (Prev. UD15-0347)</div><div>20-Jun-2024</div><div>KP</div><div>200 mm</div></div></div>										<div><div><div>Region of Peel Densities</div><div>Semi-detached home= 4.2 person/unit</div><div>Townhouse= 3.4 person/unit</div></div></div>																
STREET	FROM MH	TO MH	RESIDENTIAL							COMMERCIAL/INDUSTRIAL/INSTITUTIONAL/EXTERNAL					FLOW CALCULATIONS						PIPE DATA					
			AREA (ha)	ACC. AREA (ha)	UNITS (#)	DENISTY (P/ha)	DENSITY (P/unit)	POP	ACC. RES. POP.	AREA (ha)	ACC. AREA (ha)	EQUIV. POP. (p/ha)	FLOW RATE (l/s/ha)	ACC. EQUIV. POP.	INFILTRATION (l/s)	TOTAL ACC. POP.	PEAKING FACTOR	RES. FLOW (l/s)	COMM. FLOW (l/s)	TOTAL FLOW (l/s)	DIA. (mm)	SLOPE (%)	Q FULL (l/s)	V FULL (m/s)	V ACT (m/s)	% FULL %
Polaris Way	EX.MH5A	EX.MH4A	0.29	0.29	10		3.6	36	36	0	0	0	0	0	0.08	36	4.00	0.48	0.0	0.6	200	0.50	23.3	0.74	0.30	2%
Polaris Way	EX.MH4A	EX.MH3A	0.09	0.38	4		3.4	14	49	0	0	0	0	0	0.10	49	4.00	0.66	0.0	0.8	200	0.50	23.3	0.74	0.33	3%
Polaris Way	EX.MH3A	EX.MH2A	0.43	0.81	22		3.5	76	126	0	0	0	0	0	0.21	126	4.00	1.69	0.0	1.9	200	0.50	23.3	0.74	0.44	8%
Mississauga Road	EX.MH2A	EX.MH1A	0.00	0.81	0			0	126	0	0	0	0	0	0.2	126	4.00	1.7	0.0	1.9	200	0.40	20.7	0.66	0.41	9%
Mississauga Road	EX.MH1A	EX.SAN.MH3	0.00	0.81	0			0	126	0	0	0	0	0	0.2	126	4.00	1.7	0.0	1.9	250	0.43	39.0	0.79	0.41	5%

Appendix C

Storm Calculations

<div><div><div>Rainfall Intensity =</div><div><div>A</div><div>(Tc+B)^c</div></div><div><div>10-YEAR</div><div>A= 1010</div><div>B= 4.6</div><div>c= 0.78</div></div><div><div>100-YEAR</div><div>A= 1450</div><div>B= 4.9</div><div>c= 0.78</div></div><div>Starting Tc = 15 min</div><div>File Location: \\caneast.ibigroup.com\JTO\145121_1765_Polaris\7.0_Production\7.03_Design\04_Civil\Calcs\Sewer_Design\145121_1765_Polaris-STORM-10yr.xls</div></div></div>																		
<div><div>As-Constructed 10 yr Storm Sewer Design Sheet</div><div>Tributary to Existing Headwall</div></div> <div><div>City of Mississauga</div><div>Region of Peel</div><div>T-M09002 W8</div><div><div>Project: 1786 Polaris Way (previously The Archway)</div><div>Project No: 145121 (previously UD15-0347)</div><div>Date: JUN. 20, 2024</div><div>Designed by: J.F.</div></div></div>																		
STREET	FROM MH	TO MH	10-YR AREA (ha)	10-YR RUNOFF COEFFICIENT "R"	10-YR "AR"	10-YR ACCUM. "AR"	TIME OF CONCENTRATION (min)	10-YR RAINFALL INTENSITY (mm/hr)	10-YR ACCUM. FLOW (m³/s)	PIPE LENGTH (m)	PIPE SLOPE (%)	PIPE DIAMETER (mm)	FULL FLOW CAPACITY (m3/s)	FULL FLOW VELOCITY (m/s)	TIME OF TRAVEL (min)	ACCUMULATED TIME (min)	% FULL FLOW (%)	COMMENT
Polaris Way	EX.MH.10	EX.MH.9	0.112	0.75	0.084	0.111	15.23	98.27	0.030	32	0.42	300	0.063	0.887	0.60	15.83	49%	
Polaris Way	EX.MH.9	EX.MH.8	0.0634	0.75	0.048	0.159	15.83	96.01	0.042	12	0.17	300	0.040	0.564	0.35	16.18	106%	
Polaris Way	RLCB.1	EX.MH.8	0.0481	0.75	0.036	0.036	15.00	99.17	0.010	33.5	1.00	250	0.059	1.211	0.46	15.46	17%	
Polaris Way	RLCB.2	EX.MH.8	0.0697	0.75	0.052	0.052	15.00	99.17	0.014	33.5	2.00	250	0.084	1.713	0.33	15.33	17%	
Polaris Way	RLCB.3	EX.MH.10	0.0365	0.75	0.027	0.027	15.00	99.17	0.008	23.5	2.00	250	0.084	1.713	0.23	15.23	9%	
Polaris Way	RLCB.4	EX.MH.8	0.0682	0.75	0.051	0.051	15.00	99.17	0.014	33.7	0.50	250	0.042	0.857	0.66	15.66	34%	
Polaris Way	RLCB.5	EX.MH.8	0.0271	0.75	0.020	0.020	15.00	99.17	0.006	33.4	1.00	250	0.059	1.211	0.46	15.46	9%	
Polaris Way	EX.MH.8	EX.OGS.1	0.223	0.75	0.167	0.486	16.18	94.73	0.128	57.2	0.25	450	0.142	0.896	1.06	17.25	90%	
Polaris Way	EX.OGS.1	EX.MH.7	0.00	0.00	0.000	0.486	17.25	91.11	0.123	3.8	0.25	450	0.142	0.896	0.07	17.32	86%	
Mississauga Road	EX.MH.7	EX.MH.6	0.00	0.00	0.000	0.486	17.32	90.88	0.123	16	0.45	450	0.191	1.203	0.22	17.54	64%	
Mississauga Road	EX.MH.6	EX.MH.5	0.18	0.90	0.162	0.648	17.54	90.17	0.162	74.4	0.30	525	0.235	1.088	1.14	18.68	69%	
Mississauga Road	EX.MH.5	EX.MH.4	0.34	0.90	0.306	0.954	18.68	86.71	0.230	84.3	0.28	600	0.325	1.149	1.22	19.90	71%	
Thorny-Brae Place	EX.MH.4	EX.MH.3	0.70	0.75	0.525	1.479	19.90	83.32	0.342	98.6	0.42	675	0.544	1.522	1.08	20.98	63%	
Thorny-Brae Place	EX.MH.3	EX.MH.2	0.65	0.75	0.488	1.966	20.98	80.56	0.440	72.2	0.46	750	0.755	1.709	0.70	21.69	58%	
Thorny-Brae Place	EX.MH.2	EX.MH.1	0.00	0.00	0.000	1.966	21.69	78.87	0.431	16	0.83	750	1.014	2.296	0.12	21.80	43%	
Valley Outfall	EX.MH.1	EX.HW	0.00	0.00	0.000	1.966	21.80	78.60	0.429	56.7	1.00	750	1.113	2.520	0.38	22.18	39%	

Appendix D


Water Demand Calculations

Hydrant Flow Testing

NOTE: Hydrants tested according to NFPA 291: Recommended Practice for Fire Flow Testing and Marking of Hydrants

Date of Testing	14-Jun-2024
Project Number:	145121
Test ID	H2024-028
Site Location / Address:	1786 Polaris Rd, Miss
Region / Municipality	Peel Region
Hydrants Opened By:	Peel Region
Tested by:	James W

HYDRANT TEST LOCATION - RESIDUAL HYDRANT=R, FLOW HYDRANT=F
(NORTH AT TOP)

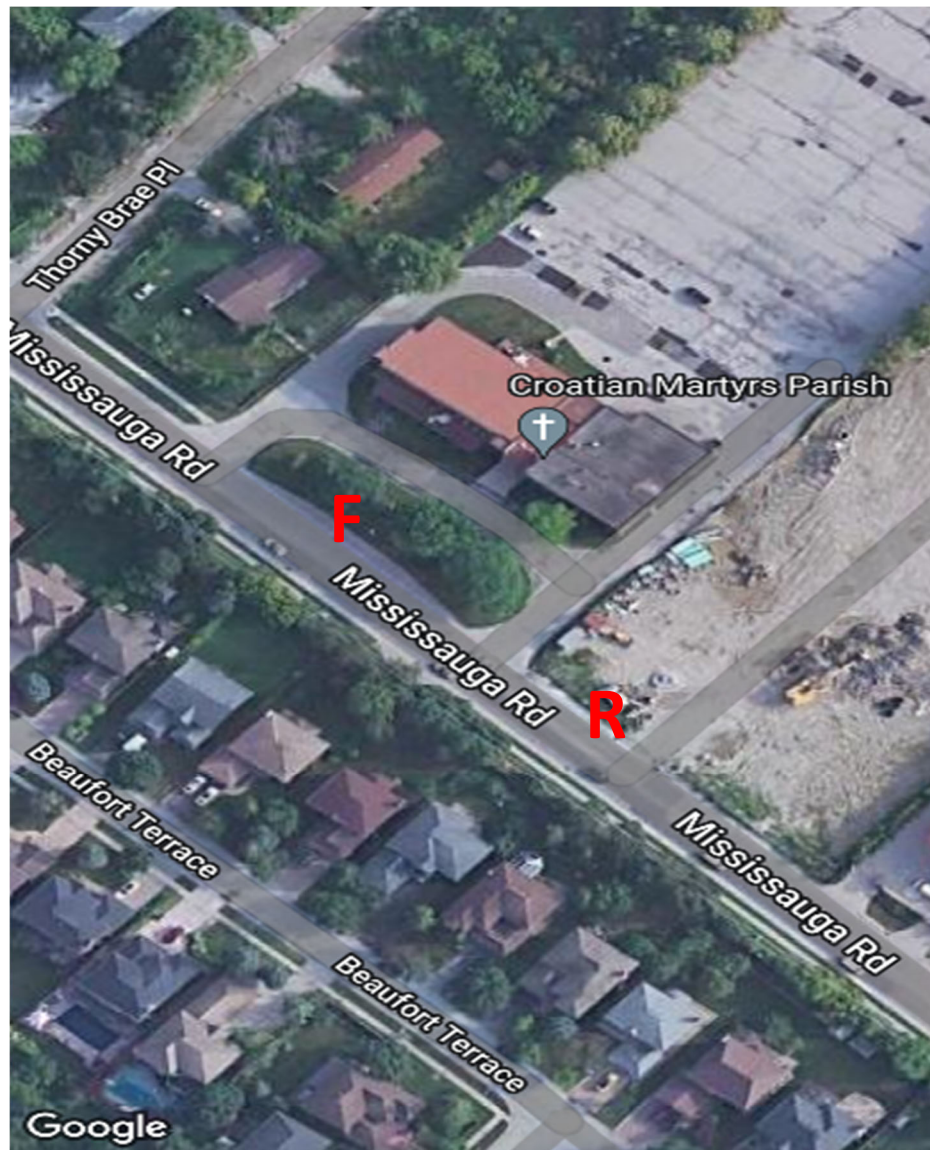

Test Data

Time of Test 11:11 AM
 Pipe Size (mm) -
 Flow Hydrant Test Location (description) 4601 Mississauga Rd
 Residual Hydrant Test Location (description) 4587 Mississauga Rd
 Static Pressure (PSIG) 90

Q1 Test Data (1 Orifice)

# OUTLETS	ORIFICE SIZE(IN)	PITOT PRESSURE(PSIG)	FLOW(USGPM)	RESIDUAL PRESSURE(PSIG)
1	2.5	60	1300	88

QT Test Data (2 Orifices)

# OUTLETS	ORIFICE SIZE(IN)	PITOT PRESSURE(PSIG)	FLOW(USGPM)	RESIDUAL PRESSURE(PSIG)
2	2.5	40	2122	86

Calculations


FORMULA: $Q = 29.83 \text{ cd}^2 \sqrt{p}$Where: c- coefficient of discharge (1 in smooth pipe)
 d- pipe diameter (inches)
p- pitot reading (psig)

Q1 - 1 Orifice(s) $Q1 = (29.83)(0.9)(2.5)^2 \sqrt{60} = 1300$

QT - 2 Orifice(s) $QT = 2(29.83)(0.9)(2.5)^2 \sqrt{40} = 2122$

Static Pressure (PSIG) 90

Test Results Plot

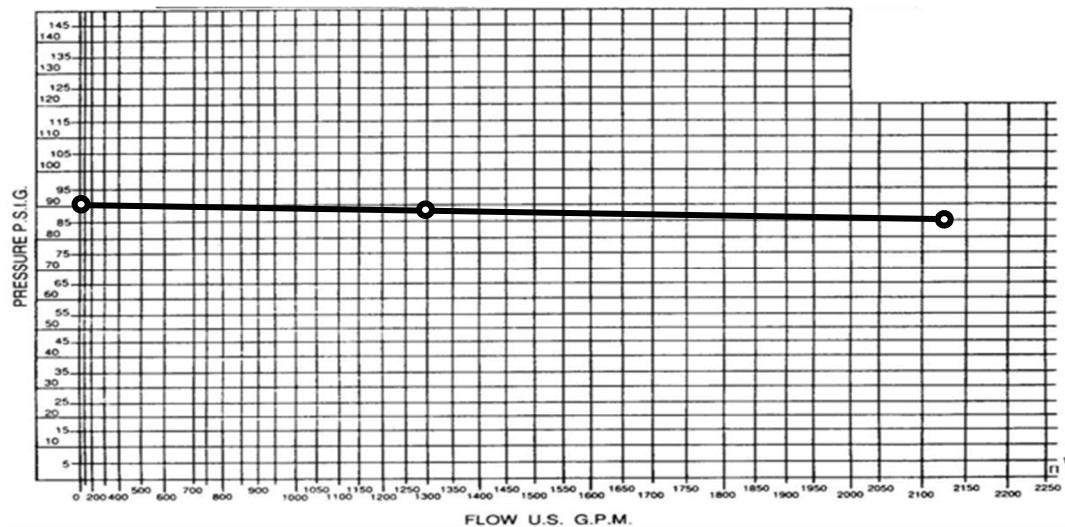

Appendix D.2 Estimated Available Pressure at Water Service Connection on Mississauga Road




Project:	1786 Polaris Way, Mississauga	Proj.#	145121
Date:	2024-06-26		
Calc'd by:	SK		

Hydrant Flow Test Results			
Flow Hydrant Test Location:	4587 Mississauga Rd		
Residual Hydrant Test Location:	4601 Mississauga Rd		
Main Size:	300mm Diameter	Test Time:	11:11 AM
Test Date:	2024-06-14		
Tested By:	Peel Region		

Elev.(m)
146.0

Number of Outlets & Orifice Size	Pilot Pressure (psi)	Flow (US GPM)	Flow (L/min)	Residual Pressure (psi)	Estimated Residual Pressure* (psi)	Estimated HGL(m)
0	0	0	0	90	90	209.4
1 x 2.5"	60	1,300	4,921	88	88	208.0
2 x 2.5"	40	2,122	8,033	86	80	206.6

*Estimated Residual Pressure: For a conservative design, it assumed that the residual pressure (at the maximum tested flow rate) would be reduced by 10 psi, which was used to estimate the available flow at 20 psi.

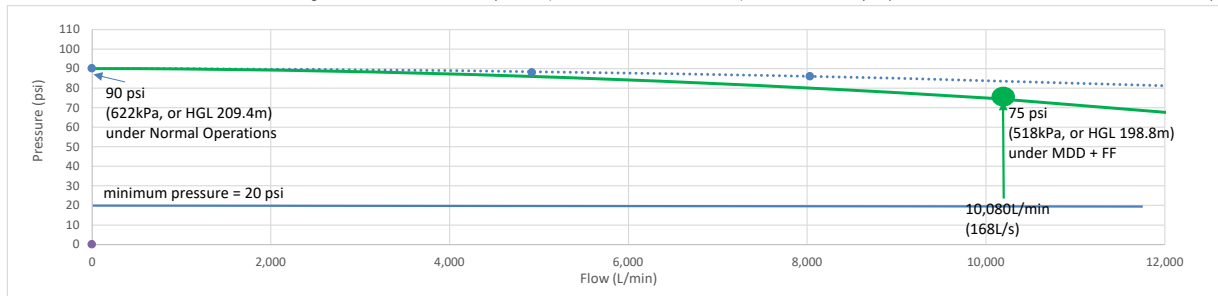

Where,

$$Q_R = Q_T \left(\frac{P_s - P_r}{P_s - P_t} \right)^{0.54}$$

Q_r = Projected Flow Rate
 Q_t = Flow Rate from Flow Test = 8033 L/min
 P_s = Static Pressure = 90 psi
 P_r = Desired System Pressure
 P_t = Residual Pressure inTest = 80 psi

Pressure Under Fire Suppression (P_{r1}) =	20.0	psi	
Calculated Flow Rate (Q_{r1}) =	22,974	L/min	6,069 USGPM 383 L/s
Pressure Under Normal Operation (P_{r2}) =	40.0	psi	
Calculated Flow Rate (Q_{r2}) =	19,157	L/min	5,061 USGPM 319 L/s

Appendix D.3 Water Demand Estimation

Project: 145121

Date:

1786 Polaris Road, City of Mississauga

26-Jun-24



Source	City of London Guidelines
Remark	
Singles/Semis*	4.02 ppu
Rows and other Multiples*	3.13 ppu
Residential (ADD, Average Day Demand)**	280 Lpcd
MDD Peaking Factor**	2
PHD Peaking Factor**	3

*City of Mississauga Development Charges Background Study (March 4, 2022)

**Region of Peel Public Works Design, Specifications & Procedures Manual - Linear Infrastructure - Watermain Design Criteria (June 2010)

Type	Number of Units	People	Demand (L/s)		
-	-	-	ADD	MDD	PHD
Singles/Semis	4	17	0.1	0.1	0.2
Rows and other Multiples	32	101	0.3	0.7	1.0
TOTAL	36	118	0.4	0.8	1.1

Appendix D.4 FIRE FLOW DEMAND CALCULATIONS

Block 5 - 2 Units (Units 1 and 2)

Project Name: **1786 Polaris Road, City of Mississauga**
 Project Number: **175121**
 Date: Jun-2024
 Designed By: SK

Based on the Water Supply for Public Fire Protection Manual, 2020 by the Fire Underwriters Survey

Step 1: Calculate Fire Flow (based on area)

Construction Coefficient (C) =	1.5	
Largest Floor Area (Level 2) =	145	m ²
Floor Above (Level 3) =	145	m ²
Floor Below (Level 1) =	145	m ²
Area (A) =	434	m ²
Fire Flow (F) =	7,000	L/min

F = required fire flow (L/min)

C = coefficient related to type of construction

- 0.6 for Type I Fire Resistive Construction
- 0.8 for Type II Noncombustible Construction
- 1.0 for Type III Ordinary Construction
- 1.5 for Wood Frame Construction

A* = total effective floor area (effective building area), m²

$$F = 220C\sqrt{A}$$

No of units	Area (m2)
6 units	434.1
1 unit	72.3

(Rounded off to nearest 1000 L/min)

1)*For a building classified with a a construction coefficient below 1.0

100% of all floor areas are considered in determining the total Effective Area to be used in the formula.

2)*For a building classified with a construction coefficient below 1.0

- If vertical openings are inadequately protected, consider two largest two largest adjoining floors plus 50% of each of any floors above up to eight floors.
- If vertical openings are adequately protected (one hour rating), consider largest floor area + 25% of two immediately floors.

Step 2: Adjustment for Building Occupancy (shall not be less than 2000 L/s)

Occupancy Adjustment = -15%
 F₁ = Fire Flow x Adjustment = **5950** L/min

- Non-Combust. -25%
- Limited Comb. -15%
- Combustible No change

- Free Burning 15%
- Rapid Burning 25%

(Do not round off the answer)

Step 3: Adjust F1 for Fire Suppression System

Sprinkler Adjustment = 0%
 F₂ = F₁ x Adjustment = **0** L/min

- Adequately Designed System -30%
- Standard for both Sprinkler & Fire Department Hose Lines -40%
- Automatic Sprinklers (monitored) -50%

(Do not round off the answer)

Step 4: Adjust F1 for Exposure / Proximity (shall not exceed 75%)

Proximity Adjustment = 60% (max 75%)
 F₃ = F₁ x Factor = **3,570** L/min

Separation Dis. Adjustment	Side of Building	Separation Dis. (m)	Adjustment (%)
0m to 3m 25%	East	2.5	25
3.1m to 10m 20%	South	>10m	15
10.1m to 20m 15%	West	Fire wall	10
20.1m to 30m 10%	North	>20m	10
30.1m to 45m 5%		sub-total	60

Step 5: Calculate Adjusted Fire Flow (shall not be less than 2000 L/min or greater than 45,000 L/min)

F₁ = 5,950 L/min
 - F₂ = 0 L/min
 + F₃ = 3,570 L/min
 Fire Flow = 10,000 L/min
 Fire Flow = **167** L/s
 Total Demand (Fire Flow + MDD) = **167** L/s

$$\text{Fire Flow} = F_1 - F_2 + F_3$$

(Rounded off to nearest 1000 L/min)

Checks:

Fire Flow greater than 2000 L/min

Fire Flow less than 45,000 L/min

Appendix D.5 Estimated System Pressure at the Hydrant within Subject Site

Project: 145121_1786 Polaris Way Residential Development
Date: June 2024
File: 145121_head loss.xls



Pipeline Section	From	To	Length	Diameter	Area	Pipe Flow	Velocity	"C"	Head Loss	Elev(m)	HGL(m)***	Pressure (kPa)	Location
			L	D	A	Q	V	Factor	Hf*				
			(m)	(m)	(m2)	(m³/s)	(m/s)	-	(m)				
						50% Flow via Polaris Way**							
										146.0	198.8	518	at Service Connection on Miss Rd
Along Polaris Way	Mississauga Rd	Pro. Hydrant within Subject Site	80	0.15	0.02	0.088	5.0	100	19.4	146.3	179.4	325	at Hydrant within Subject Site

Note: *Hf=10.67*(Q/C)^1.85*(1/D^4.871)*L
**Total Required Flow (Max day +fire Flow)=0.168 m3/s - 50% flow discharges via existing hydrant on Mississauga Rd near subject site and the remaining 50% discharges via the proposed hydrant within subject site.
*** Pressure at Service Connection on Mississauga Rd was estimated from the hydrant testing on June 14, 2024 (as shown in **Appendix D.2**)

Appendix E

Stormwater Management Report

Kingridge Developments

Stormwater Management Design Report - Revised The Archways and Hazel Common Element Condominium

**4583, 4589 and 4601 Mississauga Road
City of Mississauga**

December 13, 2024

Stormwater Management Design Report - Revised

The Archways and Hazel Common Element Condominium

4583, 4589 and 4601 Mississauga Road

City of Mississauga

December 13, 2024

Prepared By:


Arcadis Professional Services (Canada) Inc.
Suite 106, 420 Wes Graham Way
Waterloo, Ontario N2L 0J6
Canada
Phone: 519 585 2255

Prepared For:

Kingridge Developments
1660 North Service Road East
Suite 109-B
Oakville, ON L6H 7G3

Our Ref:

145121

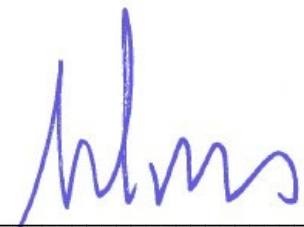

Andy Kroess, M.Eng., P.Eng.
Senior Water Resources Engineer

This document is intended only for the use of the individual or entity for which it was prepared and may contain information that is privileged, confidential and exempt from disclosure under applicable law. Any dissemination, distribution or copying of this document is strictly prohibited.

Version Control

Issue	Revision No.	Date Issued	Page No.	Description	Reviewed By
Final	2	2024-06-28		Issued for OPA/zoning/SPA	Benny Hon
Final	3	2024-12-13		Issued for OPA/zoning/SPA	

Contents

1 Introduction 1

2 Existing Conditions 1

3 Design Criteria and SWM Approach 2

4 Proposed Conditions 2

 4.1 General..... 2

 4.2 Quantity Control 3

 4.3 Quality Control..... 4

 4.4 Water Balance 4

5 Proposed Storm Connection 4

6 Conclusions 5

Tables

Table 2-1 Pre-Development Peak Flows at the Existing Headwall 2

Table 4-1 Post-Development Peak Flows at the Existing Headwall 3

Appendices

Pre-Development and Post-Development Calculations A

Storm Sewer Design Chart – 10 Year Storm A

Pre-Development Drainage Area Plan B

Post-Development Drainage Area Plan B

Water Balance & Infiltration Calculations C

1 Introduction

Arcadis (formerly Cole Engineering Group Ltd.) has been retained by Pace Developments Inc. (the “Client”) to prepare a Stormwater Management Design Report in support of the proposed The Archways common element condominium project located at 4583, 4589 and 4601 Mississauga Road, in the City of Mississauga (the “City”). The proposed redevelopment is situated at the southeast corner of Eglinton Avenue West and Mississauga Road and approximately 200 m south of Eglinton Avenue East. The subject site is Part of Lots 3 and 4, Range 5 North of Dundas Street in the City of Mississauga.

This project had received a previous approval, and the proposed storm sewer system described below was installed in 2019.

This Report is an update to the 2017 Stormwater Management Design Brief (Cole Engineering, June 29, 2017) and supersedes that version and reflects only the proposed changes to the 1786 Polaris Way development (the Archways). This Report also includes updated information originally included in the 2017 Stormwater Management Design – Water Balance Requirements Brief (Cole Engineering, June 28, 2017). The previous design for the 1786 Polaris Way development included an 11 lot condominium site plan. The current condominium site plan includes 6 townhouse blocks with a total of 32 townhouse units and 2 semi-detached units.

The stormwater assessment for the other developing and tributary areas remains the same from 2017 and have been replicated in this report unchanged.

2 Existing Conditions

The existing (pre-development) site for the Archways is located at 4583, 4589 and 4601 Mississauga Road, in the City of Mississauga and consists of approximately 2.756 ha (6.80 Ac). The pre-development drainage area plan is provided in **Appendix B**.

The 1786 Polaris Way lands have an area of approximately 1.09 ha comprised of partially developed area, vegetation, and forested areas. The lands are bounded by existing residential homes to the south and west side of Mississauga Road, the existing Church of Croatian Martyrs to the north, and the Croatian park to the east. Approximately 0.647 ha of the entire area was previously approved for development and was partially constructed in 2019.

The Archways site previously consisted of 3 single family homes (now demolished and removed off site) with individual driveway access to Mississauga Road. The site is bound by Mississauga Road and single family homes to the west, the Church of the Croatian Martyrs at 4605 Mississauga Road to the north, Croatian Park (Church) comprising a woodlot and embankments to the east and existing residence at 4573 Mississauga Road to the south.

The lands are relatively flat sloping from the east to the west towards a midpoint of the site with a grade differential of approximately 1.5 m and are located within the Credit River watershed. The easterly portion of the site is within the Credit River Valley Lands with a top of bank and 5 m buffer block that had been previously established by the Credit Valley Conservation (CVC) and the City of Mississauga.

The existing Thorny-Brae Place comprising approximately 1.55 ha. consists of 4 single family homes with a cul-de-sac that flows into a drainage feature in an existing valley depression which ultimately outlets into the Credit

River to the east. Additional drainage from the Church lands contributes approximately 1.56 ha of building, parking lot and landscaped areas into the same valley depression through an internal storm sewer system that outlets from an existing headwall.

The pre-development 2, 10, and 100 year peak flow at the existing headwall is shown in **Table 2-1 – Pre-Development Peak Flows at the Existing Headwall** and the corresponding calculations shown in **Appendix A**.

Table 2-1 Pre-Development Peak Flows at the Existing Headwall

Storm Event	Pre-Development Peak Flow
2 Year	269.9 l/s
10 Year	446.9 l/s
100 Year	634.1 l/s

3 Design Criteria and SWM Approach

The subject site is located within the Credit River Watershed. The site must therefore meet the local City of Mississauga Development Requirements, Credit Valley Conservation, and Ministry of the Environment, Conservation and Parks (MECP) stormwater standards. The following design criteria will be required:

- Storm sewers are to be designed to the City of Mississauga – 10 Year Intensity Duration Frequency (IDF) storm event;
- No quantity storage is required by the CVC and agreed upon by the City due to the close proximity to the Credit River;
- The storm runoff on Polaris Way, Mississauga Road, and Thorny-Brae Place are to be collected in the new storm sewer and discharged to the existing headwall which outlets into the valley depression and ultimately into the Credit River;
- For the Archways, Low Impact Development (LID) measures such as infiltration galleries at all rear lot catch basins and a 300mm deep topsoil layer will be implemented to reduce surface runoff and promote infiltration; and
- For The Archways, rooftop rainwater leaders of the rear-draining building areas will be collectively directed to rear yard infiltration trenches.

4 Proposed Conditions

4.1 General

The proposed 1786 Polaris Way development is comprised of 34 common element condominium townhouse lots and 2 semi-detached lots with a single driveway entrance on Mississauga Road and a “hammerhead” turnaround at the north edge of the property. Site drainage will be collected in an existing on-site storm sewer, and flows will be routed to the existing storm sewer on Mississauga Road.

LIDs such as a 300m deep topsoil layer and infiltration trenches are proposed to promote infiltration at the interior portion of the site and concentrated surface runoff is to be reduced at the rear of the lots backing on to the top of slope to mitigate erosion.

Major flows from Polaris Drive at the Archways development will be directed to Mississauga Road. Major flows in excess of the 10 year storm event on Mississauga Road are conveyed to a low point at the intersection of Mississauga Road / Tattersall Way, and runoff will pond and ultimately be captured in the local storm sewer system on Mississauga Road that is currently outletting to Mullet Creek, a tributary of the Credit River.

4.2 Quantity Control

Quantity control for the Archways is not required due to the proximity to the Credit River. An analysis of the proposed site conditions was completed using the Rational Method to determine the post-development peak flows for the site. The time in concentration is assumed to be 21.80 minutes based on the storm sewer design sheet included in **Appendix A** and a maximum of 15 minutes for the Church lands. Minimum runoff coefficient used is 0.75 notwithstanding lesser coefficients were calculated in the post-development conditions.

A minimum runoff coefficient for the strip of land along Eglinton Avenue West was 0.40 with the assumption that brick pavers may be used in this location. Notwithstanding this conservative approach, the post-development AR (area x runoff coefficient) = 0.09 ha x 0.40 = 0.036, which is less than the pre-development AR = 0.20 ha x 0.25 = 0.05, therefore the small front landscaped area for the proposed lots along Eglinton Avenue West can be conveyed north without detrimental impact. Rooftops for the houses along Eglinton Avenue West will be captured and discharged to the storm sewer connections on Thorny-Brae Place. This will be confirmed once the final design for this parcel proceeds.

The post-development 2, 10, and, 100 year peak flow at the existing headwall including the corresponding pre-development flows is shown in **Table 4-1 – Post-Development Peak Flows at the Existing Headwall** and the corresponding calculations shown in **Appendix A**.

The post-development drainage area plan is provided in **Appendix B**.

Table 4-1 Post-Development Peak Flows at the Existing Headwall

Storm Event	Pre-Development Peak Flow	Post-Development Peak Flow
2 Year	269.9 l/s	452.9 l/s
10 Year	446.9 l/s	749.9 l/s
100 Year	634.1 l/s	1,067.1 l/d

4.3 Quality Control

Low Impact Development (LID) measures such as infiltration galleries at all rear lot catch basins and a 300mm deep topsoil layer will be implemented to reduce surface runoff and promote infiltration and water quality. Refer to the infiltration galleries calculations in **Appendix C**. The design also includes an oil-grit separator unit (Stormceptor model STC 2000), which was previously installed at the outlet of Polaris Way storm sewer and provides a TSS removal efficiency of 82 percent.

4.4 Water Balance

CVC water balance criteria requires a site specific water balance analysis and mitigation measures in order to maintain pre-development groundwater recharge rates. To meet these criteria and mitigate the post-development infiltration deficit on site, Low Impact Development (LID) measures are proposed to be implemented on site, in order to promote infiltration in an effort to maintain pre-development recharge conditions.

Under pre-development conditions, the 1786 Polaris Way site currently provides an annual infiltration rate of 1447 m³, provided by the 0.97 ha pervious landscaped area on-site. In comparison, an annual infiltration rate of 900 m³ is provided in post-development (without mitigation measures), resulting in a 547 m³ infiltration deficit compared to pre-development conditions. The decrease in annual infiltration under post-development conditions is a result of the introduction of additional impervious surfaces during site development, and the corresponding decrease in pervious areas on-site (compared to pre-development conditions) from 0.97 ha to 0.60 ha.

In order to meet the water balance infiltration targets, LIDs in the form of a 300mm topsoil layer and infiltration trenches are proposed for the site. The proposed 300mm topsoil layer area of 890 m² will capture a rainfall depth of 5 mm for infiltration, as confirmed in the calculations included in **Appendix C**. Additionally, two infiltration trenches 1.0 m wide, are proposed on-site with a combined trench length of 143.0m. The proposed trenches will receive a minimum of 5 mm of rainfall runoff from their respective contributing 916 m² rooftop areas for on-site infiltration.

The proposed mitigation measures will provide an annual infiltration volume of 1448 m³, therefore achieving the pre-development infiltration target required to meet the water balance criteria outlined by the CVC. Detailed LID calculations are included in **Appendix C**.

5 Proposed Storm Connection

The proposed 1786 Polaris Way development installed in 2019 connects to an existing 525 mm to 600 mm diameter storm sewer on Mississauga Road and a 675 mm to 750 mm diameter storm sewer on Thorny-Brae Place. The sewer connects to the recently constructed wingwall on the existing headwall which is the outlet for the Church storm sewer system that outlets into the valley depression and ultimately into the Credit River. Major flows from Polaris Drive at the 1786 Polaris Way development will be directed to Mississauga Road.

6 Conclusions

The proposed stormwater management plan meets criteria outlined by the City of Mississauga, CVC, and the MECP. Due to the close proximity to the Credit River quantity controls are not required, and the site will discharge via the recently constructed storm sewer on Mississauga Road and Thorny-Brae Place to the existing drainage feature from the top of slope to the Credit River. Since the total asphalt area of the site is comparable to the existing conditions, and the proposed rooftop is considered to generate “clean” runoff, the overall water quality of the site will remain comparable to existing conditions. The design also includes an oil-grit separator unit (Stormceptor model STC 2000), which was previously installed, which provides a TSS removal efficiency of 82 percent. Effective use of LIDs will promote infiltration and provide additional water quality measures for the development site.

Appendix A

Pre-Development and Post-Development Calculations Storm Sewer Design Chart – 10 Year Storm

				Pre-Development Runoff Coefficient Calculation
				The Archways, Mississauga File No. 145121 (UD15-0347) Date: June 2024 - Revised
Drainage Area ID	Pervious Area (ha)	Impervious Area (ha)	Total Area (ha)	Composite Runoff Coefficient
A1 Pre	1.25	0.30	1.55	0.38
A2 Pre	0.56	1.00	1.56	0.67
Total	1.81	1.30	3.11	0.52

City of Mississauga

Lawns and Garden: 0.25
All other surfaces 0.90

Prepared By: SG & PF				Rational Method			
				Pre-Development Flow Calculation			
				The Archways, Mississauga			
				File No. 145121 (UD15-0347)			
				Date: June 2024 - Revised			
Area Number	Area	C	Tc				
	(ha)						
A1 Pre	1.55	0.38	15	Thorny-Brae Place			
A2 Pre	1.56	0.67	15	Church			
Rational Method Calculation							
Event 2 yr							
IDF Data Set City of Mississauga							
a = 610							
b = 4.6							
c = -0.78							
Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m³/s)	(L/s)
A1 Pre	1.55	0.38	0.583	15	59.9	0.097	96.9
A2 Pre	1.56	0.67	1.040	15	59.9	0.173	173.0
Total	3.11				0.0	0.270	269.9
Event 5 yr							
IDF Data Set City of Mississauga							
a = 820							
b = 4.6							
c = -0.78							
Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m³/s)	(L/s)
A1 Pre	1.55	0.38	0.583	15	80.5	0.130	130.3
A2 Pre	1.56	0.67	1.040	15	80.5	0.233	232.6
Total	3.11				0.0	0.363	362.9
Event 10 yr							
IDF Data Set City of Mississauga							
a = 1010							
b = 4.6							
c = -0.78							
Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m³/s)	(L/s)
A1 Pre	1.55	0.38	0.583	15	99.2	0.160	160.5
A2 Pre	1.56	0.67	1.040	15	99.2	0.286	286.5
Total	3.11				0.0	0.447	446.9

**Rational Method
Pre-Development Flow Calculation**

The Archways, Mississauga
File No. 145121 (UD15-0347)
Date: June 2024 - Revised

Event 25 yr
IDF Data Set City of Mississauga
a = 1160
b = 4.6
c = -0.78

Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m ³ /s)	(L/s)
A1 Pre	1.55	0.38	0.583	15	113.9	0.184	184.3
A2 Pre	1.56	0.67	1.040	15	113.9	0.329	329.0
Total	3.11				0.0	0.513	513.3

Event 50 yr
IDF Data Set City of Mississauga
a = 1300
b = 4.7
c = -0.78

Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m ³ /s)	(L/s)
A1 Pre	1.55	0.38	0.583	15	127.1	0.206	205.7
A2 Pre	1.56	0.67	1.040	15	127.1	0.367	367.3
Total	3.11				0.0	0.573	573.0

Event 100 yr
IDF Data Set City of Mississauga
a = 1450
b = 4.9
c = -0.78

Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m ³ /s)	(L/s)
A1 Pre	1.55	0.38	0.583	15	140.7	0.228	227.6
A2 Pre	1.56	0.67	1.040	15	140.7	0.406	406.4
Total	3.11				0.0	0.634	634.1

				Post-Development Runoff Coefficient Calculation
				The Archways, Mississauga File No. 145121 (UD15-0347) Date: June 2024 - Revised
Drainage Area ID	Pervious Area (ha)	Impervious Area (ha)	Total Area (ha)	Composite Runoff Coefficient
A1 Post	0.60	1.14	1.74	0.73
A2 Post	0.56	1.00	1.56	0.72
Total	1.16	2.14	3.30	0.72
				Use Minimum Runoff Coefficient C=0.75

City of Mississauga

Lawns and Garden:	0.40	(with patios and walkways)
All other surfaces	0.90	

				Rational Method			
				Post-Development Flow Calculation			
				The Archways, Mississauga			
				File No. 145121 (UD15-0347)			
				Date: December 2024 - Revised			
Area Number	Area (ha)	C	Tc				
B1 - The Archways	0.66	0.67	21.80	Based on Storm Sewer Design Sheet			
B2 - Mississauga Rd.	0.52	0.90	21.80	Based on Storm Sewer Design Sheet			
B3 - The Hazel	1.74	0.73	21.80	Based on Storm Sewer Design Sheet			
B4 - Church	1.56	0.72	15.00	Matches pre-development Tc			
				Use Minimum Runoff Coefficient C=0.75			
Rational Method Calculation							
Event 2 yr							
IDF Data Set City of Mississauga							
a = 610							
b = 4.6							
c = -0.78							
Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m³/s)	(L/s)
B1 - The Archways	0.66	0.75	0.491	21.80	47.5	0.065	64.8
B2 - Mississauga Rd.	0.52	0.90	0.468	21.80	47.5	0.062	61.7
B3 - The Hazel	1.74	0.75	1.305	21.80	47.5	0.172	172.1
B4 - Church	1.56	0.75	1.170	15.00	47.5	0.154	154.3
Total	4.475					0.453	452.9
Event 5 yr							
IDF Data Set City of Mississauga							
a = 820							
b = 4.6							
c = -0.78							
Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m³/s)	(L/s)
B1 - The Archways	0.66	0.75	0.491	21.80	63.8	0.087	87.1
B2 - Mississauga Rd.	0.52	0.90	0.468	21.80	63.8	0.083	83.0
B3 - The Hazel	1.74	0.75	1.305	21.80	63.8	0.231	231.4
B4 - Church	1.56	0.75	1.170	15.00	63.8	0.207	207.4
Total	4.475					0.609	608.8
Event 10 yr							
IDF Data Set City of Mississauga							
a = 1010							
b = 4.6							
c = -0.78							
Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m³/s)	(L/s)
B1 - The Archways	0.66	0.75	0.491	21.80	78.6	0.107	107.3
B2 - Mississauga Rd.	0.52	0.90	0.468	21.80	78.6	0.102	102.2
B3 - The Hazel	1.74	0.75	1.305	21.80	78.6	0.285	285.0
B4 - Church	1.56	0.75	1.170	15.00	78.6	0.255	255.5
Total	4.475					0.750	749.9


					Rational Method		
					Post-Development Flow Calculation		
					The Archways, Mississauga File No. 145121 (UD15-0347) Date: December 2024 - Revised		
Event 25 yr IDF Data Set City of Mississauga a = 1160 b = 4.6 c = -0.78							
Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m³/s)	(L/s)
B1 - The Archways	0.66	0.75	0.491	21.80	90.3	0.123	123.2
B2 - Mississauga Rd.	0.52	0.90	0.468	21.80	90.3	0.117	117.4
B3 - The Hazel	1.74	0.75	1.305	21.80	90.3	0.327	327.3
B4 - Church	1.56	0.75	1.170	15.00	90.3	0.293	293.4
Total	4.475					0.861	861.3
Event 50 yr IDF Data Set City of Mississauga a = 1300 b = 4.7 c = -0.78							
Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m³/s)	(L/s)
B1 - The Archways	0.66	0.75	0.491	21.80	100.9	0.138	137.7
B2 - Mississauga Rd.	0.52	0.90	0.468	21.80	100.9	0.131	131.1
B3 - The Hazel	1.74	0.75	1.305	21.80	100.9	0.366	365.7
B4 - Church	1.56	0.75	1.170	15.00	100.9	0.328	327.9
Total	4.475					0.962	962.4
Event 100 yr IDF Data Set City of Mississauga a = 1450 b = 4.9 c = -0.78							
Area Number	A	C	AC	Tc	I	Q	Q
	(ha)			(min.)	(mm/h)	(m³/s)	(L/s)
B1 - The Archways	0.66	0.75	0.491	21.80	111.9	0.153	152.6
B2 - Mississauga Rd.	0.52	0.90	0.468	21.80	111.9	0.145	145.4
B3 - The Hazel	1.74	0.75	1.305	21.80	111.9	0.406	405.5
B4 - Church	1.56	0.75	1.170	15.00	111.9	0.364	363.6
Total	4.475					1.067	1067.1

<div><div><div>Rainfall Intensity =</div><div><div>A</div><div>(Tc+B)^c</div></div><div><div>10-YEAR</div><div>A= 1010</div><div>B= 4.6</div><div>c= 0.78</div></div><div><div>100-YEAR</div><div>A= 1450</div><div>B= 4.9</div><div>c= 0.78</div></div><div>Starting Tc = 15 min</div><div>File Location: \\caneast.ibigroup.com\JTO\145121_1765_Polaris\7.0_Production\7.03_Design\04_Civil\Calcs\Sewer_Design\145121_1765_Polaris-STORM-10yr.xls</div></div></div>																		
<div><div>As-Constructed 10 yr Storm Sewer Design Sheet</div><div>Tributary to Existing Headwall</div></div> <div><div>City of Mississauga</div><div>Region of Peel</div><div>T-M09002 W8</div><div><div>Project: 1786 Polaris Way (previously The Archway)</div><div>Project No: 145121 (previously UD15-0347)</div><div>Date: JUN. 20, 2024</div><div>Designed by: J.F.</div></div></div>																		
STREET	FROM MH	TO MH	10-YR AREA (ha)	10-YR RUNOFF COEFFICIENT "R"	10-YR "AR"	10-YR ACCUM. "AR"	TIME OF CONCENTRATION (min)	10-YR RAINFALL INTENSITY (mm/hr)	10-YR ACCUM. FLOW (m³/s)	PIPE LENGTH (m)	PIPE SLOPE (%)	PIPE DIAMETER (mm)	FULL FLOW CAPACITY (m3/s)	FULL FLOW VELOCITY (m/s)	TIME OF TRAVEL (min)	ACCUMULATED TIME (min)	% FULL FLOW (%)	COMMENT
Polaris Way	EX.MH.10	EX.MH.9	0.112	0.75	0.084	0.111	15.23	98.27	0.030	32	0.42	300	0.063	0.887	0.60	15.83	49%	
Polaris Way	EX.MH.9	EX.MH.8	0.0634	0.75	0.048	0.159	15.83	96.01	0.042	12	0.17	300	0.040	0.564	0.35	16.18	106%	
Polaris Way	RLCB.1	EX.MH.8	0.0481	0.75	0.036	0.036	15.00	99.17	0.010	33.5	1.00	250	0.059	1.211	0.46	15.46	17%	
Polaris Way	RLCB.2	EX.MH.8	0.0697	0.75	0.052	0.052	15.00	99.17	0.014	33.5	2.00	250	0.084	1.713	0.33	15.33	17%	
Polaris Way	RLCB.3	EX.MH.10	0.0365	0.75	0.027	0.027	15.00	99.17	0.008	23.5	2.00	250	0.084	1.713	0.23	15.23	9%	
Polaris Way	RLCB.4	EX.MH.8	0.0682	0.75	0.051	0.051	15.00	99.17	0.014	33.7	0.50	250	0.042	0.857	0.66	15.66	34%	
Polaris Way	RLCB.5	EX.MH.8	0.0271	0.75	0.020	0.020	15.00	99.17	0.006	33.4	1.00	250	0.059	1.211	0.46	15.46	9%	
Polaris Way	EX.MH.8	EX.OGS.1	0.223	0.75	0.167	0.486	16.18	94.73	0.128	57.2	0.25	450	0.142	0.896	1.06	17.25	90%	
Polaris Way	EX.OGS.1	EX.MH.7	0.00	0.00	0.000	0.486	17.25	91.11	0.123	3.8	0.25	450	0.142	0.896	0.07	17.32	86%	
Mississauga Road	EX.MH.7	EX.MH.6	0.00	0.00	0.000	0.486	17.32	90.88	0.123	16	0.45	450	0.191	1.203	0.22	17.54	64%	
Mississauga Road	EX.MH.6	EX.MH.5	0.18	0.90	0.162	0.648	17.54	90.17	0.162	74.4	0.30	525	0.235	1.088	1.14	18.68	69%	
Mississauga Road	EX.MH.5	EX.MH.4	0.34	0.90	0.306	0.954	18.68	86.71	0.230	84.3	0.28	600	0.325	1.149	1.22	19.90	71%	
Thorny-Brae Place	EX.MH.4	EX.MH.3	0.70	0.75	0.525	1.479	19.90	83.32	0.342	98.6	0.42	675	0.544	1.522	1.08	20.98	63%	
Thorny-Brae Place	EX.MH.3	EX.MH.2	0.65	0.75	0.488	1.966	20.98	80.56	0.440	72.2	0.46	750	0.755	1.709	0.70	21.69	58%	
Thorny-Brae Place	EX.MH.2	EX.MH.1	0.00	0.00	0.000	1.966	21.69	78.87	0.431	16	0.83	750	1.014	2.296	0.12	21.80	43%	
Valley Outfall	EX.MH.1	EX.HW	0.00	0.00	0.000	1.966	21.80	78.60	0.429	56.7	1.00	750	1.113	2.520	0.38	22.18	39%	

Appendix B

Pre-Development Drainage Area Plan

Post-Development Drainage Area Plan

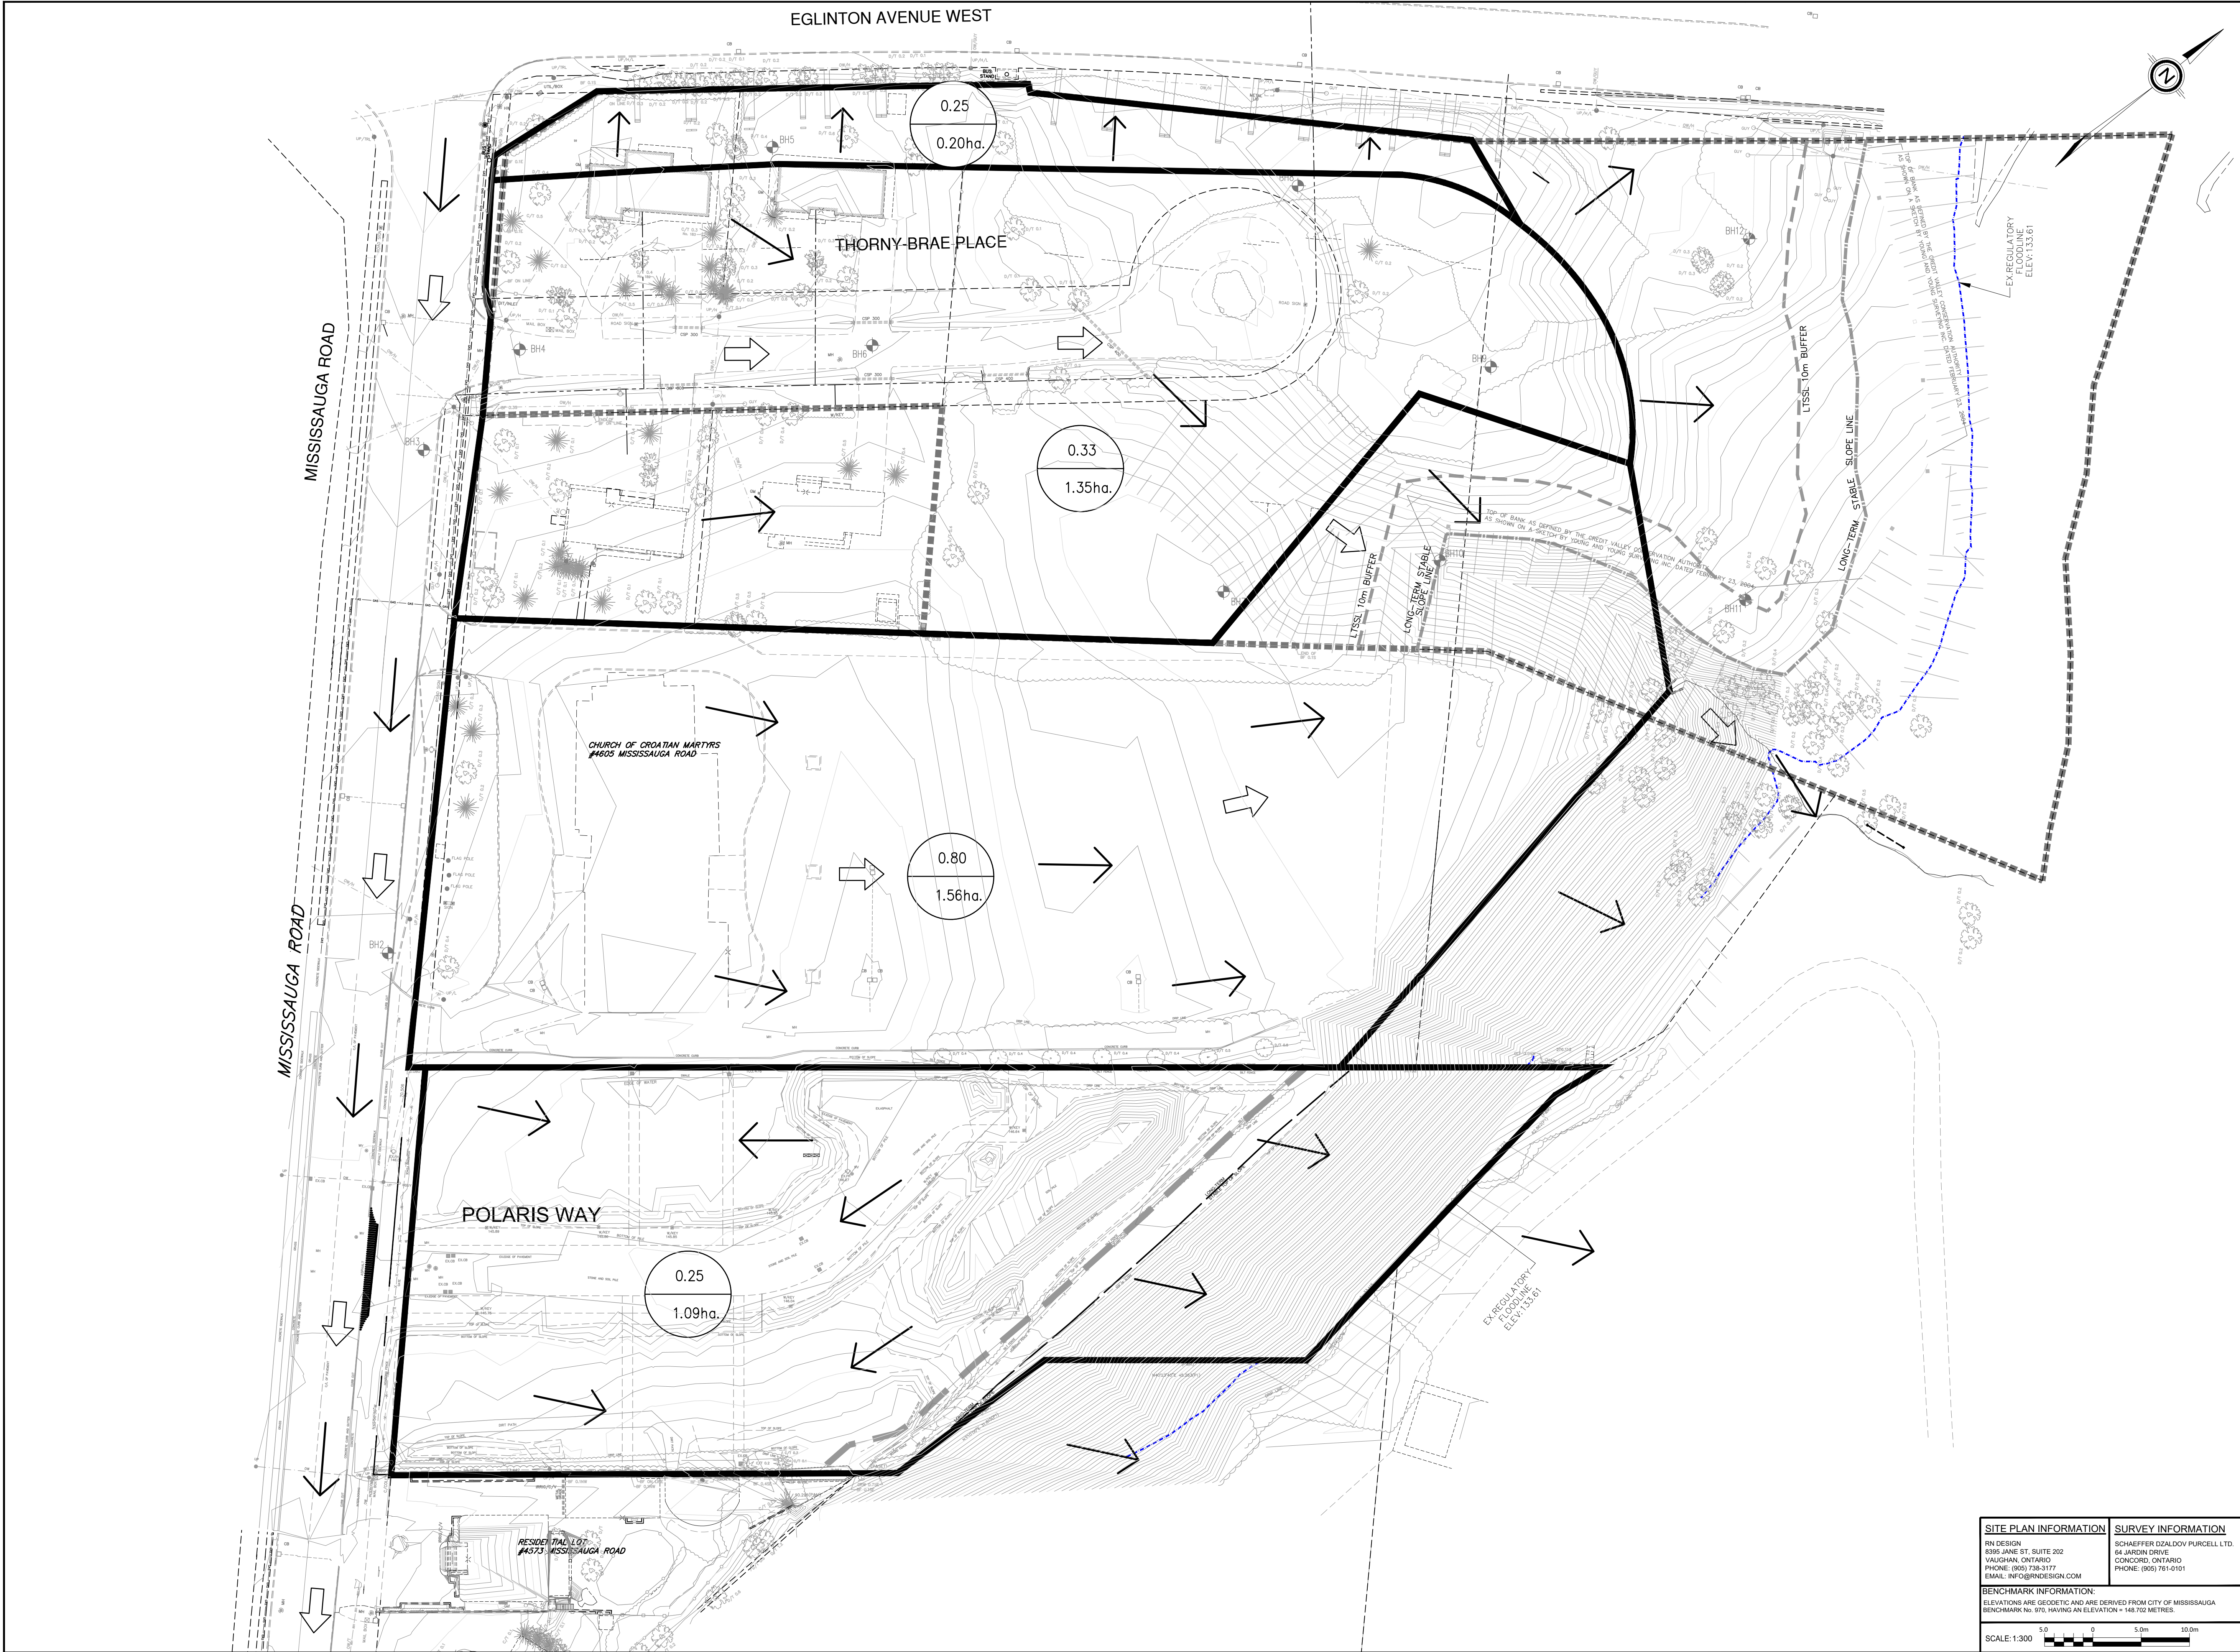


CLIENT
KINGRIDGE DEVELOPMENTS
1660 NORTH SERVICE ROAD EAST
SUITE 109-B
OAKVILLE ON. L6H 7G3
PHONE: (416) 277-7466
EMAIL: INFO@KINGRIDGEDEVELOPMENTS.CA

COPYRIGHT
This drawing has been prepared solely for the intended use, and any reproduction or distribution for any purpose other than authorized by ARCADIS is prohibited. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and ARCADIS shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to ARCADIS for general conformance before proceeding with fabrication.
ARCADIS PROFESSIONAL SERVICES (CANADA) INC.
is a member of ARCADIS Group of companies

ISSUES		
No.	DESCRIPTION	DATE
1.	SUBMITTED FOR OPA/ZONING/SPA	FEB. 23, 2024
2.	RE-SUBMITTED FOR OPA/ZONING/SPA	JUN. 28, 2024

LEGEND

- PRE-DEVELOPMENT DRAINAGE AREA
- 0.45 RUNOFF COEFFICIENT
- 0.06ha DRAINAGE AREA
- DIRECTION OF DRAINAGE
- OVERLAND FLOW

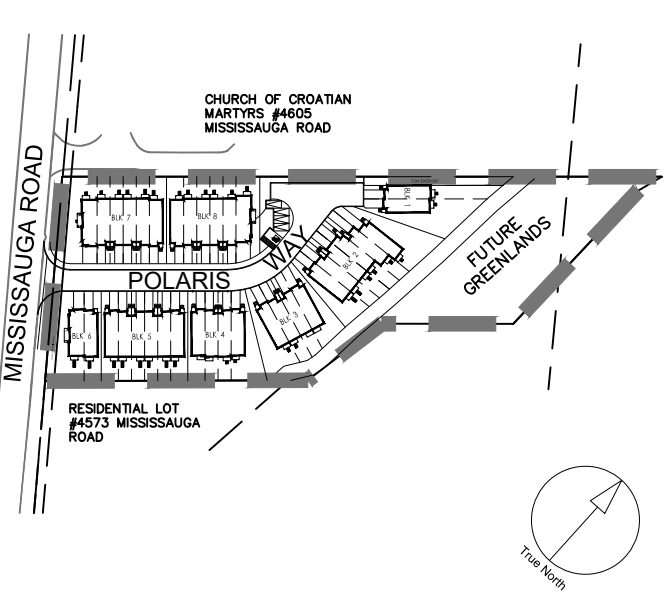

KEY PLAN (N.T.S.)




PROJECT
1786 POLARIS WAY
CITY OF MISSISSAUGA

PROJECT NO: 145121	CHECKED BY: BH/AK
DRAWN BY: JF	APPROVED BY: AK
PROJECT MGR: SR	

SHEET TITLE
PRE-DEVELOPMENT DRAINAGE AREA PLAN

SHEET NUMBER SWM-01	ISSUE 01
------------------------	-------------

SITE PLAN INFORMATION RN DESIGN 8395 JANE ST. SUITE 202 VAUGHAN, ONTARIO PHONE: (905) 758-3177 EMAIL: INFO@RNDESIGN.COM	SURVEY INFORMATION SCHAEFFER DZALDOV PURCELL LTD. 84 JARDIN DRIVE CONCORD, ONTARIO PHONE: (905) 761-0101
BENCHMARK INFORMATION: ELEVATIONS ARE GEODETIC AND ARE DERIVED FROM CITY OF MISSISSAUGA BENCHMARK No. 970, HAVING AN ELEVATION = 148.702 METRES.	
SCALE: 1:300 0 5.0m 10.0m	

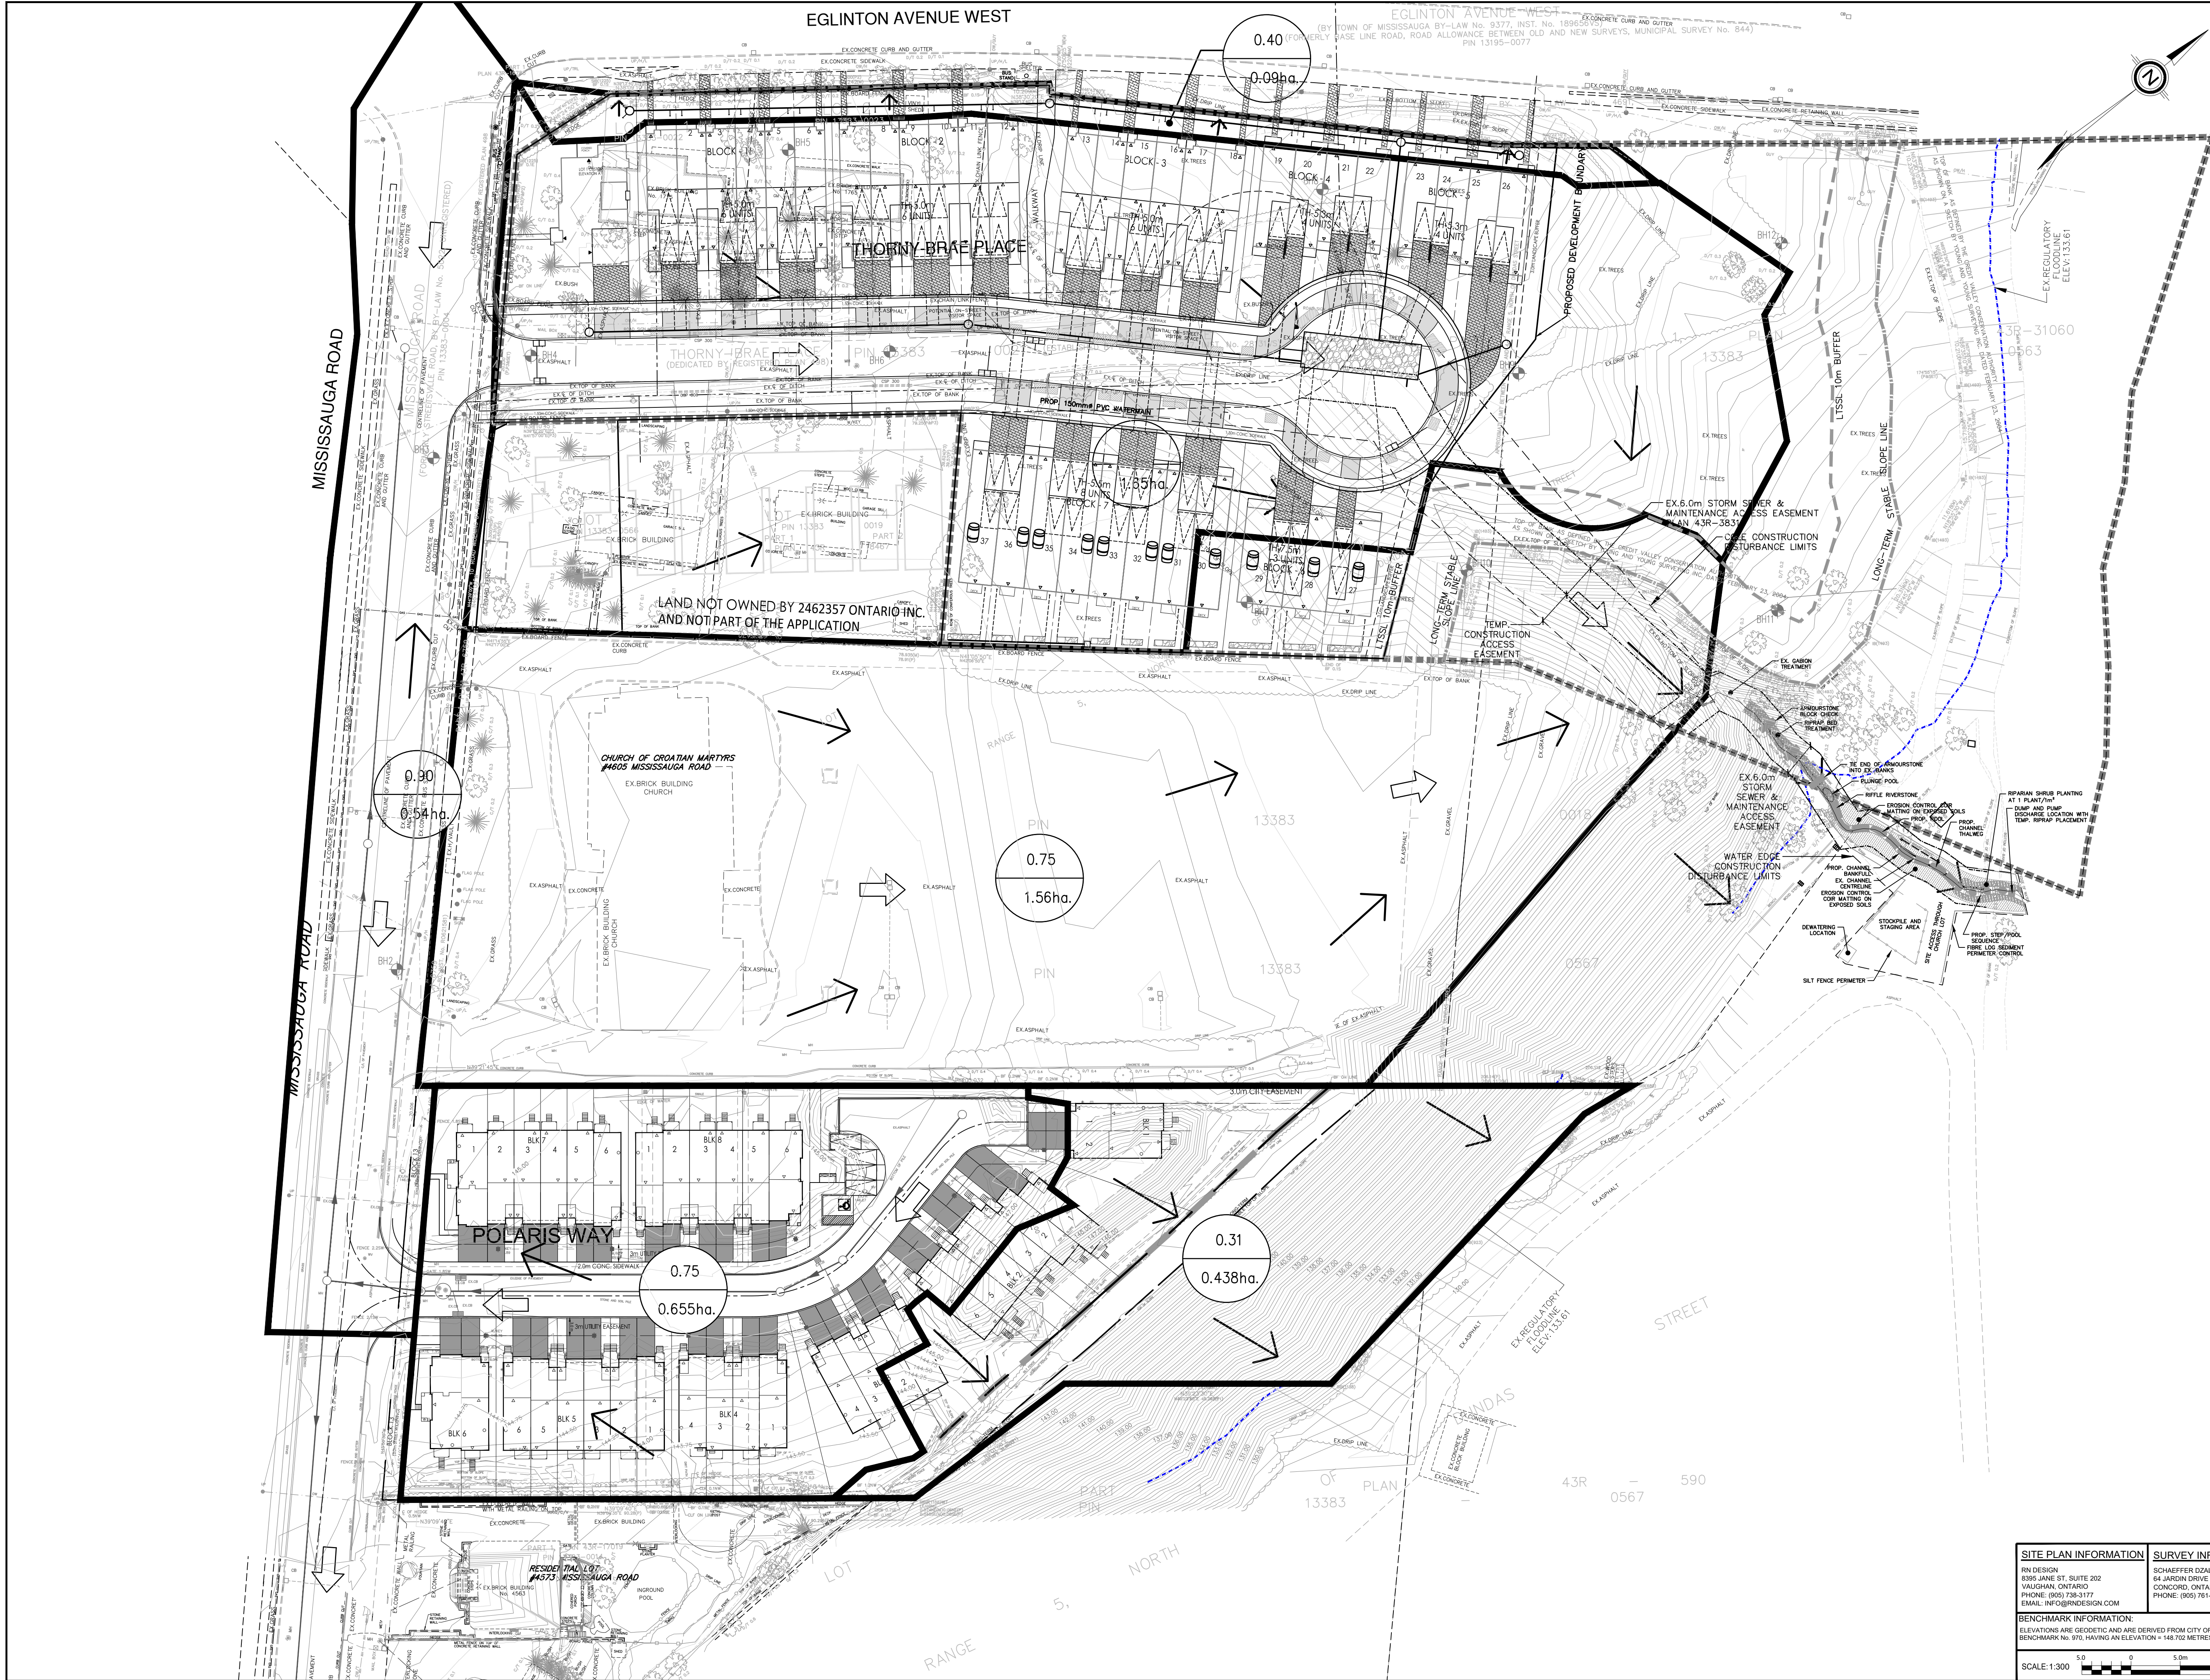


CLIENT
KINGRIDGE DEVELOPMENTS
1660 NORTH SERVICE ROAD EAST
SUITE 109-B
OAKVILLE ON. L6H 7G3
PHONE: (416) 277-7466
EMAIL: INFO@KINGRIDGEDEVELOPMENTS.CA

COPYRIGHT
This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by ARCADIS is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and ARCADIS shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to ARCADIS for general conformance before proceeding with fabrication.
ARCADIS PROFESSIONAL SERVICES (CANADA) INC.
is a member of ARCADIS Group of companies.

ISSUES		
No.	DESCRIPTION	DATE
1.	SUBMITTED FOR OPA/ZONING/SPA	FEB. 23, 2024
2.	RE-SUBMITTED FOR OPA/ZONING/SPA	DEC 18, 2024

LEGEND

- POST-DEVELOPMENT DRAINAGE AREA
- 0.75 RUNOFF COEFFICIENT
- 1.56ha DRAINAGE AREA
- DIRECTION OF DRAINAGE
- OVERLAND FLOW

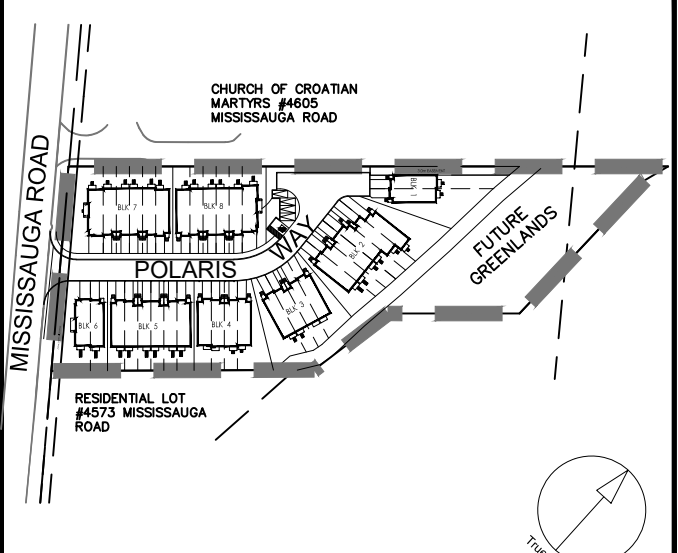

KEY PLAN (N.T.S.)



PROJECT
1786 POLARIS WAY
CITY OF MISSISSAUGA

PROJECT NO:
145121
DRAWN BY:
JF
PROJECT MGR:
SR
CHECKED BY:
BH/AK
APPROVED BY:
AK

SHEET TITLE
POST-DEVELOPMENT DRAINAGE AREA PLAN

SHEET NUMBER
SWM-02
ISSUE
01

SITE PLAN INFORMATION	SURVEY INFORMATION
RD DESIGN 8395 JANE ST. SUITE 202 VAUGHAN, ONTARIO PHONE: (905) 738-3177 EMAIL: INFO@RDDESIGN.COM	SCHAEFFER DZALDOV PURCELL LTD. 64 JARDIN DRIVE CONCORD, ONTARIO PHONE: (905) 761-0101
BENCHMARK INFORMATION: ELEVATIONS ARE GEODETIC AND ARE DERIVED FROM CITY OF MISSISSAUGA BENCHMARK No. 970, HAVING AN ELEVATION = 148.702 METRES.	
SCALE: 1:300	

Appendix C

Water Balance & Infiltration Calculations

		Water Balance Calculations	
		4583, 4589 and 4601 Mississauga Road File No. 145121 (UD15-0347) Date: June 2024 - Revised	

Based on MOE Table 3.1

Site Data

Hydrologic Soil group:	C	Silty Clay Till (Soil Map)
Vegetation Cover:	Urban Lawn	

PRE-DEVELOPMENT WATER BALANCE

	Pervious Area	Impervious Area	Total
Area (ha)	0.965	0.128	1.093
Precipitation (mm)	785.9	785.9	
ET (mm)	536	79	
Surplus (mm)	250	707	
Infiltration (mm)	150	0	
Runoff (mm)	100	707	
ET (m³)	5173	101	5274
Infiltration (m³)	1447	0	1447
Runoff (m³)	965	905	1869

POST-DEVELOPMENT WATER BALANCE (NO MITIGATION)

	Pervious Area	Impervious Area	Total
Area (ha)	0.600	0.493	1.093
Precipitation (mm)	785.9	785.9	
ET (mm)	536	79	
Surplus (mm)	250	707	
Infiltration (mm)	150	0	
Runoff (mm)	100	707	
ET (m³)	3217	387	3605
Infiltration (m³)	900	0	900
Runoff (m³)	600	3487	4087

POST-DEVELOPMENT WATER BALANCE (WITH MITIGATION)


	Pervious Area	Impervious Area	300mm Topsoil	Rooftop to Trench	Total
Area (ha)	0.511	0.401	0.089	0.092	1.093
Precipitation (mm)	785.9	785.9	785.9	785.9	
ET (mm)	536	79	79	79	
Surplus (mm)	250	707	707	707	
Infiltration (mm)	150	0	377	377	
Runoff (mm)	100	707	330	330	
ET (m³)	2740	315	70	72	3197
Infiltration (m³)	766	0	336	346	1448
Runoff (m³)	511	2839	294	302	3946

4.6 m³ of infiltration trench volume equals about 5 mm of depth over the impervious area. 5 mm daily capture roughly equals 48% capture of the annual rainfall.

4.5 m³ of 300mm topsoil infiltration volume equals about 5 mm of depth over the impervious area. 5mm daily capture roughly equals 48% capture of the annual rainfall.

SUMMARY

	ET	Infiltration m³	Runoff
Pre	5274	1447	1869
w/o Mitigation	3605	900	4087
	-32%	-38%	119%
w/ Mitigation	3197	1448	3946
	-39%	0%	111%

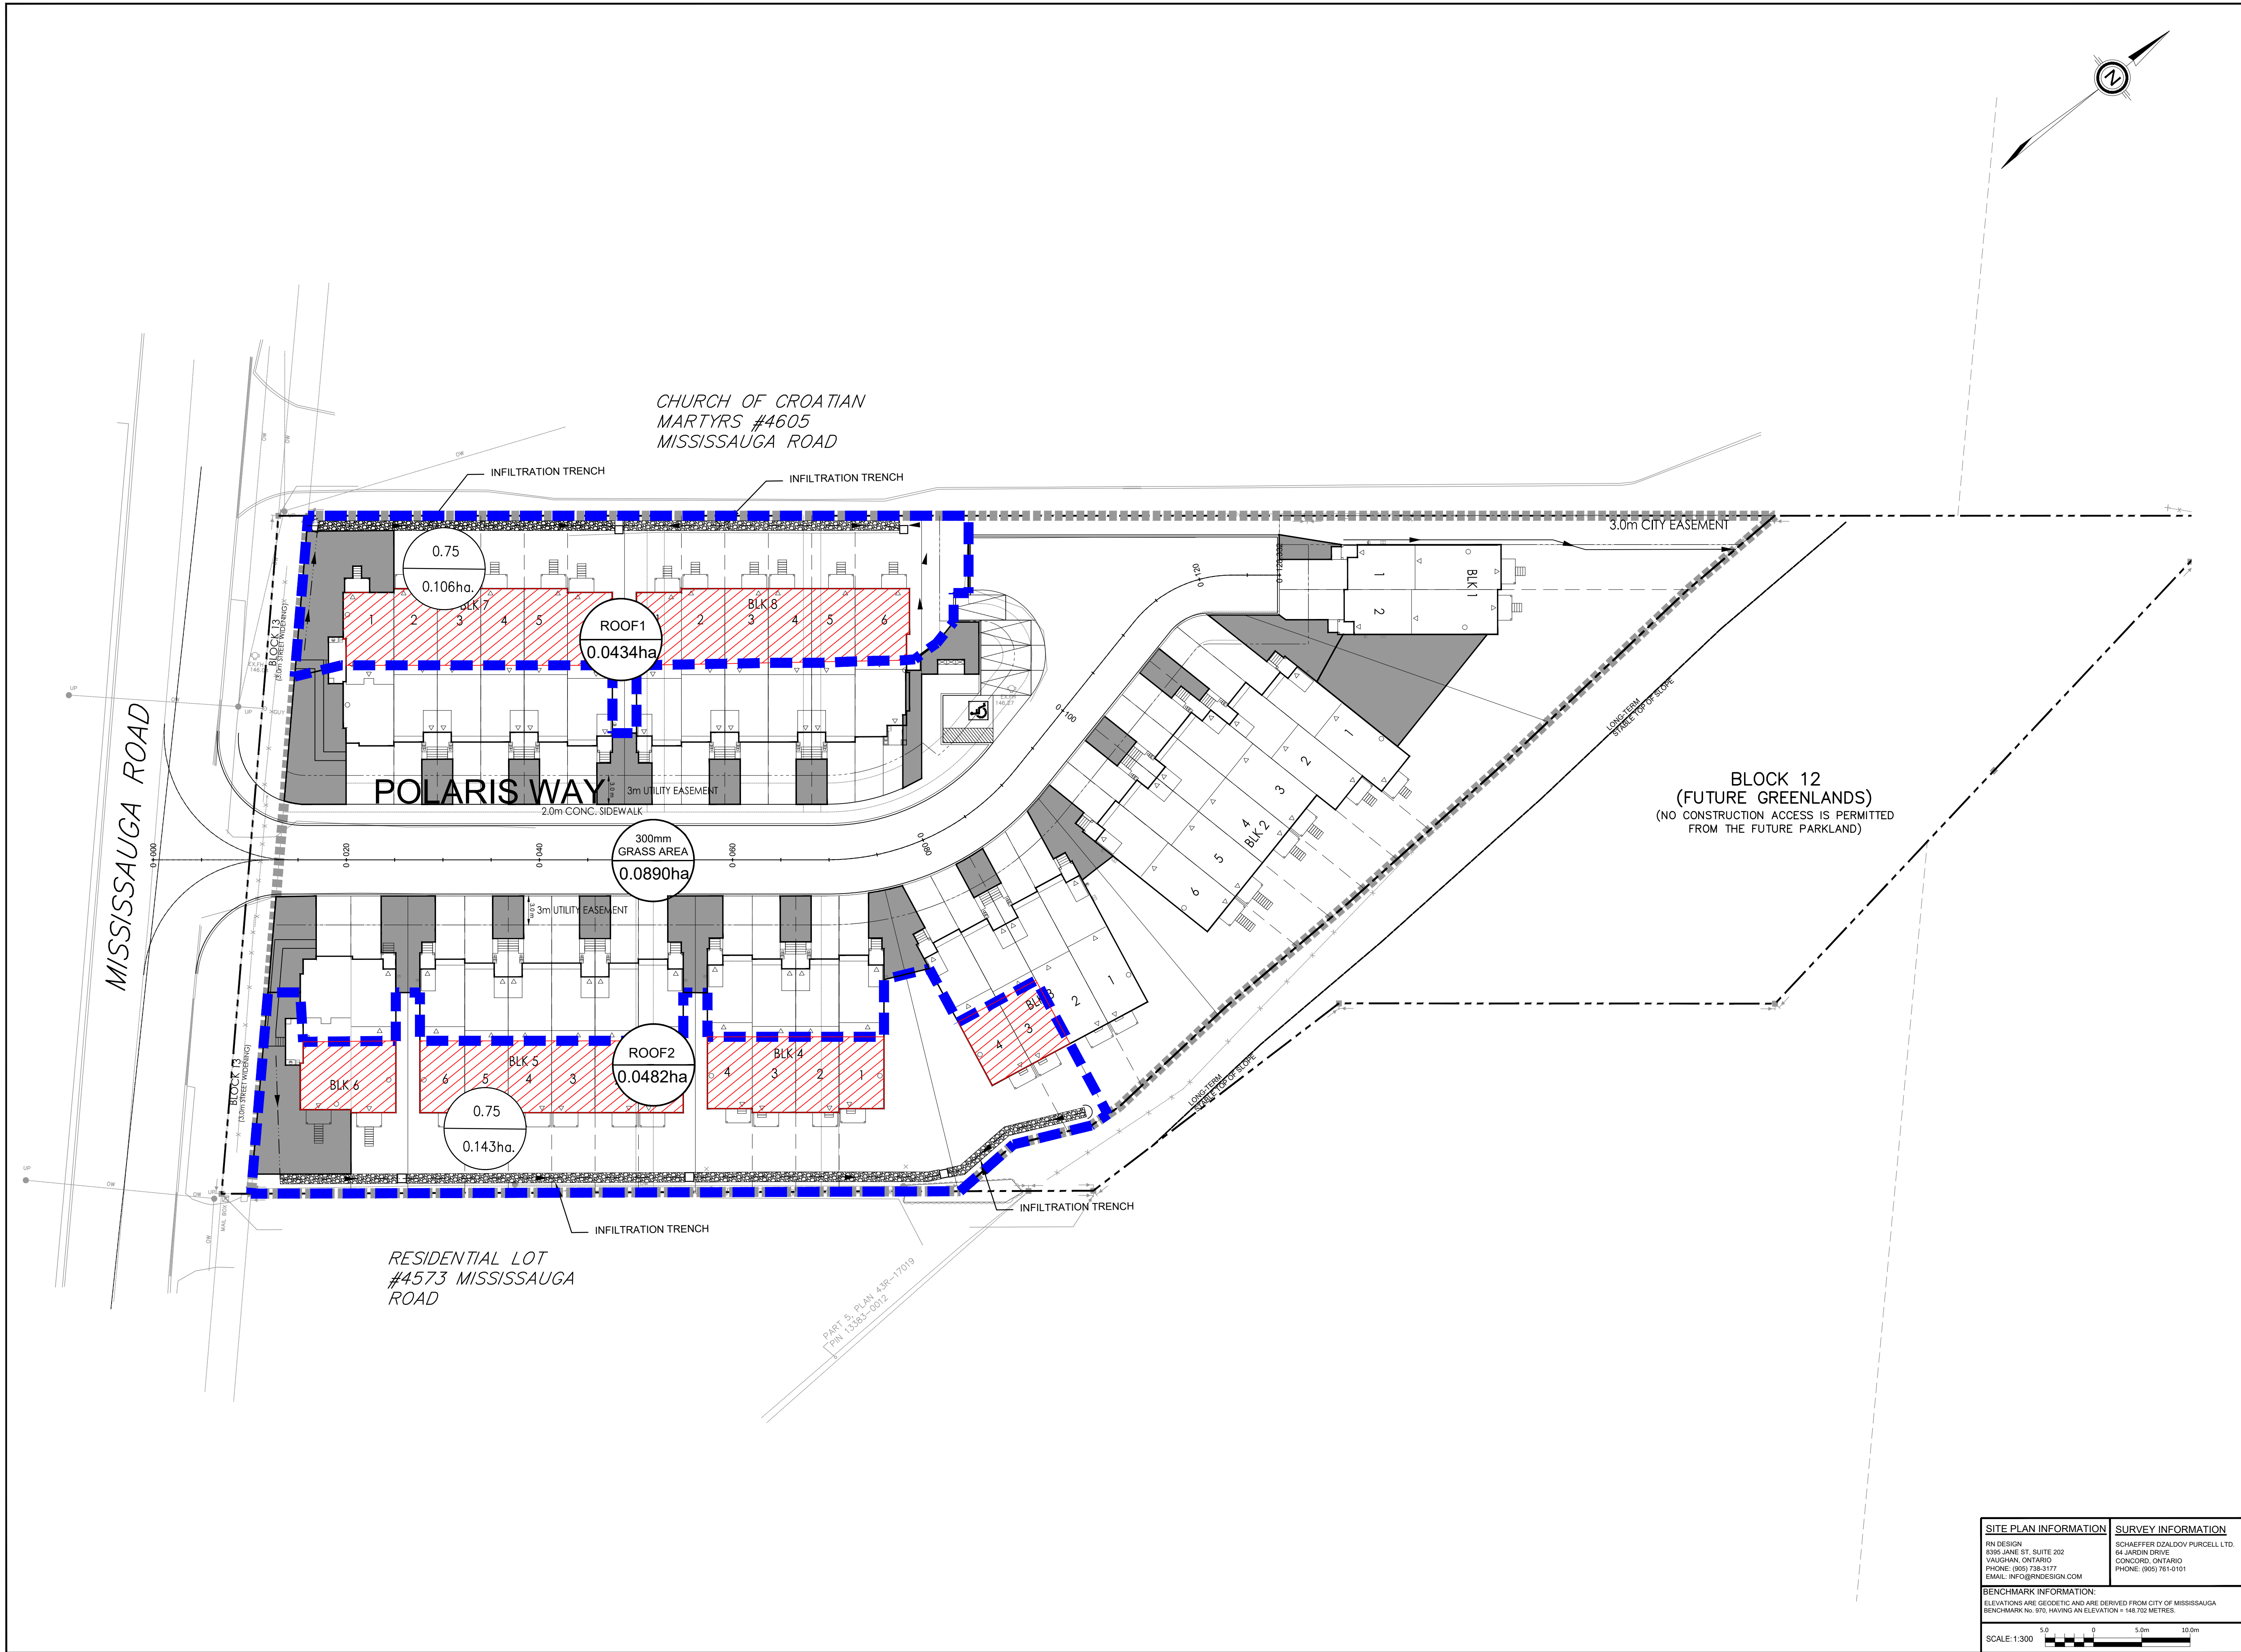


CLIENT
KINGRIDGE DEVELOPMENTS
1660 NORTH SERVICE ROAD EAST
SUITE 109-B
OAKVILLE ON. L6H 7G3
PHONE: (416) 277-7466
EMAIL: INFO@KINGRIDGEDEVELOPMENTS.CA

COPYRIGHT
This drawing has been prepared solely for the intended use, thus any reproduction or distribution for any purpose other than authorized by ARCADIS is forbidden. Written dimensions shall have precedence over scaled dimensions. Contractors shall verify and be responsible for all dimensions and conditions on the job, and ARCADIS shall be informed of any variations from the dimensions and conditions shown on the drawing. Shop drawings shall be submitted to ARCADIS for general conformance before proceeding with fabrication.
ARCADIS PROFESSIONAL SERVICES (CANADA) INC.
is a member of ARCADIS Group of companies

ISSUES		
No.	DESCRIPTION	DATE
1.	SUBMITTED FOR OPAZONING/SPA	FEB. 23, 2024
2.	RE-SUBMITTED FOR OPAZONING/SPA	DEC 18, 2024

LEGEND

- PROPERTY LINE
- TRENCH DRAINAGE AREA
- INFILTRATION TRENCH
- ROOF ID NUMBER
- CONTRIBUTING ROOFTOP AREA
- CONTRIBUTING ROOFTOP AREA
- 300mm TOPSOIL AREA
- RUNOFF COEFFICIENT
- TOTAL DRAINAGE AREA

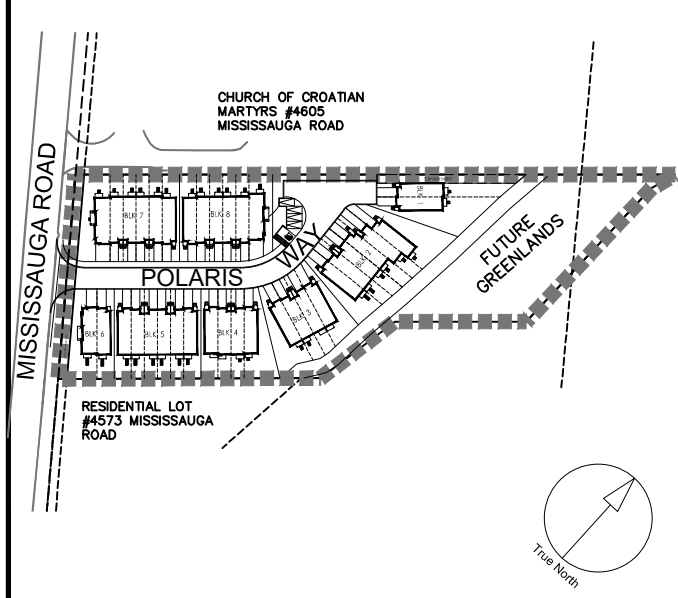

KEY PLAN (N.T.S.)



PROJECT
1786 POLARIS WAY
CITY OF MISSISSAUGA

PROJECT NO:
145121
DRAWN BY:
JF
PROJECT MGR:
SR
CHECKED BY:
BH/AK
APPROVED BY:
AK

SHEET TITLE
**LOW IMPACT
DEVELOPMENT PLAN**

SHEET NUMBER
LID-01
ISSUE
01


SITE PLAN INFORMATION PIN DESIGN 6395 JANE ST. SUITE 202 VAUGHAN, ONTARIO PHONE: (905) 738-3177 EMAIL: INFO@PINDESIGN.COM	SURVEY INFORMATION SCHAEFFER DZALDOV PURCELL LTD. 64 JARDIN DRIVE CONCORD, ONTARIO PHONE: (905) 731-0101
BENCHMARK INFORMATION: ELEVATIONS ARE GEODETIC AND ARE DERIVED FROM CITY OF MISSISSAUGA BENCHMARK No. 876, HAVING AN ELEVATION = 18.702 METRES	
SCALE: 1:300 	

Arcadis Professional Services (Canada) Inc.
Suite 106, 420 Wes Graham Way
Waterloo, Ontario N2L 0J6
Canada
Phone: 519 585 2255

www.arcadis.com

Appendix F

References

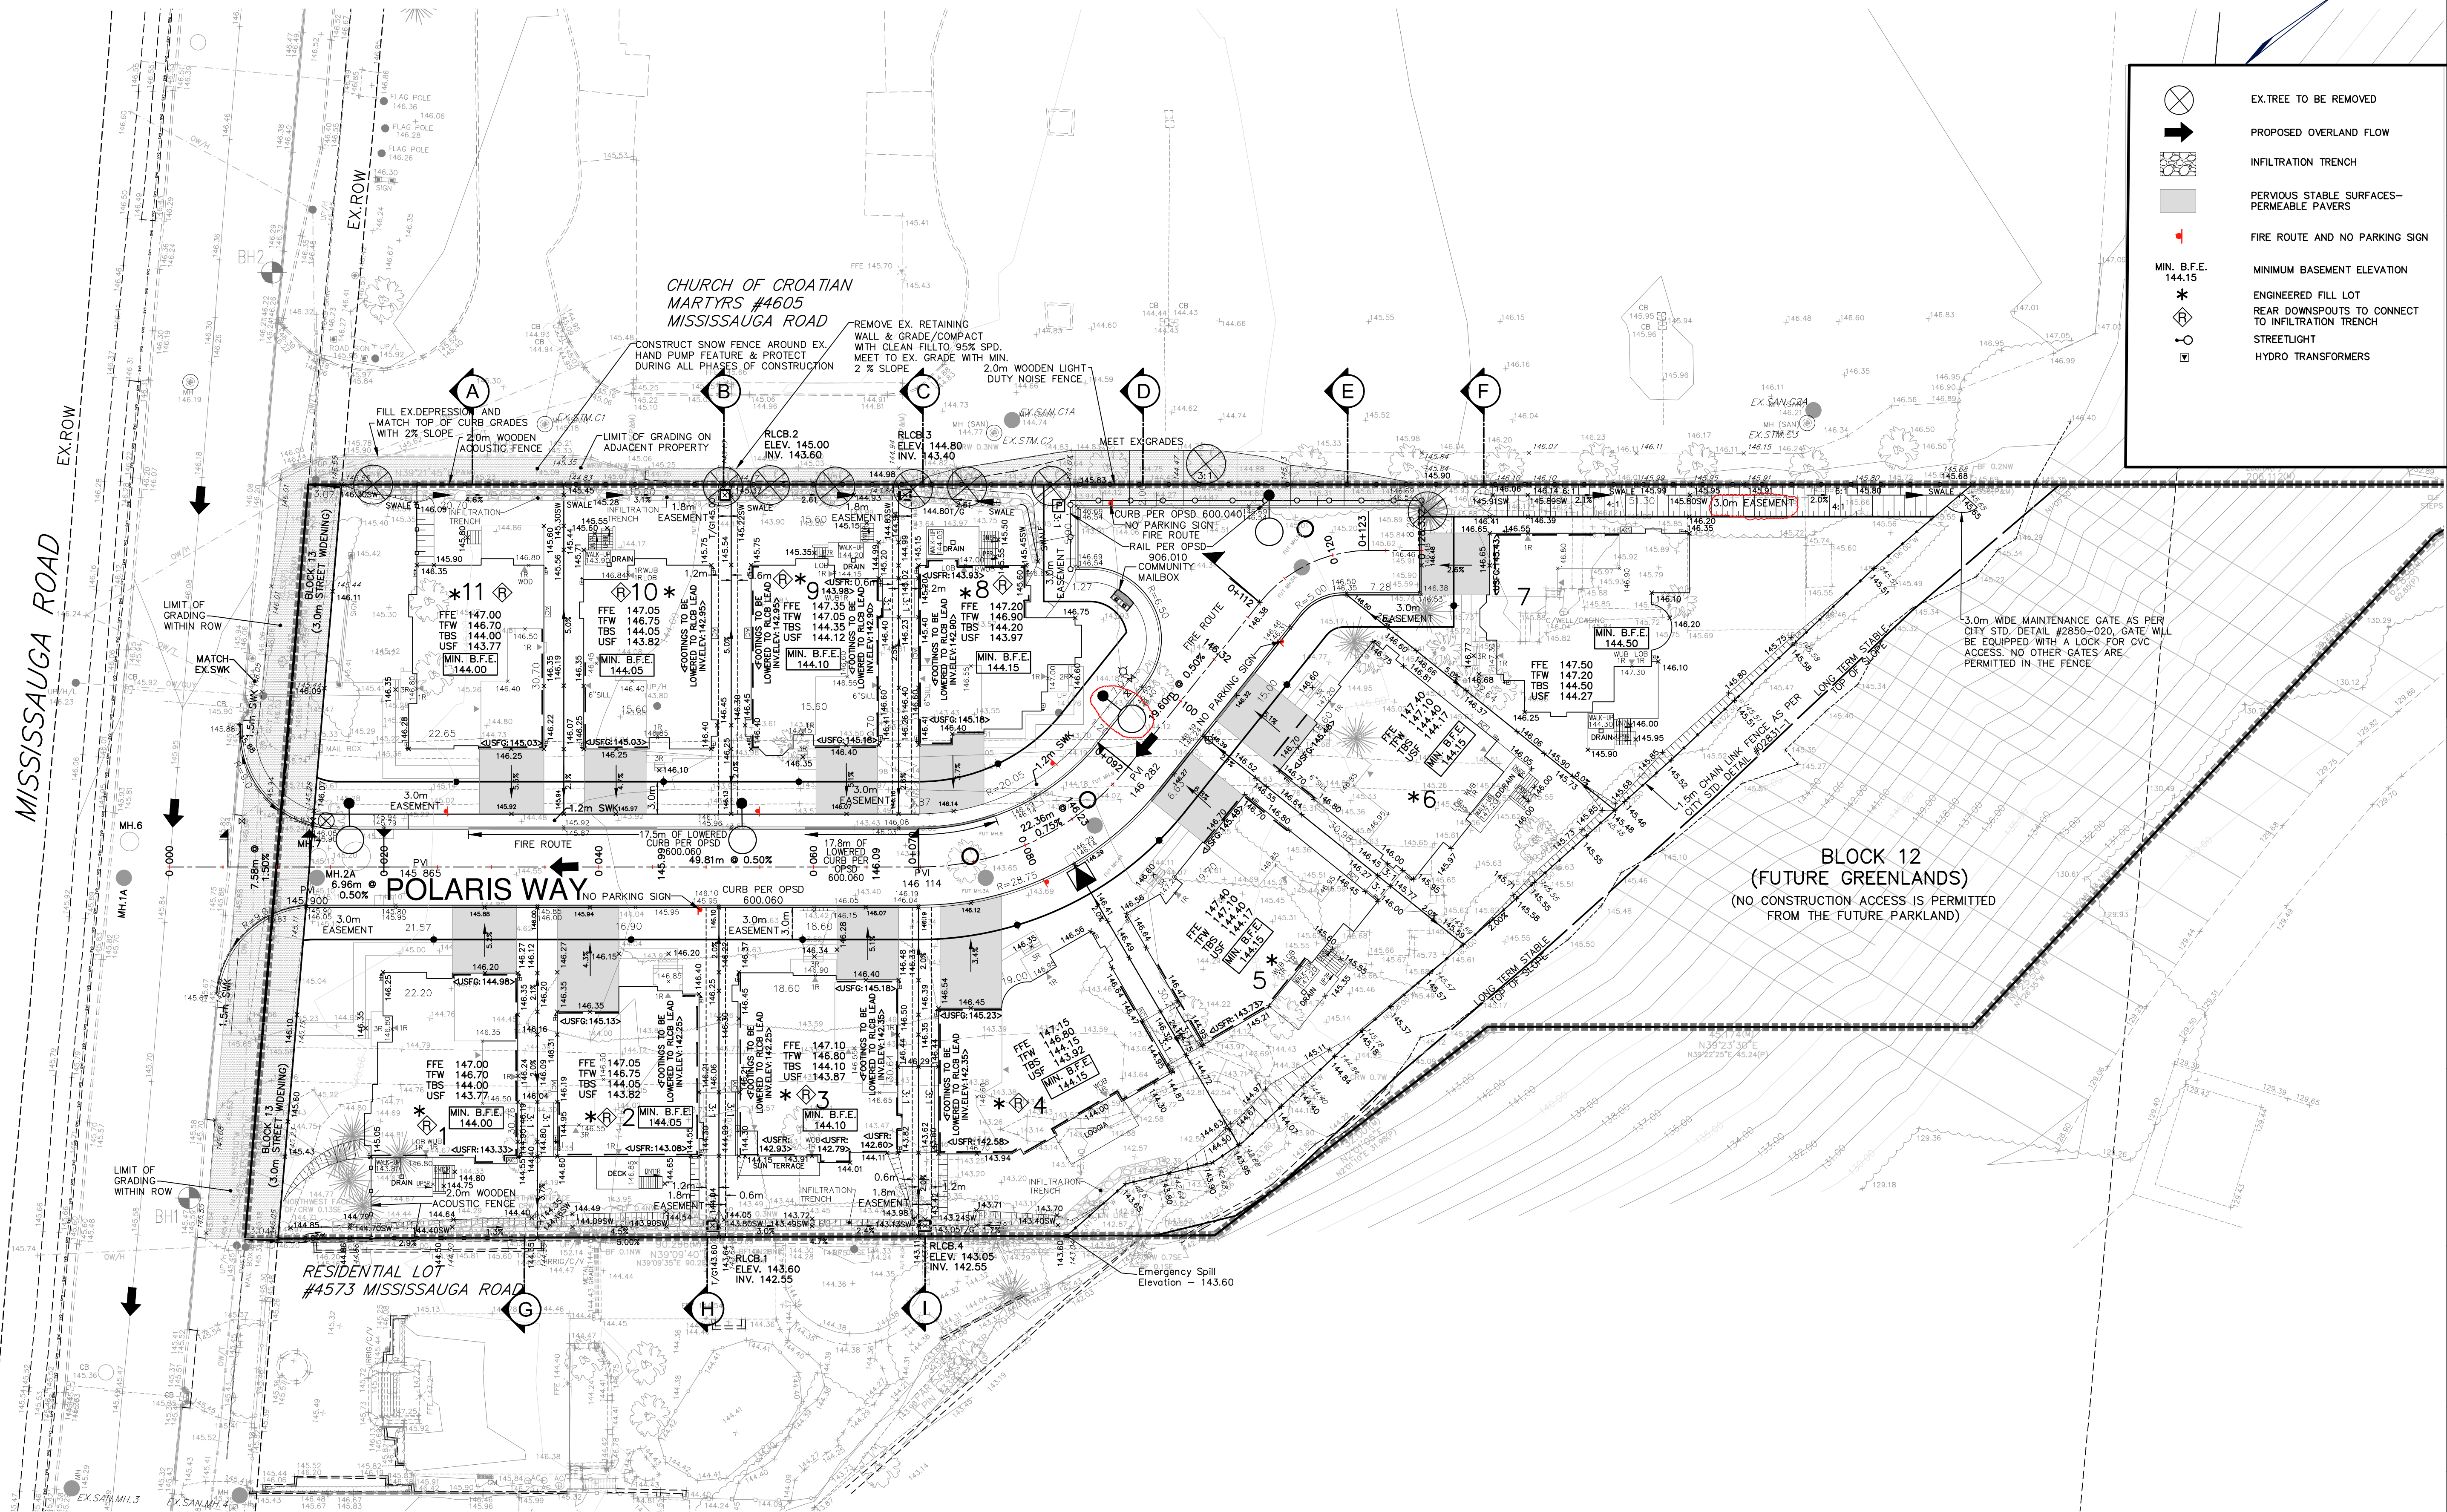

NOTE:
CURB IN FRONT OF LOTS 8 & 9, 10 & 11
TO BE CONTINUOUSLY LOWERED AS
SHOWN ON THE PLAN BY
AND PROPOSED ELEVATIONS. CURB
BETWEEN LOTS 9 & 10 TO BE FULL CURB

- EX.TREE TO BE REMOVED
- PROPOSED OVERLAND FLOW
- INFILTRATION TRENCH
- PERVIOUS STABLE SURFACES-
PERMEABLE PAVERS
- FIRE ROUTE AND NO PARKING SIGN
- MIN. B.F.E.
144.15
- MINIMUM BASEMENT ELEVATION
- ENGINEERED FILL LOT
- REAR DOWNSPOUTS TO CONNECT
TO INFILTRATION TRENCH
- STREETLIGHT
- HYDRO TRANSFORMERS

- LEGEND**
- PROPOSED STORM MANHOLE
 - PROPOSED SANITARY MANHOLE
 - PROPOSED CATCH BASIN
 - PROPOSED DOUBLE CATCH BASIN
 - PROPOSED VALVE & BOX
 - PROPOSED HYDRANT & VALVE
 - EXISTING STORM MANHOLE
 - EXISTING SANITARY MANHOLE
 - EXISTING CATCHBASIN
 - EXISTING VALVE & BOX
 - EXISTING HYDRANT & VALVE
 - PROPOSED LOT NUMBERS
 - PROPOSED 2.0m HIGH WOODEN
ACOUSTIC FENCE
 - PROPOSED 2.0m HIGH WOODEN
LIGHT DUTY NOISE FENCE
 - PROPOSED 1.5m HIGH
CHAIN LINK FENCE
 - PROPERTY LINE
 - EXISTING CONTOUR
 - EXISTING ELEVATION
 - PROPOSED ELEVATION
 - PROPOSED DOWNSPOUT LOCATION

EXISTING SERVING INFORMATION FOR MISSISSAUGA ROAD AND
THORNHURST PLACE WAS OBTAINED FROM MUNICIPAL RECORD
DRAWINGS: C-33221, C-33222, C-9829, 1156-D, 7235-D
EXISTING SERVING AND UTILITIES INFORMATION SHOWN ON
THIS DRAWING IS NOT TO BE RELIED ON. THE CONTRACTOR TO
VERIFY ELEVATION AND LOCATION OF ALL UNDERGROUND
SERVICES AND UTILITIES PRIOR TO COMMENCING WORK.


- LIST OF DRAWINGS**
- | | |
|-------|--------------------------|
| SG-01 | (SITE GRADING PLAN) |
| SS-01 | (SITE SERVING PLAN) |
| ST-01 | (STORM DRAINAGE PLAN) |
| SA-01 | (SANITARY DRAINAGE PLAN) |
| EC-01 | (EROSION CONTROL PLAN) |
| DD-01 | GENERAL NOTES |
| DD-02 | DETAIL DRAWINGS |
| DD-03 | CROSS SECTIONS |

SITE PLAN INFORMATION
SCHAEFFER DZALOVY BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

SURVEY INFORMATION
SCHAEFFER DZALOVY BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

BENCHMARK
ELEVATIONS SHOWN HEREON ARE REFERRED TO
CITY OF MISSISSAUGA BENCHMARK No. 970
HAVING A PUBLISHED ELEVATION OF 148.702 METRES.

11.	REVISED PER REGION COMMENTS	OCT. 19, 2018	S.G.
10.	ISSUED FOR SPA #4	SEPT. 5, 2018	S.G.
9.	ISSUED FOR SPA #3	APR. 27, 2018	S.G.
8.	ISSUED FOR SPA #2	JULY 27, 2017	S.G.
7.	SPA #2	JULY 04, 2017	S.G.
6.	REVISED FOR CVC & CITY COMMENTS	MAY 8, 2017	S.G.
5.	ISSUED FOR SITE PLAN APPROVAL	SEPT. 30, 2016	S.G.
4.	PER REGION AND CITY COMMENTS	AUG 12, 2016	S.G.
3.	PER CVC COMMENTS	JUNE 13, 2016	S.G.
2.	FIRST ENGINEERING SUBMISSION	APR 26, 2016	S.G.
NO.	REVISION	DATE	BY

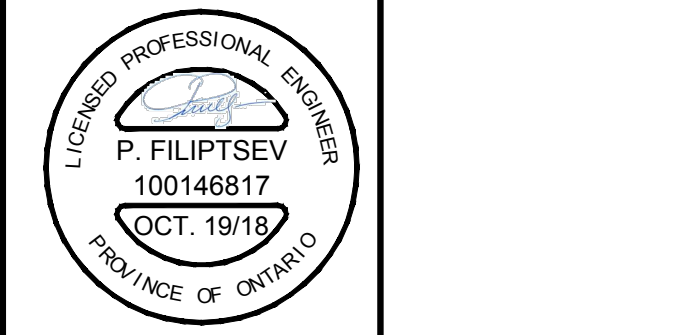

Region
of Peel
working with you

MISSISSAUGA
2482357 ONTARIO INC. (PACE DEVELOPMENTS)
THE ARCHWAYS
4583, 4589, 4601 MISSISSAUGA ROAD,
MISSISSAUGA, ON


COLE
ENGINEERING
70 VALLEYVIEW DRIVE, MARKHAM, ON L3R 4T5
T 905 947 8711 F 905 940 0191 T 905 940 0201

DESIGNED BY: P.F.	DATE: OCTOBER 2015	CHECKED BY: S.G.
DRAWN BY: P.F.	PROJECT No.	APPROVED BY: S.G.
SCALE: 1:300	UD15-0347	DRAWING No.
© COPYRIGHT 2015 Cole Engineering Group Ltd.		SG-01

"I have reviewed the plans for the construction of
OZ 09/004 W8 located at 4583, 4589, 4601 MISSISSAUGA ROAD
and have prepared this plan to indicate the
compatibility of the proposal to existing adjacent
properties and municipal services. It is my belief that
adherence to the proposed grades as shown will
produce adequate surface drainage and proper facility
of the municipal services without any detrimental effect
to the existing drainage patterns or adjacent properties"

REFER TO DRAWING DD-03
FOR CROSS-SECTIONS

CITY FILE #
OZ 09/004 W8
PEEL FILE#
T-M09002 M
SP-16-147M

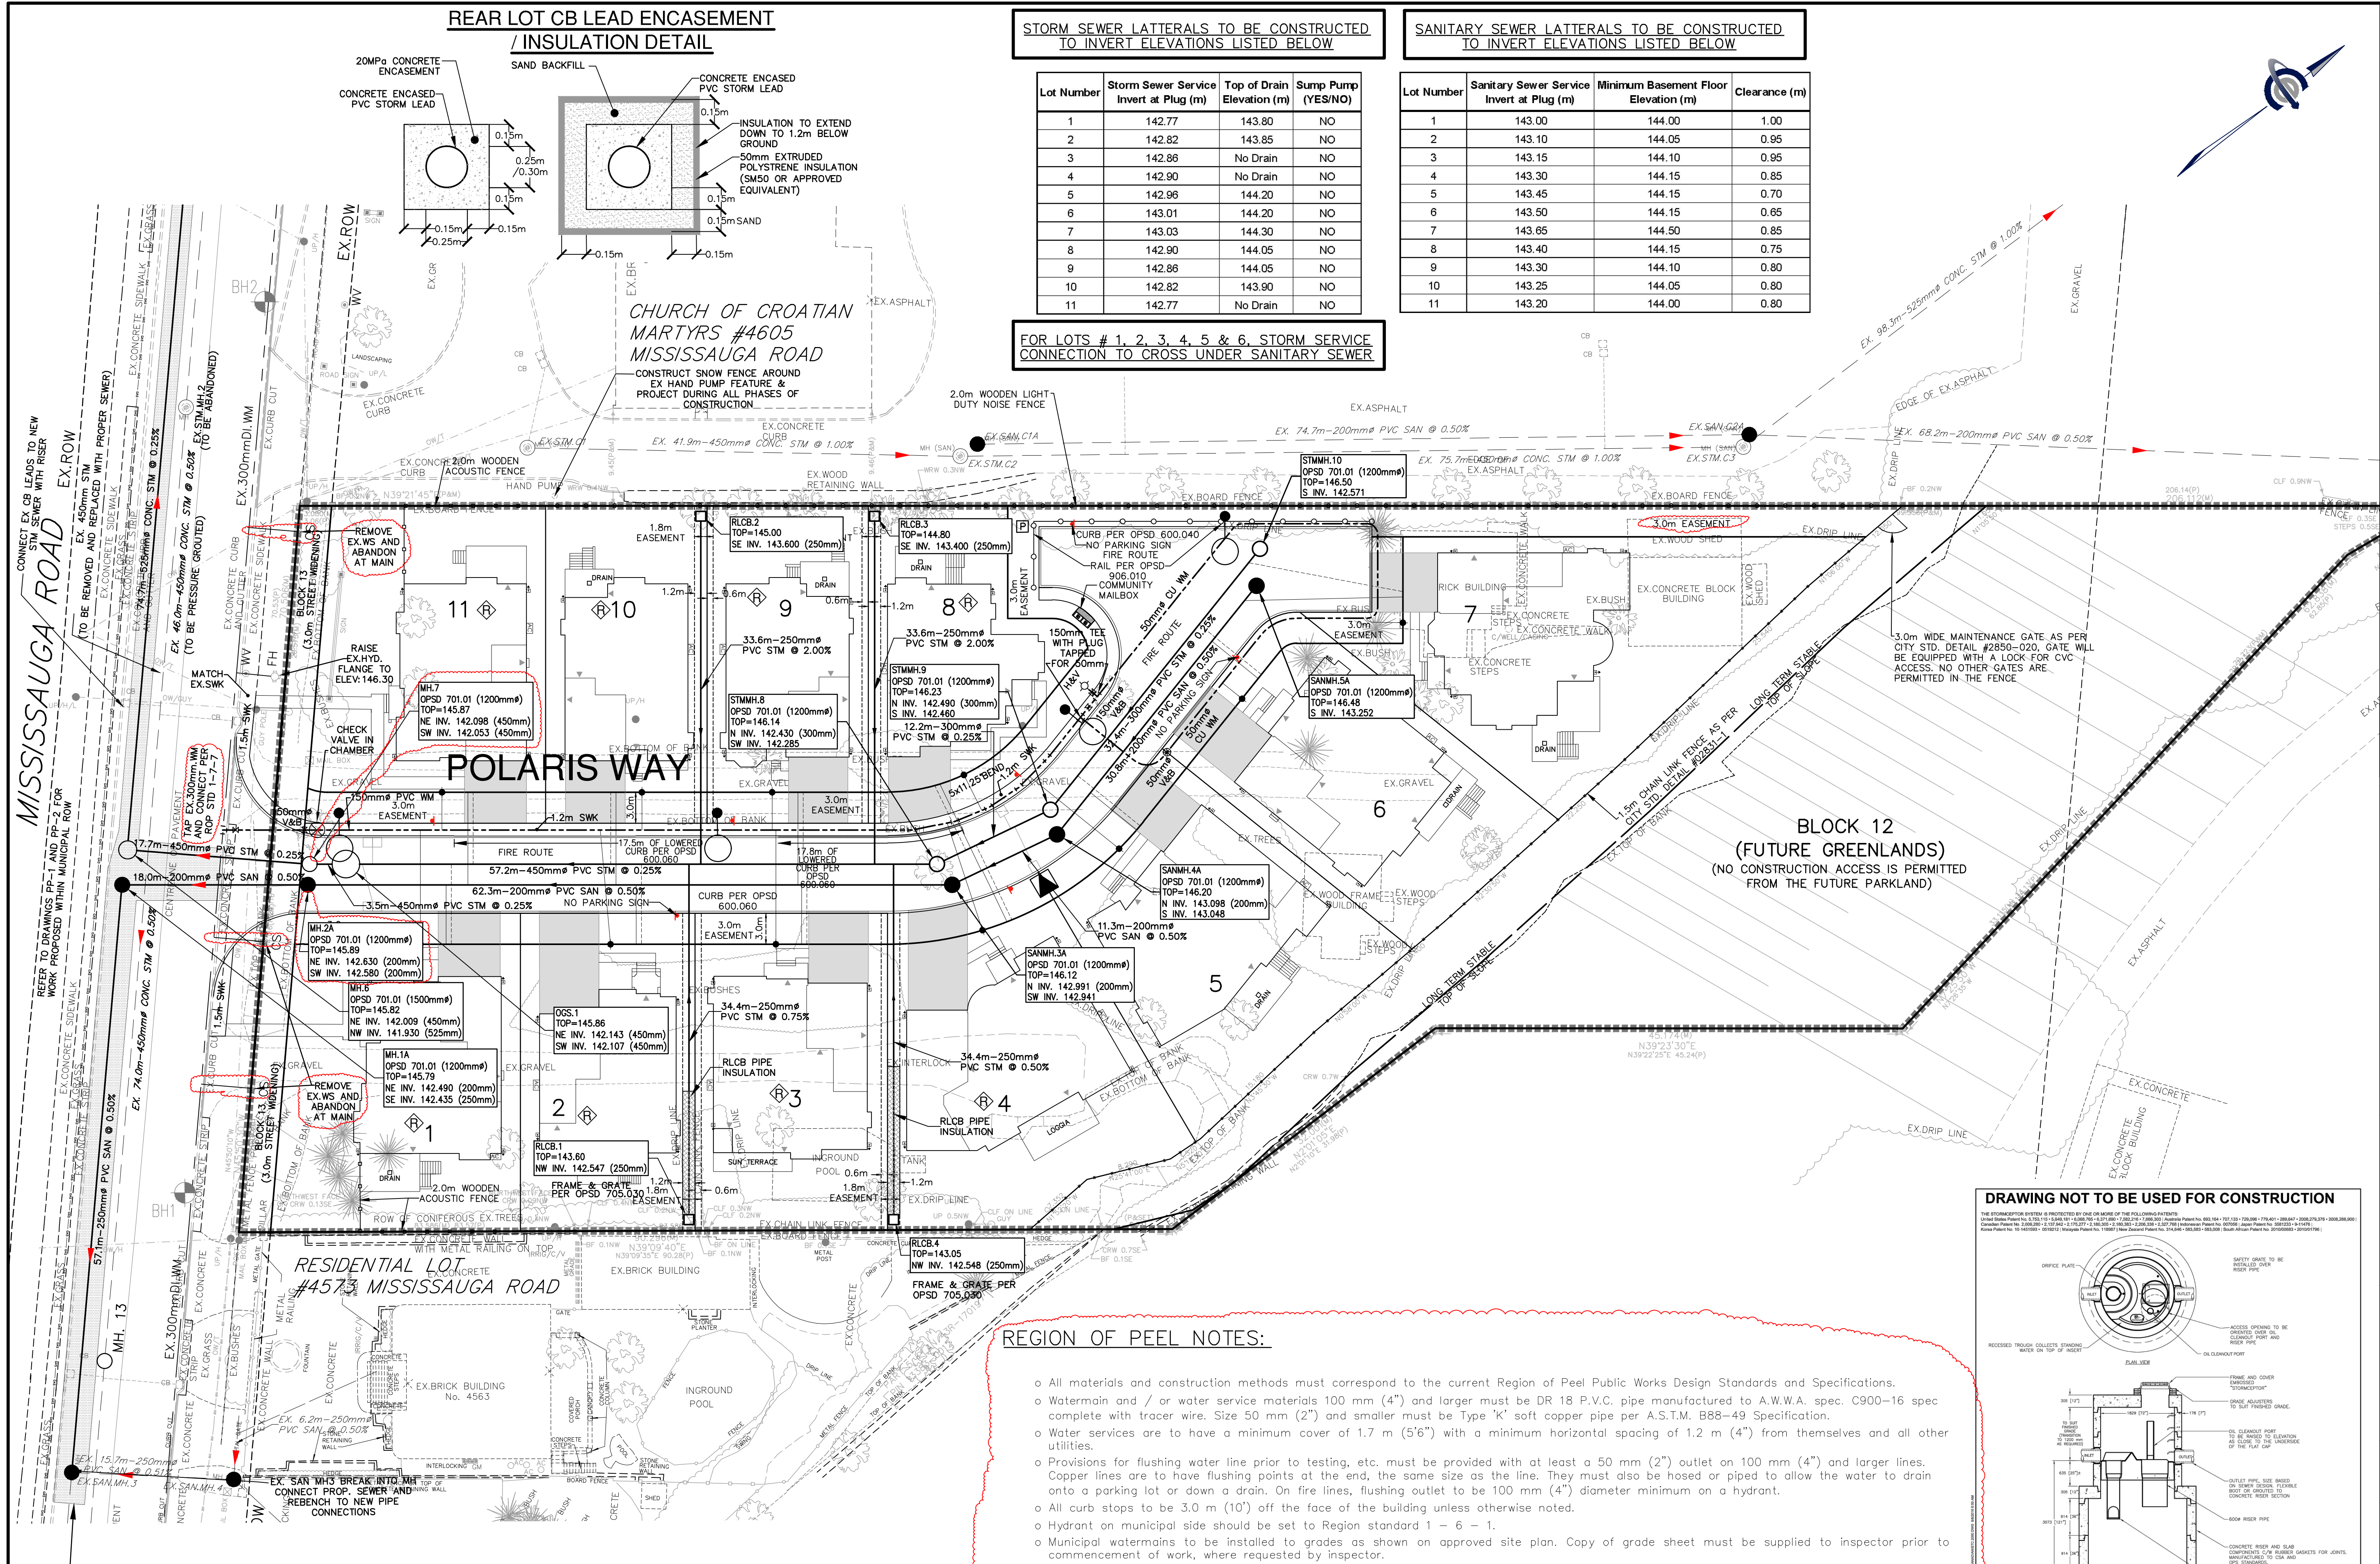


CONSTRUCTION AND ROAD RESTORATION COMPRISING:

- ALL ROAD EXCAVATIONS AND RESTORATIONS TO BE IN ACCORDANCE WITH CITY OF MISSISSAUGA STANDARD DRAWINGS # 2220.030; 2220.031 AND 2220.032

REGION OF PEEL NOTES:

- All materials and construction methods must correspond to the current Region of Peel Public Works Design Standards and Specifications.
- Watermain and / or water service materials 100 mm (4") and larger must be DR 18 P.V.C. pipe manufactured to A.W.W.A. spec. C900-16 spec complete with tracer wire. Size 50 mm (2") and smaller must be Type 'K' soft copper pipe per A.S.T.M. B88-49 Specification.
- Water services are to have a minimum cover of 1.7 m (5'6") with a minimum horizontal spacing of 1.2 m (4") from themselves and all other utilities.
- Provisions for flushing water line prior to testing, etc. must be provided with at least a 50 mm (2") outlet on 100 mm (4") and larger lines. Copper lines are to have flushing points at the end, the same size as the line. They must also be holed or piped to allow the water to drain onto a parking lot or down a drain. On fire lines, flushing outlet to be 100 mm (4") diameter minimum on a hydrant.
- All curb stops to be 3.0 m (10') off the face of the building unless otherwise noted.
- Hydrant on municipal side should be set to Region standard 1 - 6 - 1.
- Municipal watermain to be installed to grades as shown on approved site plan. Copy of grade sheet must be supplied to inspector prior to commencement of work, where requested by inspector.
- Watermain must have a minimum vertical clearance of 0.3m (12") over /0.5 m (20") under sewers and all other utilities when crossing and 2.5m horizontal clearance.
- All live tapping and operation of Region water valves shall be arranged through the Regional Inspector assigned or by contacting the Operations and Maintenance Division.
- The contractor(s) shall be solely responsible for locating, exposing, supporting and protecting of all underground and overhead utilities and structures existing at the time of construction in the area of their work whether shown on the plans or not and for all repairs and consequences resulting from damage to same.
- The contractor(s) shall be solely responsible to give 72 hours written notice to the utilities prior to crossing such utilities, for the purpose of inspection by the concerned utility. This inspection will be for the duration of the construction, with the contractor responsible for all costs arising from such inspection.
- All proposed water piping must be isolated through a temporary connection that shall include an appropriate cross-connection control device, consistent with the degree of hazard, for backflow prevention of the active distribution system, conforming to Region of Peel standards 1-7-7 or 1-7-8.
- All water services to be 25mm, water meters 19mm.

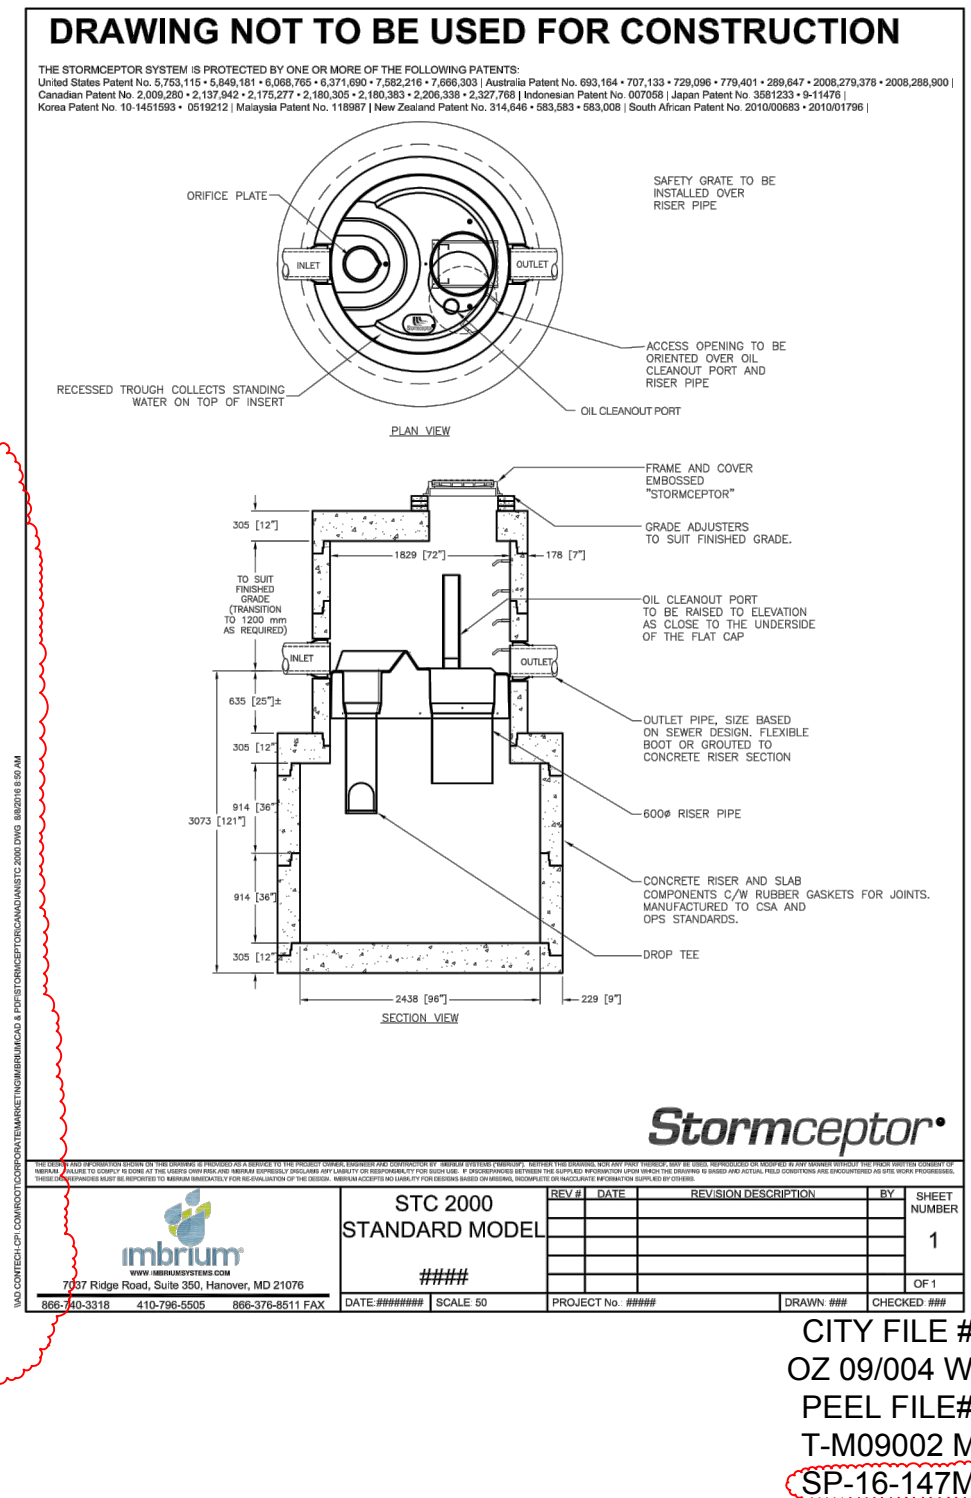

KEY PLAN
N.T.S.

LEGEND

- PROPOSED STORM MANHOLE
- PROPOSED SANITARY MANHOLE
- PROPOSED CATCH BASIN
- PROPOSED DOUBLE CATCH BASIN
- PROPOSED VALVE & BOX
- PROPOSED VALVE & BOX
- EXISTING STORM MANHOLE
- EXISTING SANITARY MANHOLE
- EXISTING CATCH BASIN
- EXISTING VALVE & CHAMBER
- EXISTING HYDRANT & VALVE
- PROPOSED LOT NUMBERS
- PROPOSED 2.0m HIGH WOODEN ACUSTIC FENCE
- PROPOSED 2.0m HIGH WOODEN LIGHT DUTY NOISE FENCE
- PROPOSED 1.5m HIGH CHAIN LINK FENCE
- PROPERTY LINE
- PERVIOUS STABLE SURFACES- PERMEABLE PAVERS
- DOOR LOCATION
- STREETLIGHT
- HYDRO TRANSFORMERS
- PROPOSED DOWNSPOUT LOCATION

EXISTING SERVICING INFORMATION FOR MISSISSAUGA ROAD AND THORNY BRAE PLACE WAS OBTAINED FROM MUNICIPAL RECORD DRAWINGS: C-33221, C-33222, C-9829, 1156-D, 7235-D

EXISTING SERVICING AND UTILITIES INFORMATION SHOWN ON THIS DRAWING IS NOT TO BE RELIED ON. THE CONTRACTOR TO VERIFY INVERT ELEVATION AND LOCATION OF ALL UNDERGROUND SERVICES AND UTILITIES PRIOR TO COMMENCING WORK.

LIST OF DRAWINGS

SG-01 (SITE GRADING PLAN)	
SS-01 (SITE SERVICING PLAN)	
ST-01 (STORM DRAINAGE PLAN)	
SA-01 (SANITARY DRAINAGE PLAN)	
EC-01 (EROSION CONTROL PLAN)	
DD-01 (GENERAL NOTES)	
DD-02 (DETAIL DRAWINGS)	
DD-03 (CROSS SECTIONS)	

SITE PLAN INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

SURVEY INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

BENCHMARK

ELEVATIONS SHOWN HEREON ARE REFERRED TO CITY OF MISSISSAUGA BENCHMARK No. 870, HAVING A PUBLISHED ELEVATION OF 148.702 METRES.

11. REVISED PER REGION COMMENTS	OCT. 19, 2018	S.G.
10. ISSUED FOR SPA #4	SEPT. 5, 2018	S.G.
9. ISSUED FOR SPA #3	APR. 27, 2018	S.G.
8. ISSUED FOR SPA #2	JULY 27, 2017	S.G.
7. SPA #2	JULY 04, 2017	S.G.
6. REVISED FOR CVC & CITY COMMENTS	MAY 8, 2017	S.G.
5. ISSUED FOR SITE PLAN APPROVAL	SEPT. 30, 2016	S.G.
4. PER REGION AND CITY COMMENTS	AUG. 12, 2016	S.G.
3. PER CVC COMMENTS	JUNE 13, 2016	S.G.
2. FIRST ENGINEERING SUBMISSION	APR. 26, 2016	S.G.
NO. REVISION	DATE	BY

Region of Peel
working with you

MISSISSAUGA
2462357 ONTARIO INC. (PACE DEVELOPMENTS)
THE ARCHWAYS
4583, 4589, 4601 MISSISSAUGA ROAD,
MISSISSAUGA, ON
SITE SERVICING PLAN



COLE ENGINEERING
2015-2016 MISSISSAUGA ROAD, MISSISSAUGA, ON
L4X 1L9
TEL: (905) 876-1111
WWW.COLEENGINEERING.COM

DESIGNED BY: P.F.
DRAWN BY: P.F.
SCALE: 1:300

DATE: OCTOBER 2015
PROJECT No. UD15-0347

CHECKED BY: S.G.
APPROVED BY: S.G.
DRAWING No. SS-01

CITY FILE #
OZ 09/004 W8
PEEL FILE #
T-M09002 M
(SP-16-147M)

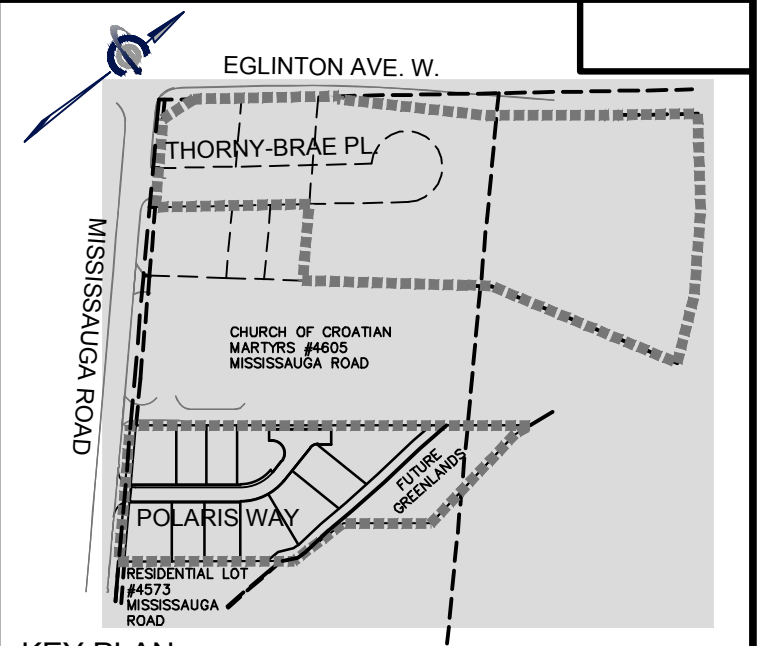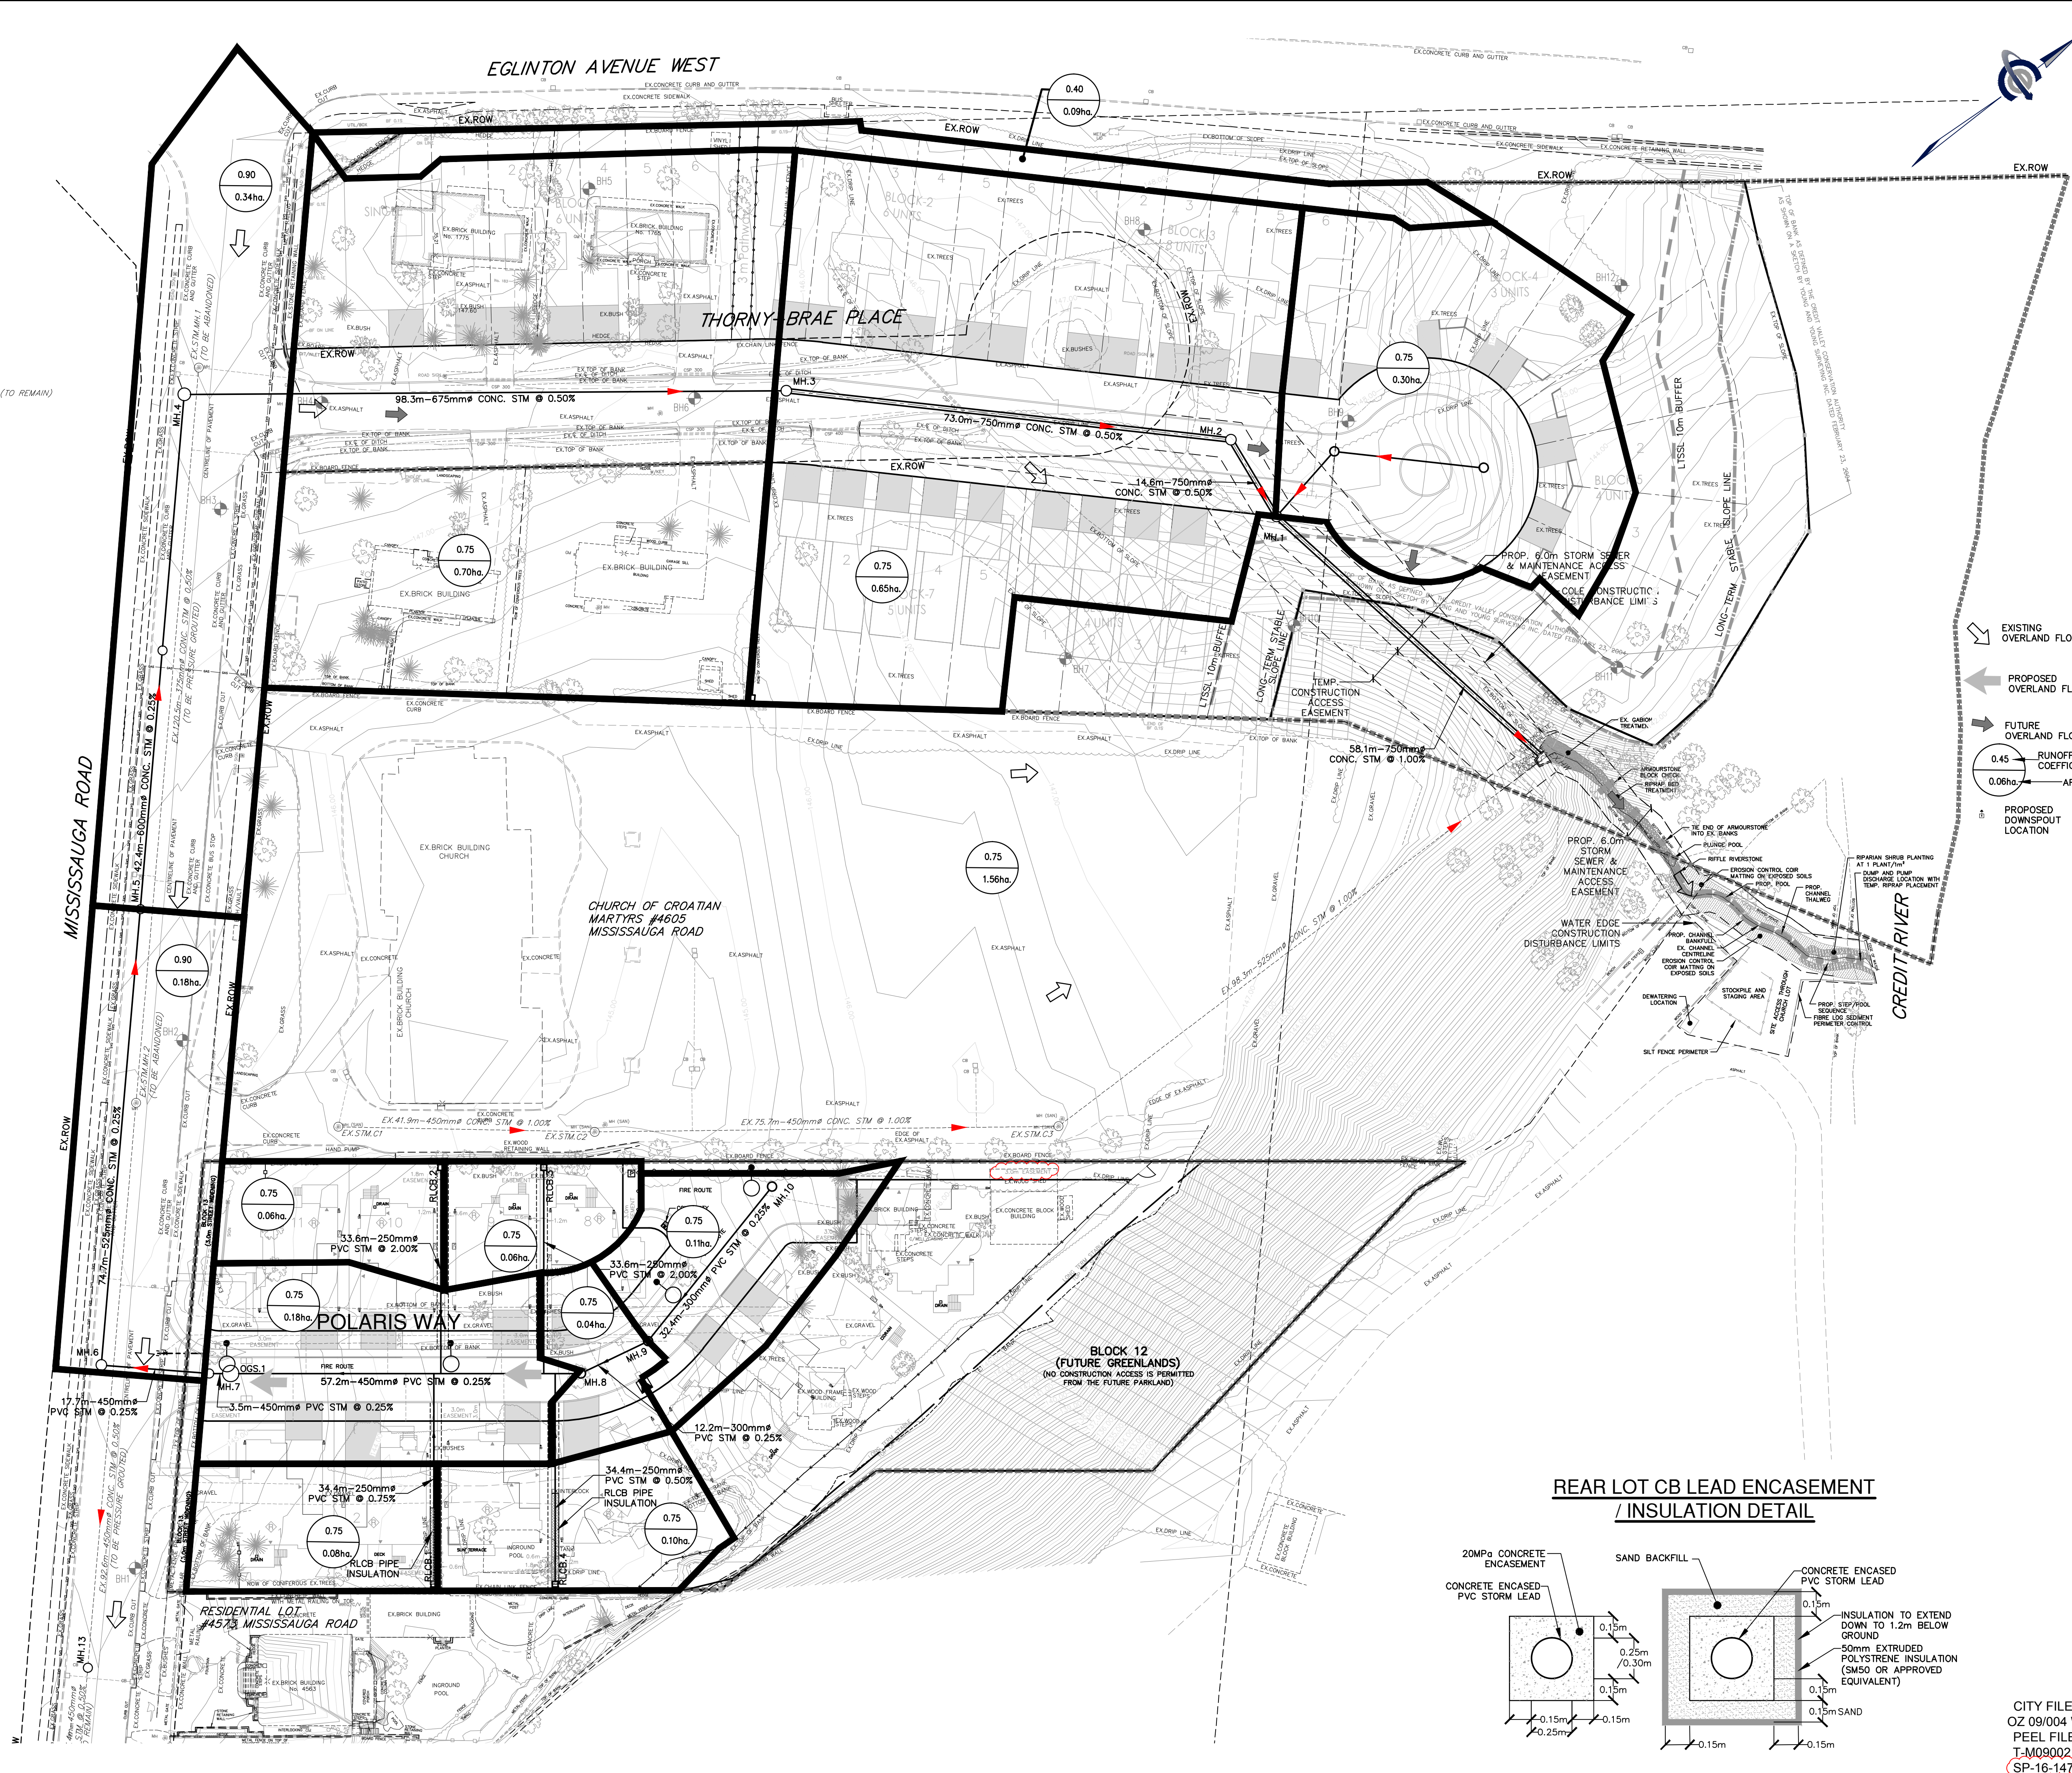

- LEGEND**
- PROPOSED STORM MANHOLE
 - PROPOSED SANITARY MANHOLE
 - PROPOSED DOUBLE CATCH BASIN
 - PROPOSED VALVE & BOX
 - PROPOSED HYDRANT & VALVE
 - EXISTING STORM MANHOLE
 - EXISTING SANITARY MANHOLE
 - EXISTING CATCHBASIN
 - EXISTING VALVE & CHAMBER
 - EXISTING HYDRANT & VALVE
 - PROPOSED LOT NUMBERS
 - PROPOSED 2.0m HIGH WOODEN ACUSTIC FENCE
 - PROPOSED 2.0m HIGH WOODEN LIGHT DUTY NOISE FENCE
 - PROPOSED 1.5m HIGH CHAIN LINK FENCE
 - PROPERTY LINE
 - PERVIOUS STABLE SURFACES- PERMEABLE PAVERS
 - REAR DOWNSPOUTS TO CONNECT TO INFILTRATION TRENCH
 - DRAINAGE AREA BOUNDARY

EXISTING SERVING INFORMATION FOR MISSISSAUGA ROAD AND THORNY BRAE PLACE WAS OBTAINED FROM MUNICIPAL RECORD DRAWINGS: C-3321, C-3322, C-98829, 1156-D, 7235-D. EXISTING SERVING AND UTILITIES INFORMATION SHOWN ON THIS DRAWING IS NOT TO BE RELIED ON. THE CONTRACTOR TO VERIFY INVERT ELEVATION AND LOCATION OF ALL UNDERGROUND SERVICES AND UTILITIES PRIOR TO COMMENCING WORK.

- LIST OF DRAWINGS**
- SG-01 (SITE GRADING PLAN)
 - SS-01 (SITE SERVING PLAN)
 - ST-01 (STORM DRAINAGE PLAN)
 - SA-01 (SANITARY DRAINAGE PLAN)
 - EC-01 (EROSION CONTROL PLAN)
 - DD-01 GENERAL NOTES
 - DD-02 DETAIL DRAWINGS
 - DD-03 CROSS SECTIONS

SITE PLAN INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101


SURVEY INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

BENCHMARK

ELEVATIONS SHOWN HEREON ARE REFERRED TO
CITY OF MISSISSAUGA BENCHMARK No. 970,
HAVING A PUBLISHED ELEVATION OF 148.702 METRES.

11. REVISED PER REGION COMMENTS	OCT. 19, 2018	S.G.
10. ISSUED FOR SPA #4	SEPT. 5, 2018	S.G.
9. ISSUED FOR SPA #3	APR. 27, 2018	S.G.
8. ISSUED FOR SPA #2	JULY 27, 2017	S.G.
7. SPA #2	JULY 04, 2017	S.G.
6. REVISED FOR CVC & CITY COMMENTS	MAY 8, 2017	S.G.
5. ISSUED FOR SITE PLAN APPROVAL	SEPT. 30, 2016	S.G.
4. PER REGION AND CITY COMMENTS	AUG 12, 2016	S.G.
3. PER CVC COMMENTS	JUNE 13, 2016	S.G.
2. FIRST ENGINEERING SUBMISSION	APR 26, 2016	S.G.
NO.	REVISION	DATE

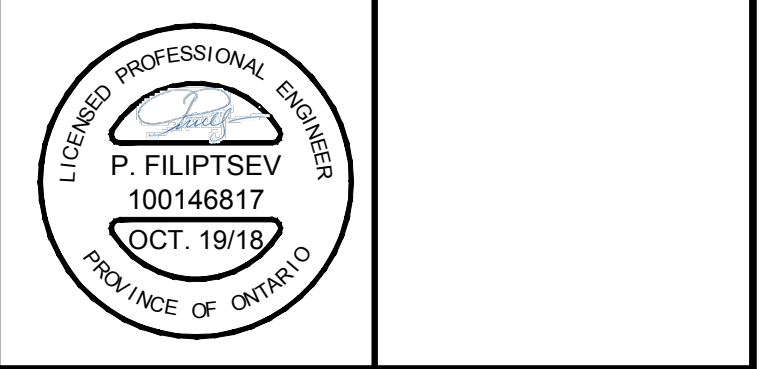

Region of Peel
working with you


MISSISSAUGA
2462357 ONTARIO INC. (PACE DEVELOPMENTS)
THE ARCHWAYS
4583, 4589, 4601 MISSISSAUGA ROAD,
MISSISSAUGA, ON

STORM DRAINAGE PLAN


COLE ENGINEERING
75 VALLEYVIEW DRIVE, MARKHAM, ON L3R 4T5
TEL: (905) 479-0800 EXT. 1000 FAX: (905) 479-0800

DESIGNED BY: P.F.	DATE: OCTOBER 2015	CHECKED BY: S.G.
DRAWN BY: P.F.	PROJECT No.	APPROVED BY: S.G.
SCALE: 1:500	UD15-0347	DRAWING No.
© COPYRIGHT 2015 Cole Engineering Group Ltd.		ST-01

REAR LOT CB LEAD ENCASEMENT / INSULATION DETAIL

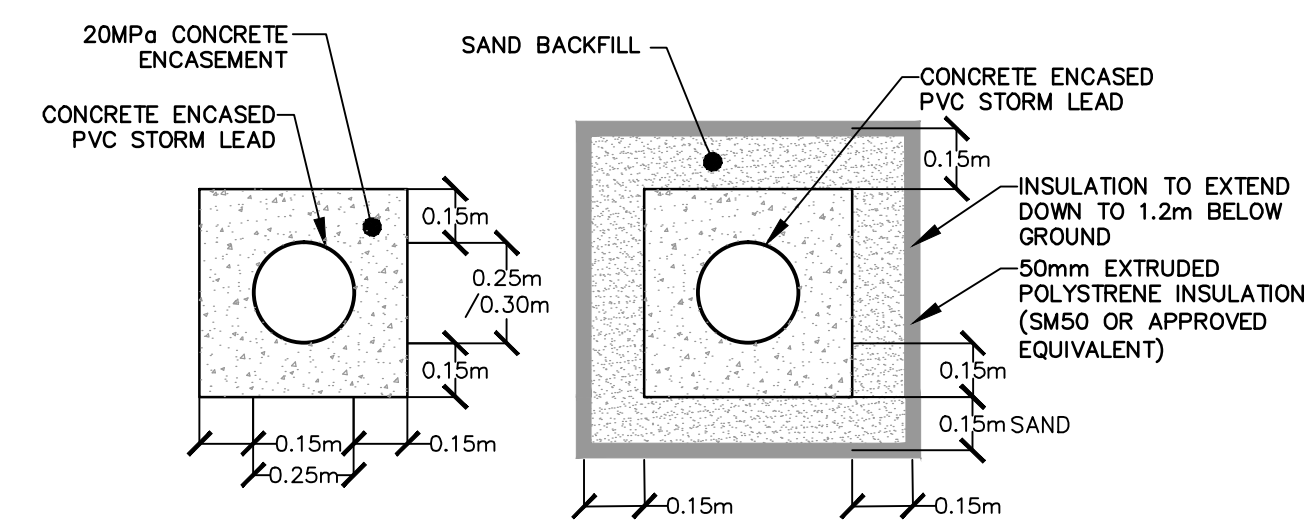

CITY FILE #
OZ 09/004 W8
PEEL FILE #
T-M09002.M
SP-16-147M

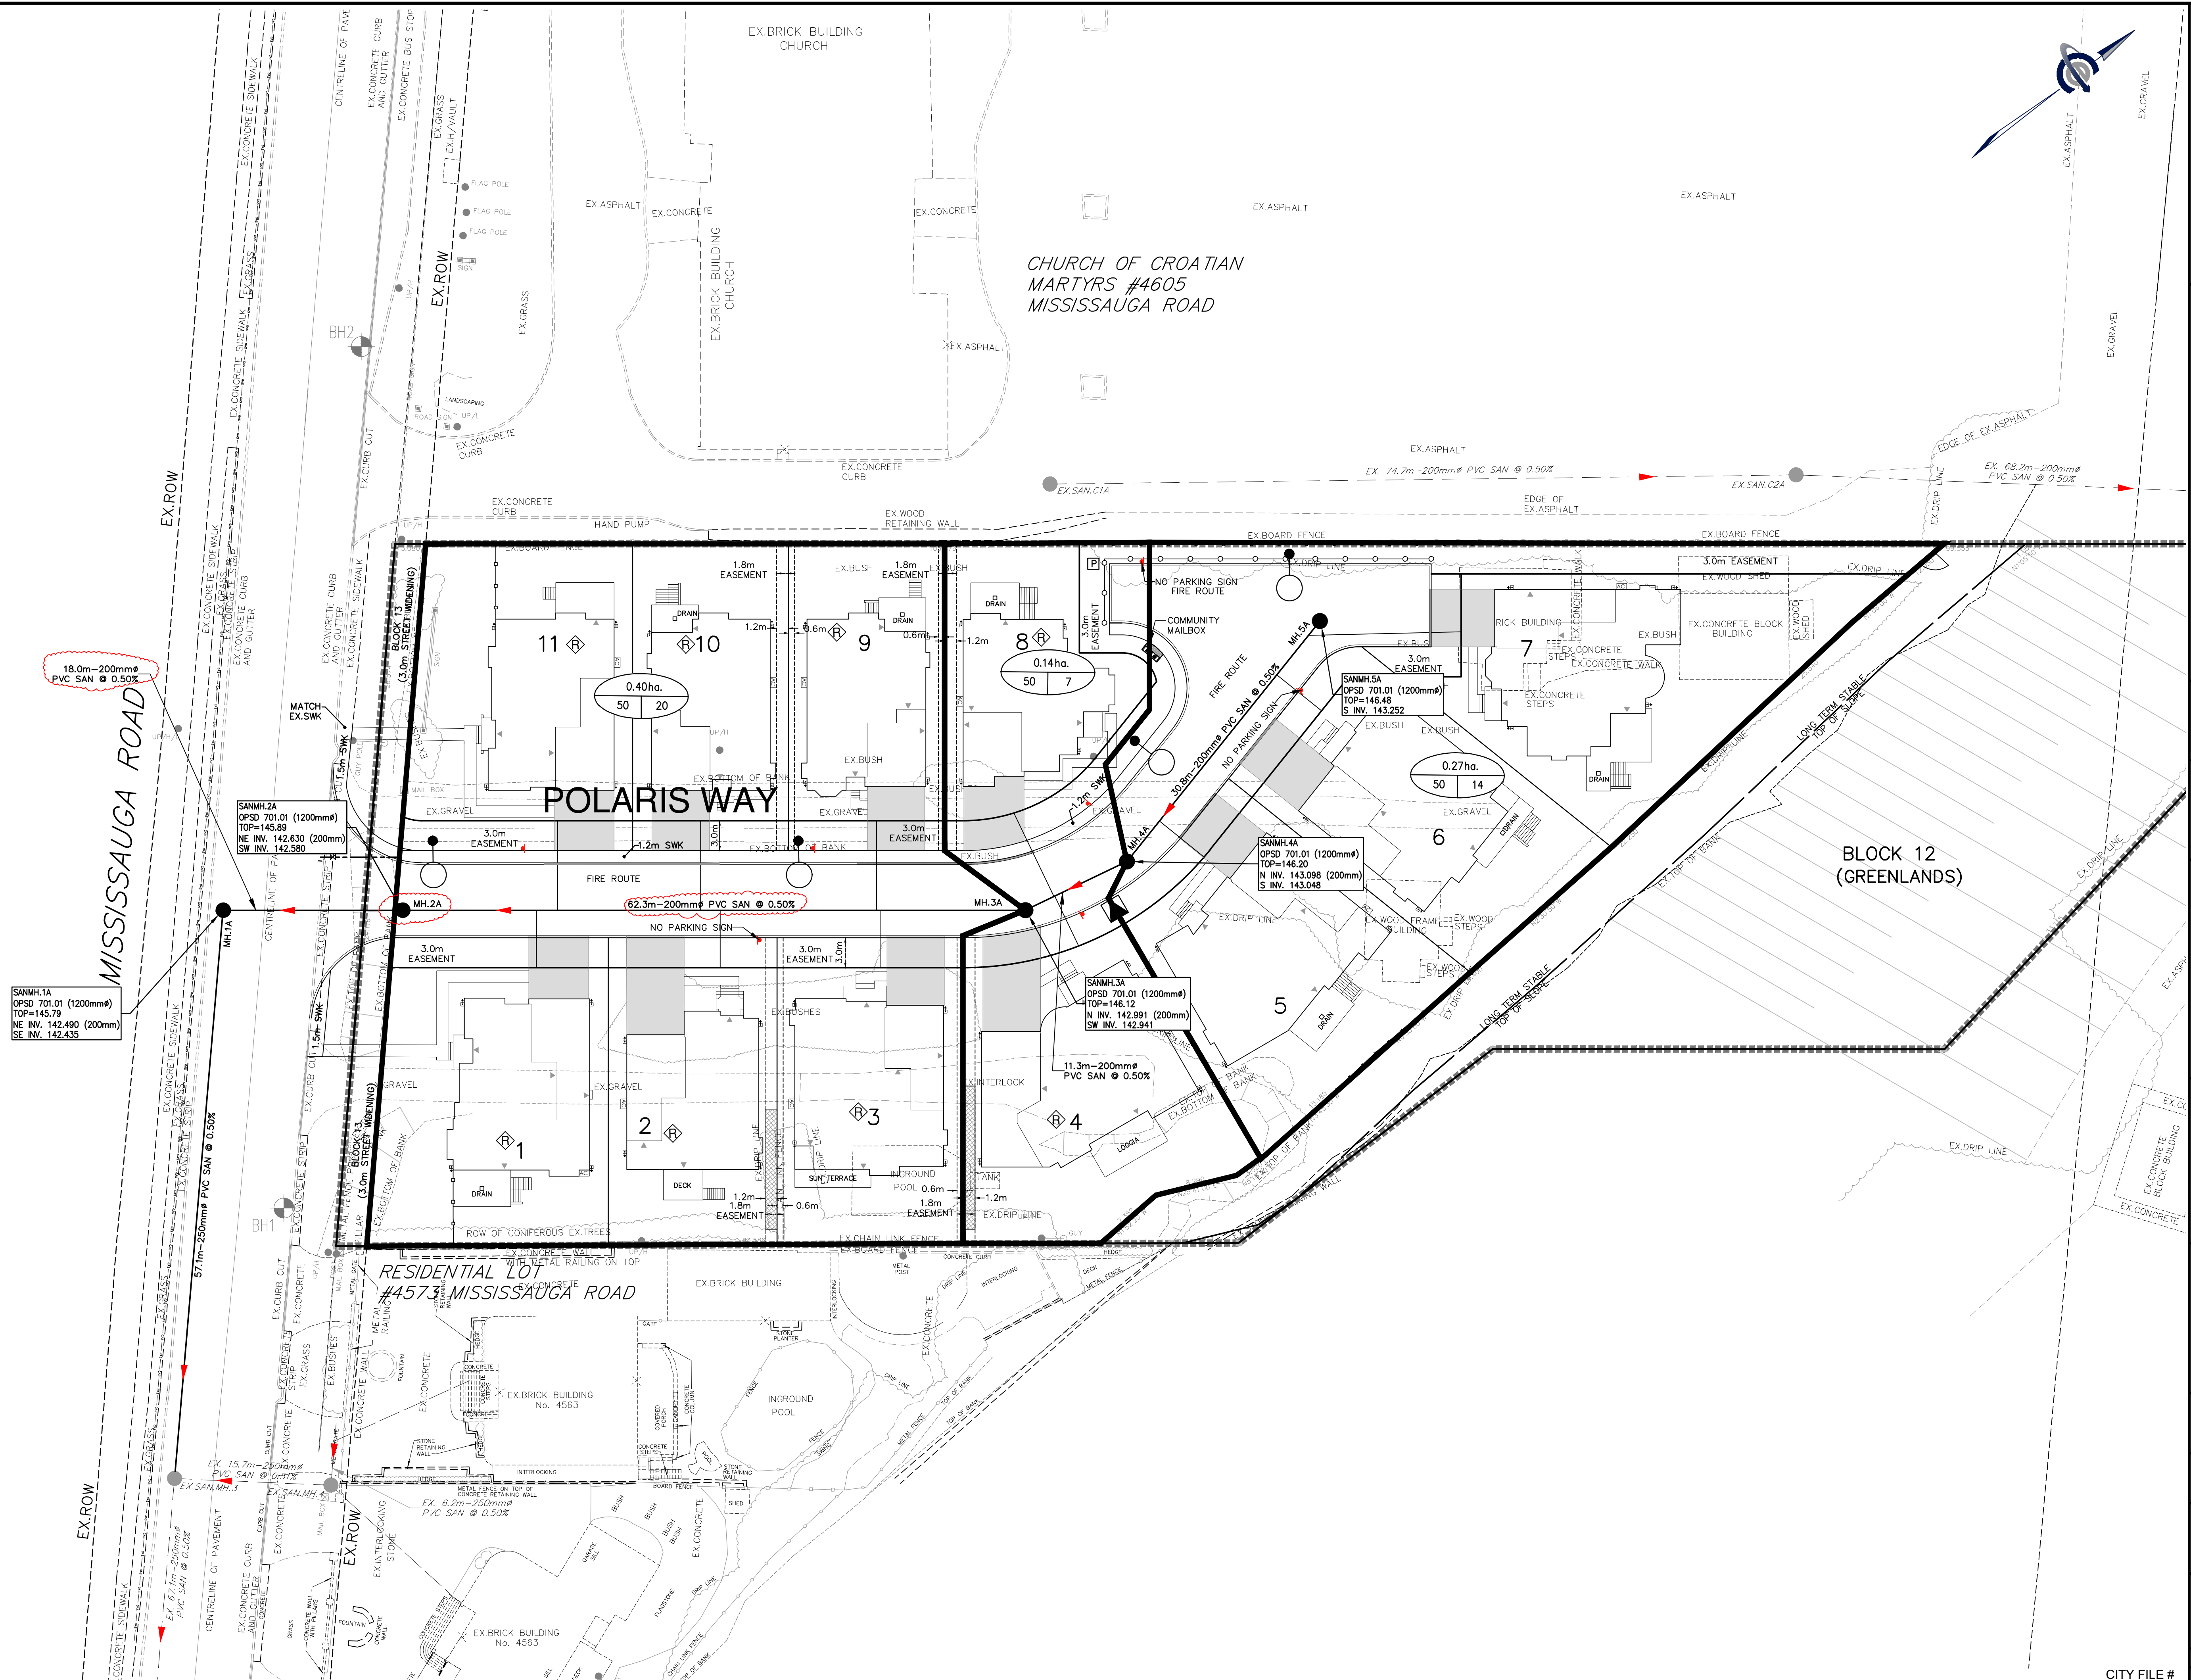

KEY PLAN
N.T.S.

LEGEND

- PROPOSED STORM MANHOLE
- PROPOSED SANITARY MANHOLE
- PROPOSED CATCH BASIN
- PROPOSED DOUBLE CATCH BASIN
- PROPOSED VALVE & BOX
- PROPOSED HYDRANT & VALVE
- EXISTING STORM MANHOLE
- EXISTING SANITARY MANHOLE
- EXISTING CATCHBASIN
- EXISTING VALVE & CHAMBER
- EXISTING HYDRANT & VALVE
- PROPOSED LOT NUMBERS
- PROPOSED 2.0m HIGH ACOUSTIC FENCE
- PROPOSED 2.0m HIGH LIGHT DUTY ACOUSTIC FENCE
- PROPERTY LINE
- DRIVEWAY WITH PERMEABLE PAVERS
- DRAINAGE AREA BOUNDARY
- PROPOSED DOWNSPOUT LOCATION

135

0.40ha. AREA

POPULATION (PERSON per Ha)

50	20
----	----

POPULATION (PERSON)

EXISTING SERVICING INFORMATION FOR MISSISSAUGA ROAD AND THORNY BRAE PLACE WAS OBTAINED FROM MUNICIPAL RECORD DRAWINGS: C-33221, C-33222, C-98828, 1156-D, 7235-D. EXISTING SERVICING AND UTILITIES INFORMATION SHOWN ON THIS DRAWING IS NOT TO BE RELIED ON. THE CONTRACTOR TO VERIFY INVERT ELEVATION AND LOCATION OF ALL UNDERGROUND SERVICES AND UTILITIES PRIOR TO COMMENCING WORK.

LIST OF DRAWINGS

SG-01 (SITE GRADING PLAN)	SS-01 (SITE SERVING PLAN)
ST-01 (STORM DRAINAGE PLAN)	SA-01 (SANITARY DRAINAGE PLAN)
EC-01 (EROSION CONTROL PLAN)	DD-01 (GENERAL NOTES)
DD-02 (DETAIL DRAWINGS)	DD-03 (CROSS SECTIONS)

SITE PLAN INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

SURVEY INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

BENCHMARK

ELEVATIONS SHOWN HEREON ARE REFERRED TO
CITY OF MISSISSAUGA BENCHMARK No. 970,
HAVING A PUBLISHED ELEVATION OF 148.702 METRES.

NO.	REVISION	DATE	BY
11.	REVISED PER REGION COMMENTS	OCT. 19, 2018	S.G.
10.	ISSUED FOR SPA #4	SEPT. 5, 2018	S.G.
9.	ISSUED FOR SPA #3	APR. 27, 2018	S.G.
8.	ISSUED FOR SPA #2	JULY 27, 2017	S.G.
7.	SPA #2	JULY 04, 2017	S.G.
6.	REVISED FOR CVC & CITY COMMENTS	MAY 8, 2017	S.G.
5.	ISSUED FOR SITE PLAN APPROVAL	SEPT. 30, 2016	S.G.
4.	PER REGION AND CITY COMMENTS	AUG 12, 2016	S.G.
3.	PER CVC COMMENTS	JUNE 13, 2016	S.G.
2.	FIRST ENGINEERING SUBMISSION	APR 26, 2016	S.G.

PROFESSIONAL ENGINEER
P. FILIPSEV
100146817
OCT. 19/18
PROVINCE OF ONTARIO

Region of Peel
working with you

Mississauga
2462357 ONTARIO INC. (PACE DEVELOPMENTS)
THE ARCHWAYS
4583, 4589, 4601 MISSISSAUGA ROAD,
MISSISSAUGA, ON

SANITARY DRAINAGE PLAN


COLE ENGINEERING
70 VALLEYWOOD DRIVE, MARKHAM, ON L3R 4T5
TEL: (905) 477-0800 FAX: (905) 477-0808

DESIGNED BY: P.F. **DATE: OCTOBER 2015** **CHECKED BY: S.G.**


DRAWN BY: P.F. **PROJECT No.** **APPROVED BY: S.G.**

SCALE: 1:300 **UD15-0347** **DRAWING No. SA-01**


CITY FILE # OZ 09/004 W8
PEEL FILE # T-M09002 M
SP-16-147M

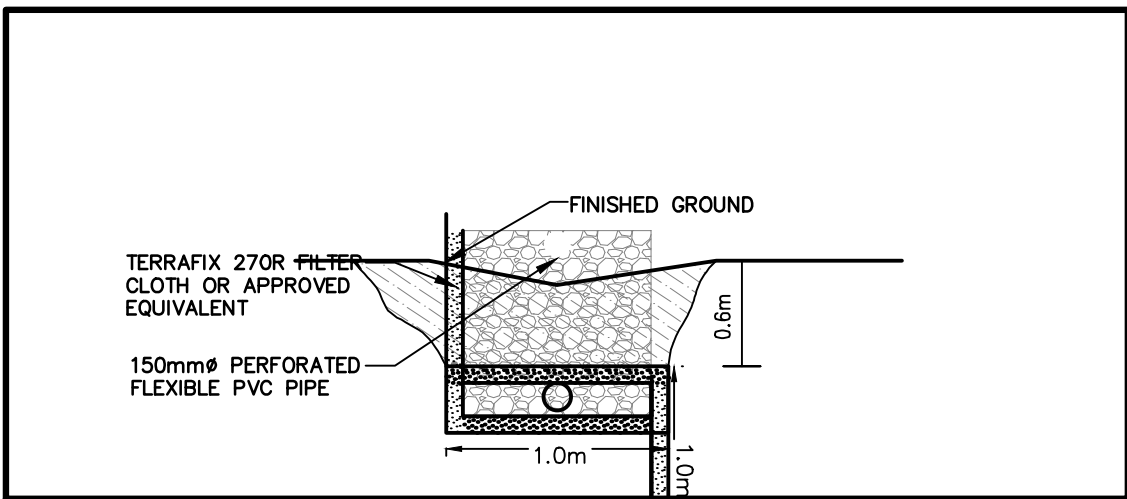




INFILTRATION TRENCH DETAIL
N.T.S.

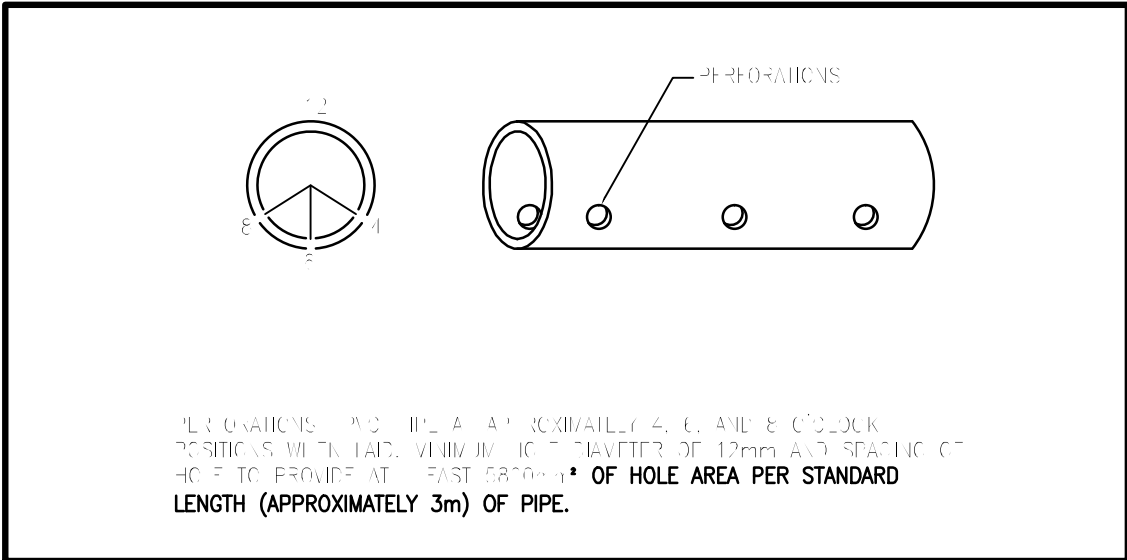

PERFORATED PIPE DETAIL
N.T.S.

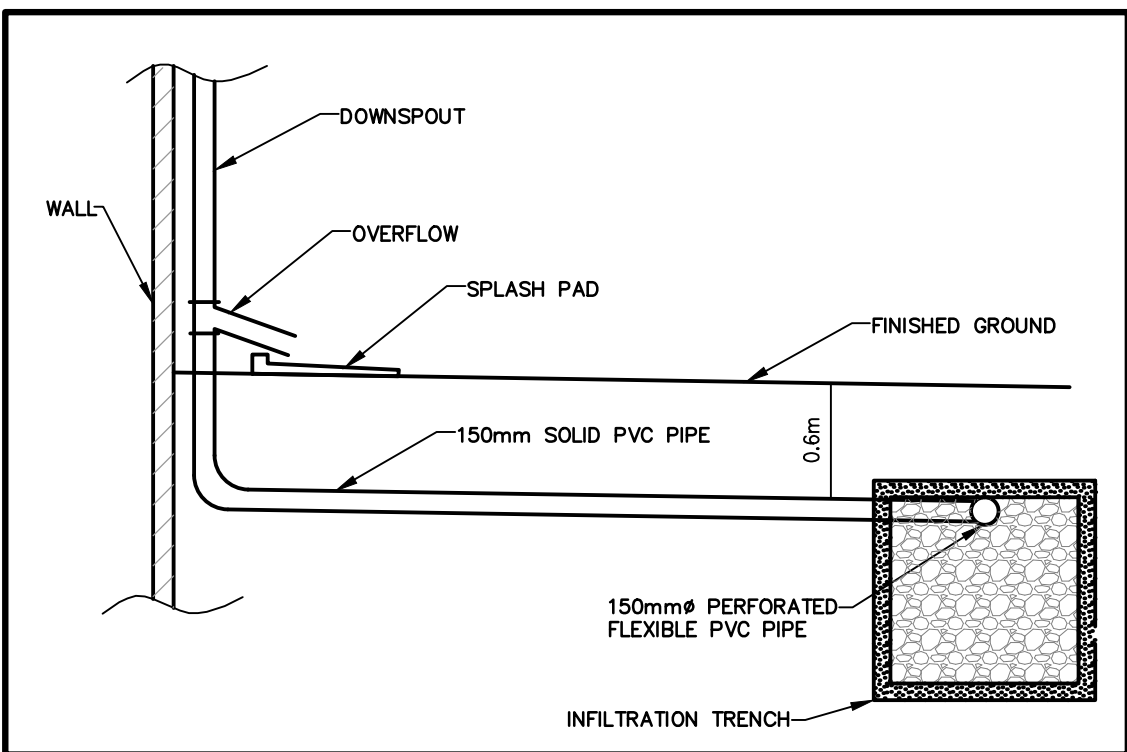

REAR DOWNSPOUT CONNECTION TO TRENCH DETAIL
N.T.S.

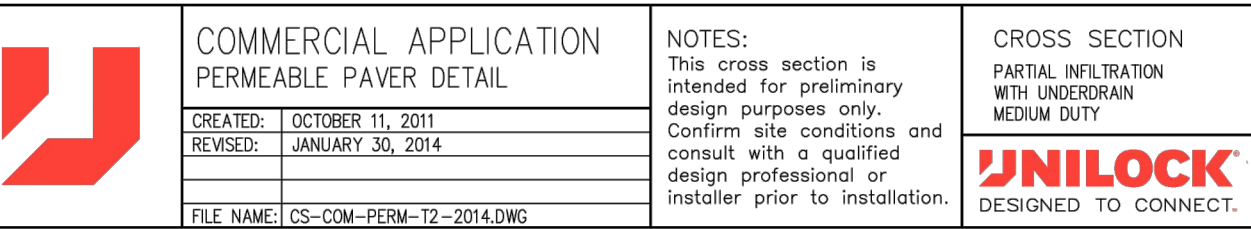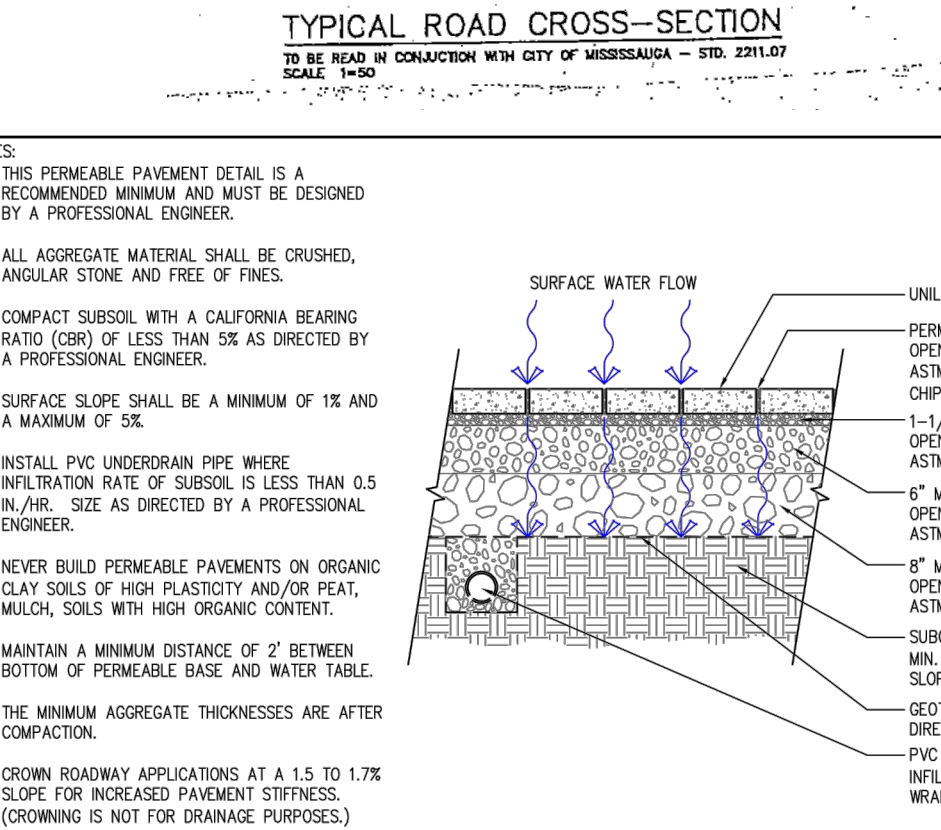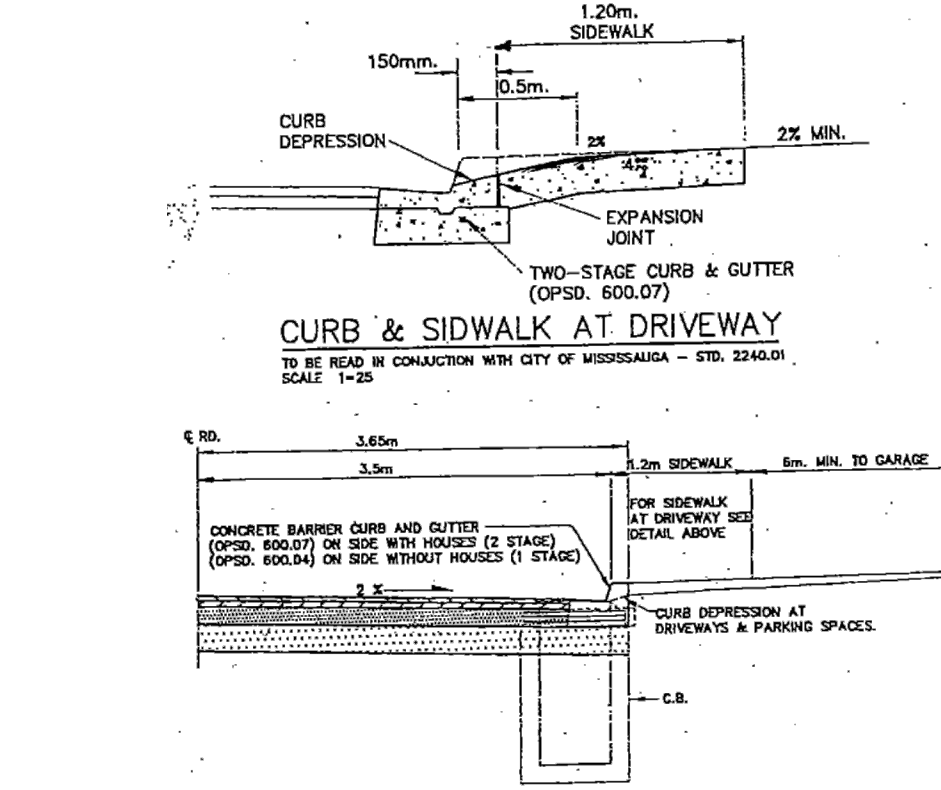

PERMEABLE PAVER DETAIL
N.T.S.

GRADING:


- PRIOR TO COMMENCEMENT OF GRADING WORKS ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE INSTALLED AND OPERATIONAL. THE CONTRACTOR SHALL MAINTAIN ALL WORKS UNTIL SERVICING CONSTRUCTION IS COMPLETED TO THE SATISFACTION OF THE ENGINEER AND THE CITY OF MISSISSAUGA.
- ALL GRANULAR BASE AND SUB-BASE COURSE MATERIALS SHALL BE COMPACTED TO 100% STANDARD PROCTOR MAXIMUM DRY DENSITY.
- PAVEMENT STRUCTURE TO BE CONSTRUCTED, AS RECOMMENDED BY THE GEOTECHNICAL REPORT.
- CONCRETE BARRIER CURB SHALL BE AS PER (OPSD 600.110).
- INSPECTIONS: ALL WORK ON THE MUNICIPAL RIGHT-OF-WAY AND EASEMENTS TO BE INSPECTED BY THE MUNICIPALITY PRIOR TO BACKFILLING. ALL WORK RELATING TO WATERMAINS AND SEWERS TO BE INSPECTED BY THE MUNICIPALITY WHEN REQUIRED BY THE MUNICIPALITY.
- CONTRACTOR TO OBTAIN A ROAD OCCUPANCY PERMIT 48 HOURS PRIOR TO COMMENCING ANY WORK WITHIN THE MUNICIPAL ROAD ALLOWANCE IF REQUIRED BY THE MUNICIPALITY OR THE REGION.
- EMBANKMENTS TO BE SLOPED AT MAX. 3:1, UNLESS OTHERWISE SPECIFIED.
- SEDIMENT CONTROL TO BE PROVIDED AT CATCH BASINS AND CATCH BASIN MANHOLES UPON INSTALLATION OF STRUCTURES AS PER DETAIL PROVIDED.
- CONTRACTOR WILL BE RESPONSIBLE FOR ALL REMOVALS AS REQUIRED TO FACILITATE NEW CONSTRUCTION. ALL EXISTING STRUCTURES, VALVES, ETC. ARE TO BE ADJUSTED TO PROPOSED ELEVATIONS.
- EXISTING ELEVATIONS AT MATCH POINTS, AS SHOWN ON PLANS, ARE TO BE CONFIRMED BY THE CONTRACTOR 72 HOURS PRIOR TO MOBILIZATION OF FORCES. LOST TIME AND/OR ANY ADDITIONAL WORKS DUE TO FAILURE OF THE CONTRACTOR TO CONFIRM EXISTING ELEVATIONS AND NOTIFY THE ENGINEER OF POSSIBLE CONFLICTS 72 HOURS PRIOR TO MOBILIZATION WILL BE AT THE EXPENSE OF THE CONTRACTOR.

EROSION:

- ALL SEEDING TO BE COMPLETED AS PER THE RECOMMENDATIONS OF THE LANDSCAPE ARCHITECT.
- ALL DISTURBED AREAS TO BE STABILIZED WITH SEED AS SOON AS CONSTRUCTION ACTIVITY IS COMPLETED.
- ALL EROSION AND SEDIMENT CONTROL MEASURES SHALL BE CHECKED AND MAINTAINED ON A REGULAR BASIS. INSPECTION OF SUCH MEASURES SHALL BE COMPLETED AFTER EVERY RAINFALL.
- ADDITIONAL SILT FENCING SHALL BE AVAILABLE IN CASE IMMEDIATE REPAIR IS REQUIRED.
- ALL EROSION AND SEDIMENT CONTROL MEASURES TO BE INSTALLED PRIOR TO ANY GROUND DISTURBANCE ACTIVITIES.

REGION OF PEEL NOTES:

- ALL MATERIALS AND CONSTRUCTION METHODS MUST CORRESPOND TO THE CURRENT PEEL PUBLIC WORKS STANDARDS AND SPECIFICATIONS.
- WATERMAINS AND / OR WATER SERVICE MATERIALS 100mm (4") AND LARGER MUST BE PVC CLASS 150, DR-18. SIZE 50mm (2") AND SMALLER COPPER TYPE "K".
- WATERMAINS AND / OR WATER SERVICES ARE TO HAVE A MINIMUM COVER OR 1.7m (5'6") WITH A MINIMUM HORIZONTAL SPACING OF 1.2m (4') FROM THEMSELVES AND ALL OTHER UTILITIES.
- PROVISIONS FOR FLUSHING WATER LINE PRIOR TO TESTING, ETC. MUST BE PROVIDED WITH AT LEAST A 50mm (2") OUTLET ON 100mm (4") AND LARGER LINES. COPPER LINES ARE TO HAVE FLUSHING POINTS AT THE END, THE SAME SIZE AS THE LINE. THEY MUST ALSO BE HOSED OR PIPED TO ALLOW THE WATER TO DRAIN ONTO A PARKING LOT OR DOWN A DRAIN. ON FIRE LINES, FLUSHING OUTLET TO BE 100mm (4") DIAMETER MINIMUM ON A HYDRANT.
- ALL CURB STOPS TO BE 3.0m (10') OFF THE FACE OF THE BUILDING UNLESS OTHERWISE NOTED.
- HYDRANT AND VALVE SET TO REGION STANDARD 1-6-1 DIMENSION A AND B, 0.7m (2') AND 0.9m (3') AND TO HAVE PUMPER NOZZLE.
- WATERMAINS TO BE INSTALLED TO GRADES AS SHOWN ON APPROVED SITE PLAN. COPY OF GRADING SHEET MUST BE SUPPLIED TO INSPECTOR PRIOR TO COMMENCEMENT OF WORK, WHERE REQUESTED BY INSPECTOR.
- WATERMAINS MUST HAVE A MINIMUM VERTICAL CLEARANCE OF 0.3m (12") OVER / 0.5m (20") UNDER SEWERS AND ALL OTHER UTILITIES WHEN CROSSING.
- ALL PROPOSED WATER PIPING MUST BE INSULATED FROM EXISTING LINES IN ORDER TO ALLOW INDEPENDENT PRESSURE TESTING AND CHLORINATING FROM THE EXISTING SYSTEMS.
- ALL LIVE TAPPING AND OPERATION OF REGION WATER VALVES SHALL BE ARRANGED THROUGH THE REGIONAL INSPECTOR ASSIGNED OR BY CONTACTING THE OPERATIONS AND MAINTENANCE DIVISION.

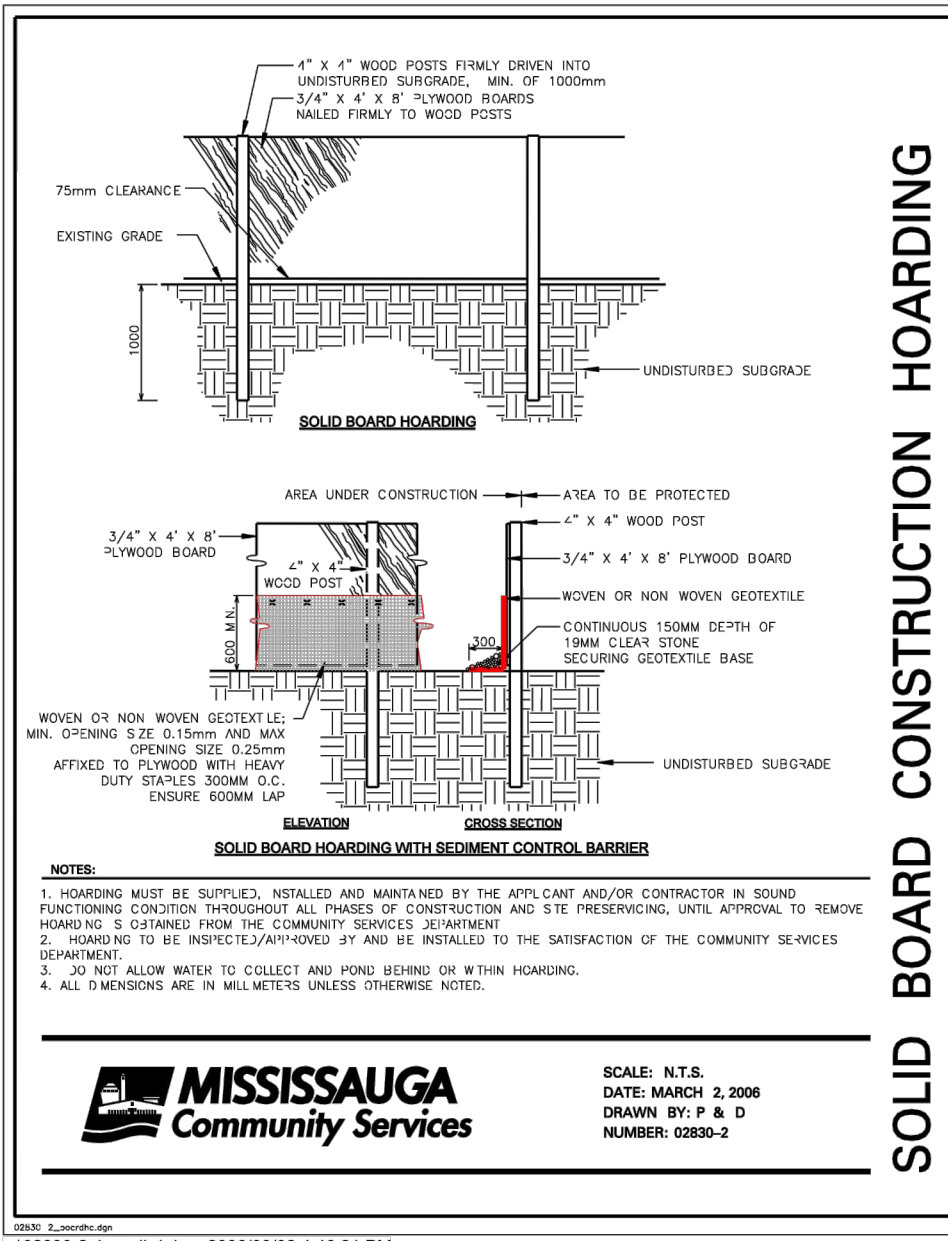

CITY OF MISSISSAUGA NOTES:

- AT THE ENTRANCES TO THE SITE, THE MUNICIPAL CURB AND SIDEWALK WILL BE CONTINUOUS THROUGH THE DRIVEWAY AND A CURB DEPRESSION WILL BE PROVIDED FOR EACH ENTRANCE.
- ALL PROPOSED CURBING WITHIN THE MUNICIPAL BOULEVARD AREA FOR THE SITE IS TO SUIT AS FOLLOWS: A) FOR ALL SINGLE FAMILY RESIDENTIAL PROPERTIES INCLUDING ON STREET TOWNHOUSES, ALL CURBING IS TO STOP AT THE PROPERTY LIMIT OR THE BACK OF THE MUNICIPAL SIDEWALK, WHICHEVER IS APPLICABLE, OR B) FOR ALL OTHER PROPOSALS INCLUDING INDUSTRIAL, COMMERCIAL AND CONDOMINIUM DEVELOPMENTS, ALL ENTRANCES TO THE SITE ARE TO BE IN ACCORDANCE WITH OPSD 350.010.
- THE EXISTING DRAINAGE PATTERN WILL BE MAINTAINED EXCEPT WHERE NOTED.
- PRIOR TO ANY CONSTRUCTION TAKING PLACE, STRUCTURALLY CERTIFIED OVERHEAD HOARDING WITHIN THE RIGHT-OF-WAY AS SHOWN ON THE SITE PLAN (AS APPLICABLE), HOARDING ADJACENT TO EXISTING PROPERTIES TO PROTECT FROM CONSTRUCTION ACTIVITY, AND ALL REQUIRED HOARDING IN ACCORDANCE WITH ONTARIO OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS MUST BE ERECTED AND MAINTAINED THROUGHOUT ALL PHASES OF CONSTRUCTION.
- THE MINIMUM PAVEMENT STRUCTURE FOR THE ROADS AND DRIVEWAYS WILL BE AS FOLLOWS, BUT MAY VARY DEPENDING UPON SOIL CONDITIONS, FOR SITE CONDITIONS OR ANY SPECIFIC USES WHICH WILL REQUIRE EXTRA STRENGTH PAVEMENT, THE PAVEMENT STRUCTURE SHALL BE SUBSTANTIATED BY A REPORT FROM THE APPLICANT'S GEOTECHNICAL CONSULTANT.

MINIMUM PAVEMENT STRUCTURE FOR ROADS:
OPSS GRANULAR 'B' 250mm
OPSS GRANULAR 'A' 200mm
OPSS HL8 65mm
HL3 40mm


MINIMUM PAVEMENT STRUCTURE FOR DRIVEWAYS:
OPSS GRANULAR 'A' 150mm
HL8 50mm
HL3F 25mm

CITY MINIMUM PAVEMENT STRUCTURE RECOMMENDATIONS ARE TO BE REVIEWED BY THE GEOTECHNICAL ENGINEER TO CONFIRM THAT IT MEETS THE MINIMUM REQUIREMENTS BASED ON THE EXISTING SOIL CONDITIONS.

- THE APPLICANT IS ADVISED THAT THEY WILL BE REQUIRED TO PROVIDE INSPECTION STAFF 48 HOURS NOTICE PRIOR TO COMMENCEMENT OF ANY ROAD CONSTRUCTION.
- THE APPLICANT IS ADVISED THAT CONFIRMATION MUST BE RECEIVED FROM THE DEVELOPMENT CONSTRUCTION SECTION THAT THEY HAVE MADE ARRANGEMENTS FOR A PRECONSTRUCTION MEETING.

GENERAL NOTES:

- PRIOR TO STARTING ANY WORKS, THE CONTRACTOR MUST ENSURE THAT ALL NECESSARY APPROVALS ARE IN PLACE FROM THE CITY OF MISSISSAUGA AND OTHER EXTERNAL AGENCIES, AS REQUIRED.
- ALL WORK SHALL BE CARRIED OUT IN COMPLIANCE WITH THE APPLICABLE HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS.
- ALL WORK AND MATERIALS TO CONFORM WITH THE CURRENT PROVINCIAL BUILDING CODE, MINISTRY OF THE ENVIRONMENT OF ONTARIO, CITY OF MISSISSAUGA, ONTARIO PROVINCIAL STANDARDS AND SPECIFICATIONS, LOCAL UTILITY STANDARDS AND MINISTRY OF TRANSPORTATION STANDARDS WILL APPLY WHERE REQUIRED.
- FOR ALL CONSTRUCTION DETAILS NOT SHOWN ON THE DRAWINGS, REFERENCE SHALL BE MADE TO THE DESIGN STANDARDS OF THE CITY OF MISSISSAUGA.
- THE CONTRACTOR IS ADVISED THAT WORKS BY OTHERS MAY BE ONGOING DURING THE PERIOD OF THIS CONTRACT. THE CONTRACTOR SHALL COORDINATE CONSTRUCTION ACTIVITIES WITH ALL OTHER CONTRACTORS AND PREVENT CONSTRUCTION CONFLICTS.
- THE INFORMATION SHOWN FOR EXISTING UTILITIES WAS PROVIDED BY OTHERS. THE CONTRACTOR IS RESPONSIBLE FOR LOCATING AND PROTECTING ALL UTILITIES DURING CONSTRUCTION. ALL EXISTING UTILITIES MUST BE LOCATED AND VERIFIED BY EACH PROVIDER PRIOR TO COMMENCEMENT OF WORK. ANY VARIANCE IS TO BE REPORTED TO THE ENGINEER 48 HRS PRIOR TO CONSTRUCTION. LOST TIME AND/OR ANY ADDITIONAL WORKS DUE TO FAILURE OF THE CONTRACTOR TO CONFIRM UTILITY LOCATIONS AND NOTIFY THE ENGINEER OF ANY CONFLICTS 48 HRS PRIOR TO CONSTRUCTION WILL BE AT THE CONTRACTORS EXPENSE.
- THE CONTRACTOR MUST INSTALL ALL SEDIMENT CONTROL DEVICES PRIOR TO THE COMMENCEMENT OF SITE GRADING WORKS. SILT LADEN WATER MUST NOT BE PERMITTED TO ENTER INTO ANY EXISTING CATCH BASINS, INLETTING STRUCTURES, OR WATERCOURSES. ADDITIONAL CONTROLS AS DEEMED REQUIRED BY THE AUTHORITIES AND/OR THE ENGINEER DURING CONSTRUCTION ACTIVITIES SHALL BE PROVIDED BY THE CONTRACTOR, THE CONTRACTOR MUST INSPECT SEDIMENT CONTROLS ON A REGULAR BASIS AND AFTER EVERY RAINFALL EVENT. REPAIRS MUST BE DONE IN A TIMELY MANNER TO PREVENT SEDIMENT FROM ENTERING ANY WATER SYSTEMS. ADDITIONAL SILT FENCING MUST BE AVAILABLE IN CASE IMMEDIATE REPAIR IS REQUIRED.
- ALL DIMENSIONS, ELEVATIONS AND OTHER INFORMATION SHALL BE CHECKED AND VERIFIED IN THE FIELD BY THE CONTRACTOR 72 HOURS PRIOR TO ANY CONSTRUCTION. ANY DISCREPANCIES FOUND MUST BE REPORTED IMMEDIATELY TO THE ENGINEER.
- THE CONTRACTOR IS TO PROVIDE A TOTAL OF TWO CCTV CAMERA INSPECTIONS OF ALL SANITARY AND STORM SEWERS, INCLUDING PICTORIAL REPORT, TWO CD COPIES AND ONE VIDEO TAPE IN A FORMAT SATISFACTORY TO THE ENGINEER. ALL SEWERS ARE TO BE FLUSHED PRIOR TO CAMERA INSPECTION.
- LASER ALIGNMENT CONTROL TO BE UTILIZED ON ALL SEWER INSTALLATIONS.
- ALL PVC SANITARY SEWERS TO BE MANDREL AND AIR TESTED.
- ALL PVC STORM SEWERS TO BE MANDREL TESTED. AIR TEST ONLY ON RECOMMENDATION BY SOIL CONSULTANT.

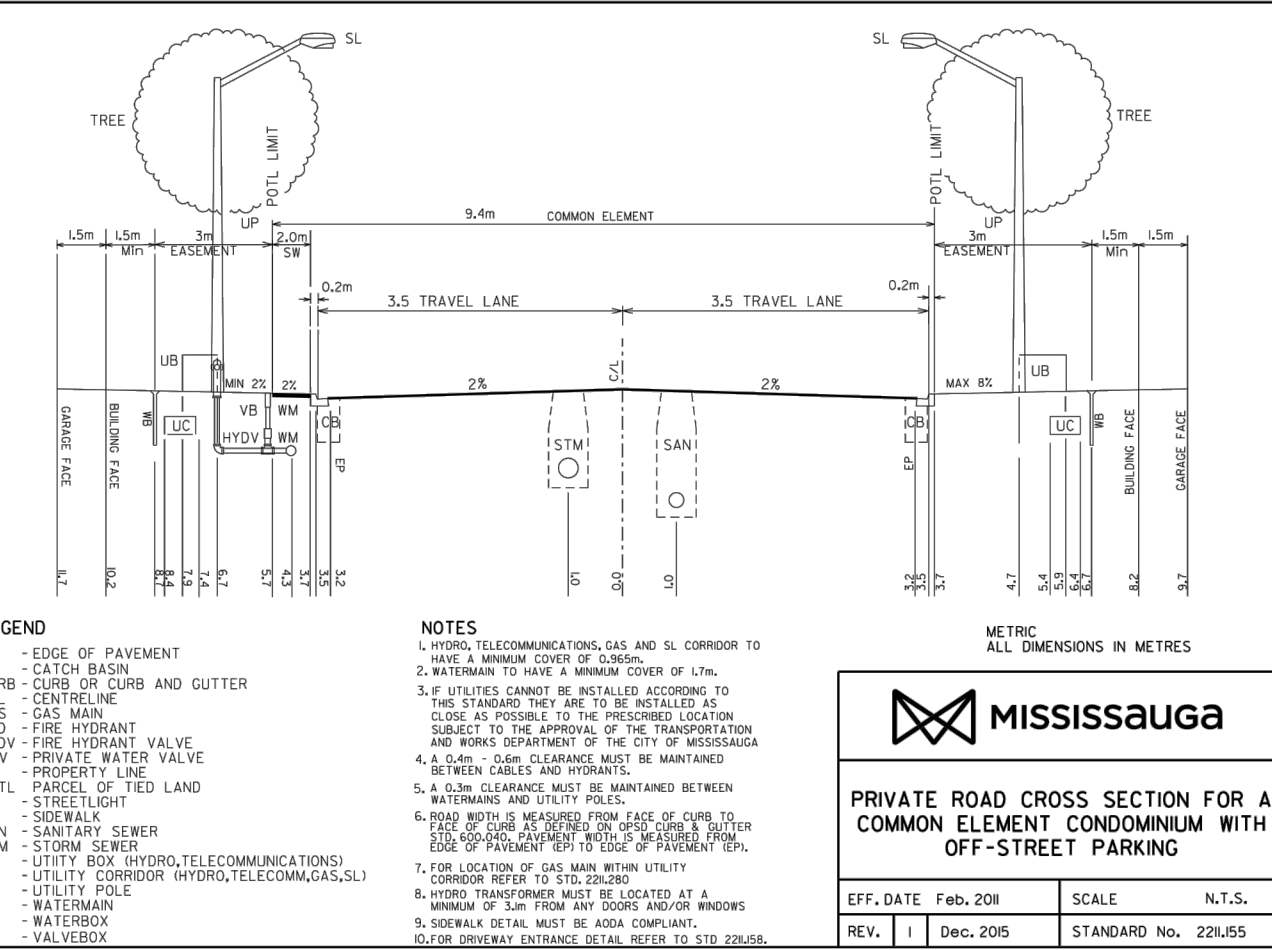

CATCH BASINS:

- ALL SINGLE AND DOUBLE CATCH BASINS SHALL BE PRECAST AS PER OPSD 705.010 AND 705.020 RESPECTIVELY.
- ALL CATCH BASIN FRAMES AND COVERS SHALL BE AS PER OPSD 400.020.
- ALL CATCH BASIN LEADS SHALL BE SDR-35, 200mmØ FOR SINGLE AND 250mmØ FOR DOUBLE WITH A MINIMUM SLOPE OF 1.00% UNLESS OTHERWISE NOTED. CB LEAD INVERT TO BE MINIMUM 1.50m BELOW FINISHED GRADE, UNLESS OTHERWISE NOTED.
- 'MODULOC' OR APPROVED CATCH BASIN ADJUSTERS SHALL BE USED IN LIEU OF BRICKING.
- DURING CONSTRUCTION ALL CATCH BASINS SHALL BE EQUIPPED WITH A TEMPORARY SEDIMENT CONTROL DEVICE.

SEWER MATERIALS:

- ALL SEWERS OF 450mmØ OR SMALLER SHALL BE PVC. ALL SEWERS 525mmØ OR GREATER SHALL BE CONCRETE.
- POLYVINYL CHLORIDE (PVC) SEWER PIPE TO MEET M.O.E. SPECIFICATIONS, CLASS SDR 35 UNLESS OTHERWISE NOTED.
- ALL CONCRETE SEWER PIPES SHALL BE REINFORCED CLASS 65-D, UNLESS OTHERWISE NOTED, CONFORMING TO CSA-A257.2.
- THE MINIMUM PIPE SIZE FOR MAINLINE OR BRANCH SANITARY OR STORM SEWERS SHALL BE 250mmØ AND 300mmØ RESPECTIVELY.

SEWER BEDDING:

- STORM AND SANITARY SEWER BEDDING SHALL BE AS PER OPSD 802.010 CLASS 'B' FOR FLEXIBLE PIPES AND OPSD 802.030, 802.031, 802.032 CLASS 'B' FOR RIGID PIPES UNLESS OTHERWISE SPECIFIED.
- ALL SERVICES AND STRUCTURES LOCATED IN TRENCH CUT SHALL BE SUPPORTED BY COMPACTED GRANULAR TO UNDISTURBED OR STRUCTURALLY COMPACTED GROUND.

BACKFILL:


- ALL MANHOLE AND CATCH BASIN EXCAVATIONS SHALL BE BACKFILLED WITH GRANULAR 'B' COMPACTED TO 98% SPMD AND BE PLACED IN ACCORDANCE WITH THE LATEST REVISION OF THE GEOTECHNICAL REPORT.

WATERMAINS:

- ALL WATERMAINS SHALL BE CONSTRUCTED IN ACCORDANCE WITH OPSS 701.
- WATERMAINS AND APPURTENANCES SHALL BE AS PER THE REGION OF PEEL'S SPECIFICATIONS.
- WATERMAIN SHALL BE POLYVINYL CHLORIDE (PVC) CLASS-150, DR-18 CONFORMING TO APPLICABLE AWWA STANDARDS.
- ALL WATERMAINS SHALL HAVE A MINIMUM COVER OF 1.70m.
- ALL WATERMAIN HORIZONTAL AND VERTICAL BENDS, JOINTS AND PLUGS TO BE MECHANICALLY RESTRAINED. MECHANICAL RESTRAINERS MUST BE INSTALLED ON ALL WATERMAIN BENDS, TEES, AND PLUGS AS PER REGION OF PEEL STANDARDS.
- WATERMAINS MUST COMPLY WITH MINIMUM HORIZONTAL AND VERTICAL CLEARANCES IN ACCORDANCE WITH LOCAL PROVINCIAL GUIDELINES AND THE APPLICABLE BUILDING AND PLUMBING CODE. WHERE HORIZONTAL SEPARATIONS CANNOT BE ACHIEVED, APPROVAL FROM THE ENGINEER MUST BE OBTAINED AND A MINIMUM 500mm VERTICAL SEPARATION MUST BE MAINTAINED.
- ALL WATERMAIN BEDDING COVER AND TRENCH DETAIL SHALL BE AS PER LOCAL MUNICIPAL, REGIONAL OR PROVINCIAL STANDARDS. THE CONTRACTOR SHALL SUBMIT SAMPLES OF BEDDING AND COVER MATERIALS TO THE GEOTECHNICAL ENGINEER AND OBTAIN APPROVAL FOR USE PRIOR TO COMMENCEMENT OF SERVICE INSTALLATION.
- ALL WATERMAIN AND APPURTENANCES (VALVES, HYDRANTS, FITTINGS, ETC.) SHALL BE INSTALLED WITH CATHODIC PROTECTION AS PER OPSD 1109.011.
- ALL PVC WATERMAIN SHALL BE INSTALLED COMPLETE WITH #14 GAUGE TRACER WIRE, TERMINATING AT GRADE AT A FIRE HYDRANT OR VALVE LOCATION, AND SHALL BE POSITIVELY CONNECTED TO THE HYDRANT OR VALVE.
- ALL WATERMAINS SHALL BE HYDROSTATICALLY TESTED IN ACCORDANCE WITH LOCAL MUNICIPAL AND PROVINCIAL GUIDELINES UNLESS OTHERWISE DIRECTED. PROVISIONS FOR FLUSHING WATER LINE PRIOR TO TESTING, ETC. MUST BE PROVIDED. FLUSHING, PRESSURE TESTING, CHLORINATION AND SAMPLING SHALL BE DONE IN ACCORDANCE WITH THE CITY OF MISSISSAUGA AND REGION OF PEEL'S REQUIREMENTS.
- ALL WATERMAINS SHALL BE BACTERIOLOGICALLY TESTED IN ACCORDANCE WITH LOCAL MUNICIPAL AND PROVINCIAL GUIDELINES. ALL CHLORINATED WATER TO BE DISCHARGED AND PRETREATED TO ACCEPTABLE LEVELS PRIOR TO DISCHARGE. ALL DISCHARGED WATER MUST BE CONTROLLED AND TREATED SO AS NOT TO ADVERSELY EFFECT THE ENVIRONMENT. THE LOCAL MUNICIPALITY MAY HAVE SPECIFIC REQUIREMENTS TO BE COMPLIED WITH. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE THAT ALL MUNICIPAL AND/OR PROVINCIAL REQUIREMENTS ARE FOLLOWED.
- ALL SERVICES TO BE 25mm DIAMETER COPPER TYPE "K"

MANHOLES:

- ALL PRECAST CONCRETE MANHOLES TO MEET M.O.E. SPECIFICATIONS AND CONFORM TO OPSD 701.010, 701.011, 701.012, 701.013 AND 701.014.
- MANHOLE COVERS TO BE AS PER OPSD 401.010, TYPE 'A' FOR SANITARY AND TYPE 'B' FOR STORM.
- 'MODULOC' OR APPROVED MANHOLES ADJUSTERS SHALL BE USED IN LIEU OF BRICKING.
- MANHOLE STEPS SHALL BE RECTANGULAR STAINLESS STEEL AS PER OPSD 405.010.
- SAFETY PLATFORMS SHALL BE PROVIDED, AS PER OPSD 404.020, FOR MANHOLES WITH DEPTH EXCEEDING 5.0m.
- BENCHING TO BE PROVIDED AT ALL MANHOLES UNLESS OTHERWISE STATED IN ACCORDANCE WITH OPSD 701.021
- ALL DROP STRUCTURES TO BE CONSTRUCTED AS PER OPSD 1003.010 AND OPSD 1003.020.

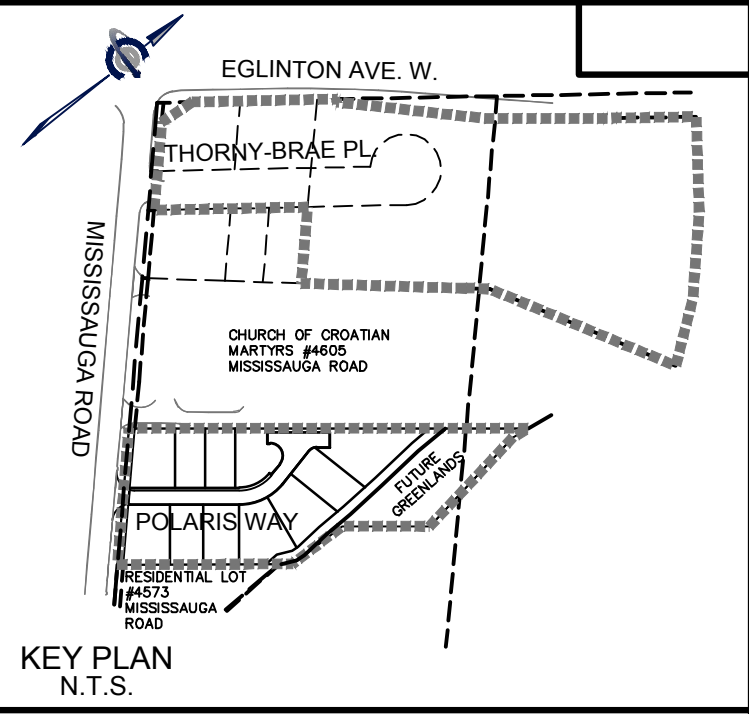

KEY PLAN
N.T.S.

LEGEND

- EXISTING SERVICING INFORMATION FOR MISSISSAUGA ROAD AND THORNY BRAE PLACE WAS OBTAINED FROM MUNICIPAL RECORD DRAWINGS: C-33221, C-33222, C-98929, 1156-D, 7235-D EXISTING SERVICING AND UTILITIES INFORMATION SHOWN ON THIS DRAWING IS NOT TO BE RELIED ON. THE CONTRACTOR TO VERIFY INVERT ELEVATION AND LOCATION OF ALL UNDERGROUND SERVICES AND UTILITIES PRIOR TO COMMENCING WORK.

LIST OF DRAWINGS

- SG-01 (SITE GRADING PLAN)
- SS-01 (SITE SERVICING PLAN)
- ST-01 (STORM DRAINAGE PLAN)
- SA-01 (SANITARY DRAINAGE PLAN)
- EC-01 (EROSION CONTROL PLAN)
- DD-01 GENERAL NOTES
- DD-02 DETAIL DRAWINGS
- DD-03 CROSS SECTIONS

SITE PLAN INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

SURVEY INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

BENCHMARK

ELEVATIONS SHOWN HEREON ARE REFERRED TO
CITY OF MISSISSAUGA BENCHMARK No. 870,
HAVING A PUBLISHED ELEVATION OF 148.702 METRES.

REVISIONS

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----





NO.	REVISION	DATE	BY
-----	----------	------	----


NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----


NO.	REVISION	DATE	BY
-----	----------	------	----

NO.	REVISION	DATE	BY
-----	----------	------	----

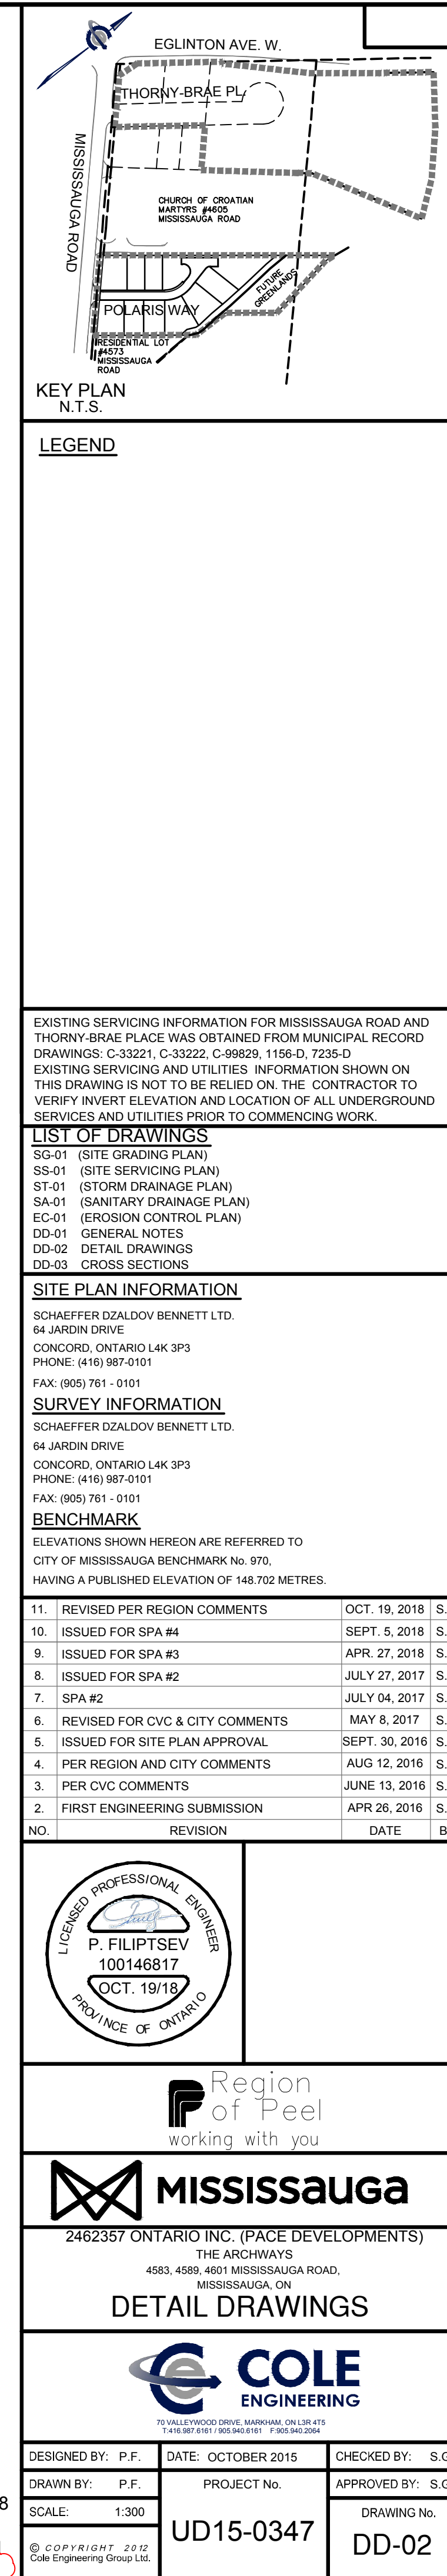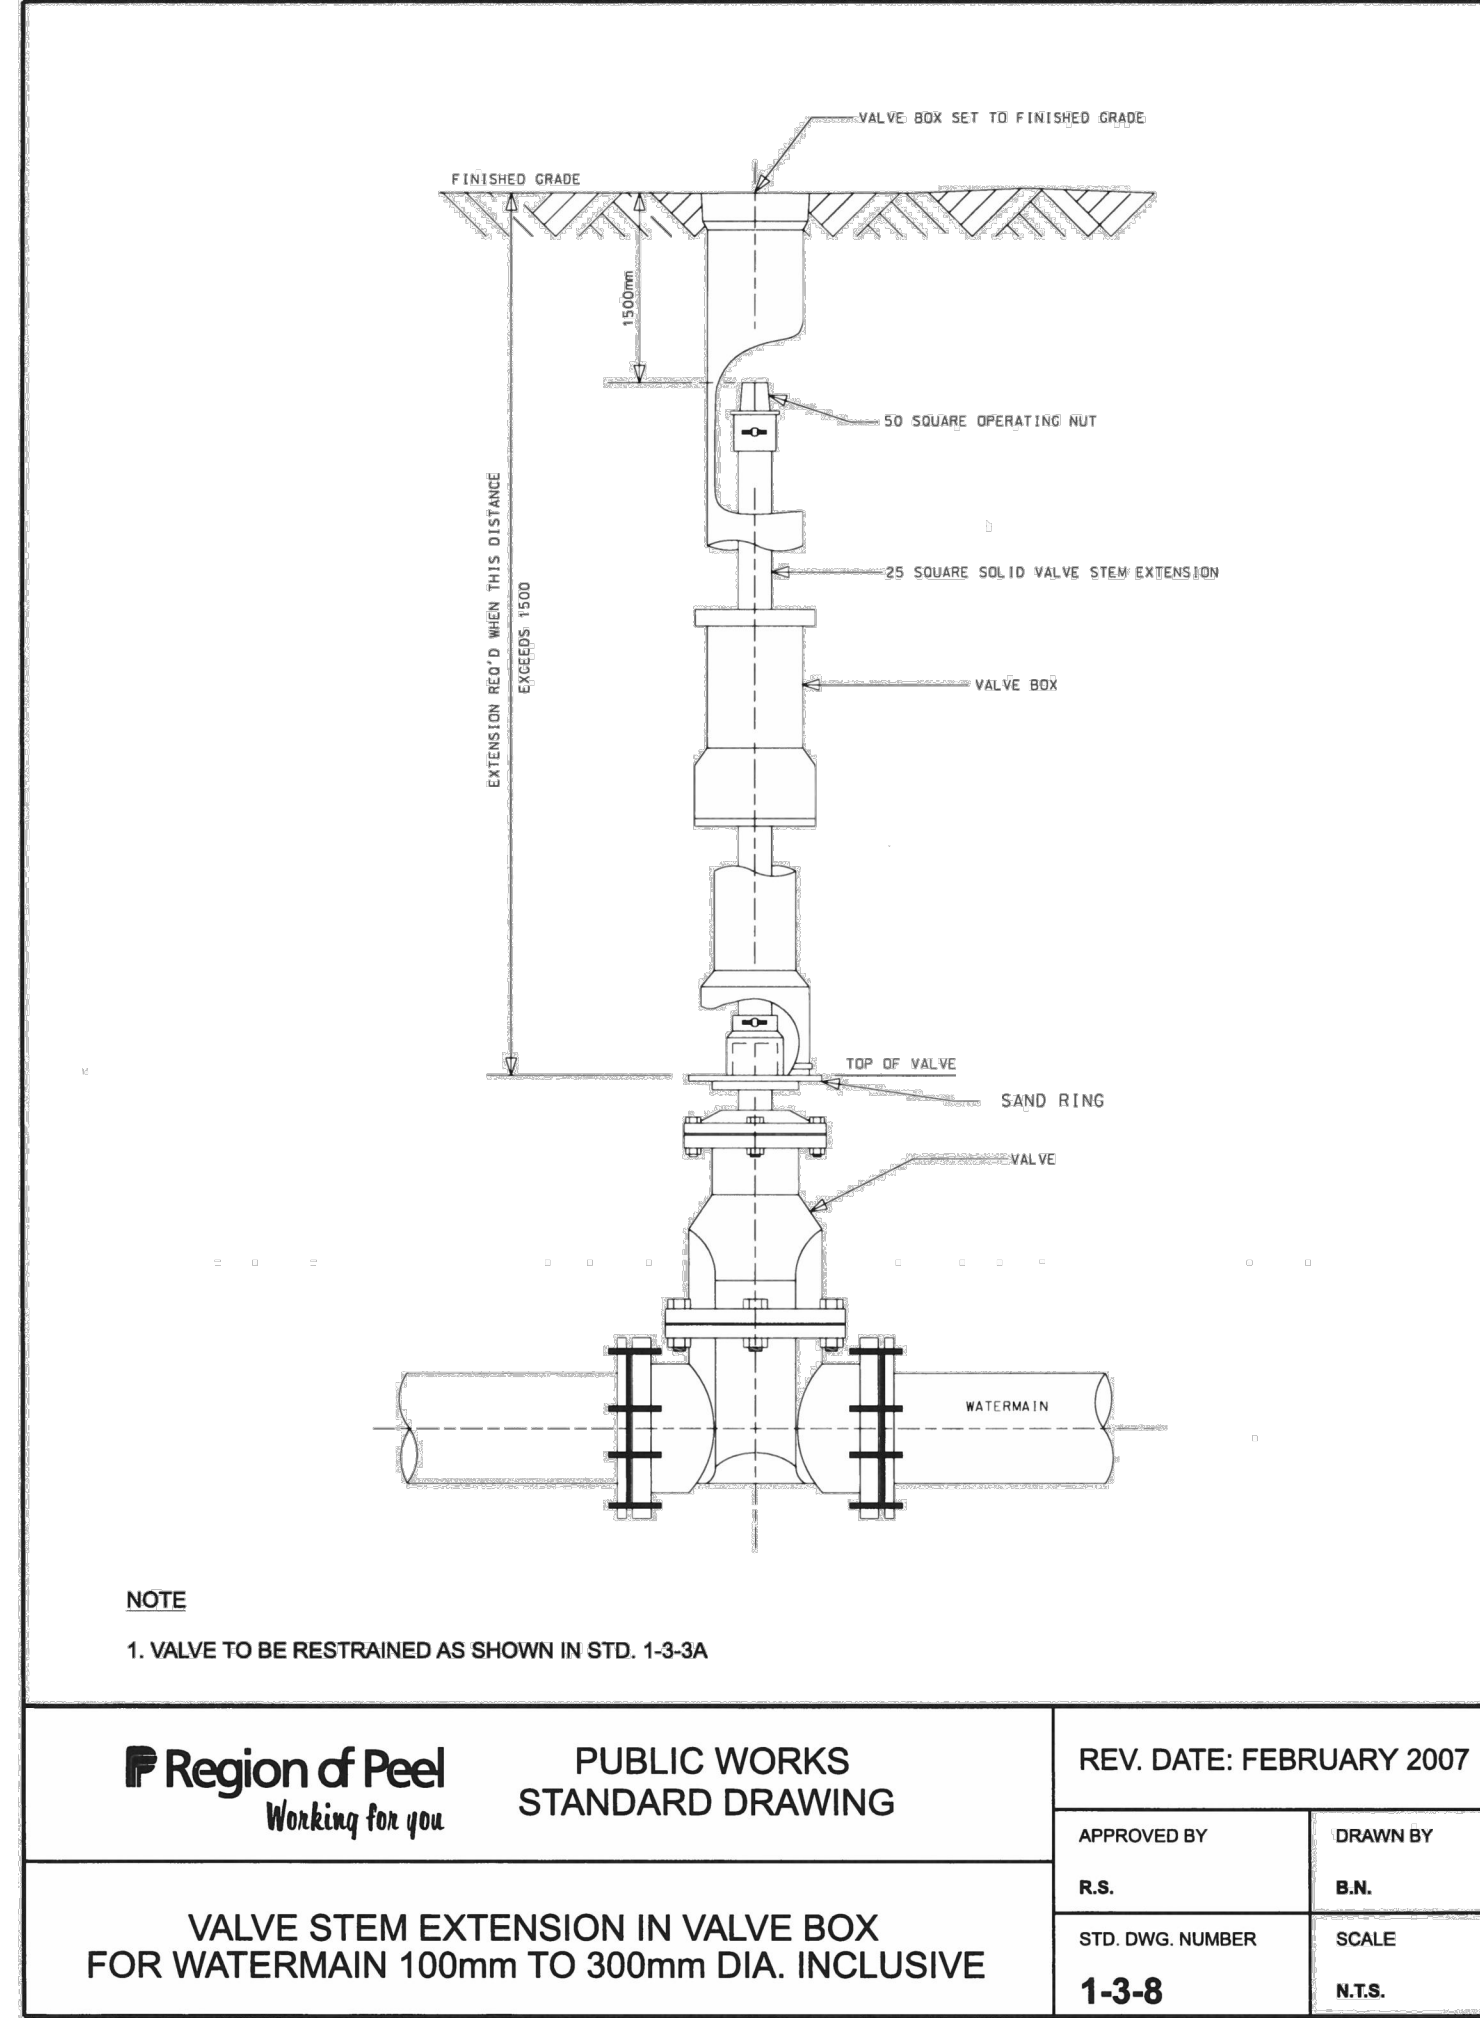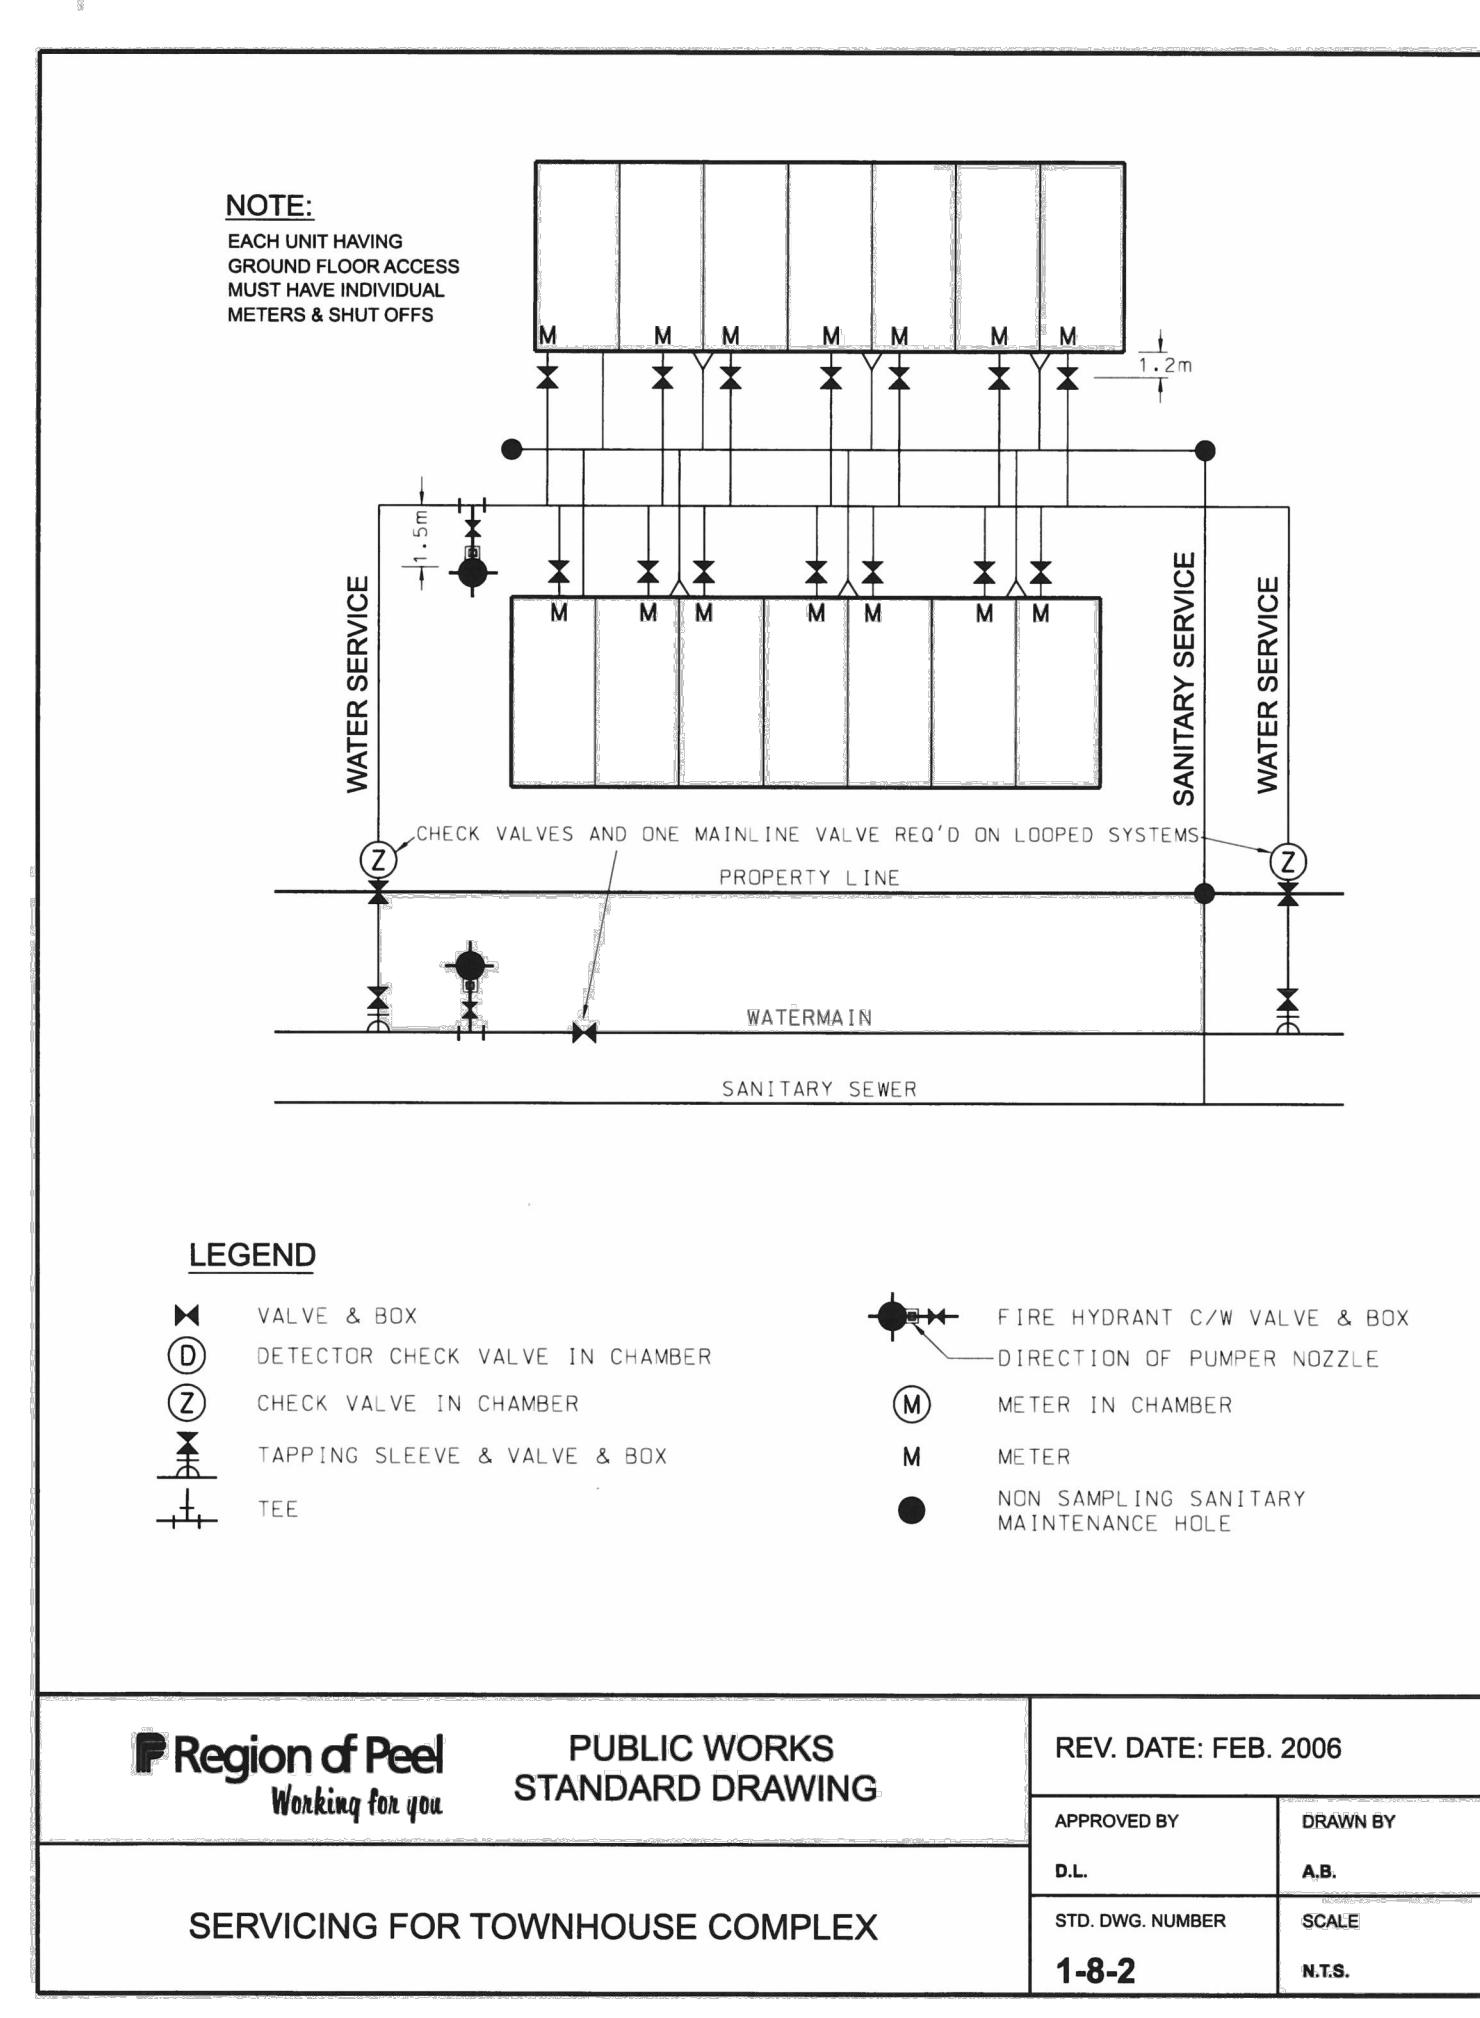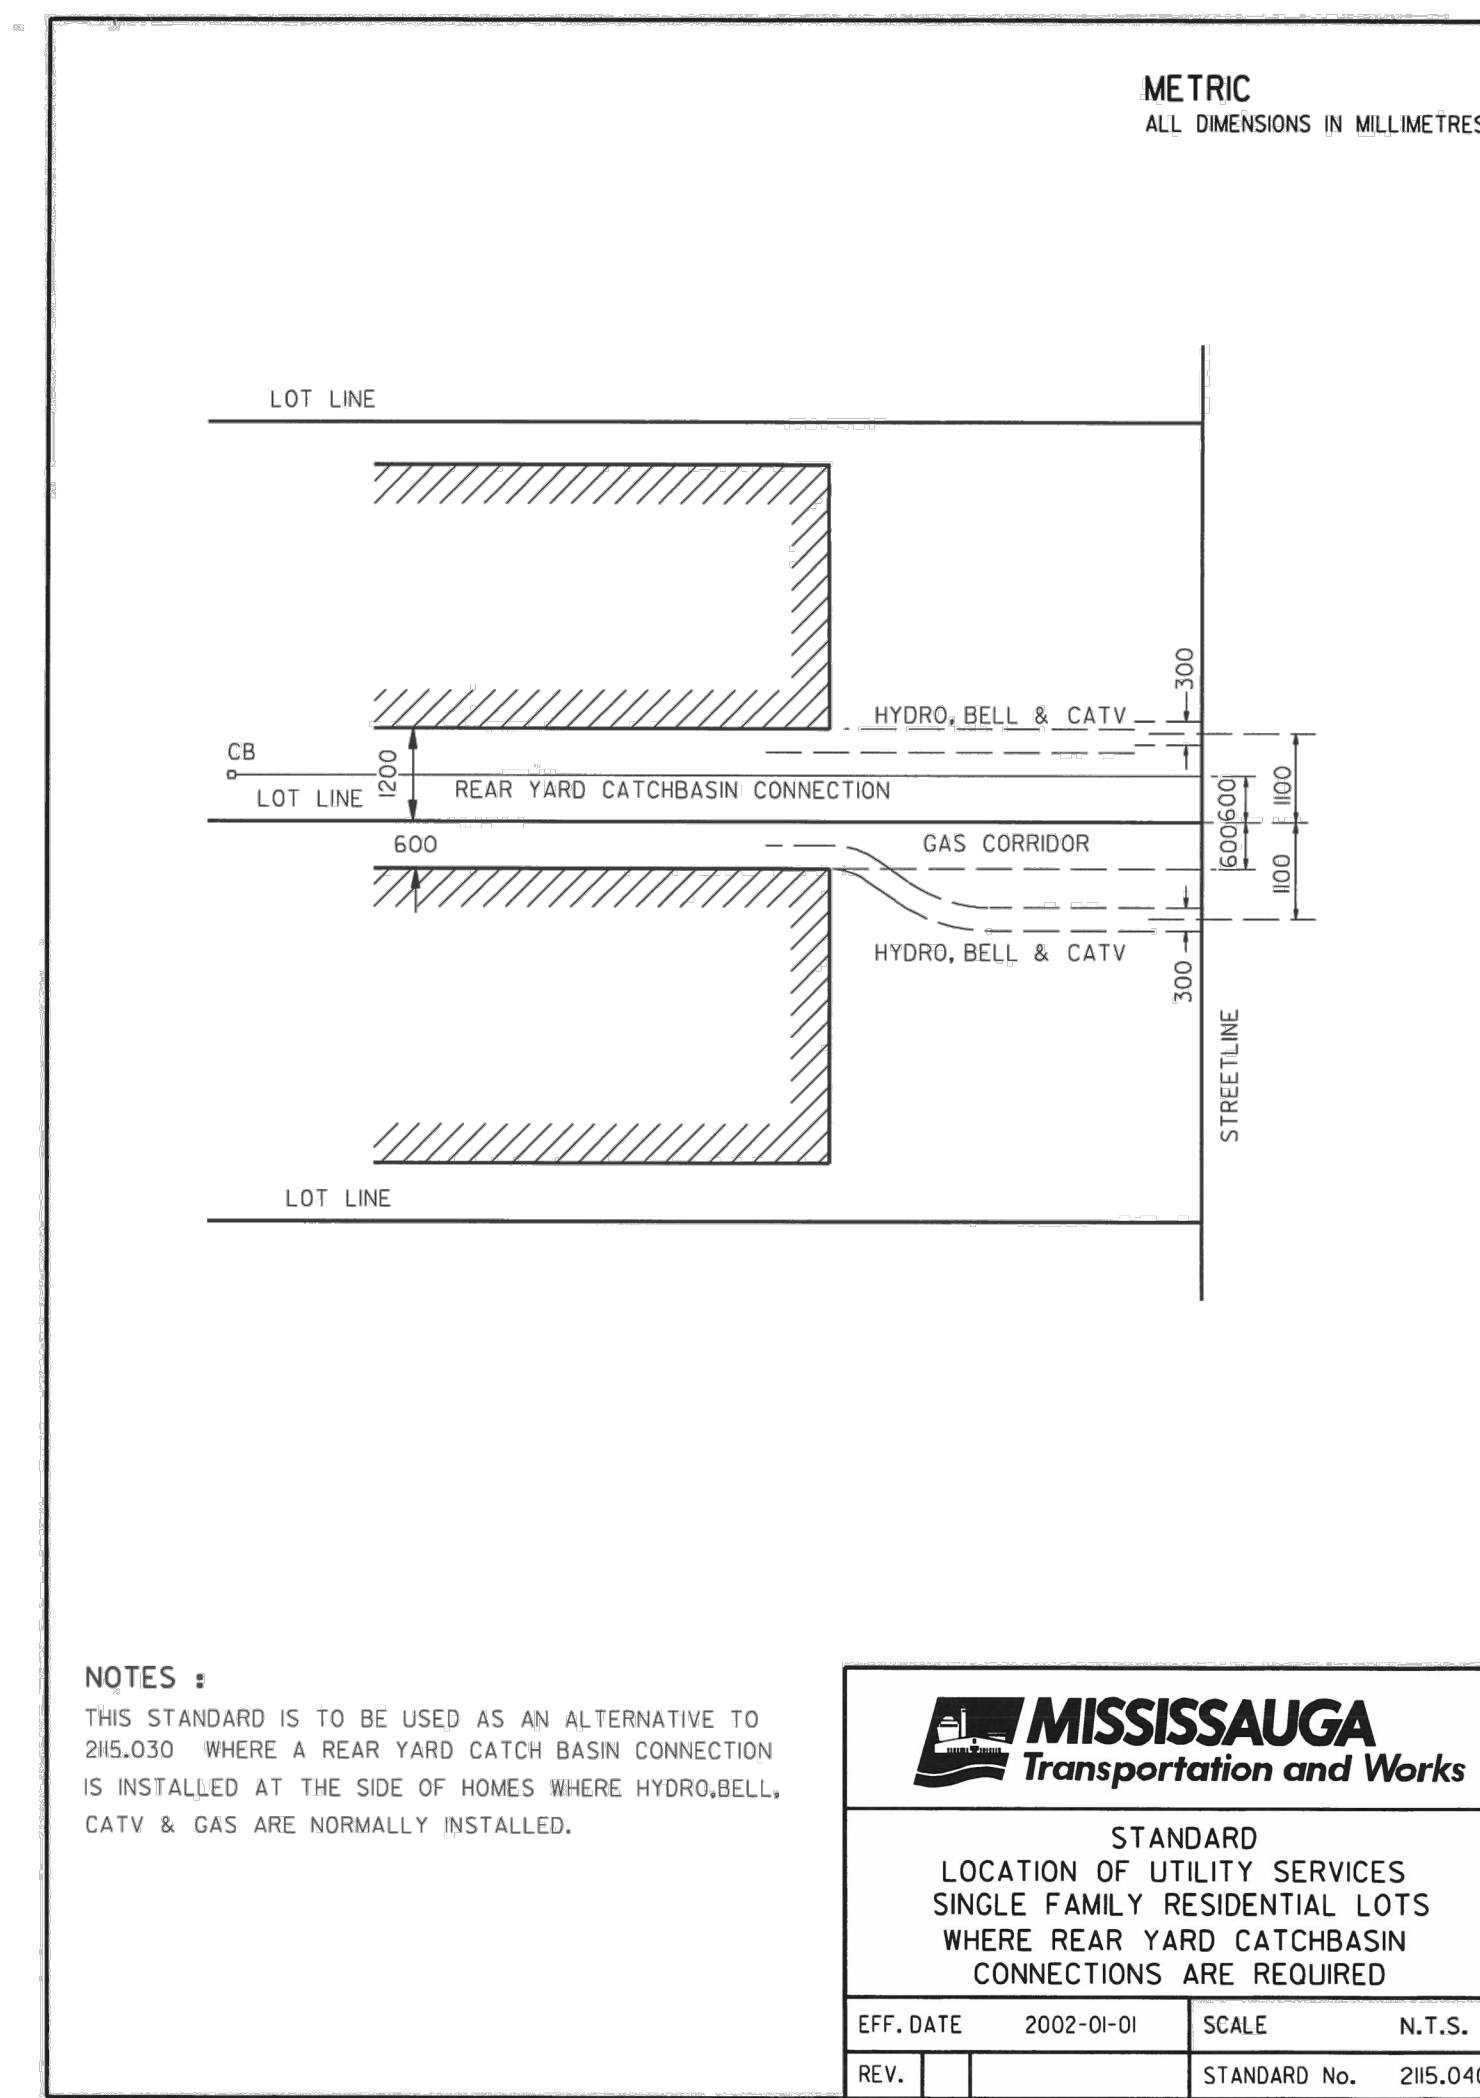


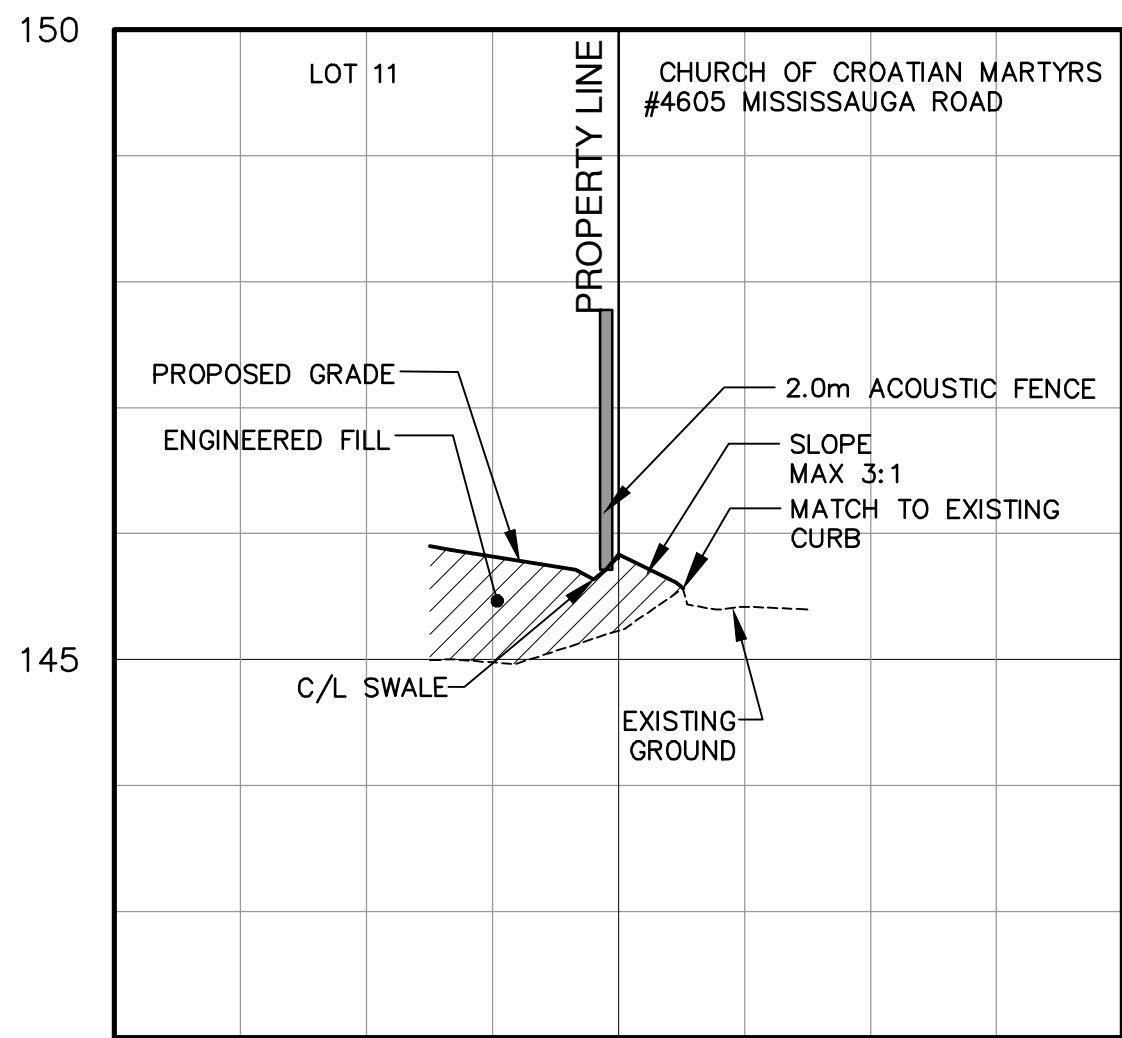


SECTION A-A
SCALE HOR: 1:300
VER: 1:50

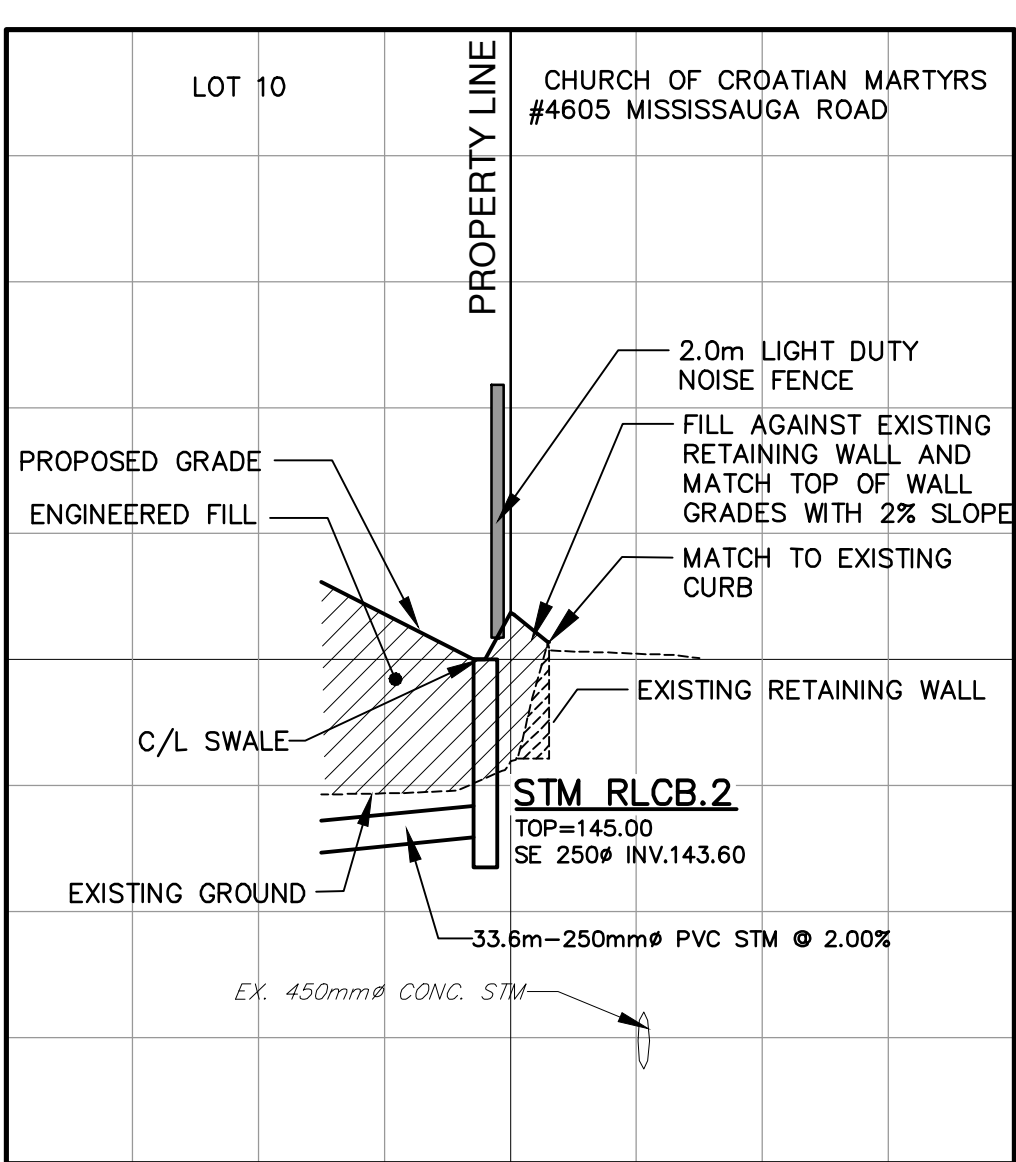


SECTION B-B
SCALE HOR: 1:300
VER: 1:50

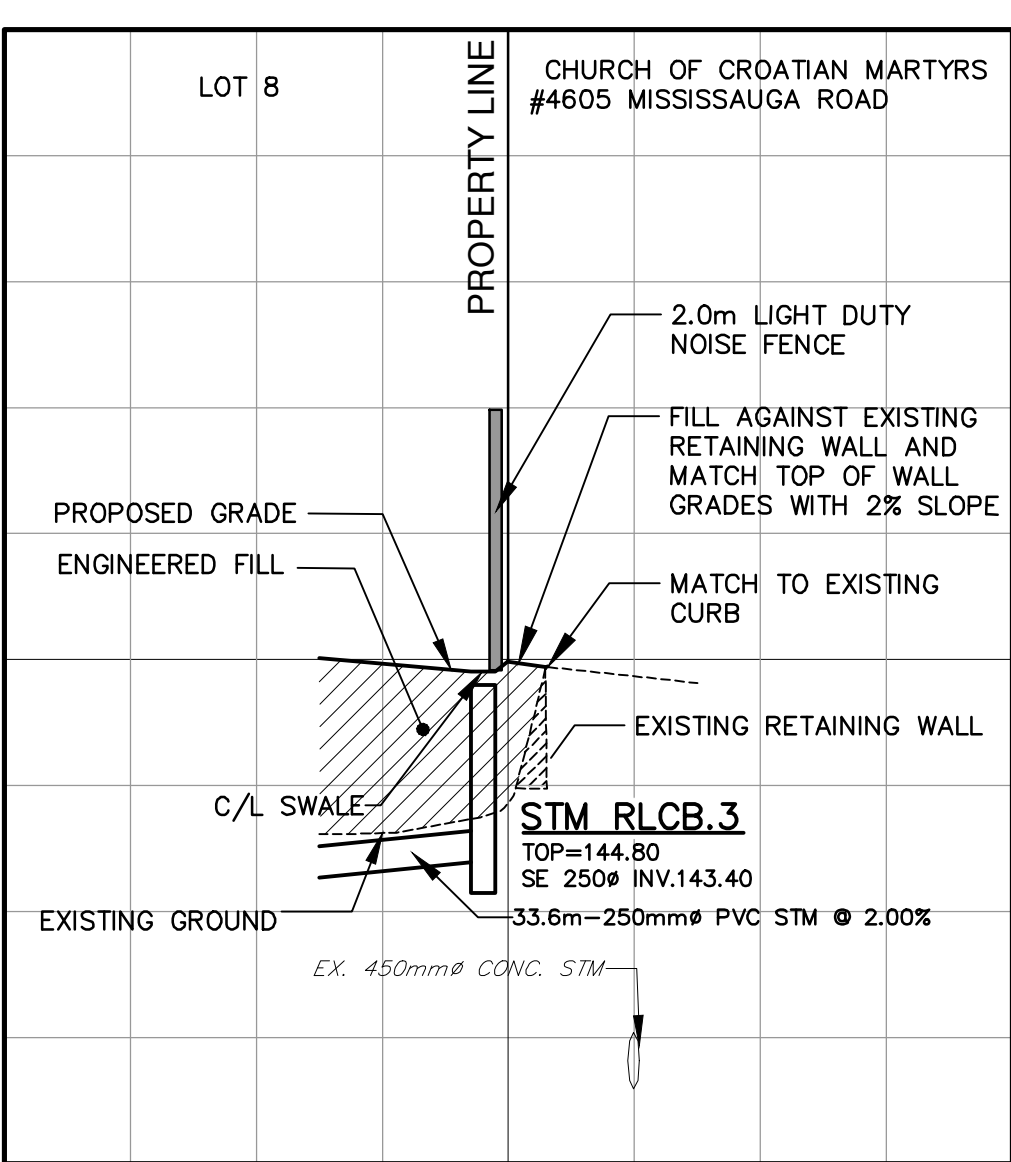


SECTION C-C
SCALE HOR: 1:300
VER: 1:50

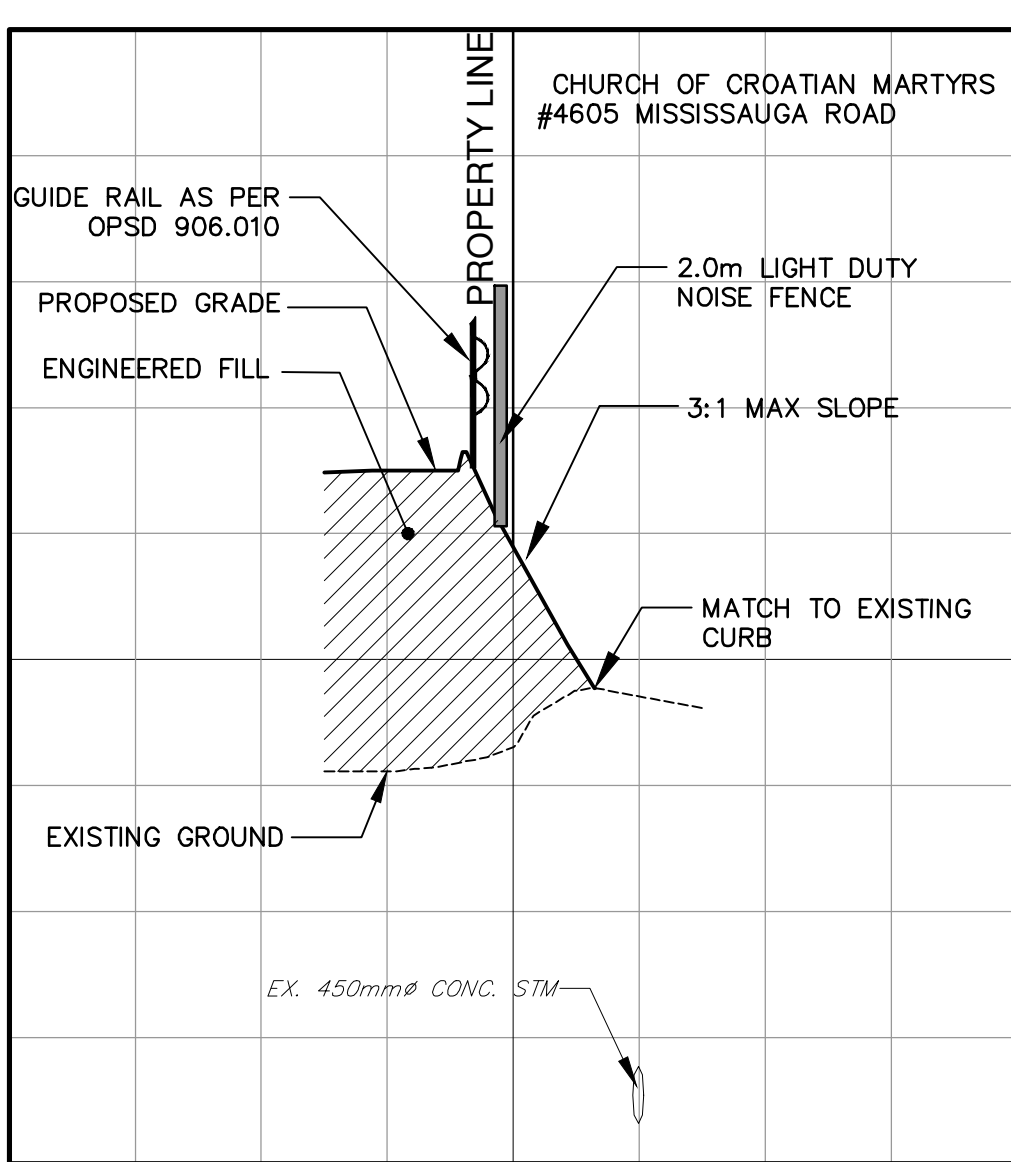


SECTION D-D
SCALE HOR: 1:300
VER: 1:50

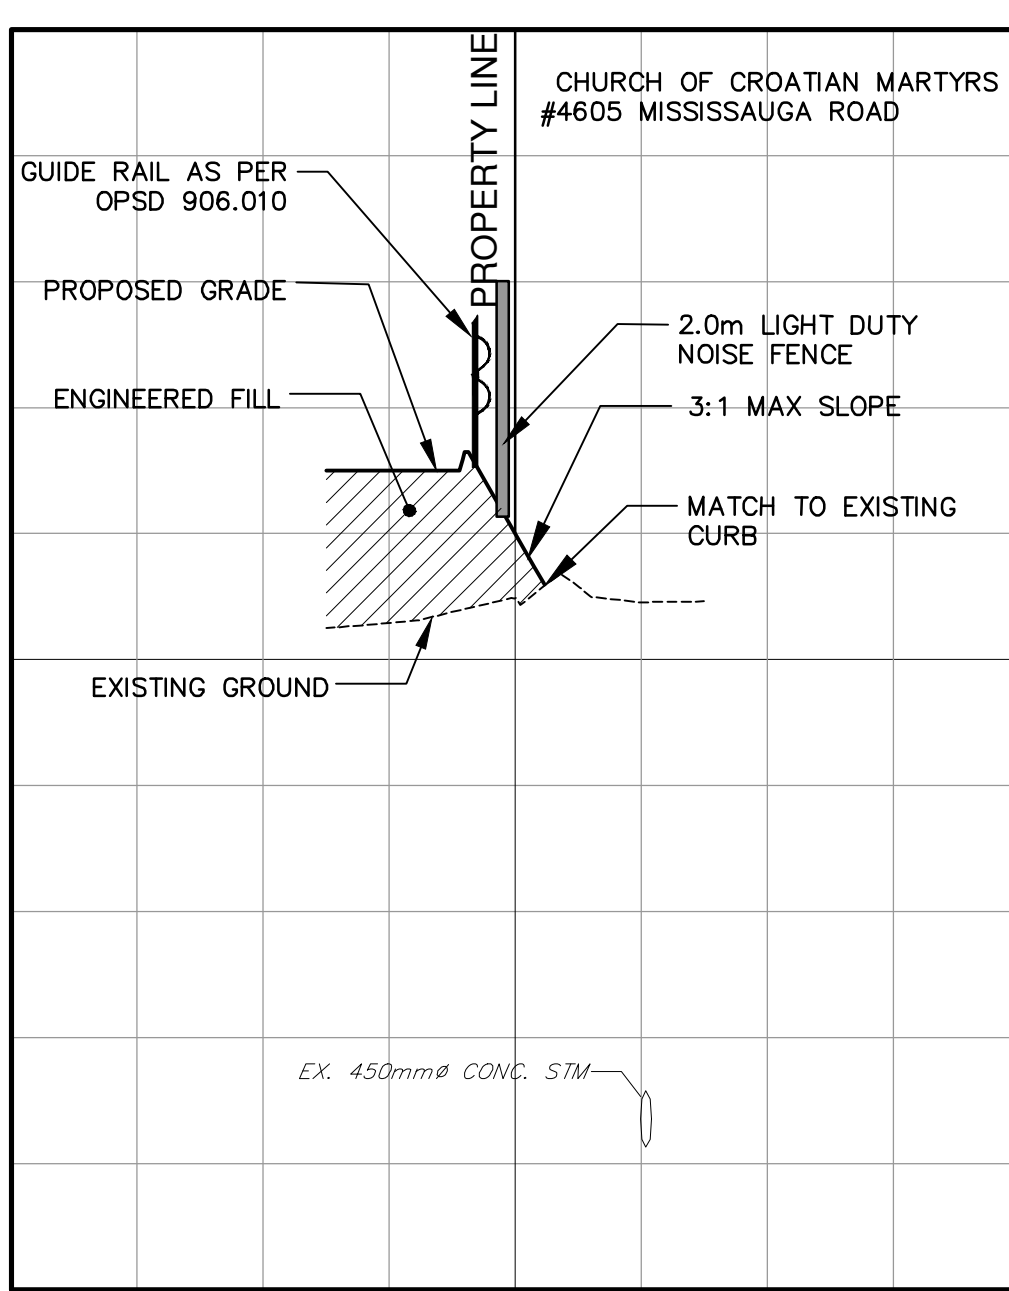


SECTION E-E
SCALE HOR: 1:300
VER: 1:50

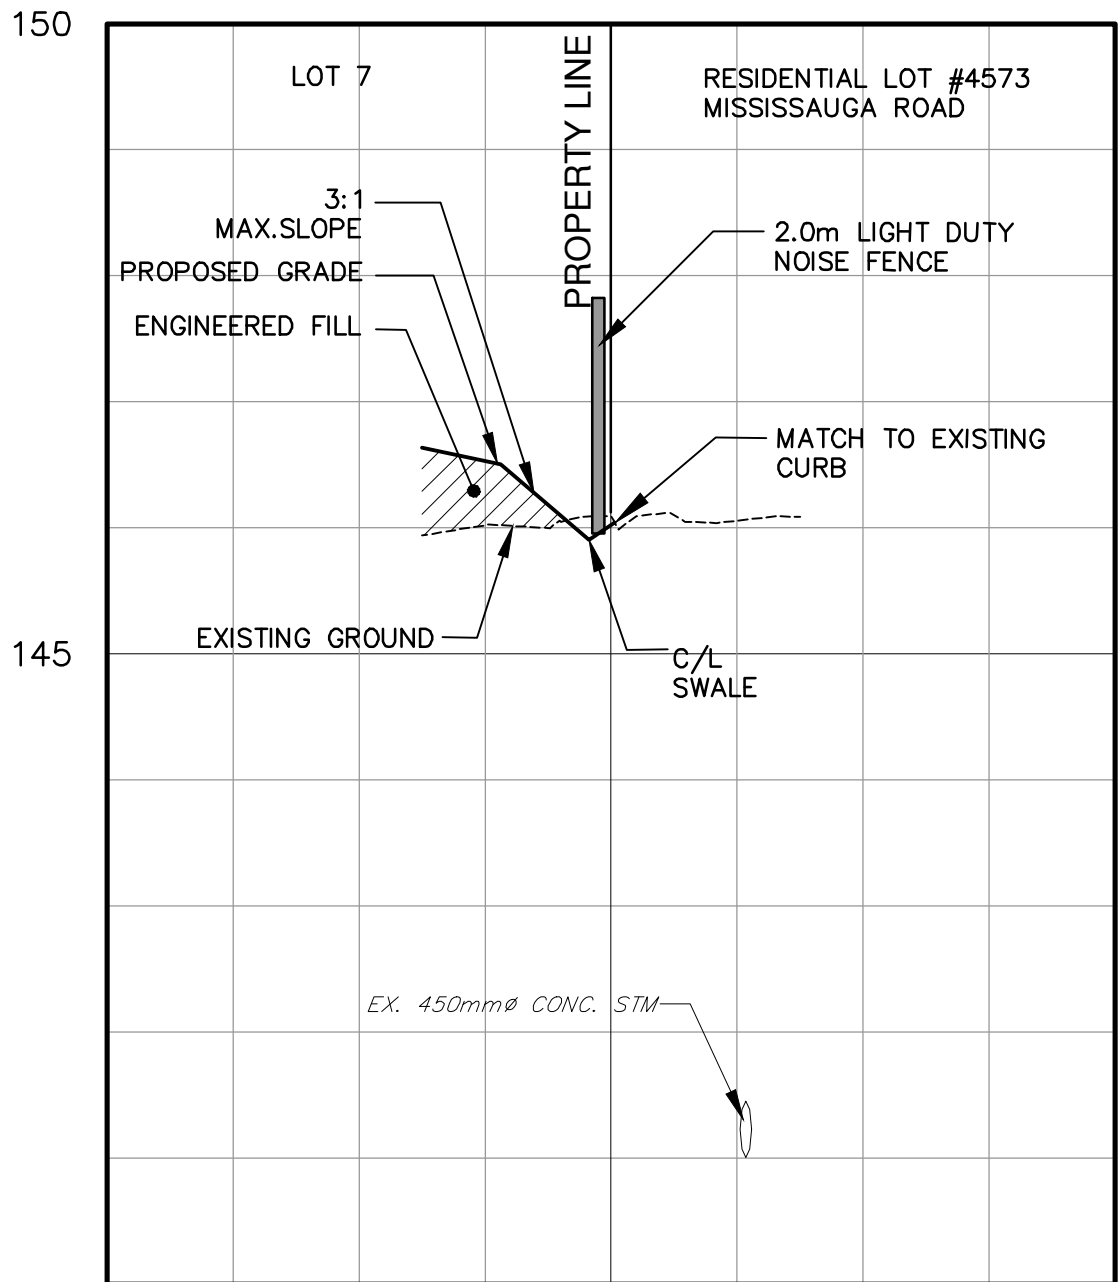


SECTION F-F
SCALE HOR: 1:300
VER: 1:50

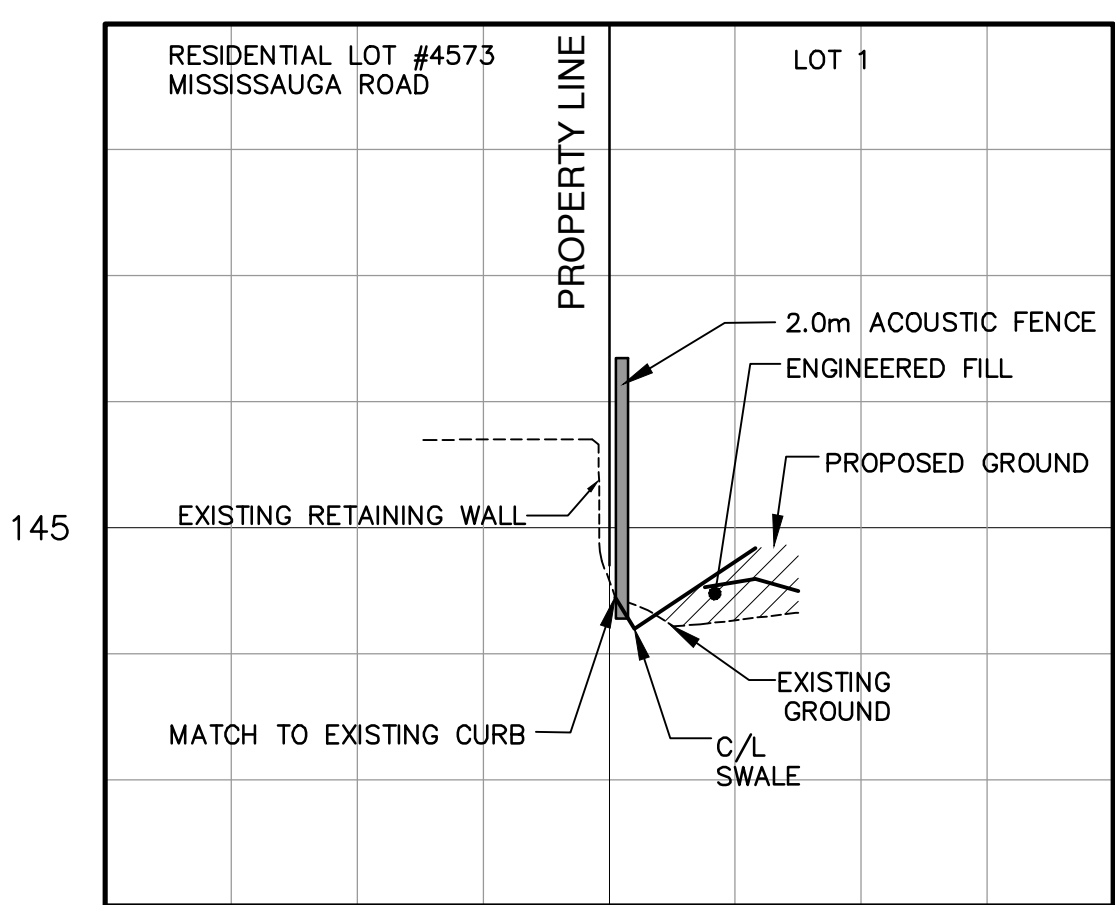

SECTION G-G
SCALE HOR: 1:300
VER: 1:50

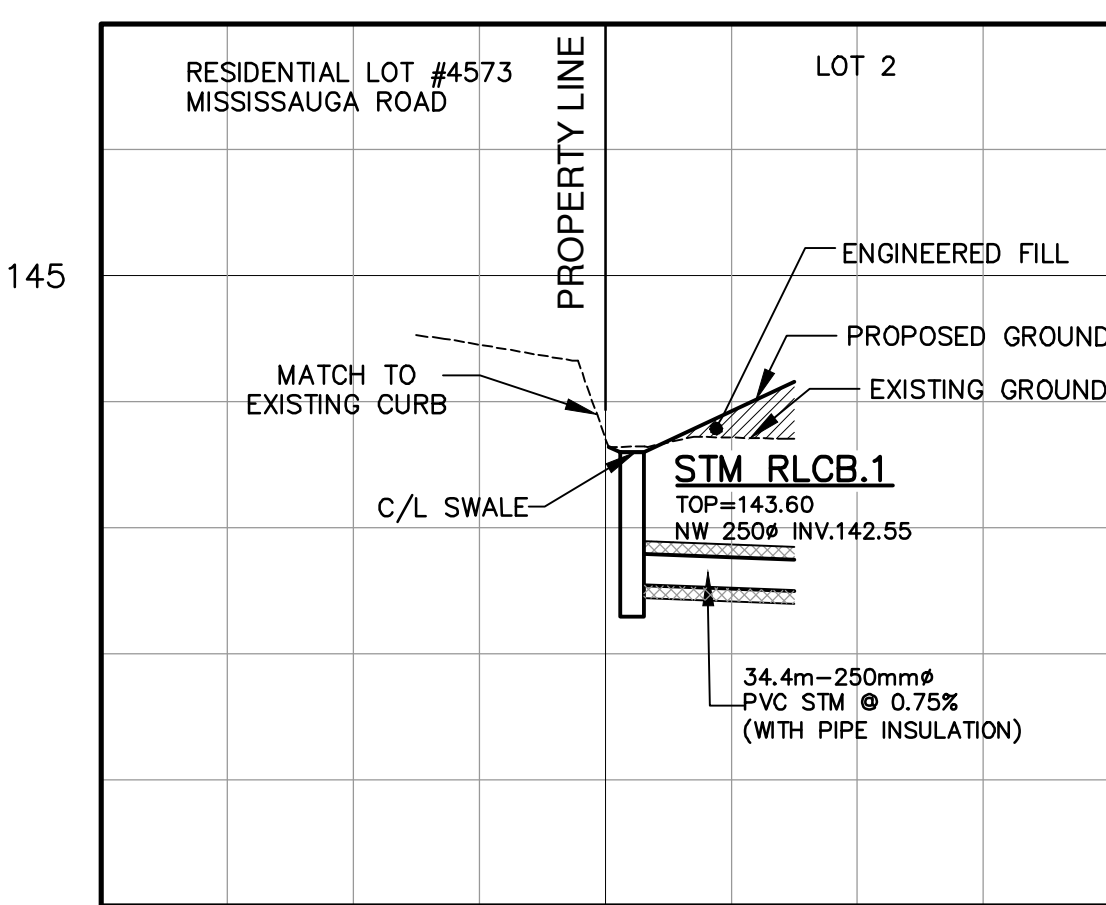

SECTION H-H
SCALE HOR: 1:300
VER: 1:50

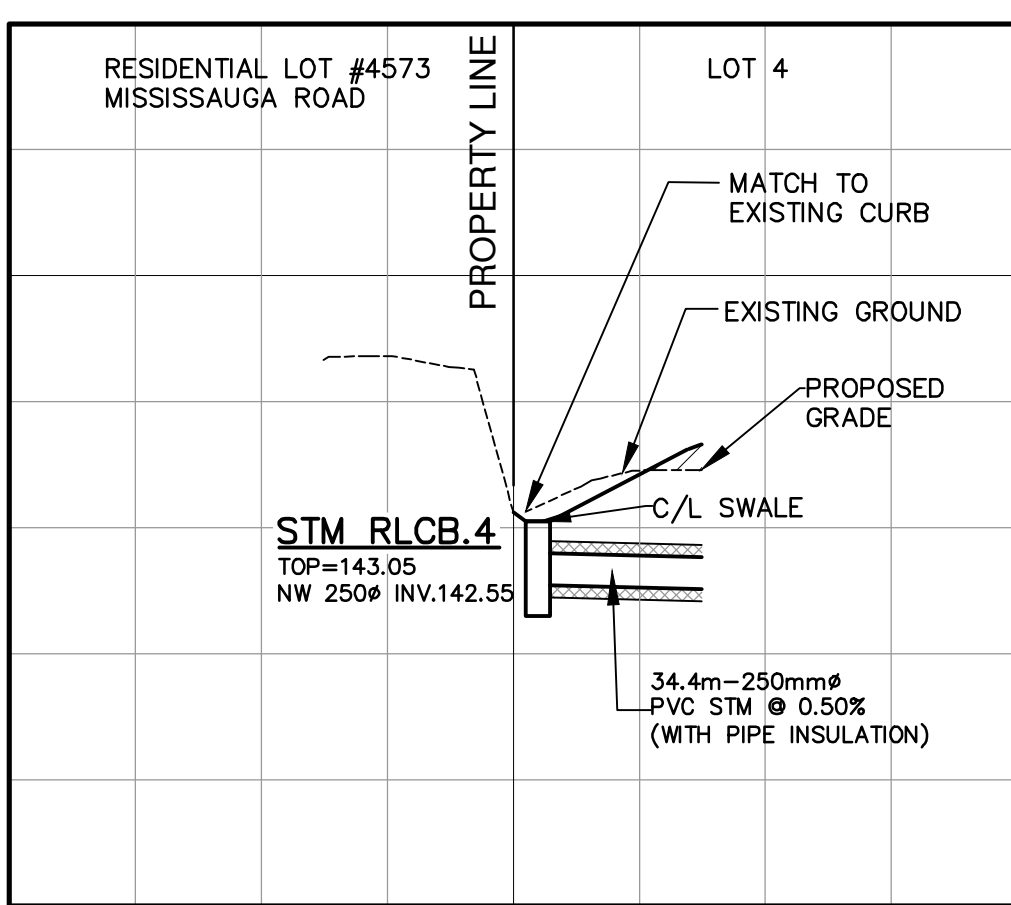

SECTION I-I
SCALE HOR: 1:300
VER: 1:50

EXISTING SERVICING INFORMATION FOR MISSISSAUGA ROAD AND THORNY-BRAE PLACE WAS OBTAINED FROM MUNICIPAL RECORD DRAWINGS: C-33221, C-33222, C-99828, 1156-D, 7235-D. EXISTING SERVICING AND UTILITIES INFORMATION SHOWN ON THIS DRAWING IS NOT TO BE RELIED ON. THE CONTRACTOR TO VERIFY INVERT ELEVATION AND LOCATION OF ALL UNDERGROUND SERVICES AND UTILITIES PRIOR TO COMMENCING WORK.

- LIST OF DRAWINGS**
- SG-01 (SITE GRADING PLAN)
 - SS-01 (SITE SERVICING PLAN)
 - ST-01 (STORM DRAINAGE PLAN)
 - SA-01 (SANITARY DRAINAGE PLAN)
 - EC-01 (EROSION CONTROL PLAN)
 - DD-01 GENERAL NOTES
 - DD-02 DETAIL DRAWINGS
 - DD-03 CROSS SECTIONS

SITE PLAN INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101


SURVEY INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

BENCHMARK

ELEVATIONS SHOWN HEREON ARE REFERRED TO CITY OF MISSISSAUGA BENCHMARK No. 970, HAVING A PUBLISHED ELEVATION OF 148.702 METRES.

NO.	REVISION	DATE	BY
6.	REVISED PER REGION COMMENTS	OCT. 19, 2018	S.G.
5.	ISSUED FOR SPA #4	SEPT. 4, 2018	S.G.
4.	ISSUED FOR SPA #3	APR. 27, 2018	S.G.
3.	ISSUED FOR SPA #2	JULY 27, 2017	S.G.
2.	SPA #2	JULY 04, 2017	S.G.
1.	REVISED PER CVC & CITY COMMENTS	MAY 31, 2017	S.G.

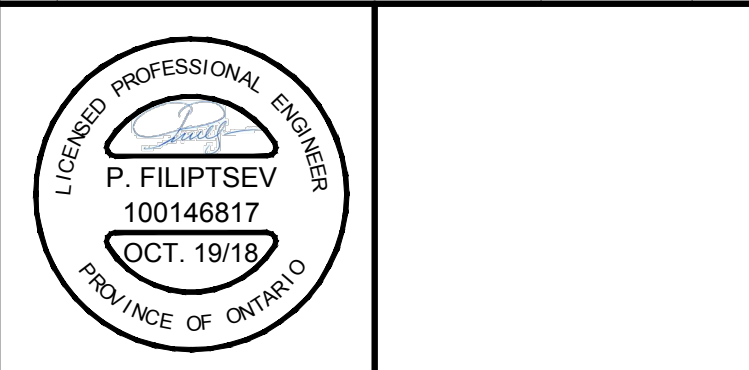


CITY OF MISSISSAUGA
REGIONAL MUNICIPALITY OF PEEL
2462357 ONTARIO INC. (PACE DEVELOPMENTS)
THE ARCHWAYS
4583, 4589, 4601 MISSISSAUGA ROAD,
MISSISSAUGA, ON



DESIGNED BY: P.F.	DATE: OCTOBER 2015	CHECKED BY: S.G.
DRAWN BY: P.F.	PROJECT No.	APPROVED BY: S.G.
SCALE: 1:300	DRAWING No.	
UD15-0347	DD-03	

CITY FILE #
OZ 09/004 W8
PEEL FILE#
T-M09002 M
SP-16-147M

REFER TO DWG SG-01 FOR
CROSS SECTION LOCATIONS

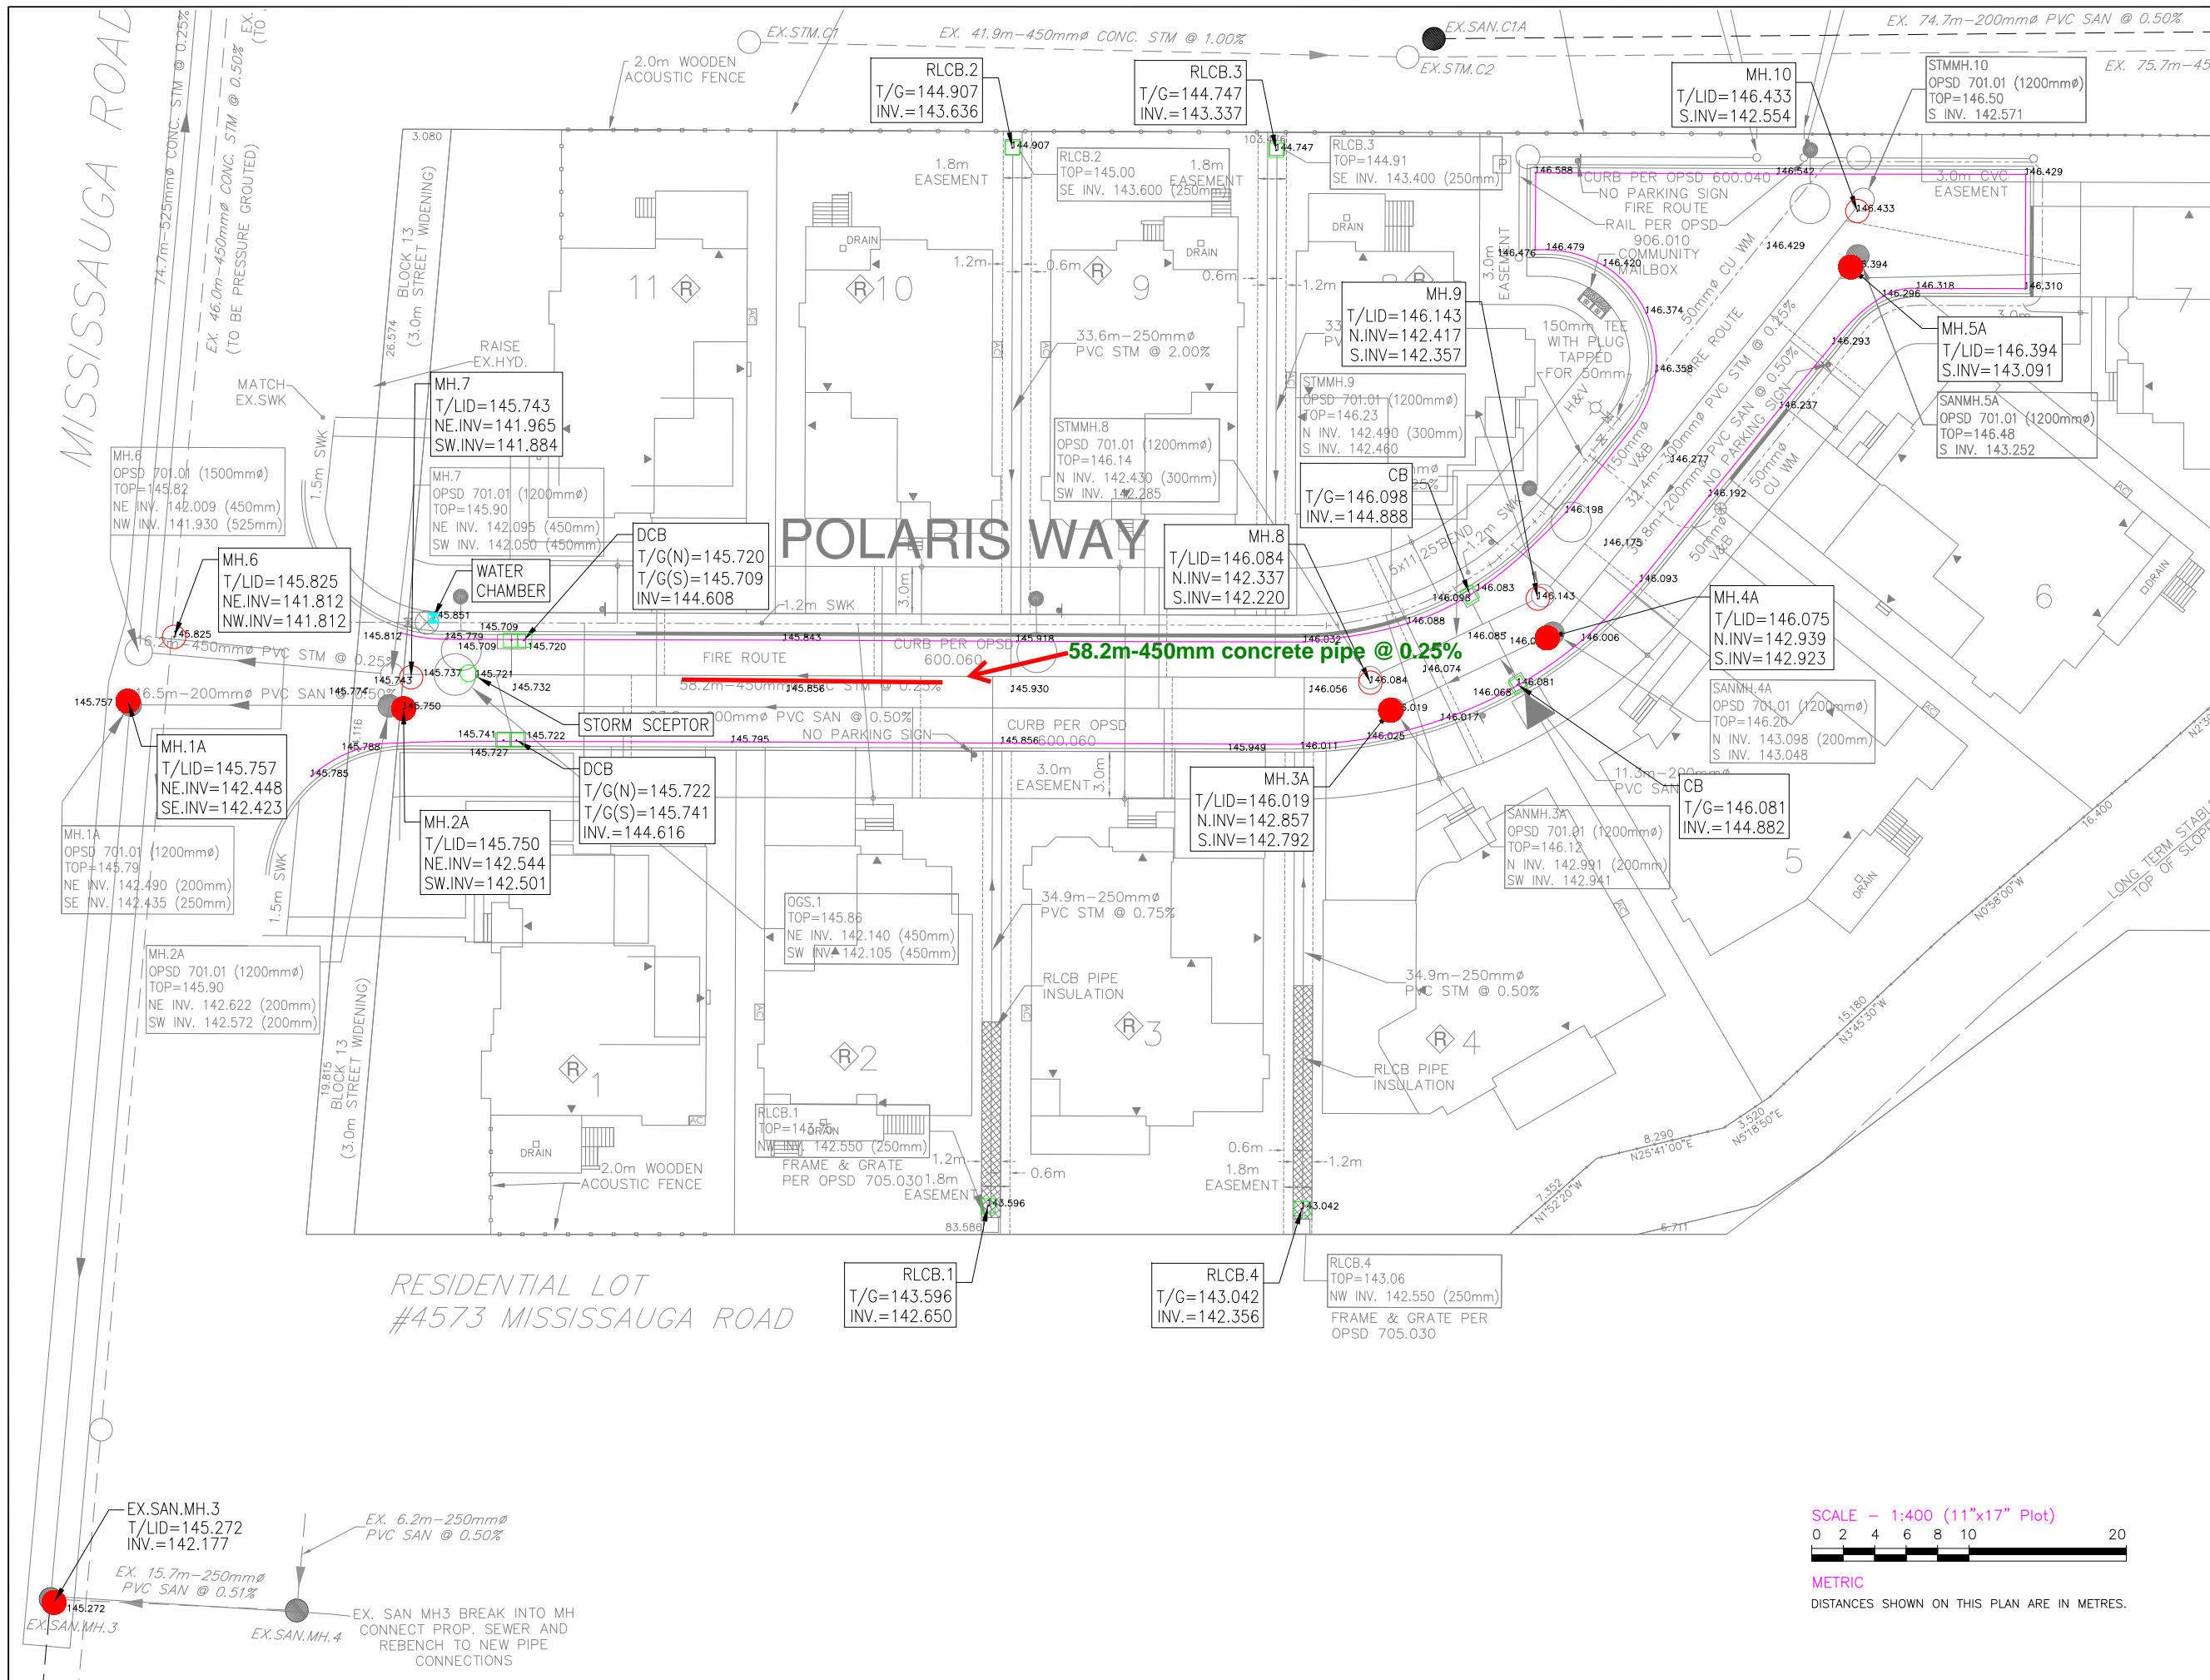

KEY PLAN (N.T.S.)

LEGEND

145.757 ASBUILT GRADES

NOTES

1.
2.
3.

REFERENCE

BENCHMARKS :
LEGAL DRAWINGS :
GEODETIC SYSTEM :

REVISIONS

NO.	DATE	DESCRIPTION	BY	CHKD.
1.	20/01/22	UPDATED INVERTS FOR MH2A & RLCB1	RWS	AP
2.				
3.				

CSS Inc.
COMPLETE SURVEY SOLUTIONS
22-2051 Williams Prkwy., Brampton, ON. L6S 5T3
Tel (905) 789-8338, Fax (905) 789-8227

SEWER ASBUILT
THE ARCHWAYS

PROJECT No.:
18-1016
CLIENTS BASE FILE NAME:
UD15-0347 SS-01
CADD FILE NAME:
SEWER



DRAFTED BY:
R.W.S.
CHECKED BY:
A.P.
DATE:
20/01/22

SCALE - 1:400 (11"x17" Plot)

0 2 4 6 8 10 20

METRIC

DISTANCES SHOWN ON THIS PLAN ARE IN METRES.

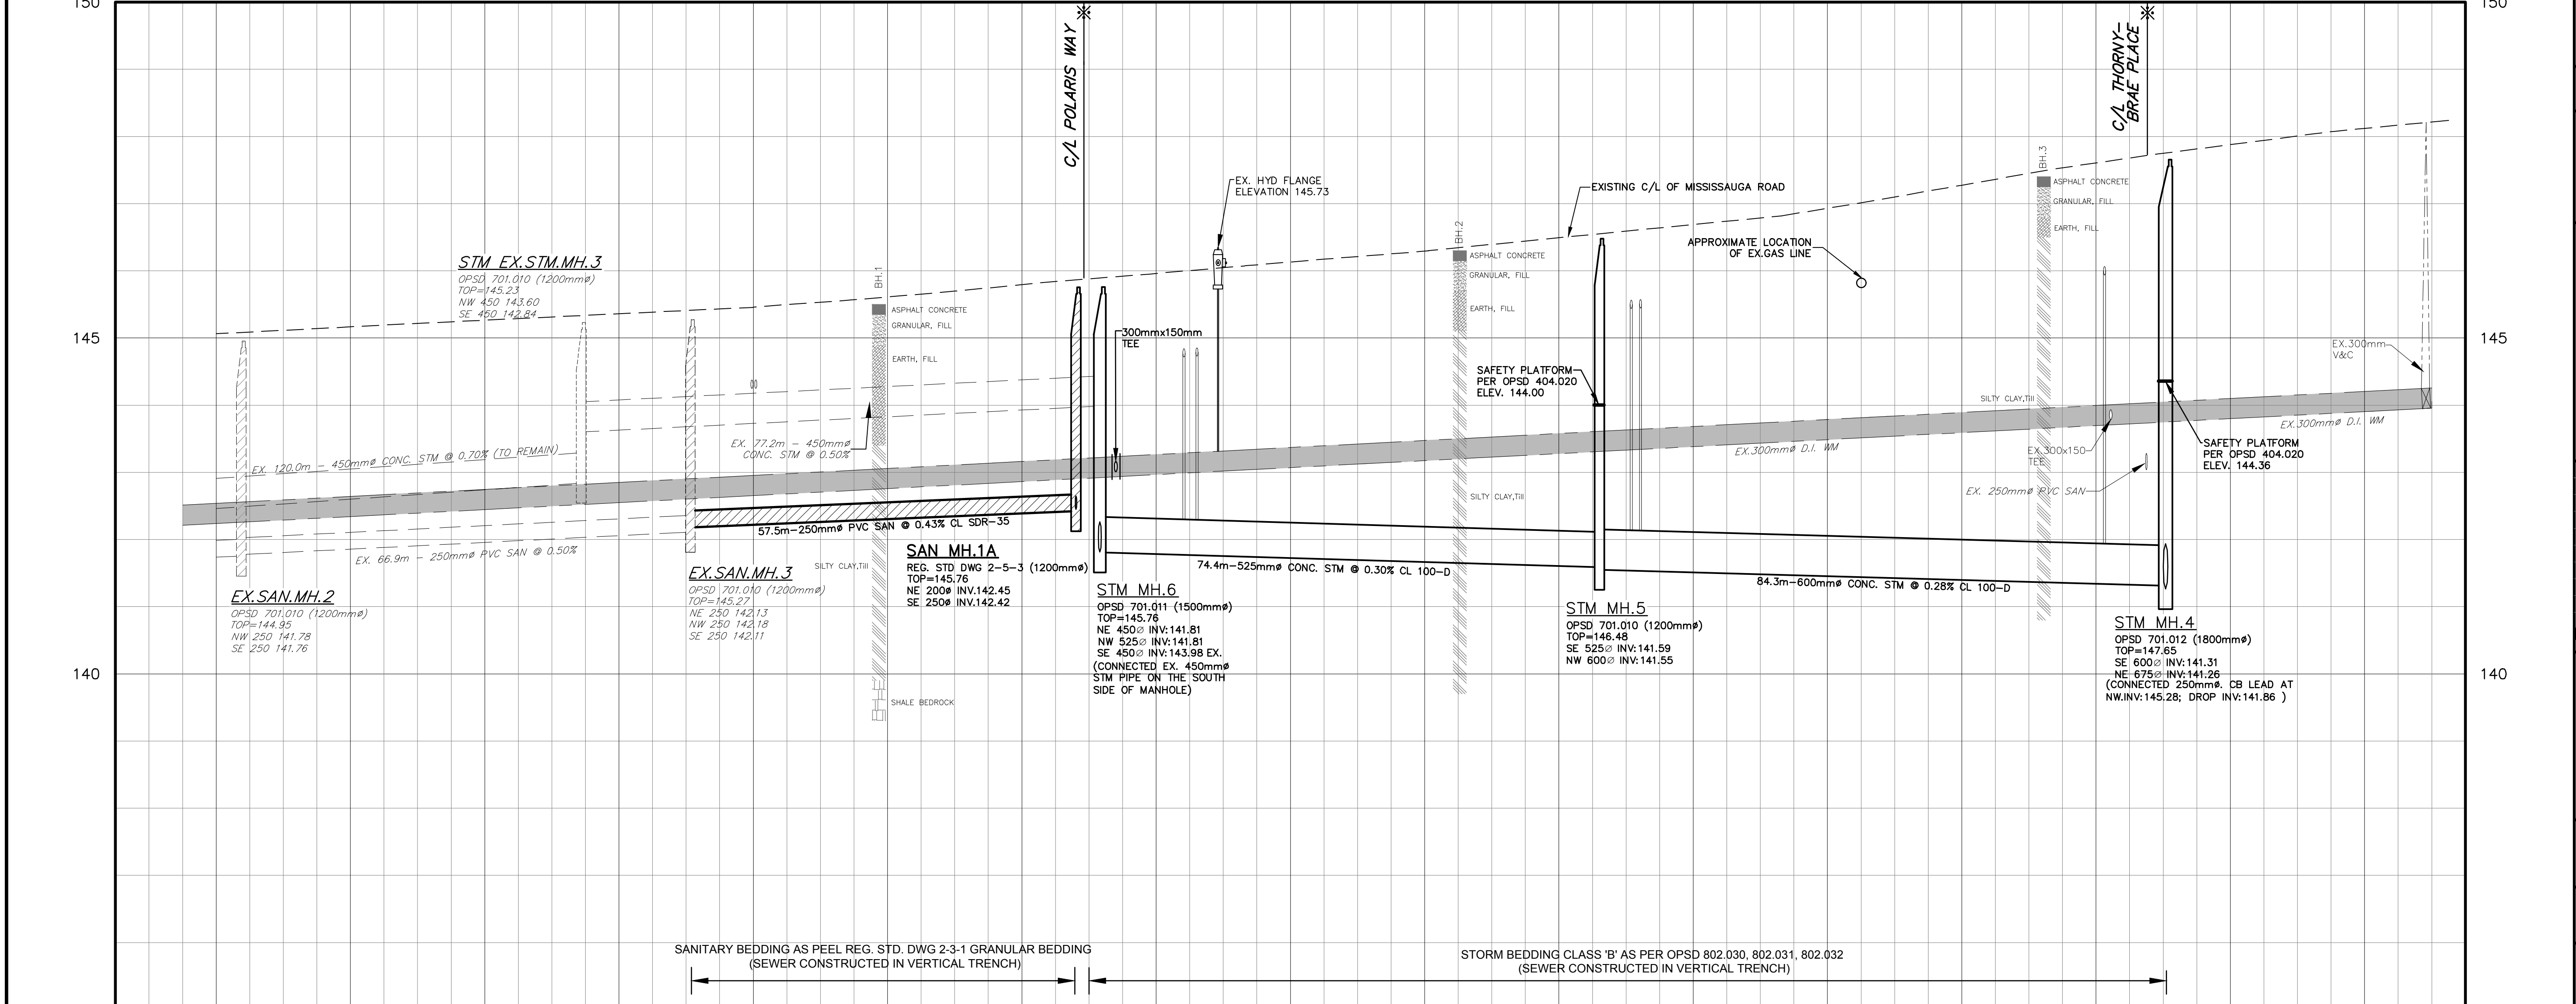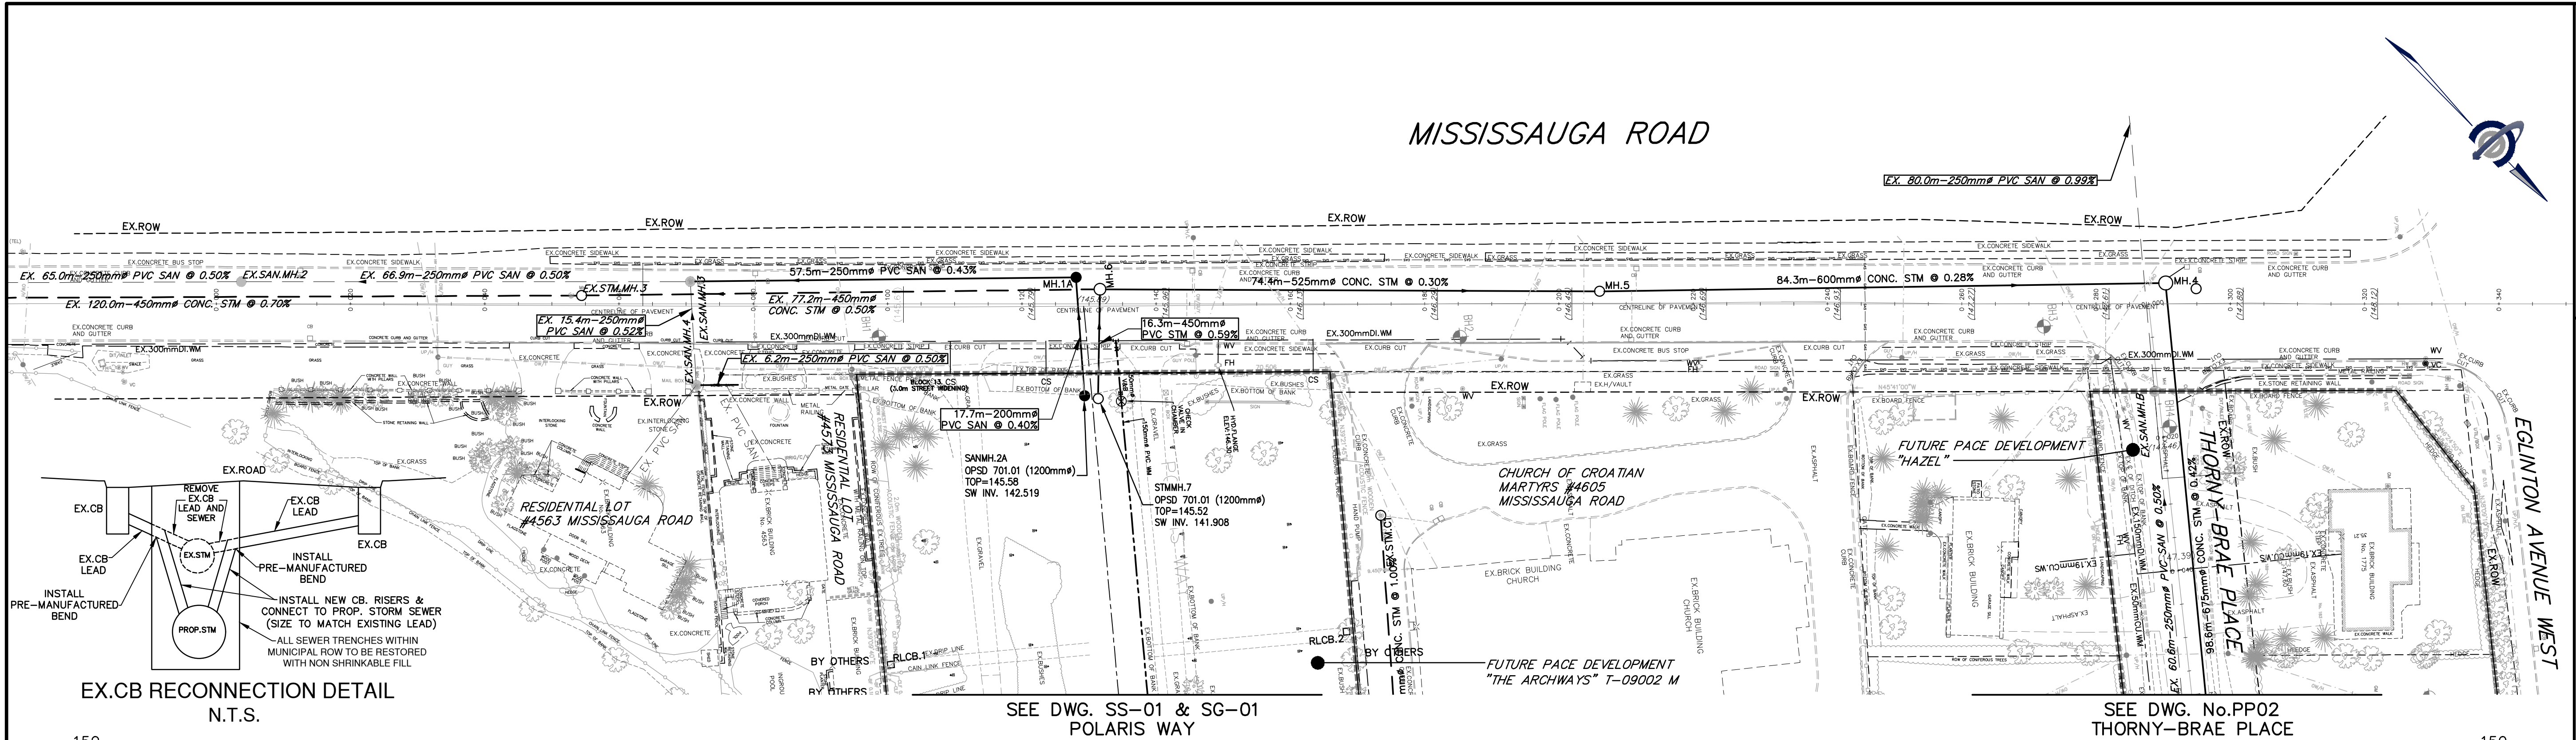

EXISTING CENTRELINE ELEVATIONS	145.06	145.17	145.26	145.36	145.46	145.61	145.79	145.96	146.13	146.29	146.49	146.69	146.93	147.27	147.61	147.89	148.12
CENTRELINE CHAINAGE	0+000	0+020	0+040	0+060	0+080	0+100	0+120	0+140	0+160	0+180	0+200	0+220	0+240	0+260	0+280	0+300	0+320
EXISTING CENTRELINE ELEVATIONS																	
CENTRELINE CHAINAGE																	

EGLINTON AVE. W.

THORNY-BRAE PL

CHURCH OF CROATIAN MARTYRS #4605

POLARIS WAY

MISSISSAUGA ROAD

KEY PLAN N.T.S.

LEGEND

- PROPOSED STORM MANHOLE
- PROPOSED SANITARY MANHOLE
- PROPOSED CATCH BASIN
- PROPOSED DOUBLE CATCH BASIN
- PROPOSED VALVE & BOX
- PROPOSED HYDRANT & VALVE
- EXISTING STORM MANHOLE
- EXISTING SANITARY MANHOLE
- EXISTING CATCHBASIN
- EXISTING VALVE & CHAMBER
- EXISTING HYDRANT & VALVE
- PROPOSED LOT NUMBERS
- STREETLIGHT
- PROPERTY LINE (2462357 ONTARIO INC.)
- EXISTING SEWER TO BE PRESSURE GROUTED
- EXISTING ELEVATION
- EXISTING ELEVATION TO REMAIN
- PROPOSED ELEVATION

THE DEVELOPER TO VERIFY INVERT ELEVATION AND LOCATION OF ALL UNDERGROUND SERVICES AND UTILITIES PRIOR TO COMMENCING WITH WORK.

LIST OF DRAWINGS

GA-01 (GENERAL ABOVEGROUND)	PP-01 (MISSISSAUGA ROAD)
GA-01S (GENERAL ABOVEGROUND)	PP-02 (THORNY-BRAE PLACE)
PLAN - STAGING PLAN	PP-03 (STORM OUTFALL)
GU-01 (GENERAL UNDERGROUND)	DD-01 (GENERAL NOTES)
ST-01 (STORM DRAINAGE PLAN)	DD-02 (DETAIL DRAWINGS)
SA-01 (SANITARY DRAINAGE PLAN)	DD-03 (STRUCTURAL DETAILS)
TM-01 (TRAFFIC MANAGEMENT)	WE 15045-01 (OUTFALL CHANNEL)
PM-01 (PAVEMENT MARKING)	WE 15045-02 (OUTFALL CHANNEL)

SITE PLAN INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

SURVEY INFORMATION

SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101

BENCHMARK

ELEVATIONS SHOWN HEREON ARE REFERRED TO CITY OF MISSISSAUGA BENCHMARK No. 970, HAVING A PUBLISHED ELEVATION OF 148.702 METRES.

NO.	AS CONSTRUCTED	REVISION	DATE	P.F.
1.			March 2019	BY

Region of Peel
working with you


MISSISSAUGA

2462357 ONTARIO INC. (PACE DEVELOPMENTS)
THE ARCHWAYS
4583, 4589, 4601 MISSISSAUGA ROAD,
MISSISSAUGA, ON









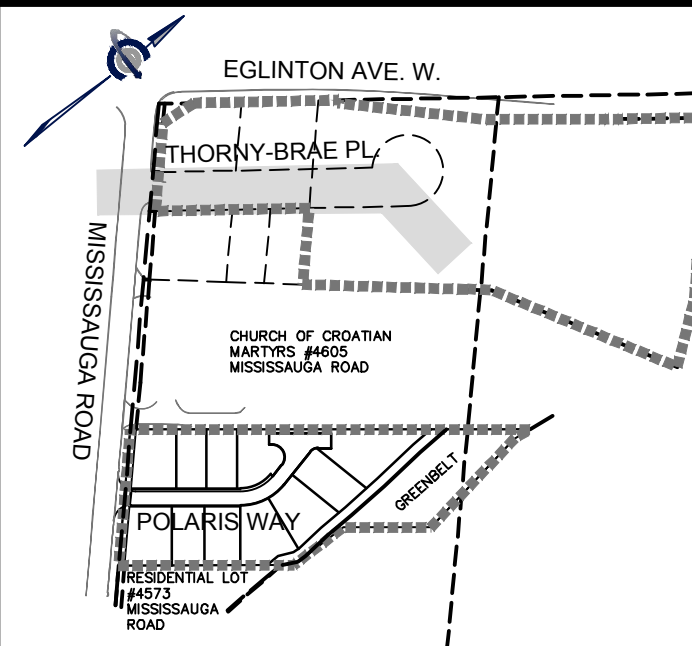











MISSISSAUGA ROAD
STA 0+000 to 0+300

COLE ENGINEERING

DESIGNED BY: P.F. DATE: OCTOBER 2015 CHECKED BY: S.G.
DRAWN BY: P.F. PROJECT No. APPROVED BY: S.G.
SCALE: 1:500 UD15-0347
T-09002 M PP-01



LEGEND

-  PROPOSED STORM MANHOLE
 PROPOSED SANITARY MANHOLE
 PROPOSED CATCH BASIN
 PROPOSED DOUBLE CATCH BASIN
 PROPOSED VALVE & BOX
 PROPOSED VALVE & BOX
 PROPOSED HYDRANT & VALVE
 PROPOSED HYDRANT & VALVE
 EXISTING STORM MANHOLE
 EXISTING SANITARY MANHOLE
 EXISTING CATCHBASIN
 EXISTING VALVE & CHAMBER
 EXISTING HYDRANT & VALVE
 PROPOSED LOT NUMBERS
 PROPOSED 2.0m HIGH ACOUSTIC FENCE
 PROPOSED 2.0m HIGH LIGHT DUTY ACOUSTIC FENCE
 PROPERTY LINE
 (2462357 ONTARIO INC.)
 EXISTING ELEVATION
 EXISTING ELEVATION TO REMAIN
 PROPOSED ELEVATION

LIST OF DRAWINGS	
GA-01 (GENERAL ABOVEGROUND)	PP-01 (MISSISSAUGA ROAD)
GA-01S (GENERAL ABOVEGROUND	PP-02 (THORNY-BRAE PLACE)
PLAN - STAGING PLAN)	PP-03 (STORM OUTFALL)
GU-01 (GENERAL UNDERGROUND)	DD-01 (GENERAL NOTES)
ST-01 (STORM DRAINAGE PLAN)	DD-02 (DETAIL DRAWINGS)
SA-01 (SANITARY DRAINAGE PLAN)	DD-03 (STRUCTURAL DETAIL)
TM-01 (TRAFFIC MANAGEMENT)	WE 15045-01 (OUTFALL CHAN
PM-01 (PAVEMENT MARKING)	WE 15045-02 (OUTFALL CHAN


SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101
FAX: (905) 761-0101


SCHAEFFER DZALDOV BENNETT LTD.
64 JARDIN DRIVE
CONCORD, ONTARIO L4K 3P3
PHONE: (416) 987-0101

ELEVATIONS SHOWN HEREON ARE REFERRED TO
CITY OF MISSISSAUGA BENCHMARK No. 970,

HAVING A PUBLISHED ELEVATION OF 148.702 METRES.				
1.	AS CONSTRUCTED			March 2019
NO.	REVISION			DATE
<input type="checkbox"/>	FIRST	<input type="checkbox"/>	SECOND	<input type="checkbox"/>
DATE	DATE	DATE	INTERIM	DATE
				<input type="checkbox"/> FINAL
				DATE (SEP. 12, 2018)



 COLE ENGINEERING 70 VALLEYWOOD DRIVE, MARSHALL, ON L3R 4T5 T: 905.887.8511 / 1-866-865-8151 / F: 905.887.2054		
DESIGNED BY: P.F.	DATE: OCTOBER 2015	CHECKED BY:
DRAWN BY: P.F.	PROJECT No.	APPROVED BY:
SCALE: 1:500	UD15-0347	DRAWING No.
© COPYRIGHT 2012 Cole Engineering Group Ltd.	T-09002 M	PP-02



Arcadis Professional Services (Canada) Inc.
8133 Warden Ave, Unit 300
Markham, ON L6G 1B3
Canada
Phone: 1 905 763 2322
www.arcadis.com