

ENGINEERING + MANAGEMENT

HUSSON

**FUNCTIONAL SERVICING
AND STORMWATER
MANAGEMENT REPORT**

**128 LAKESHORE ROAD EAST
CITY OF MISSISSAUGA**

**PREPARED FOR:
128 LAKESHORE DEVELOPMENTS INC.
2676 BAYVIEW AVENUE
TORONTO, ON M2L 1B9**

DATE: AUGUST 2025

PROJECT: 211246



FUNCTIONAL SERVICING AND STORMWATER MANAGEMENT REPORT

**128 LAKESHORE ROAD EAST
CITY OF MISSISSAUGA**

**PREPARED FOR:
128 LAKESHORE DEVELOPMENTS INC.
2676 BAYVIEW AVENUE
TORONTO, ON M2L 1B9**

DATE: AUGUST 2025

PROJECT NO. 211246

PREPARED BY HUSSON
200 CACHET WOODS COURT, SUITE 204
MARKHAM, ON L6C 0Z8
GENERAL@HUSSON.CA

TABLE OF CONTENTS

1.0	Introduction	1
1.1	Site Description	1
1.2	Background	1
2.0	Design Criteria	2
3.0	Site Drainage	2
3.1	Existing Drainage	2
3.1.1	Target Flows	2
3.2	Minor System Drainage	3
4.0	Stormwater Management Plan	3
4.1	Water Balance	3
4.2	Quality Control	4
4.3	Quantity Control	4
4.3.1	Target Release Rate	4
4.3.2	Quantity Control Measures	5
5.0	Wastewater	6
6.0	Water Distribution	6
7.0	Erosion and Sediment Control	7
8.0	Conclusions	7

LIST OF FIGURES

- Figure 1. Site Location Plan
Figure 2. Existing Drainage Plan
Figure 3. Proposed Drainage Plan

LIST OF TABLES

Table 1.	Target Flows	3
Table 3.	Site Quantity Control – Drainage to Lakeshore Road East5	
Table 4.	Water Demand Summary	6

LIST OF APPENDICES

- Appendix A – SWM Background
Appendix B – SWM Calculations
Appendix C – Demand Table
Appendix D – FUS and Hydrant Flow Test Summary

LIST OF DRAWINGS

- C100 Grading Plan
C101 Servicing Plan
C102 Utility Plan

1.0 INTRODUCTION

The purpose of this report is to provide detailed design information related to the storm drainage and stormwater management (SWM) plan, sanitary and water servicing for the proposed development at 128 Lakeshore Road East, generally west of Hurontario Street in Mississauga. This report will demonstrate the stormwater management measures that will be undertaken to deal with water quantity and quality, the proposed sanitary and water servicing, as well as erosion and sediment control during construction.

1.1 Site Description

The site is located on the north side of Lakeshore Road East, west of Ann Street, generally west of Hurontario Street. The total site area is 930m² and has an existing two-storey building that is to be demolished. Refer to **Figure 1** for the site location.



A eight-storey mixed use residential building is proposed for the site, with one level of underground parking as well as landscaping.

1.2 Background

Water and sanitary connections are proposed to meet the functional needs of the site and to meet the requirements of the Region of Peel. The SWM plan has been designed to meet the requirements of the City of Mississauga (The City) and Credit Valley Conservation (CVC). The following materials were referenced in the preparation of this report.

- The City of Mississauga Development Requirements Manual (DRM), updated and effective January 2020.
- The Stormwater Management Planning and Design Manual (MECP Guidelines), prepared by the Ministry of the Environment, March 2003.
- The Erosion & Sediment Control Guideline for Urban Construction, prepared by the Greater Golden Horseshoe Area Conservation Authorities (GGHA CA), December 2006.
- As-constructed plan and profile drawings for Lakeshore Road and Ann Street, provided by the City and Region.

The proposed SWM scheme has been prepared to meet the City's requirements. Refer to **Appendix A** for the background information.

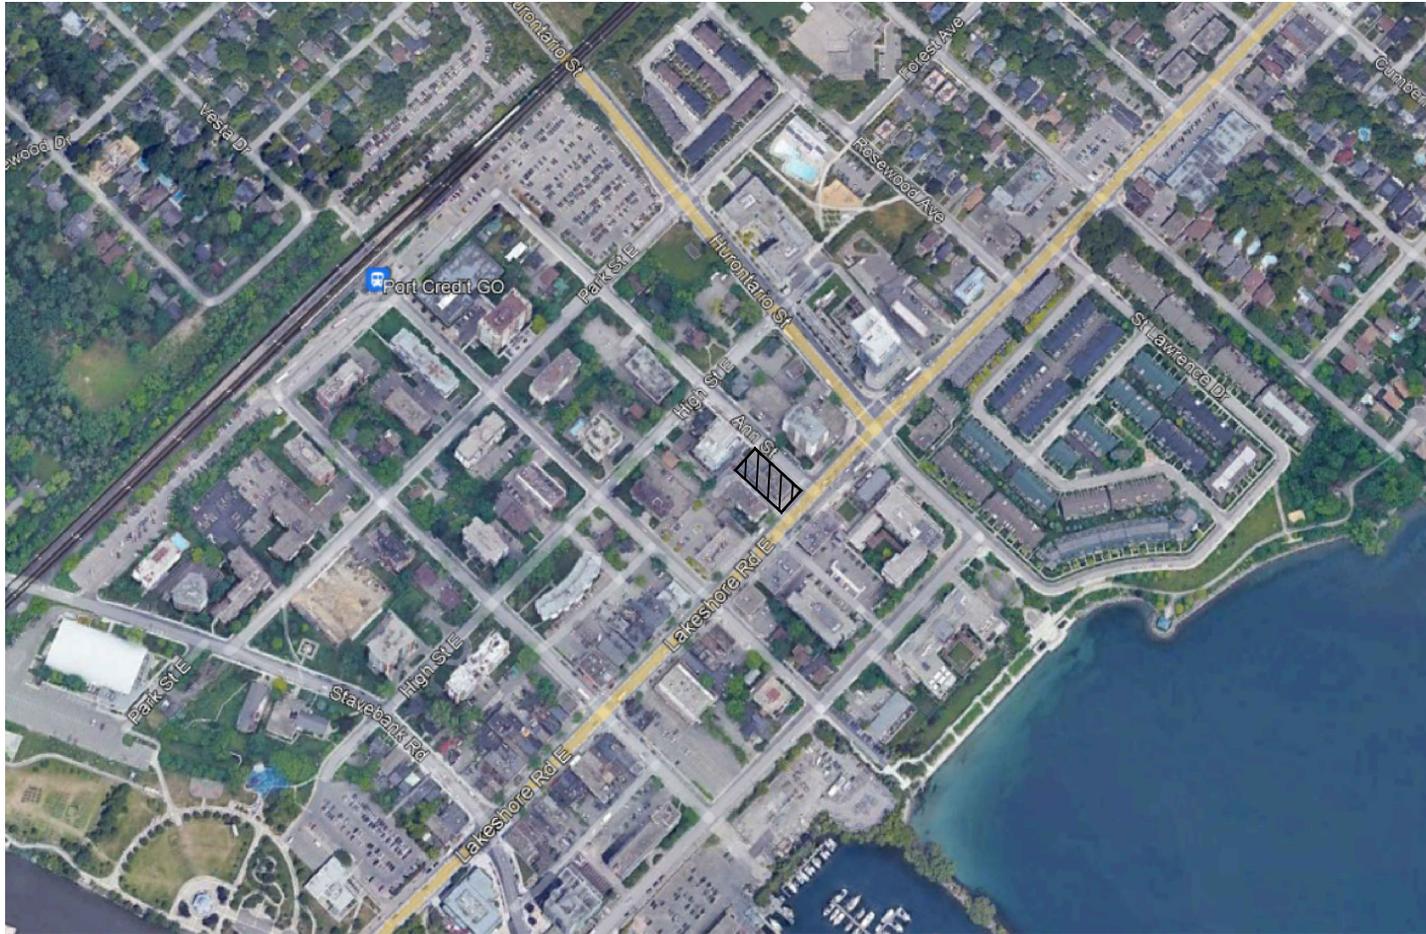

HUSSON

ENGINEERING + MANAGEMENT

P 905.709.5826
300 CAGNET WOODS COURT, SUITE 204
MARKHAM, ON L3C 0Z8
HUSSON.CA

LEGEND



SITE LOCATION

FIGURE 1
128 LAKESHORE ROAD EAST
SITE LOCATION PLAN

DATE: AUGUST 2025 SCALE: N.T.S. PROJECT: 211246

2.0 DESIGN CRITERIA

The following design criteria have been followed in the preparation of the grading, servicing and Stormwater management on the site.

- The DRM requires retention of water on site, to the extent possible, to match pre-development runoff volumes. This requirement is typically achieved by retaining the runoff from a 5mm 24-hour storm on-site, which is equivalent to approximately 50 percent of the total average rainfall volume.
- Water quality controls are required to achieve enhanced water quality control, which requires an 80 percent total suspended solids (TSS) removal level.
- The downstream sewer is at capacity based on discussions with the City, so over-control of the flows onsite to levels below the existing condition is required.
- Provide an erosion and sediment control plan following the Erosion & Sediment Control Guidelines for Urban Construction, prepared by the Greater Golden Horseshoe Area Conservation Authorities (GGHACA), December 2006.

The proposed design has been prepared following these criteria.

3.0 SITE DRAINAGE

All grading will be completed in a manner to satisfy the following goals:

- Maintain sufficient sight lines and existing road gradients.
- Enable gravity servicing connections to the existing sewers on Lakeshore Road.
- Not adversely impact adjacent private properties.
- Achieve stormwater management and environmental objectives required for the site.

The proposed grading of the site has been designed to meet these requirements. Refer to **Drawing C100** for the proposed site grading design.


3.1 Existing Drainage

There is an existing 1650mm diameter storm sewer on Lakeshore Road East to the south of the site. There is no storm sewer adjacent to the site on Ann Street. The majority of the existing site generally drains towards Lakeshore Road East. Refer to **Figure 2** for the existing site drainage.

The design of the site is proposed to generally maintain the existing drainage patterns, and outlet at the south to the existing MH.



3.1.1 Target Flows

The existing site runoff coefficient is 0.87 to Lakeshore Road East. In order to reduce the contribution from the site based on the capacity issues identified by the City, the target is based on controlling all flows up to and including the 100-year event to the 10-year event with a Runoff Coefficient of 0.50.

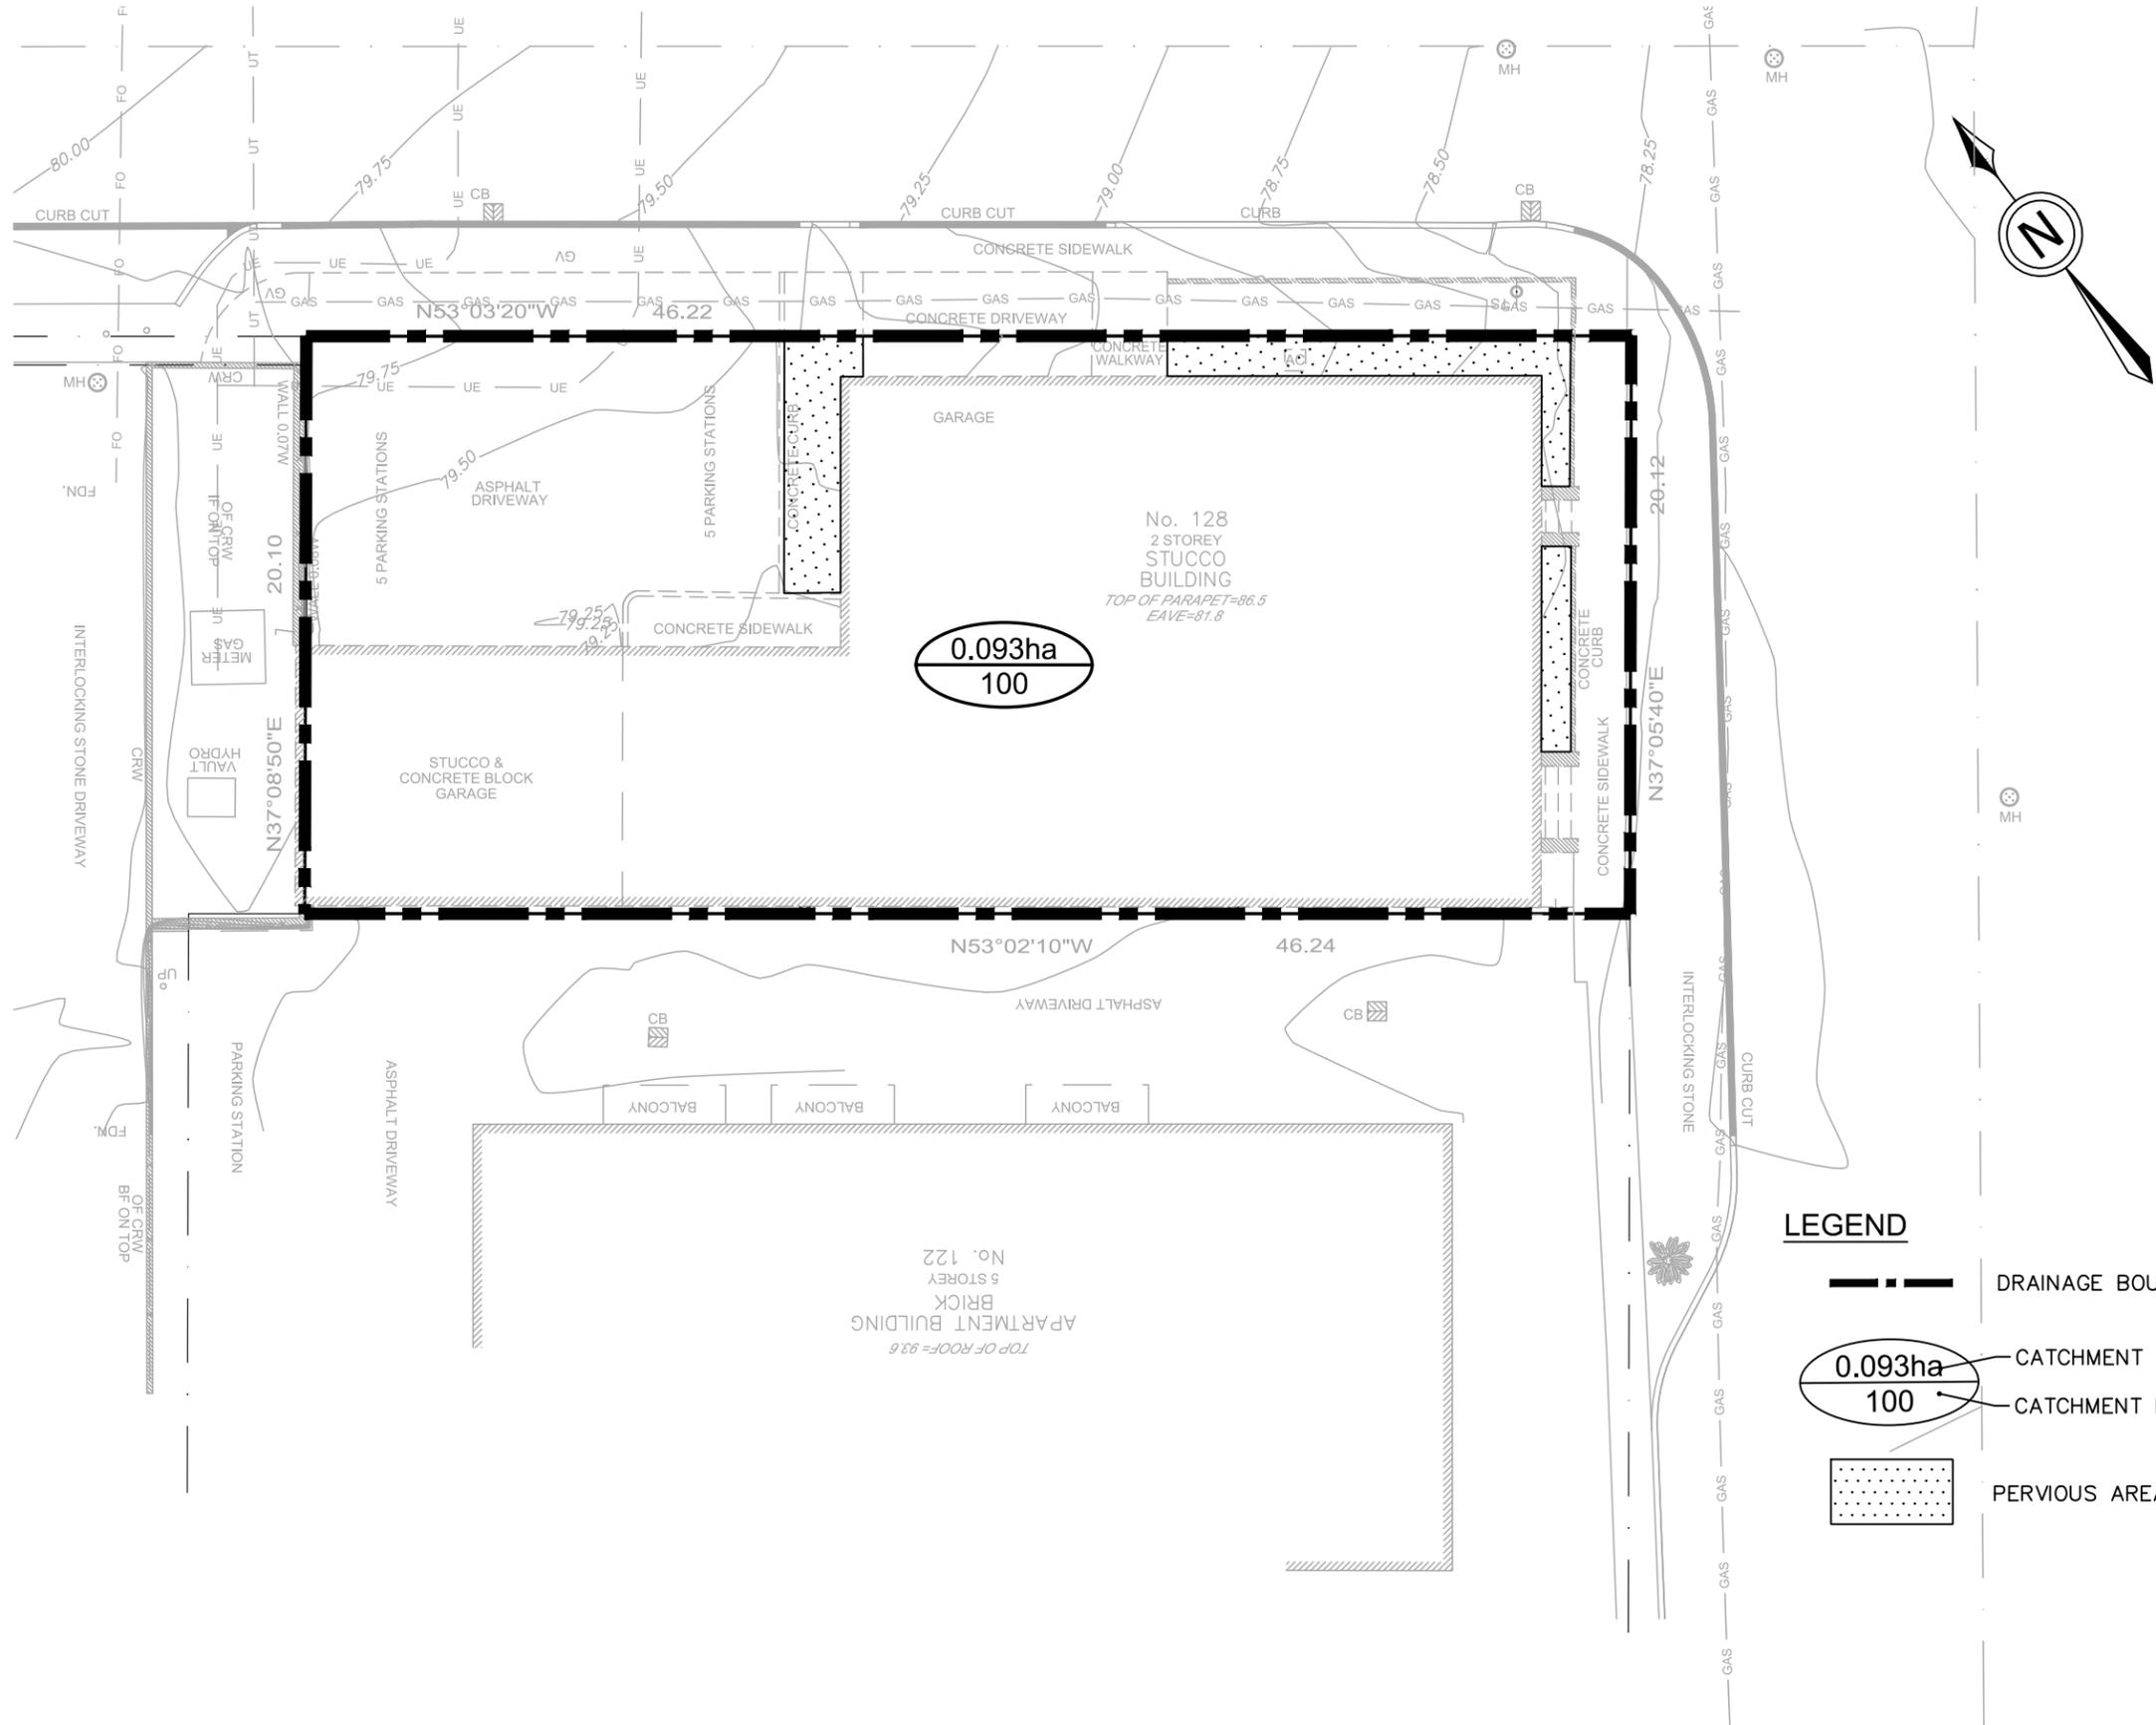

CATCHMENT 100			
	AREA (ha)	C	C x A
PERVIOUS	0.005	0.25	0.001
IMPERVIOUS	0.026	0.90	0.023
BUILDING	0.062	0.90	0.056
TOTAL	0.093	0.87	0.080

LEGEND

-  DRAINAGE BOUNDARY
-  CATCHMENT AREA (ha)
CATCHMENT ID
-  PERVIOUS AREA

HUSSON
ENGINEERING + MANAGEMENT
P 905.709.5926
300 CACHET WOODS COURT, SUITE 204
MARKHAM, ON L3C 0Z8
HUSSON.CA

FIGURE 2
128 LAKESHORE ROAD E
EXISTING DRAINAGE

Therefore, the post development flows will be less than the existing condition, as required. **Table 1** summarizes the target flows for the site.

Table 1. Target Flows

Existing Site (Storm Event)	Catchment Area (m ²)	Runoff Coefficient	Target Flow Rate (L/s)
10 Year	930	0.50	12.8

The proposed design was completed to provide controls for all storm events up to the 100 year storm to meet the target flow rates from the site, as outlined following. Refer to **Appendix B** for the stormwater management calculations.

3.2 Minor System Drainage

The internal storm sewer system will be designed to collect drainage from the building for a 100 year design storm. The system will drain through the building to a cistern located on the basement level.

The controlled flow will be directed to the control MH at the southern portion of the site. There is a small portion of the site, around the perimeter to the south and east, that will direct flows uncontrolled to the Lakeshore Road East Right of Way as a result of grading constraints on the site.

The proposed servicing can be referenced on **Drawing C101**, and the grading design is shown on **Drawing C100**.

4.0 STORMWATER MANAGEMENT PLAN

A stormwater management plan has been prepared for the site following the DRM and MECP Guidelines, to meet the stormwater management criteria for the site. Low-Impact Development (LID) techniques were investigated for the site, including the use of infiltration measures.


4.1 Water Balance

As per the DRM erosion design criteria, retention of runoff from a 5mm design storm on-site is required.

The required retention volume is 4.65m³ (930m² x 5mm). A variety of options are discussed following that could potentially be used to meet the target storage volume.

Permeable Pavement – The surface area could be paved with Permeable Interlocking Concrete Pavers. These are pre-cast pavers that permit water to infiltrate between the paving stones into a clear stone storage reservoir. A permeable pavement with a stone reservoir could be considered a dry-well and, therefore, must be located a minimum of 5m from the building foundation, as per OBC requirements. With the size of the proposed development, this is not feasible for the site.

Green Roof – Green roofs offer water resource benefits such as water quality, water balance and peak flow controls, in addition to other benefits including improved energy efficiency and reduced heat from the rooftop. However, a green roof is not proposed for the building.

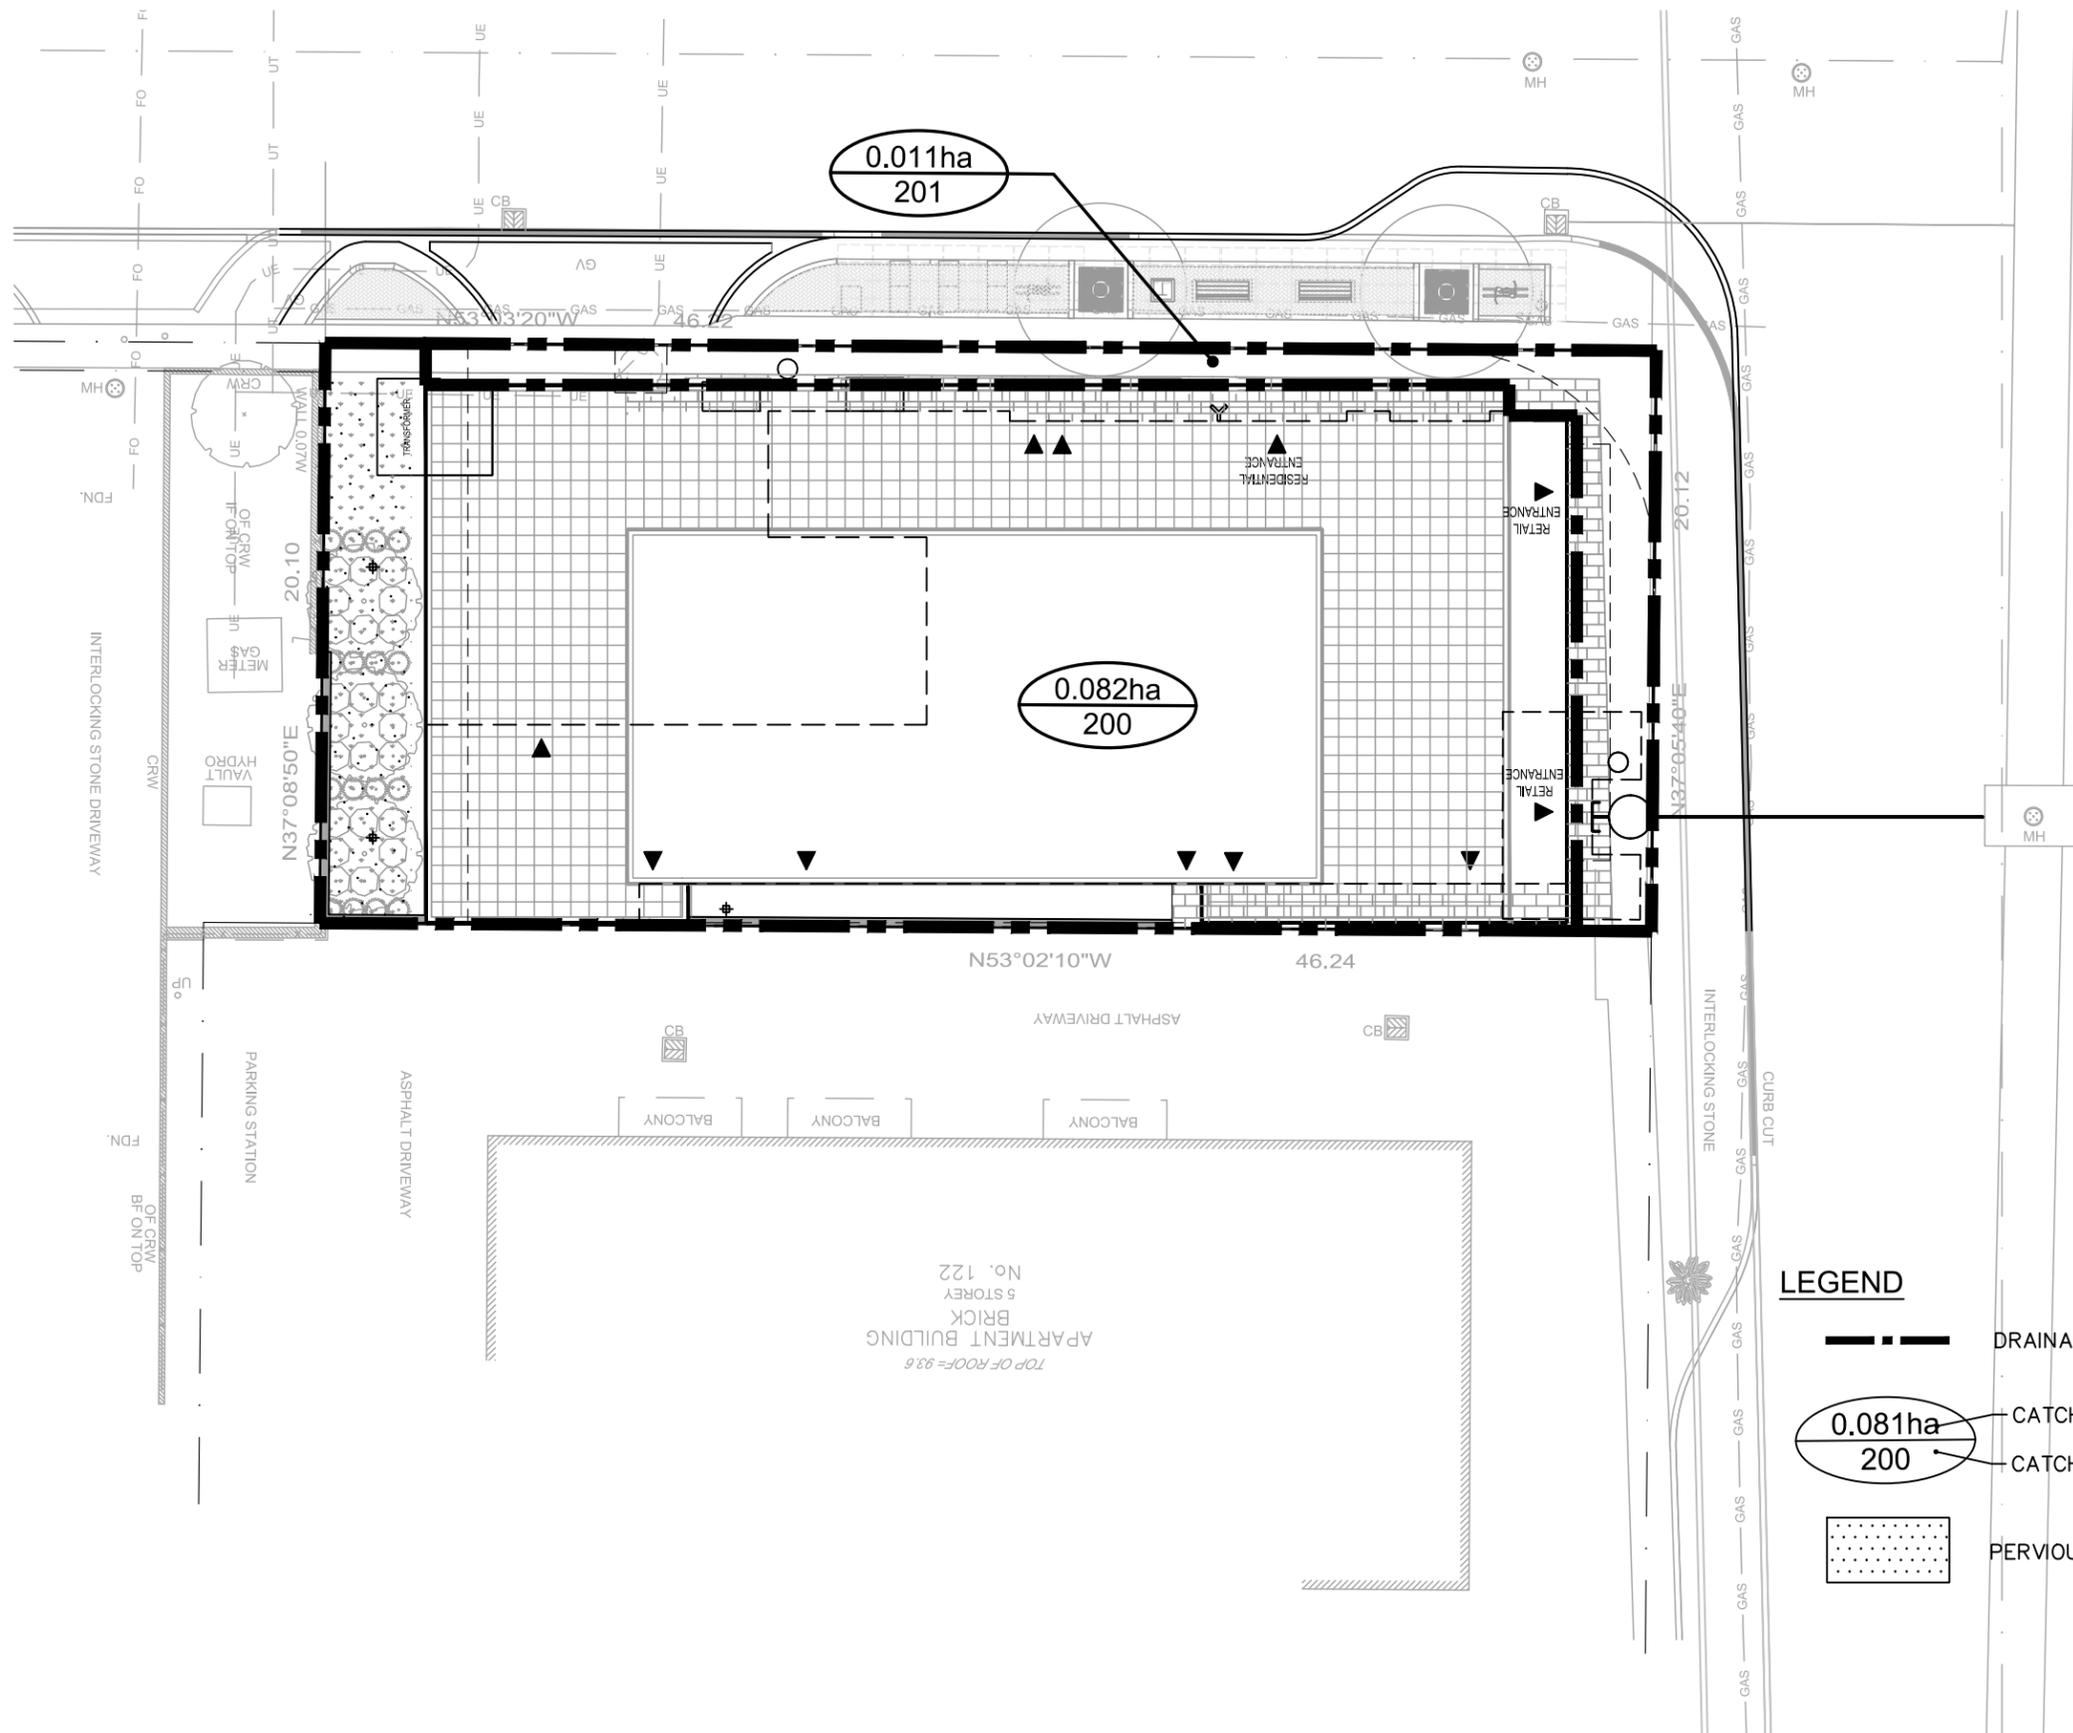

CATCHMENT 200			
	AREA (ha)	C	C x A
PERVIOUS	0.007	0.25	0.002
IMPERVIOUS	0.003	0.90	0.003
BUILDING	0.072	0.90	0.065
TOTAL	0.082	0.84	0.069

CATCHMENT 201			
	AREA (ha)	C	C x A
IMPERVIOUS	0.011	0.90	0.010

LEGEND

- DRAINAGE BOUNDARY
- CATCHMENT AREA (ha)
- CATCHMENT ID
- PERVIOUS AREA

HUSSON
ENGINEERING + MANAGEMENT
P 905.709.5825
300 CACHET WOODS COURT, SUITE 304
MARKHAM, ON L3C 0Z8
HUSSON.CA

FIGURE 3
128 LAKESHORE ROAD EAST
PROPOSED PLAN

Grassed Swales – Grassed swales are used to provide additional water quality controls for surface water, but in this case, the impact would be negligible and not provide sufficient treatment given the limited landscaping proposed on the site. Therefore, this measure is not proposed for this development.

Bioretention – This is a facility that temporarily stores and infiltrates water. Quality treatment is provided by plant material and by filtration through the bed material, which consists of a mixture of sand, fines and organic material. The roof drainage could be routed to a bioretention swale, and stormwater from frequent storms could be infiltrated. However, this is not feasible for this project, given the limited landscaped area on site.

Underground Storage – Storage could be provided in an underground system surrounded by clear stone for infiltration. Storage is provided in both the chambers as well as in the voids within the clear stone, below the outlet invert of the system, so that the required retention volume will only discharge via infiltration. However, infiltration is not feasible for the site due to the minimum 5m separation from the building foundation.

For storms up to the 100-year event, the roof area drains of the proposed building will route drainage to the cistern. Retention will be provided below the outlet invert of the proposed cistern. The total required retention volume is approximately 4.65m³. It is anticipated that best efforts will be made to re-use this volume on the site through landscape irrigation and other internal measures as feasible, to be confirmed during the detailed design stage.

4.2 Quality Control

Based on the DRM, the water quality criterion for this site is 80 percent average TSS removal from runoff originating onsite. The majority of the site is rooftop or landscaped which produces clean runoff. The split is approximately 77% rooftop area, 23% ground area.

The quality control requirements for the site can be addressed through a combination of the roof and other on-site landscape measures. Overall TSS removal capabilities are based on the following assumptions:

- Rooftop and terraces runoff is generally clean and credited with 80 percent TSS removal. Runoff from the roof and terraces will be routed to the proposed cistern.
- Landscaped areas provide significant infiltration and generally have a lower TSS loading compared to roadways, therefore landscape runoff is credited with 80 percent TSS removal.

As shown in **Figure 3**, there is no driveway or loading area draining to the cistern. It is not expected that the site will contribute any contaminants to stormwater runoff, therefore there is no requirement for an Oil Grit Separator to meet the City requirements.

4.3 Quantity Control

4.3.1 Target Release Rate

Calculations using a Runoff Coefficient of 0.50 were used to determine the target flows from the site, as outlined in **Section 3.1.1**. The allowable peak release rate for the site is outlined in **Table 1**.

4.3.2 Quantity Control Measures

The following options were considered for quantity control on site:

Rooftop Storage – Controlled flow roof drains could be installed on the rooftop and water could be stored on the rooftops to attenuate peak flows. With typical flat rooftop design, flows can generally be limited to approximately 42L/s/ha. Rooftop storage is not counted for the quantity controls for the site, based on the proposed development.

Underground Storage – A restrictor pipe would be provided at the site outlet; with surplus storage provided in the cistern.

In order to meet the target release rates, cistern storage is proposed to provide quantity control for the proposed development, as follows.

Controlled Site Drainage

In the 100-year event, the required storage volume required to control the flows to meet the 12.8L/s target is approximately 23m³. Given that pipes and structures would provide a negligible amount of storage, and surface storage cannot be utilized, the cistern would be needed to provide all of the required storage. Approximately 30m³ of storage is estimated to be provided above the outlet of the proposed cistern – details will be finalized in the detailed design stage of the project.

The summary table following shows the proposed flows for the site outletting to the Lakeshore Road East storm sewer. The majority of flow is captured and routed through the building's mechanical drainage system to the cistern, so that the affected area is controlled to meet the target release rate. The controlled flow will be provided by an ICD at the downstream end of the cistern.

Table 2. Site Quantity Control – Drainage to Lakeshore Road East

Catchment Name	Area (m ²)	Runoff Coefficient (C)	Storage Required (m ³)	100 Year Peak Flow (L/s)
Controlled Area (200)	821	0.84	23	8.0
Uncontrolled Area (201)	109	0.90	-	4.2
Total				12.3

Given the location of the cistern in the basement, it will be feasible to convey the controlled flows to the control MH by gravity. The details will be coordinated with the mechanical engineer in the detailed design stage of the project.

As shown, the proposed development flows for all the storm events meets the target flow, and the proposed flows will be conveyed underground for events up to 10-year storm event. Detailed calculations can be referenced in **Appendix B**. Refer to **Drawing C-101** for details of the proposed servicing for the site.

5.0 WASTEWATER

According to the As Constructed drawings for Ann Street and Lakeshore Road East provided by the City, there is a 250mm diameter sanitary sewer along Ann Street, and a 300mm diameter sanitary sewer along Lakeshore Road adjacent to the site. There is a control MH provided at the property line, connected to the 250mm main sewer on Ann Street by a 150mm diameter sewer, that can service the development.

The anticipated flows from the proposed development have been estimated based on the proposed design, for use by the Region to review the receiving system. Detail of the proposed sanitary connection is shown on **Drawing C-101**.

Based on the single-use demand table included in Appendix C, the sanitary flow from the site is estimated to be 1.62L/S, assuming 119 persons at the proposed site. The existing 250mm sanitary sewer service is capable of conveying this flow.

6.0 WATER DISTRIBUTION

According to the As Constructed drawings for Lakeshore provided by the City, a 300mm diameter watermain has been installed along the northern and eastern side of the right-of-way, adjacent to the site.

A fire flow test has been completed, with the results shown in **Appendix D**.

The following water usage parameters were used to determine the daily water demands for the proposed building as per Region Standards.

- Estimated population = 119
- Water Demand = 270 Liters/cap/day
- Peak Hour Peaking Factor = 3.0
- Maximum Day Peaking Factor = 1.8
- Required minimum fire flow = Estimated using the Fire Underwriters Survey

Using the water usage parameters mentioned above the maximum daily flows and peak hourly flows for the proposed building was determined, as shown in **Table 4** below.

Table 3. Water Demand Summary

Scenario	Bldg Demand (L/s)
Max Day	0.67
Peak Hour	1.11
Max Day with Fire Flow	383.3

Based on the hydrant flow test conducted by L&D Waterworks on October 8th, 2021, the available fire flow at 20psi is approximately 624L/s (9,886gpm). Therefore, there is sufficient flow to service the site based on Region of Peel standards. The Single Use Demand Table can be referenced in **Appendix C**, while the FUS and hydrant flow test results can be seen in **Appendix D**.

7.0 EROSION AND SEDIMENT CONTROL

The erosion and sediment control plan will be prepared following the Erosion and Sediment Control Guidelines for Urban Construction (ESC Guidelines), prepared by The Greater Golden Horseshoe Area Conservation Authorities, December 2006. The plan will be designed to limit sediment and debris from leaving the site during all stages of construction.

The sediment control plan for this site will generally consist of the following:

- A sediment control fence will be installed along the perimeter of the site where the grade will direct flows off-site.
- Site access will be limited to one entrance per phase of construction. A gravel access pad will be installed for staging of construction material and vehicles.
- Any mud tracked from the site should be swept immediately and a sweeper truck should be used as necessary to remove any additional debris.
- Trucks leaving the site should be covered with tarpaulin.
- During dry weather, above freezing construction periods, dust control measures including wetting the site and egress points should be implemented on an as needed basis.
- Once the storm sewer system has been constructed, catchbasin sediment control and protection devices will be installed and maintained until the site is ready to be paved.

Erosion measures will be in place prior to any grading on the site. A program will be in place to monitor and maintain the erosion and sediment controls. The sediment controls will be inspected by the Site Engineer and contractor:

- Once every 7 days and/or
- Within 24 hours following any significant rainfall event or snowmelt.

The inspection frequency can be extended to monthly inspections if there is no construction activity on-site. A detailed erosion and sediment control plan will be completed as part of the SPA submission.

8.0 CONCLUSIONS

The stormwater management design for the site has been designed to meet the criteria outlined by the City and the MECP Guidelines. The plan will consist of the following:

- The water balance targets for the proposed development will be achieved through the proposed landscape areas and proposed water re-use from the proposed cistern. Best efforts will be made to meet the City's requirements.
- The quality control requirements for the site can be addressed through a combination of the roof and other on-site landscape measures, which meets the City standard for 80 percent overall TSS removal.

- Peak flows for storms up to and including the 100-year event will be controlled on site to meet the 10-year event with a Runoff Coefficient of 0.5. The proposed development will not have an adverse impact on the existing storm sewer system downstream of the site.
- Sanitary drainage will be conveyed to the existing 250mm diameter sanitary sewer on Ann Street, as per the Region requirements.
- Internal water distribution mains will be connected to the existing watermain located on Ann Street. A hydrant flow test has been completed, and the existing system provides sufficient flows to meet the requirements of the proposed development.


Therefore, based on the information provided herein, the stormwater management and site servicing requirements for the Site Plan Approval have been provided.







APPENDIX A

SWM BACKGROUND

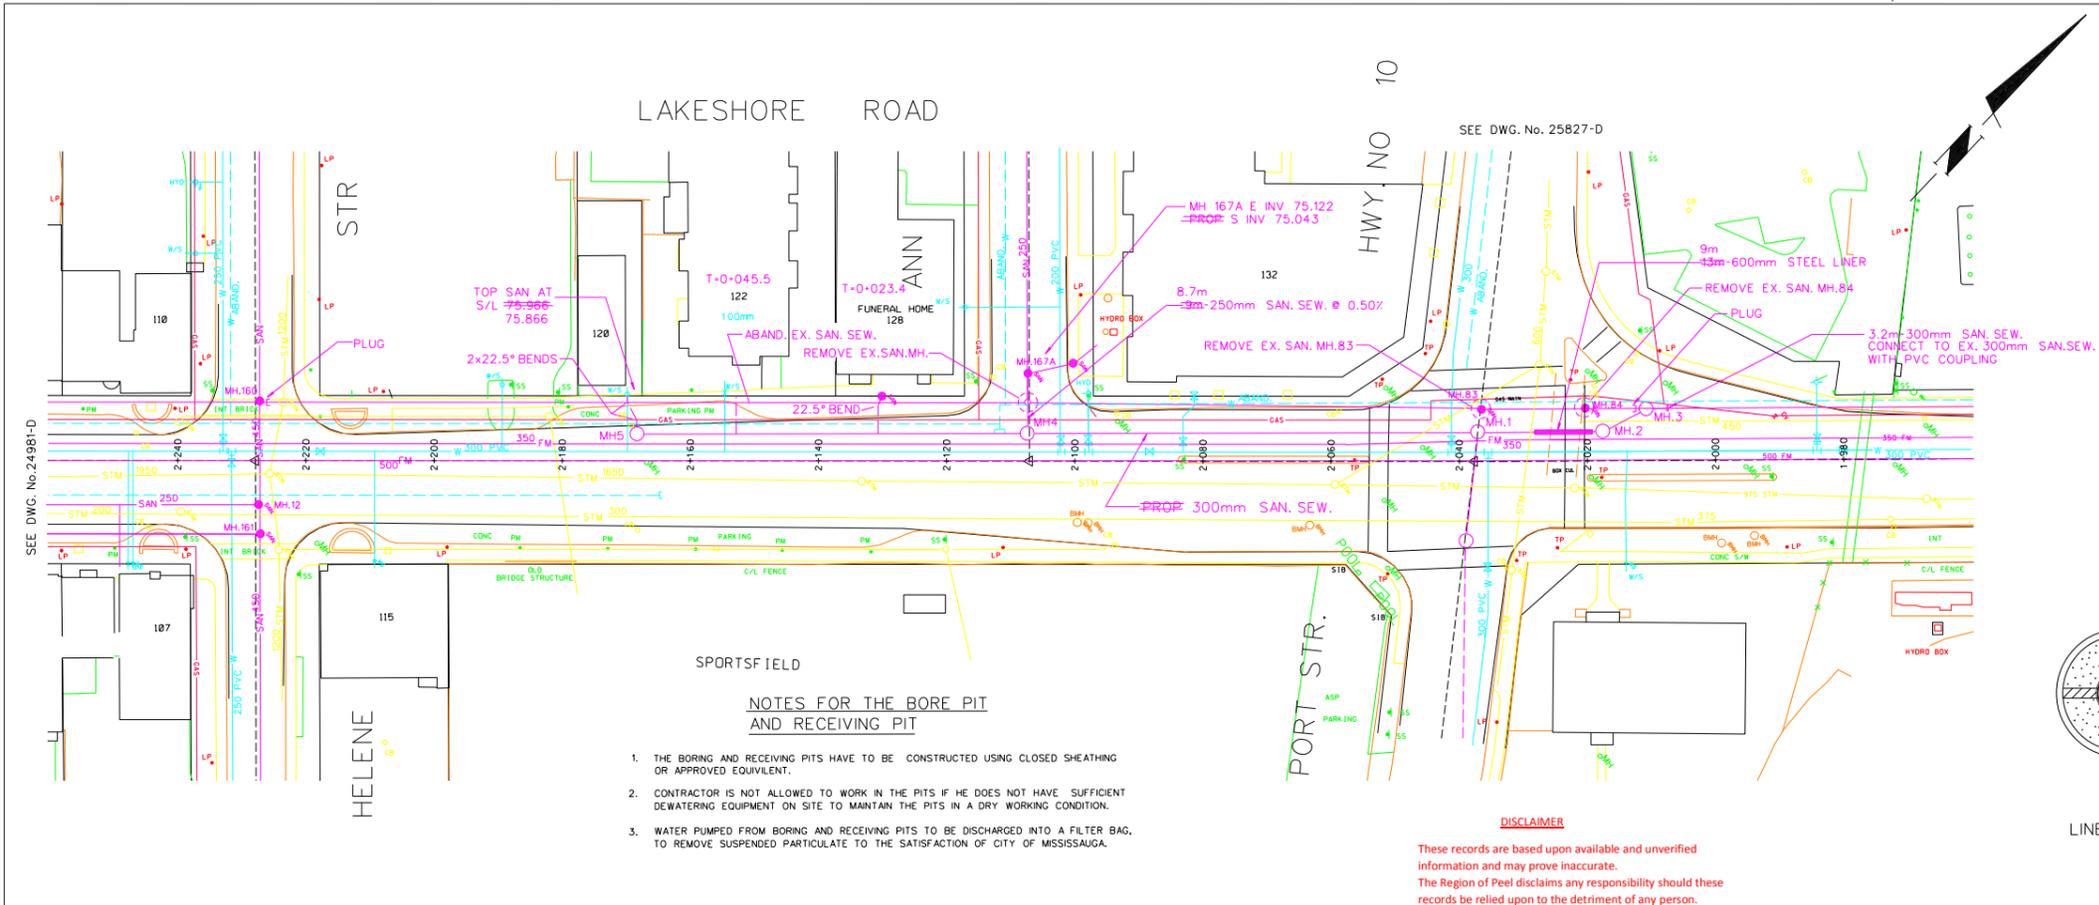

SERVICE DATA					
SERVICE	DATE	INIT.	SERVICE	DATE	INIT.
SAN SEWERS			GAS MAINS		
STORM SEWERS			BELL T.V.G. CABLE		
WATERMANS			HYDRO T.V.G. CABLE		
TRANSIT			ONT. HYDRO		
PARKS & REC.			CTV		
ONT. CLEAN WATER					


REVISIONS		
DATE	DETAILS	INIT.
JULY 17, 2002	AS CONSTRUCTED	Y.C.

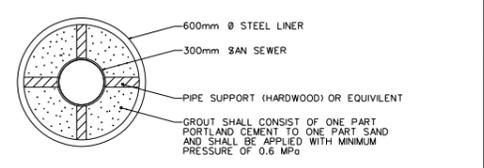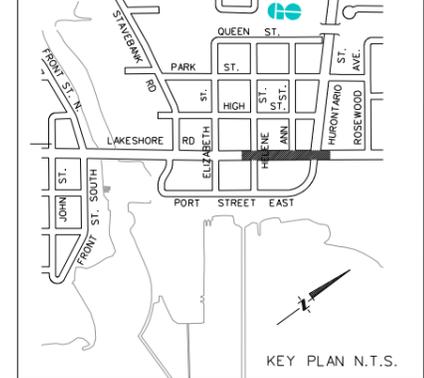

LINER DETAIL
N.T.S.

- NOTES FOR THE BORE PIT AND RECEIVING PIT**
1. THE BORING AND RECEIVING PITS HAVE TO BE CONSTRUCTED USING CLOSED SHEATHING OR APPROVED EQUIVALENT.
 2. CONTRACTOR IS NOT ALLOWED TO WORK IN THE PITS IF HE DOES NOT HAVE SUFFICIENT DEWATERING EQUIPMENT ON SITE TO MAINTAIN THE PITS IN A DRY WORKING CONDITION.
 3. WATER PUMPED FROM BORING AND RECEIVING PITS TO BE DISCHARGED INTO A FILTER BAG, TO REMOVE SUSPENDED PARTICULATE TO THE SATISFACTION OF CITY OF MISSISSAUGA.

DISCLAIMER
These records are based upon available and unverified information and may prove inaccurate. The Region of Peel disclaims any responsibility should these records be relied upon to the detriment of any person.

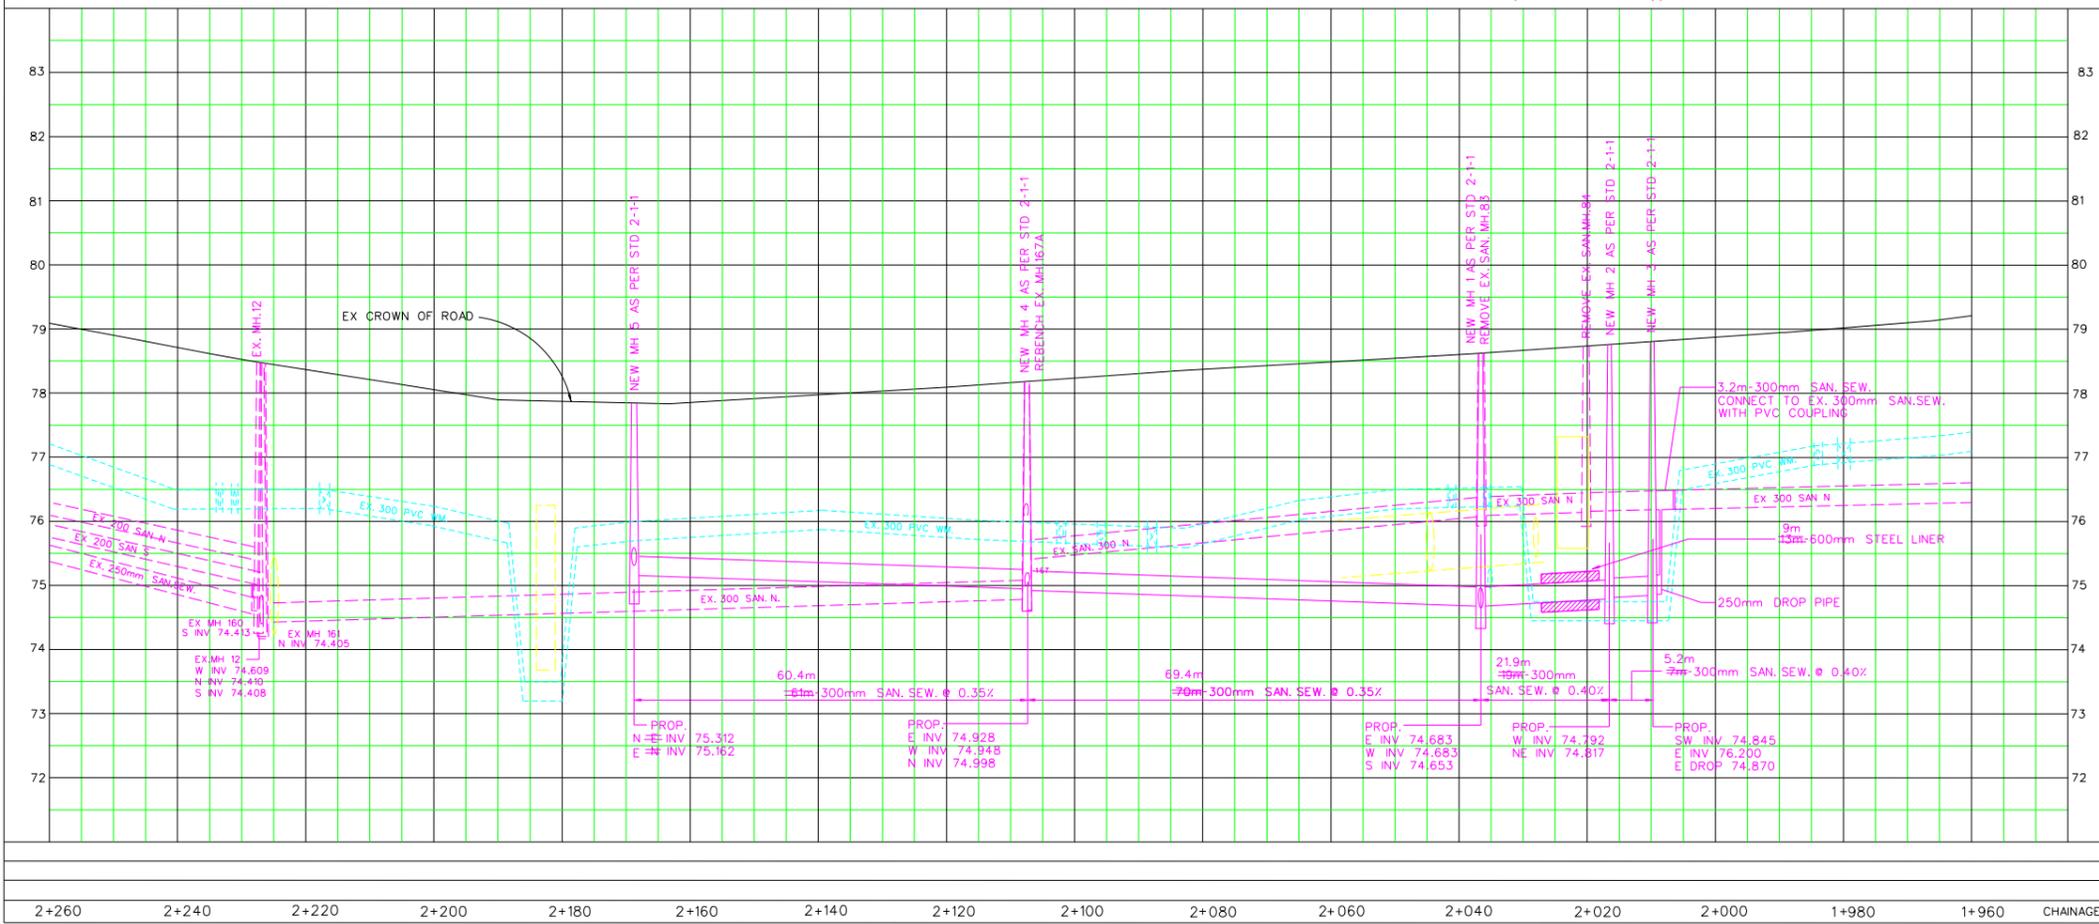

General Notes

- All Driveways ASPHALT Unless Otherwise Noted.
- All Service Locations Are Approximate And Must Be Located Accurately In The Field.
- ⊙ Denotes Building - Not Located
- ⊞ Denotes Building Located
- Type 'B' Bedding Unless Otherwise Noted (SAN)

B.M. No. Elev.

The Contractor Is Responsible For Locating And Protecting All Existing Utilities Prior To And During Construction Location of Existing Utilities Approximate Only To Be Verified In Field By Contractor.

Designed by _____ Chkd. _____ Approved by _____

NOTICE TO CONTRACTOR
48 HOURS PRIOR TO COMMENCING WORK NOTIFY THE FOLLOWING
THE REGIONAL MUNICIPALITY OF PEEL
CITY OF MISSISSAUGA WORKS DEPT.
CITY OF BRAMPTON WORKS DEPT.
TOWN OF CALEDON WORKS DEPT.
BELL TELEPHONE COMPANY
CONSUMERS GAS COMPANY
MINISTRY OF TRANSPORTATION
ONTARIO CLEAN WATER AGENCY
HYDRO ELECTRIC POWER COMM. OF ONTARIO
HYDRO ELECTRIC COMM. CITY OF MISSISSAUGA
HYDRO ELECTRIC COMM. CITY OF BRAMPTON
CABLE TELEVISION



Region of Peel
Public Works

LAKESHORE ROAD
300mm SANITARY SEWER
Sta. 1+960 To Sta. 2+260

Lots	Area Z-B	Project No. 00-2210 SAN
Checked by	Drawn by Ed K	Plan No. 26274-D
Date NOV 00	Sheet 1 of 1	

2+260	2+240	2+220	2+200	2+180	2+160	2+140	2+120	2+100	2+080	2+060	2+040	2+020	2+000	1+980	1+960	CHAINAGE
-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------	----------

GENERAL NOTES

1. LOCATION OF ALL EXISTING UTILITIES IN THE FIELD TO BE ESTABLISHED BY THE DEVELOPER.
2. THE DEVELOPER SHALL BE SOLELY RESPONSIBLE FOR LOCATES, EXPOSING, SUPPORTING AND PROTECTING OF ALL UNDERGROUND AND OVERHEAD UTILITIES AND STRUCTURES EXISTING AT THE TIME OF CONSTRUCTION IN THE AREA OF HIS WORK, WHETHER SHOWN ON THE PLANS OR NOT, AND FOR ALL REPAIRS AND CONSEQUENCES RESULTING FROM DAMAGE TO SAME.
3. THE DEVELOPER SHALL BE SOLELY RESPONSIBLE TO GIVE 72 HOURS WRITTEN NOTICES TO UTILITIES PRIOR TO CROSSING SUCH UTILITIES, FOR THE PURPOSE OF INSPECTION BY THE CONCERNED UTILITY. THIS INSPECTION WILL BE FOR THE DURATION OF THE CONSTRUCTION, WITH THE CONTRACTOR RESPONSIBLE FOR ALL COST ARISING FROM SUCH INSPECTION.
4. ALL PROPOSED CURBING WITHIN THE MUNICIPAL BOUNDARY AREA FOR THE SITE IS TO SUIT AS FOLLOWS: INDUSTRIAL, COMMERCIAL AND CONDOMINIUM DEVELOPMENTS; ALL ENTRANCES TO THE SITE ARE TO BE IN ACCORDANCE WITH O.P.S.D. 355.10.
5. THE EXISTING DRAINAGE PATTERN WILL BE MAINTAINED EXCEPT WHERE NOTED.
6. THE DEVELOPER WILL BE RESPONSIBLE FOR THE COST OF ANY UTILITY RELOCATIONS NECESSITATED BY THE SITE PLAN.
7. PRIOR TO CONSTRUCTION TOWARD PLACE, ALL REQUIRED HOARDING IN ACCORDANCE WITH THE ONTARIO OCCUPATIONAL HEALTH & SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS MUST BE ERECTED AND THEN MAINTAINED THROUGHOUT ALL PHASES OF CONSTRUCTION.
8. THE GEOTECHNICAL AND ENVIRONMENTAL SUITABILITY OF THE FILL WILL BE ASSESSED BY THE GEOTECHNICAL ENGINEER.
9. ALL DIMENSIONS AND ELEVATIONS TO BE VERIFIED PRIOR TO CONSTRUCTION AND ANY DISCREPANCIES FOUND PRIOR TO OR DURING CONSTRUCTION SHALL BE CLARIFIED WITH THE ENGINEER.
10. SIDEWALK CONCRETE STRENGTH 30MPa MINIMUM.

WATER SERVICING NOTES

- ALL MATERIALS AND CONSTRUCTION METHODS MUST CORRESPOND TO THE CURRENT PEEL PUBLIC WORKS STANDARDS AND SPECIFICATIONS.
- WATERMAIN AND/OR WATER SERVICE MATERIALS 100mm (4") AND LARGER MUST BE PVC, SIZE 50mm (2") AND SMALLER SHALL BE COPPER.
- WATERMANS AND/OR WATER SERVICES ARE TO HAVE A MINIMUM COVER OF 1.7m (5ft) WITH A MINIMUM HORIZONTAL SPACING OF 1.2M FROM THEMSELVES AND ALL OTHER UTILITIES.
- PROVISIONS FOR FLUSHING WATER LINE PRIOR TO TESTING ETC. MUST BE PROVIDED WITH AT LEAST 4 50mm (2") OUTLET ON 100mm (4") AND LARGER LINES. COVER LINES ARE TO HAVE FLUSHING POINTS AT THE END, THE SAME SIZE AS THE LINE THEY MUST ALSO BE USED TO ALLOW THE WATER TO DRAIN ONTO A PARKING LOT OR DOWN A DRAIN, ON FIRE LINES, THE FLUSHING OUTLET TO BE 100mm (4") DIAMETER MINIMUM ON A HYDRANT.

- ALL CURB STOPS TO BE 30mm (10") OFF THE FACE OF BUILDING UNLESS OTHERWISE NOTED.
- HYDRANT AND VALVE SET TO BE TO REGION STANDARD 1-B-1, DIMENSION A AND B, 0.3m (12") AND 0.9m (37") AND TO HAVE FLAMPER NOZZLE.
- WATERMANS TO BE INSTALLED TO GRADES AS SHOWN ON APPROVED SITE PLAN. COPY OF GRADE SHEET MUST BE SUBMITTED TO INSPECTOR PRIOR TO COMMENCEMENT OF WORK, WHERE REQUESTED BY INSPECTOR.
- WATERMANS MUST HAVE MINIMUM VERTICAL CLEARANCE OF 0.3m (12") OVER / 0.5m (20") UNDER SEWERS AND ALL OTHER UTILITIES WHEN CROSSING.
- ALL PROPOSED WATER TYPING MUST BE ISOLATED FROM EXISTING LINES IN ORDER TO ALLOW INDEPENDENT PRESSURE, TESTING AND CHLORINATING FROM EXISTING SYSTEMS.
- ALL LIVE TAPPING AND OPERATION OF REGION WATER VALVES SHALL BE ARRANGED THROUGH THE REGION INSPECTOR ASSIGNED OR BY CONTACTING THE OPERATIONS AND MAINTENANCE DIVISION.

GENERAL SERVICING NOTES

1. THE LOCATION OF ALL EXISTING UTILITIES AND SERVICES TO BE VERIFIED BY THE DEVELOPER PRIOR TO CONSTRUCTION. MIN. 1.2m HORIZONTAL AND 0.3m (CROSSING ABOVE) OR 0.5m (CROSSING) BELOW VERTICAL CLEARANCE. MUST DAUGHTER ALL CORNERS WHEN CROSSING REGION INFRASTRUCTURE.
2. THIS PLAN SHOULD BE READ IN CONJUNCTION WITH ALL OTHER CONSULTANT'S PLANS ANY DISCREPANCIES SHALL BE CLARIFIED PRIOR TO CONSTRUCTION. INFORMATION RELATED TO DIMENSIONS FOR PRIVATE ROAD, FACING AND SETBACKS TO BE TAKEN FROM THE SITE PLAN PREPARED BY CHAIRMAN REGIONAL ASSOCIATION OF ARCHITECTS.
3. ALL SERVICES AND APPURTENANCE MATERIAL AND CONSTRUCTION METHODS SHALL BE IN ACCORDANCE WITH THE LATEST CITY OF MISSISSAUGA, REGIONAL MUNICIPALITY OF PEEL, ONTARIO PLUMBING CODE AND ONTARIO PROVINCIAL STANDARDS AND SPECIFICATIONS.
4. ALL REMOVED OR DAMAGED CURBS, SIDEWALK AND SOI RESULTING FROM SERVICE INSTALLATION SHALL BE REINSTATED BY SERVING DEVELOPER TO THE CITY OF MISSISSAUGA STANDARDS.
5. WATERMAIN RECONSTRUCTION TRENCH BACKFILL TO BE UNSHRIKABLE FILL AS PER CITY STANDARDS.

LEGEND

- PROPOSED STORM SEWER MANHOLE
- EXISTING SANITARY SEWER MANHOLE
- EXISTING STORM SEWER MANHOLE
- EXISTING CATCH-BASIN
- PROPERTY LINE
- UNDERGROUND PARKING LIMIT
- EXISTING HYDRANT
- PROPOSED HYDRANT
- EXISTING HYDRO LIGHT
- LIMIT OF DISTURBANCE (PROPOSED)
- EX. SIDEWALK TO REMAIN
- PROP. SIDEWALK

SERVICE DATA			
SERVICE	DATE	INT.	INT.

REVISIONS		
DATE	DETAILS	INT.

- NOTE:**
1. ALL DIMENSIONS AND ELEVATIONS ARE METRIC, UNLESS OTHERWISE NOTED.
 2. SITE PLAN PROVIDED BY BROOKMILLROY DATED: JUNE 1, 2015
 3. TOPOGRAPHIC SURVEY COMPLETED BY JD. BARNES LTD DATED: JULY 4TH, 2012
 4. DEVELOPER TO BE RESPONSIBLE FOR LOCATION OF ALL EXISTO LINES & OVERHEAD UTILITIES. VARIOUS UTILITIES CONCERNED TO BE GIVEN REQUIRED ADVANCE NOTICE PRIOR TO ANY DIGGING, FOR STAKE OUT.

DATE	DESCRIPTION	S.P.	INT.
13/05/17	SERVING AGREEMENT SUBMISSION	S.P.	
17/02/17	SERVING AGREEMENT SUBMISSION	S.P.	
09/05/16	SERVING AGREEMENT SUBMISSION	S.P.	



BENCHMARK

CITY BM No. 650179 ELEV. 85.641

ELEVATIONS ARE REFERRED TO THE CITY OF MISSISSAUGA BENCHMARK No. 80079, LOCATED AT CHURCH BRIDGE OVER HURON AVENUE STREET, TABLE 1 IN TOP OF SIDEWALK ON N.W. SIDE OF RAILWAY 4 FEET N.E. END, 2 FEET N.W. OF (EDGE OF CURB) HAVING A PUBLISHED ELEVATION OF 85.641 METERS

LOCAL BENCHMARK No.1
CUT CROSS IN CONCRETE SIDEWALK AT DRIVEWAY ENTRANCE. EL= 81.24m

LOCAL BENCHMARK No.2
CUT CROSS IN CONCRETE SIDEWALK AT WALKWAY ENTRANCE. EL= 81.29m

INSPECTION

WATERMANS ROADWORK

SHOP DRAWINGS STORM SEWERS

SANITARY SEWERS TRAFFIC

DATE: Jan 26/18 JT TECHNICAL ANALYST



GHD Inc.
6705 Microtek Drive, Unit 1
Mississauga, Ontario L5M 5M4
T 416 213 7121 F 416 890 8499
E ylam@ghd.com W www.ghd.com

F. S. 6810 LIMITED PARTNERSHIP


3 Ann Street, 77 High St East & 51 High St East (OZ 14/007)

MISSISSAUGA 2-08,305
Transportation and Works

PLAN & PROFILE
ANN STREET
300 mm DIA WATERMAIN WORKS
STA. 0+00 TO STA. 0+140

SANITARY SEWER	SCALE: 1:250	AREA	PROJECT No. 11979
DATE: APRIL 2018	DRAWN BY: S.Y.	CHECKED BY: S.P.	PLAN No. P-101
CHANGE#		SHEET 4 OF 3	(6286) 0

As constructed by: Summit concrete & Drain
Inspection By: Joan Seabra July 30th 2018

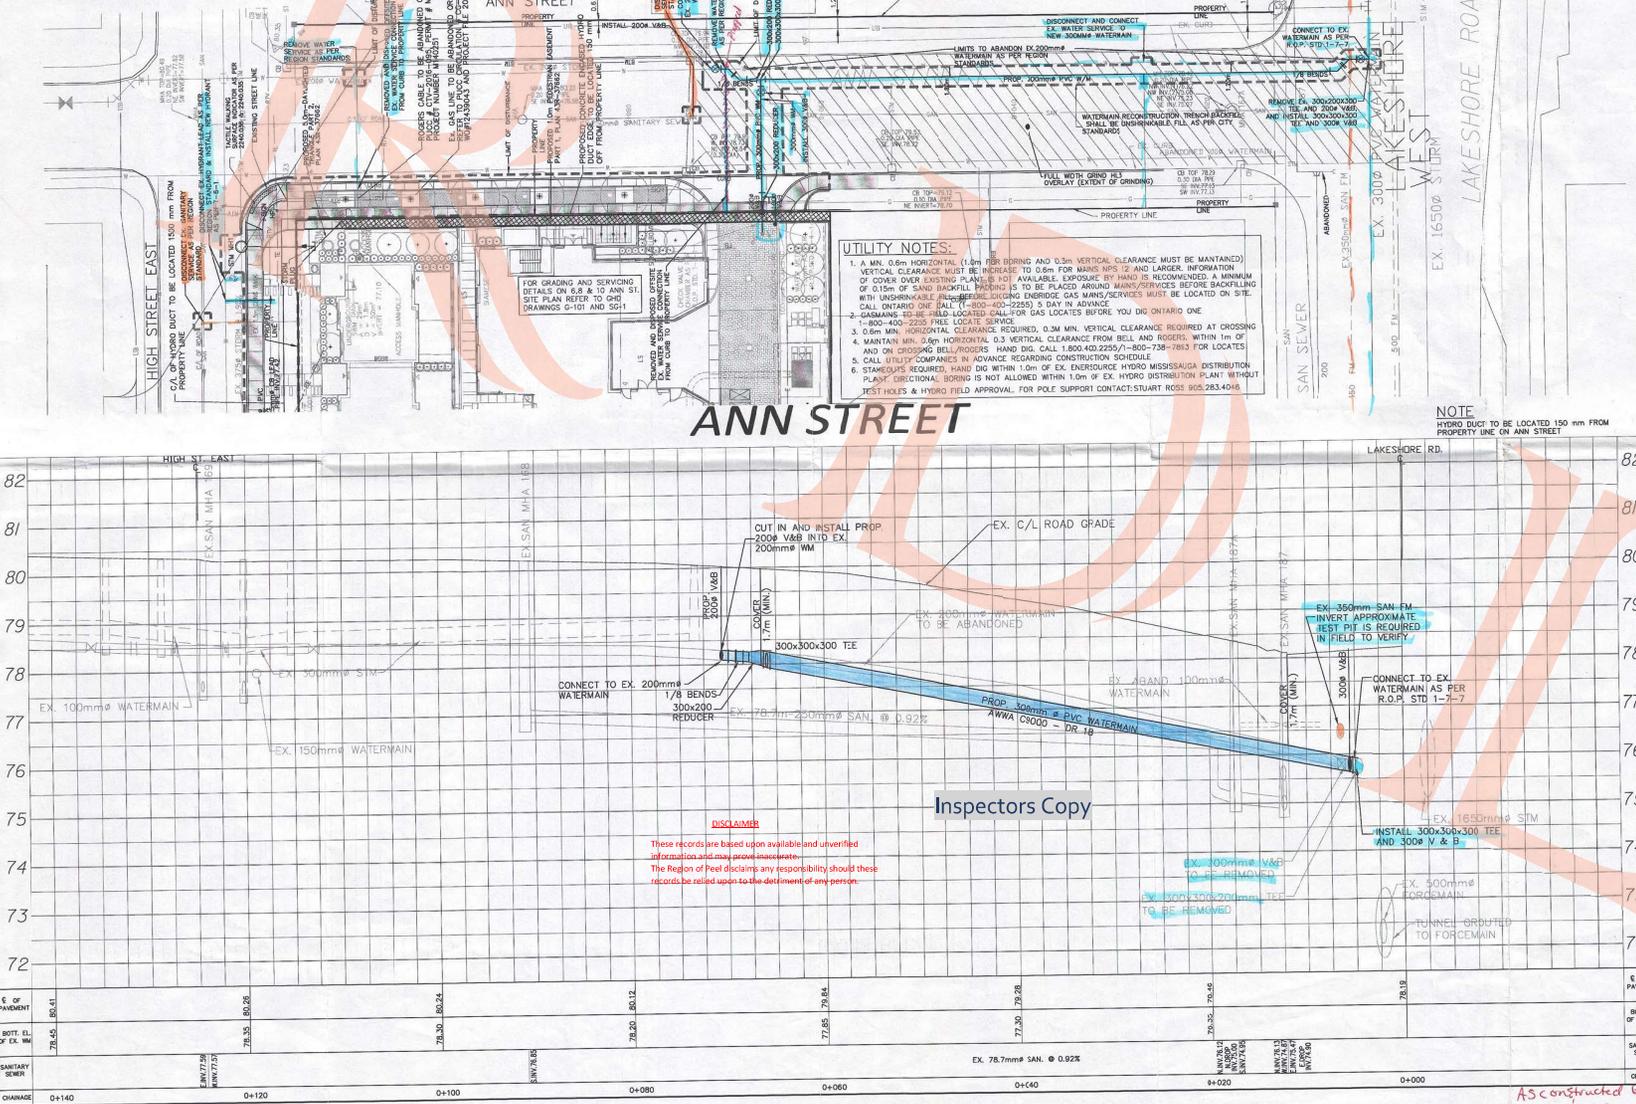



APPENDIX B

**STORMWATER MANAGEMENT
DESIGN CALCULATIONS**

Rational Method Calc.

Project: 128 Lakeshore
 Project No.: 211246
 Municipality: City of Mississauga
 Catchment: Pre-Development

Pre-Development Flow	Catchment 100	
	10 Year (Target)	100 Year (Actual)
Runoff Coefficient (C) =	0.50	0.87
Area (A) =	0.093	0.093
A:	1010.00	1450.00
B:	4.60	4.90
C:	-0.78	-0.78
Tc:	15.0	15.0
Intensity (I) mm/hr =	99.2	140.7
Peak Flow (Q) L/s =	12.8	31.4

To Lakeshore (100)			
	Area (m2)	C	CxA
Building	621	0.90	558.9
Landscape	50	0.25	12.5
Impervious Area	259	0.90	233.1
	930	0.87	804.5

Rational Method Calc.

Project: 128 Lakeshore
 Project No.: 211246
 Municipality: City of Mississauga
 Catchment: Proposed Uncontrolled Area

Uncontrolled Flow	Catchment 201
100 Year	
Runoff Coefficient (C) =	0.99
Area (A) =	0.0109
A:	1450.00
B:	4.90
C:	-0.78
Tc:	15.0
Intensity (I) mm/hr =	140.7
Peak Flow (Q) L/s =	4.2

Uncontrolled to Lakeshore (201)

	Area (m2)	C	CxA
Landscape	0	0.25	0.0
Impervious Area	109	0.90	98.1
	109	0.90	98.1

Controlled Area (200)

	Area (m2)	C	CxA
Impervious Roof	718	0.90	646.2
Landscape	72	0.25	18.0
Impervious Area	31	0.90	27.9
	821	0.84	692.1

Modified Rational Method

Project: 128 Lakeshore
 Project No.: 211246
 Municipality: City of Mississauga
 Catchment: Controlled Area (200)

			100-Year	
Area:	0.082 ha		Rainfall $I=A*(T+B)^C$	
Runoff Coefficient:	0.84		A:	1450
100-yr Runoff Coefficient:	0.99		B:	4.9
Target Flow:	0.008 m ³ /s		C:	-0.78
Storage Required	23 m ³			

Initial Time	15 min	Increment	5 min		
Time (min)	Intensity (mm/hr)	Peak Flow (m ³ /s)	Runoff Volume (m ³)	Discharge Volume (m ³)	Storage Volume (m ³)
15	140.7	0.032	28.59	7.20	21.4
20	118.1	0.027	32.00	9.60	22.4
25	102.4	0.023	34.68	12.00	22.7
30	90.8	0.020	36.89	14.40	22.5
35	81.8	0.018	38.77	16.80	22.0
40	74.6	0.017	40.41	19.20	21.2
45	68.7	0.016	41.87	21.60	20.3
50	63.8	0.014	43.18	24.00	19.2
55	59.6	0.013	44.38	26.40	18.0
60	56.0	0.013	45.48	28.80	16.7
65	52.8	0.012	46.50	31.20	15.3
70	50.0	0.011	47.45	33.60	13.8
75	47.6	0.011	48.34	36.00	12.3
80	45.4	0.010	49.17	38.40	10.8
85	43.4	0.010	49.97	40.80	9.2
90	41.6	0.009	50.72	43.20	7.5
95	40.0	0.009	51.43	45.60	5.8
100	38.5	0.009	52.12	48.00	4.1
105	37.1	0.008	52.77	50.40	2.4
110	35.8	0.008	53.40	52.80	0.6
115	34.7	0.008	54.00	55.20	-1.2
120	33.6	0.008	54.58	57.60	-3.0
125	32.6	0.007	55.14	60.00	-4.9
130	31.6	0.007	55.68	62.40	-6.7

Cistern Volume: 30 m³
 Footprint: 30 m²
 Height: 1 m

Sump Volume 4 m³
 Footprint: 8.0 m²
 Height: 0.5 m

Groundwater Discharge 0.00004 m³/s
 Uncontrolled Flow 0.00422 m³/s
 Total Peak Flow 0.01226 m³/s

Target	0.01281 m ³ /s
--------	---------------------------

Difference 0.00055 m³/s


Storage Required: 26 m³
 Storage Provided: 30 m³

Technical Specification

Control Point	Original Setting		Minimum Setting		Maximum Setting	
	Head (m)	Flow (l/s)	Head (m)	Flow (l/s)	Head (m)	Flow (l/s)
Primary Design	1.000	8.000	1.000	6.954	1.000	8.923
Flush-Flo™	0.302	7.987	0.482	6.219	0.267	9.532
Kick-Flo®	0.664	6.608	0.665	5.744	0.664	7.376
Mean Flow		6.898		5.658		7.901



hydro-int.com/patents

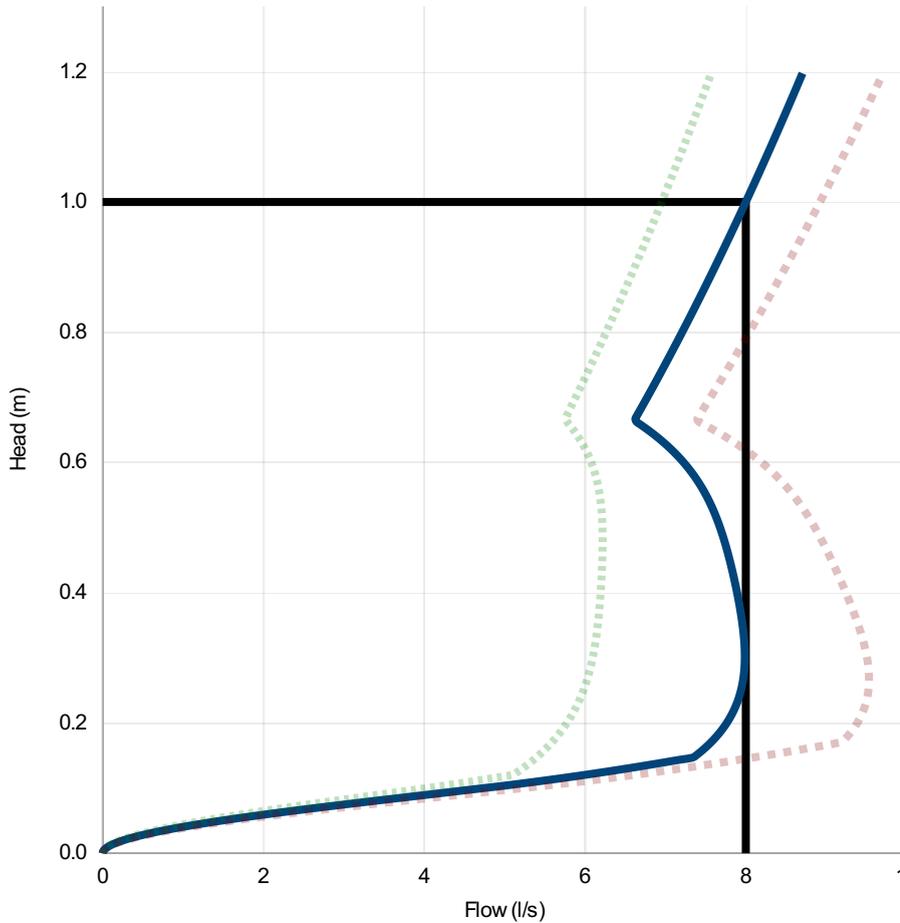

Head (m)	Flow (l/s)
0.000	0.000
0.034	0.735
0.069	2.610
0.103	4.971
0.138	6.906
0.172	7.583
0.207	7.797
0.241	7.920
0.276	7.976
0.310	7.986
0.345	7.965
0.379	7.923
0.414	7.868
0.448	7.803
0.483	7.725
0.517	7.628
0.552	7.498
0.586	7.318
0.621	7.067
0.655	6.725
0.690	6.727
0.724	6.881
0.759	7.032
0.793	7.179
0.828	7.323
0.862	7.463
0.897	7.601
0.931	7.737
0.966	7.869
1.000	7.999

DESIGN ADVICE

The head/flow characteristics of this SHE-0132-8000-1000-8000 Hydro-Brake® Optimum Flow Control are unique. Dynamic hydraulic modeling evaluates the full head/flow characteristic curve.



The use of any other flow control will invalidate any design based on this data and could constitute a flood risk.



DATE	8/8/2025 9:38 PM
Site	128 Lakeshore Road E
DESIGNER	Wendy Zhang
Ref	Cistern

SHE-0132-8000-1000-8000
Hydro-Brake® Optimum

Technical Specification

Control Point	Head (m)	Flow (l/s)
Primary Design	1.000	8.000
Flush-Flo™	0.302	7.987
Kick-Flo®	0.664	6.608
Mean Flow		6.898


This Hydro-Brake® Optimum includes:

- All in 3 mm Grade 304L stainless steel
- Integral pivoting by-pass door allowing clear line of sight through to outlet, c/w operating rope
- Media blasted for corrosion resistance
- Variable flow rate post installation via adjustable inlet (if necessary)
- Indicative Weight: 20 kg
- Product Carbon Footprint: 79.2



hydro-int.com/patents

Based on a 3rd party verified EPD: hydro-int.com/epd

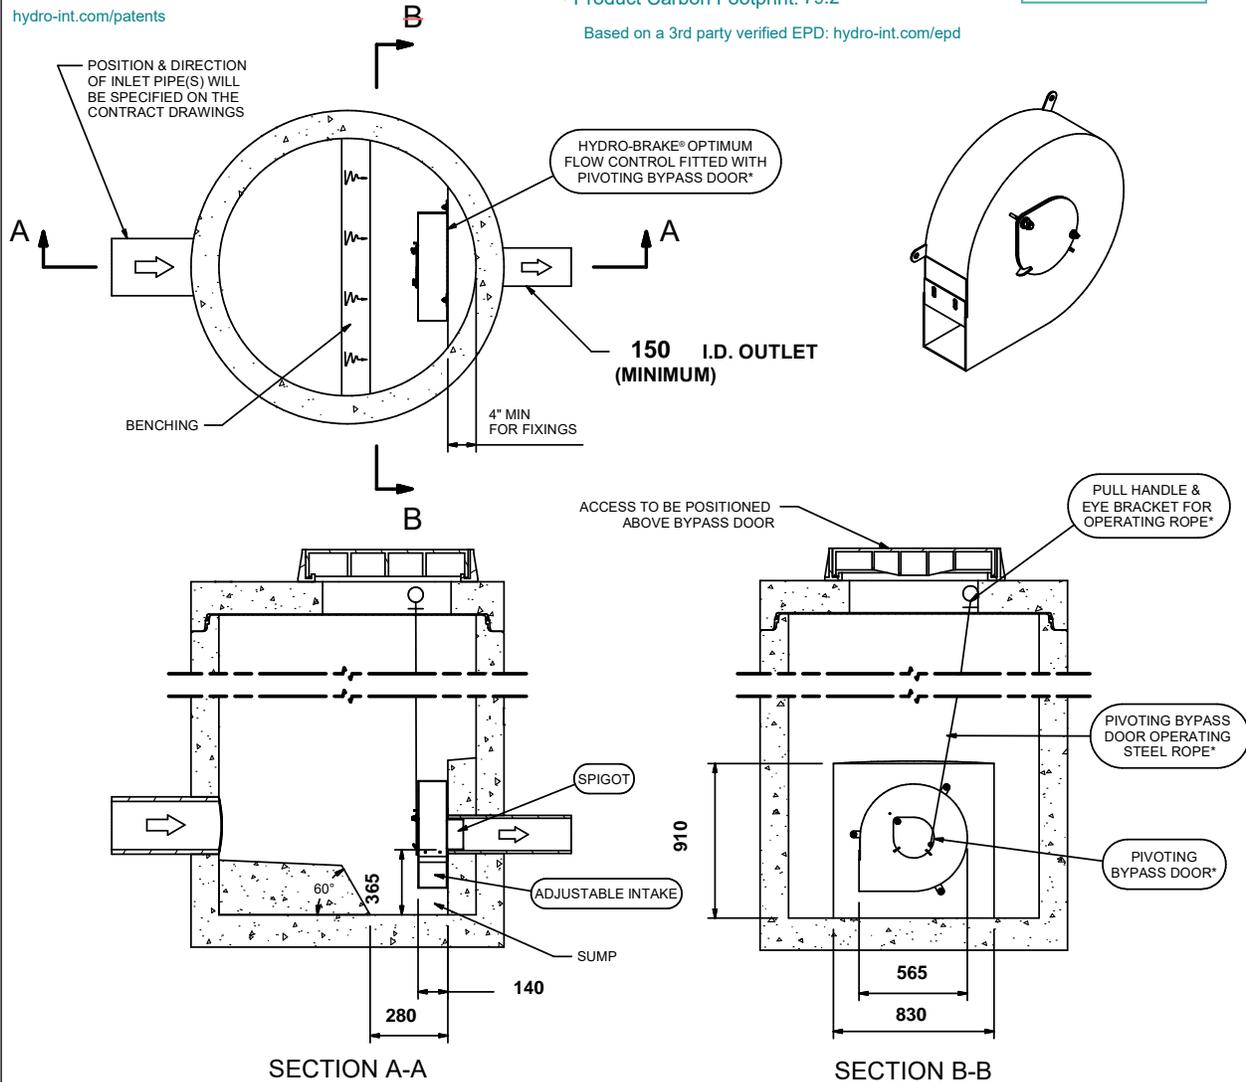

IMPORTANT: ○ LIMIT OF HYDRO INTERNATIONAL SUPPLY
THE DEVICE WILL BE HANDED TO SUIT SITE CONDITIONS
FOR SITE SPECIFIC DETAILS AND MINIMUM CHAMBER SIZE REFER TO HYDRO INTERNATIONAL
ALL CIVIL AND INSTALLATION WORK BY OTHERS
* WHERE SUPPLIED
HYDRO-BRAKE® IS A REGISTERED TRADEMARK FOR FLOW CONTROLS DESIGNED AND MANUFACTURED EXCLUSIVELY BY HYDRO INTERNATIONAL

THIS DESIGN LAYOUT IS FOR ILLUSTRATIVE PURPOSES ONLY. NOT TO SCALE.

DESIGN ADVICE



The head/flow characteristics of this SHE-0132-8000-1000-8000 Hydro-Brake® Optimum Flow Control are unique. Dynamic hydraulic modelling evaluates the full head/flow characteristic curve.
The use of any other flow control will invalidate any design based on this data and could constitute a flood risk.

Hydro International
A CRH COMPANY

DATE	8/8/2025 9:38 PM	SHE-0132-8000-1000-8000 Hydro-Brake® Optimum
SITE	128 Lakeshore Road E	
DESIGNER	Wendy Zhang	
REF	Cistern	

© 2025 Hydro International Ltd, 94 Hutchins Drive, Portland, Maine, 04102-1930. Tel: +1 (207) 756 6200 Fax: +1 (207) 756 6212 Website: hydro-int.com Email: enquiries@hydro-int.com



APPENDIX C

DEMAND TABLE

Water and Wastewater Modelling Demand Table

Site Plan Applications

Version	Date	Description of Revision
1.0	January 10 2023	Posted to Peel Website
2.0	August 30 2024	Reflects 2023 Linear Wastewater Standards and ICI population estimates as per Peel 2020 DC background study

Introduction

Water and wastewater modelling may be required as a condition of the development approval process or prior to regional site servicing connection approval where intensification is proposed, where a possible increase in water demand or wastewater discharge is identified or where deemed necessary by Regional staff.

A completed table includes the Professional Engineer’s signature and stamp as well as a site servicing concept. The table will be deemed complete once all the information below is submitted and/or included. Modelling will commence once the information is deemed complete. All required calculations must be submitted with the completed demand table. The calculations shall be based on the specific development proposal.

Application Information

Application Number:	
Address:	
Consulting Engineer:	
Date Prepared:	

Population

Existing

		Units	Persons
1	Residential ⁸⁾		
2	Institutional/Employment ⁸⁾		
3	Total		

Proposed

			Units	Persons
4	Residential ¹⁾	singles/semis (4.2 ppu)		
5		Townhomes (3.4 ppu)		
6		Large apartments (>1 bedroom – 3.1 ppu)		
7		Small apartments (<=1 bedroom – 1.7 ppu)		
8		Total proposed residential		
9	Proposed Institutional ²⁾			
10	Proposed employment ³⁾			
11	Total Proposed			

Other

12	Existing gross floor area for commercial and/or retail (sqm)	
13	Proposed gross floor area for commercial and/or retail (sqm)	
14	Land area (ha)	

Water Connection

Hydrant flow test ⁴⁾

15	Location 1	
16	Location 2	

WATER AND WASTEWATER MODELLING DEMAND TABLE

		Pressure (kPa)	Flow (L/s)	Time
17	Minimum water pressure			
18	Maximum water pressure			

Water Demands (L/s)

		Use 1 ⁶⁾	Use 2 ⁶⁾	Use 3 ⁶⁾	Total
19	Existing fire flow ^{5) 8)}				
20	Proposed average day flow				
21	Proposed maximum day flow				
22	Proposed peak hour flow				
23	Proposed fire flow ⁵⁾				

Water calculations

Please use the following updated typical water demand criteria as per Peel's 2020 Development Charges background study.

Population Type	Unit	Average Consumption Rate	Max Day Factor	Peak Hour Factor
Residential	L/cap/d	270	1.8	3.0
Institutional/Commercial/Industrial	L/emp/d	250	1.4	3.0

Wastewater Connection

Wastewater Effluent (L/s)

		Discharge location ⁷⁾	Flow
24	Existing effluent ⁸⁾		
25	Proposed effluent		
26	Proposed effluent		
27	Proposed effluent		
28	Proposed additional effluent ⁸⁾		
29	Other proposed effluent*		
30	Total proposed effluent		

*Please specify other proposed effluent (ex. occasional tank purges, off peak discharge, pool drainage)

--

Wastewater calculations

Please use the following updated daily per capita as per 2023 Peel Linear Wastewater Standards

Population Type	Unit	Average Day Demand	Min Peaking Factor	Max Peaking Factor	Inflow and Infiltration**
Residential	L/cap/d	290	2	4	0.26L/s/Ha
Non-residential	L/emp/d	270	2	4	0.26L/s/Ha

**For maintenance holes that are flood prone or located in low lying areas, an extra 0.28 L/s per maintenance hole may be added to the I&I calculation.

Notes

- 1) In accordance with Peel Linear Wastewater Standards and Region of Peel 2020 DC background Study
- 2) refer to Peel Linear Wastewater Standards
- 3) For the commercial and industrial design flow calculations, please refer to Schedule 8b on page A-9 of the Region of Peel 2020 DC background Study to determine population.
- 4) Please include the graphs associated with the hydrant flow test data. Hydrant flow tests should be performed within 2 years of submission to the Region. The Region will not permit hydrant flow tests during the winter, please contact Region Water Operations for scheduling. The Region reserves the right to request an updated hydrant flow test as required at any time.
- 5) Please reference the Fire Underwriters Survey Document
- 6) Please identify the flows for each use type, **if applicable**
- 7) Please include drainage plan for multiple discharge locations
- 8) For Intensification, sites with additions to buildings or additional buildings please provide existing flow for existing buildings and the added flows for the new proposal, **if applicable**



APPENDIX D

**FUS AND HYDRANT FLOW
TEST SUMMARY**

Fire Flow Requirements

Project: 128 Lakeshore Road East
 Project No.: 211246
 Municipality: Mississauga

GUIDE FOR DETERMINATION OF REQUIRED FIRE FLOW

(as per the Water Supply for Public Fire Protection 1999 manual by the Fire Underwriters Survey)

STEP 1

Determine the fire flow.

Required Fire Flow (F) $F = 220 \times C \times \text{sqrt}(A)$

The required fire flow in litres per minute.

Maximum Floor Area (A) = 28376.1 m²

The total floor area in square metres (including all storeys, but excluding basements at least 50% below grade) in the building being considered.

Coefficient (C) = 0.6

Coefficient related to the type of construction.

= 1.5 for wood frame construction (structure essentially all combustible).

= 1.0 for ordinary construction (brick or other masonry walls, combustible floor)

= 0.8 for non-combustible construction (unprotected metal structural)

= 0.6 for fire-resistive construction (fullyprotected frame,floors, roof).

F = 22300 L/min.

STEP 2

Determine the increase or decrease for occupancy.

0%

Reduction for Low Hazard Occupancy (Dwellings).

Decrease 0 L/min.

STEP 3

Determine the decrease, if any, for automatic sprinkler protection.

50%

Decrease 11150 L/min.

STEP 4

Determine the total increase for exposures (Not to Exceed 75%).

west (15m) 15%

0 to 3m - 25% Increase

north (22m) 10%

3.1 to 10m - 20% Increase

east (30m) 10%

10.1 to 20m - 15% Increase

South (7m) 20%

20.1 to 30m - 10% Increase

55.0%

30.1 to 45m - 5% Increase

Increase 12265 L/min.

Greater then 45m - No Increase

STEP 5

Determine the minimum required fire flow.

F = 390.25 L/s

Fire Flow Calculation

Project: 128 Lakeshore Road East
Project No.: 211246
Municipality: Mississauga

GUIDE FOR CALCULATING CAPACITY AT 20psi FOR FIRE FLOW

(as per the NFPA 291: Recommended Practice for Fire Flow Testing and Marking of Hydrants. (2010). (Section 4.10.1.2.))

The Formula for Calculating Rated Capacity at 20psi

$$Q_R = Q_F \times (H_R / H_F)^{0.54}$$

Where:

Q_R = Rated Capacity at 20psi (in GPM)

Q_F = Total test flow (in GPM)

H_R = Static Pressure minus 20 psi

H_F = Static Pressure minus Residual Pressure

Flow Test Parameters:

Based on hydrant flow test by L&D
Waterworks, dated Oct 8, 2021.

Static Pressure 88.0 psi

Residual Pressure 86.0 psi

Test Flow Rate 1472 GPM

$$Q_R = 1472 \times \left(\frac{88.0 \text{ psi} - 20}{88.0 \text{ psi} - 86.0 \text{ psi}} \right)^{0.54}$$

$$Q_R = \mathbf{9883 \text{ GPM}}$$
$$\mathbf{37,413 \text{ L/min}}$$

Hydrant Flow Test Report

SITE NAME: _____
 SITE ADDRESS / MUNICIPALITY: 128 Lakeshore Road East, Mississauga
 TEST HYDRANT LOCATION: Northeast Corner of Lakeshore Road, East at Ann Street
 BASE HYDRANT LOCATION: 1st Fire Hydrant East of Hurontario Street on Lakeshore Road East
 TEST BY: Luzia Wood

TEST DATE:
 October 08,2021

TEST TIME:
 9:35Am

TEST DATA


FLOW HYDRANT	Pipe Diam. (in / mm)	300mm P.V.C.	
	<u>PITOT 1</u>		<u>PITOT 2</u>
SIZE OPENING (inches):	<u>2.5</u>		<u>2.5</u>
COEFFICIENT (note 1):	<u>0.90</u>		<u>0.90</u>
PITOT READING (psi):	<u>77</u>		<u>60 / 60</u>
FLOW (usgpm):	<u>1472</u>		<u>2599</u>

THEORETICAL FLOW @ 20 PSI	9886
---------------------------	------

BASE HYDRANT Pipe Diam. (in / mm) 300mm P.V.C.
 STATIC READING (psi): 88 RESIDUAL 1 (psi): 86 RESIDUAL 2 (psi): 82

REMARKS: _____

NOTE 1: Conversion factor of .90 used for flow calculation based on rounded and flush internal nozzle configuration. No appreciable difference in pipe invert between flow and base hydrants.

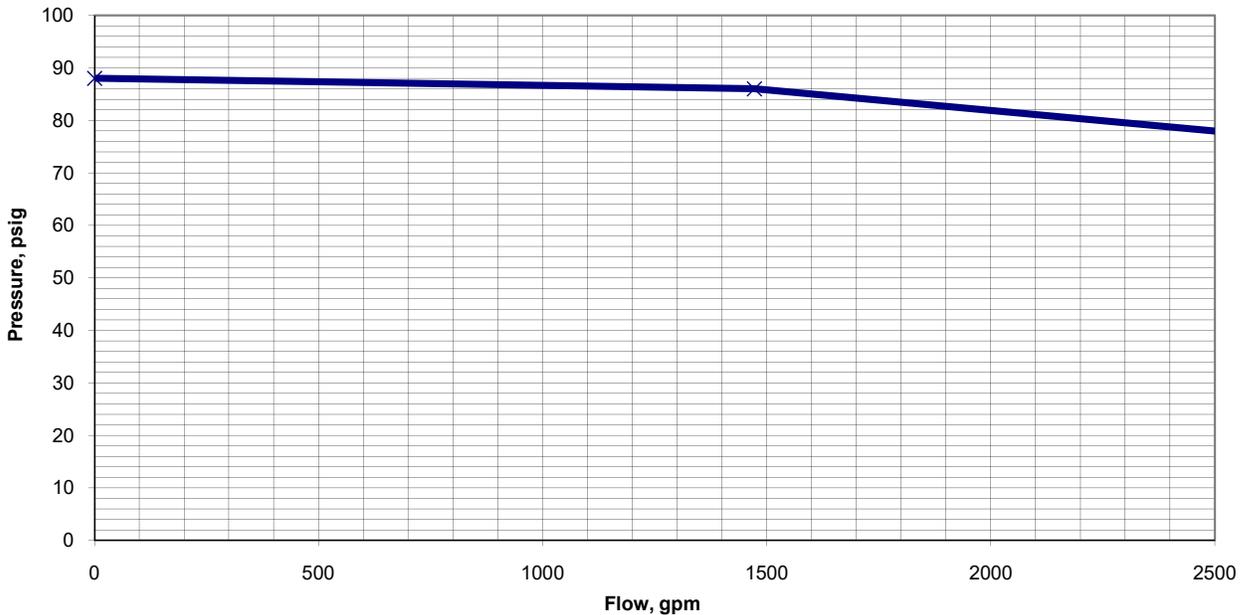



DRAWINGS



ENGINEERING + MANAGEMENT

200 CACHET WOODS COURT, SUITE 204
MARKHAM, ON L6C 0Z8
HUSSON.CA