



STATIC: 88.5 PSI
 NAME OF RISK: FILE NO.:
 STREET: VICKSBURG DRIVE of AURONTARIO STREET
 CITY: MISSISSAUGA ONT.
 DATE: OCT 7, 2025 BY: AE71
 (1) 703 USGPM @ 87 PSI
 (2) 1571 USGPM @ 86 PSI
 (3) 2601 USGPM @ 82 PSI

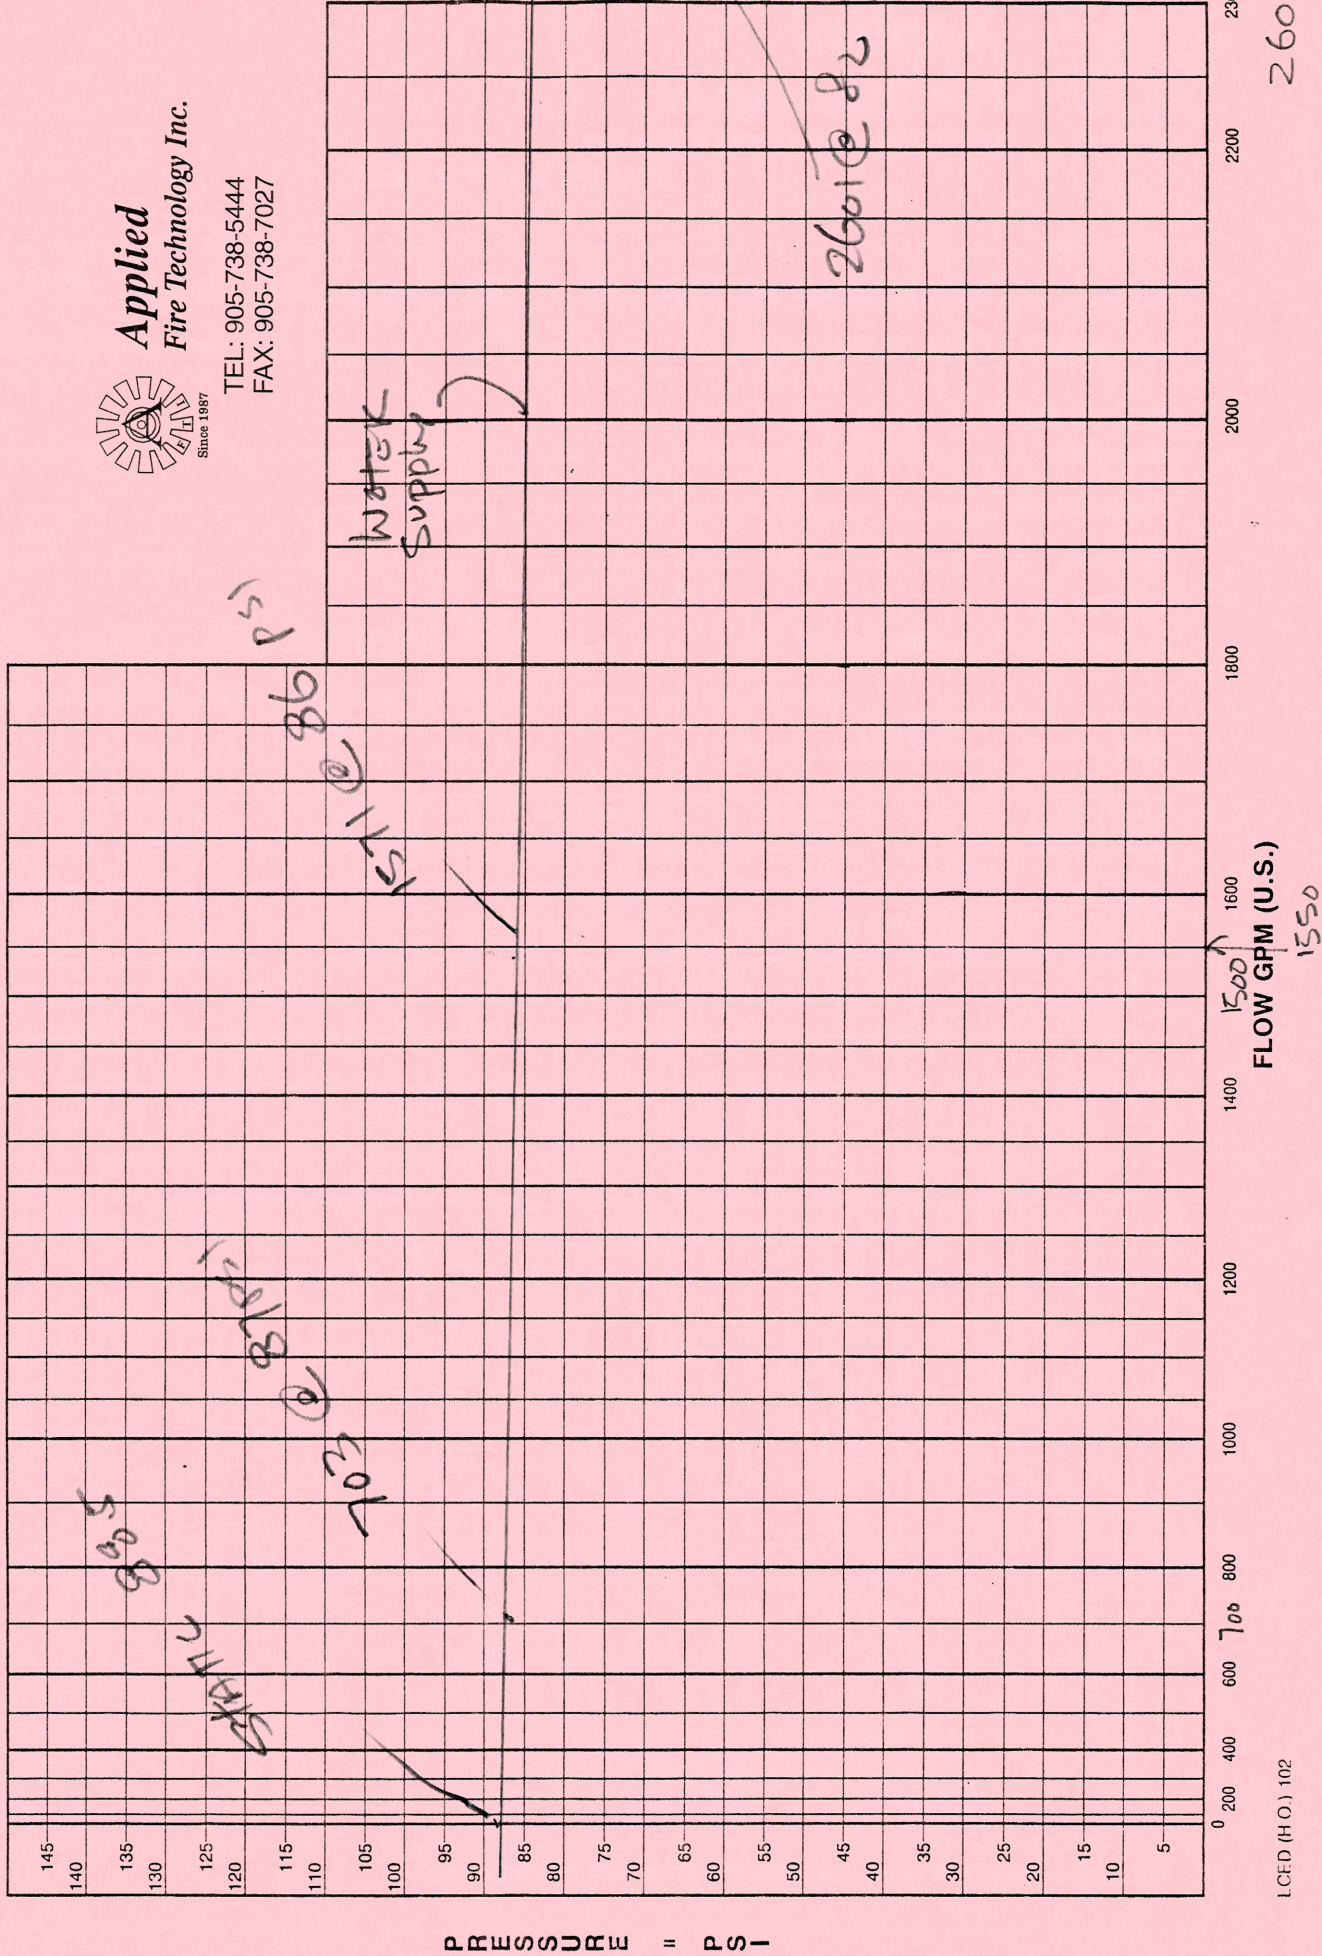

PRESSURE " PSI

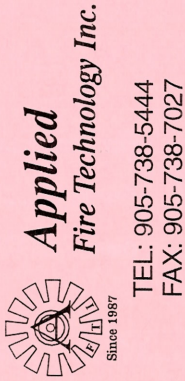

Applied Fire Technology Inc.

Design • Consulting • Testing • Inspection

WATER SUPPLY TEST

Name of risk: File No.:
Address: VICKSBURG DR AT HURONTARIO ST Test by: AFTI
Municipality: MISSISSAUGA ONT Date: OCT 7, 2025


SYSTEM DATA:

Size of Main: 300 PVC Dead End: Two Ways: ☒ Loop: ☒
Source Reliable: YES If not explain:
Comments:

TEST DATA:

Location of test fire hydrants; Residual: #1 VICKSBURG DR, MISSISSAUGA
Flow: #2 VICKSBURG DR MISSISSAUGA
Static pressure 88.5 psi Time: 9:00 A.M. — P.M.

Test No.	No. of Outlets	Orifice Size (in.)	Pitot Reading (psi)	Equivalent Flow gpm (U.S.)	Total Flow gpm (U.S.)	Residual Pressure (psi)	Comments
1	1	1 1/2	70	705	703	87	X 0.997
2	1	2 1/2	72	1745	1591	86	X 0.9
3	2	2 1/2	60, 60	1445, 1445	2601	82	X 0.9
4							

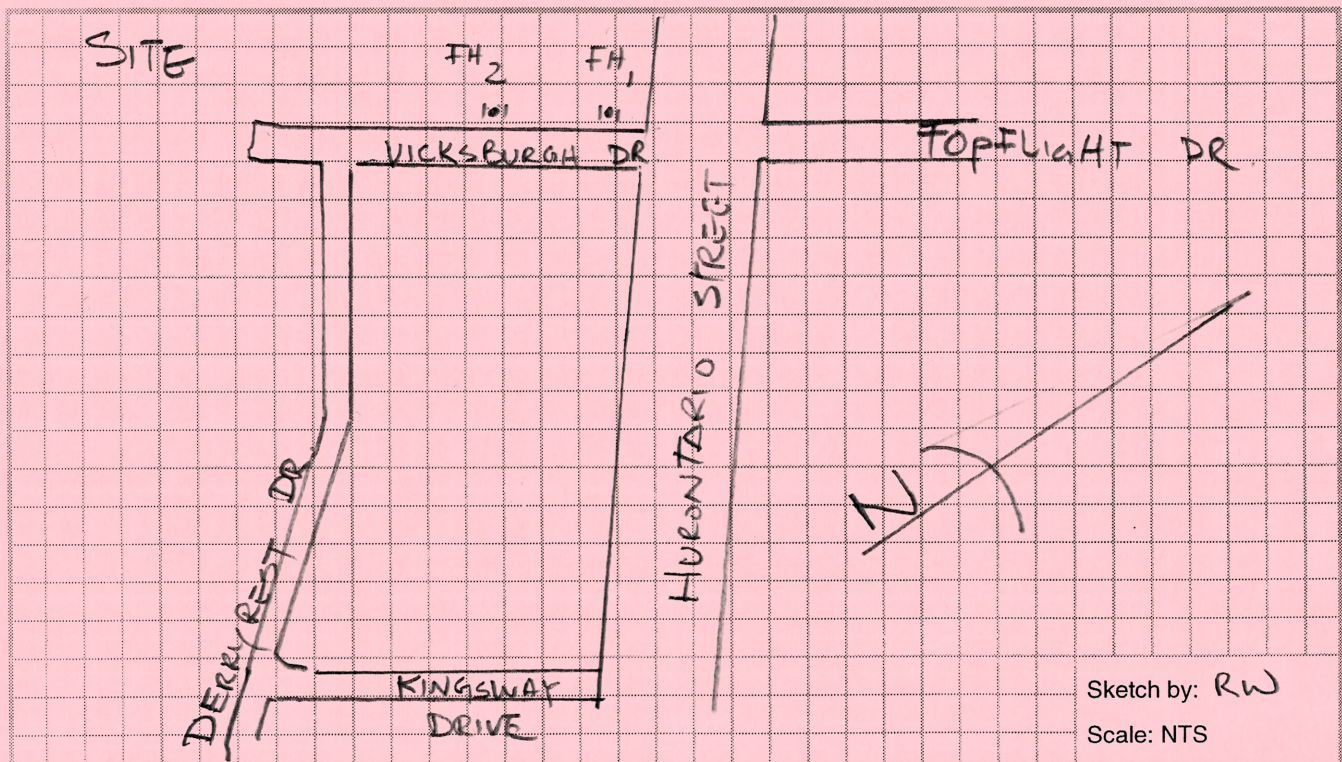

Sketch by: RW
Scale: NTS

Name and address of municipal authority who should receive a copy.
.....