


- NOTES:**
1. GRANULAR MATERIAL IS TO BE CLEAN APPROVED MATERIAL AND PLACED BY NOTED DIMENSIONS PRIOR TO LAND DISTURBANCE.
 2. GEOTEXTILE IS TO BE PLACED OVER THE ENTIRE AREA PRIOR TO STONE PLACEMENT.
 3. MAINTENANCE: THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION WHICH WILL PREVENT TRACKING OF FLOWING OR DRIPPING WATER FROM THE ENTRANCE TO THE ADJACENT DRIVEWAY AS WARRANTED FOR DIRECTED BY THE INSPECTION AND WORKS DEPARTMENT OF THE CITY OF MISSISSAUGA.
 4. FOR SITE DEVELOPMENTS GREATER THAN 4,000 IN SEE 50M MIN IS REQUIRED FOR 50MM CLEAR STONE AND 10M MIN IS REQUIRED FOR 150MM R.P. RAP.

MISSISSAUGA
Transportation and Works

STANDARD
STONE PAD
CONSTRUCTION ENTRANCE


EFF. DATE 2002-01-01 SCALE N.T.S.
REV. STANDARD No. 2970.00

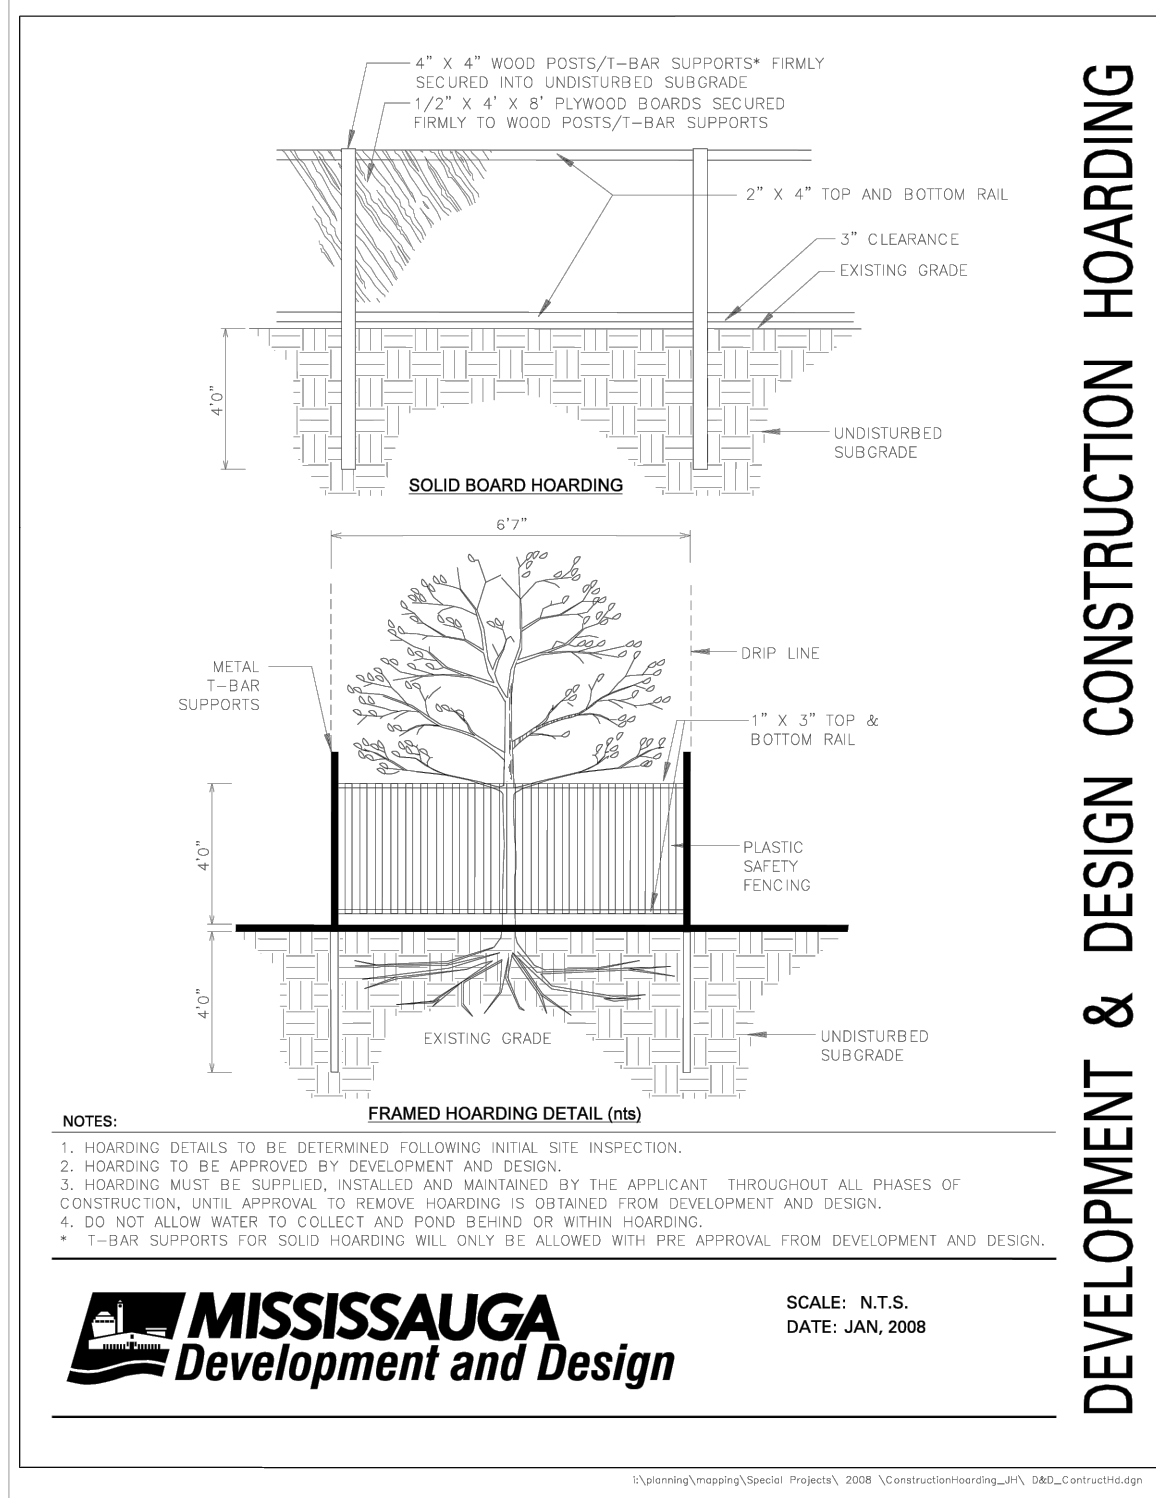

- NOTES:**
1. HOARDING DETAILS TO BE DETERMINED FOLLOWING INITIAL SITE INSPECTION.
 2. HOARDING TO BE APPROVED BY DEVELOPMENT AND DESIGN.
 3. HOARDING MUST BE SUPPLIED, INSTALLED AND MAINTAINED BY THE APPLICANT THROUGHOUT ALL PHASES OF CONSTRUCTION. UPON APPROVAL TO REMOVE HOARDING IS OBTAINED FROM DEVELOPMENT AND DESIGN.
 4. DO NOT ALLOW WATER TO COLLECT AND POND BEHIND OR WITHIN HOARDING.
 - T-BAR SUPPORTS FOR SOLID HOARDING WILL ONLY BE ALLOWED WITH PRE-APPROVAL FROM DEVELOPMENT AND DESIGN.

MISSISSAUGA
Development and Design

SCALE: N.T.S.
DATE: JAN. 2008

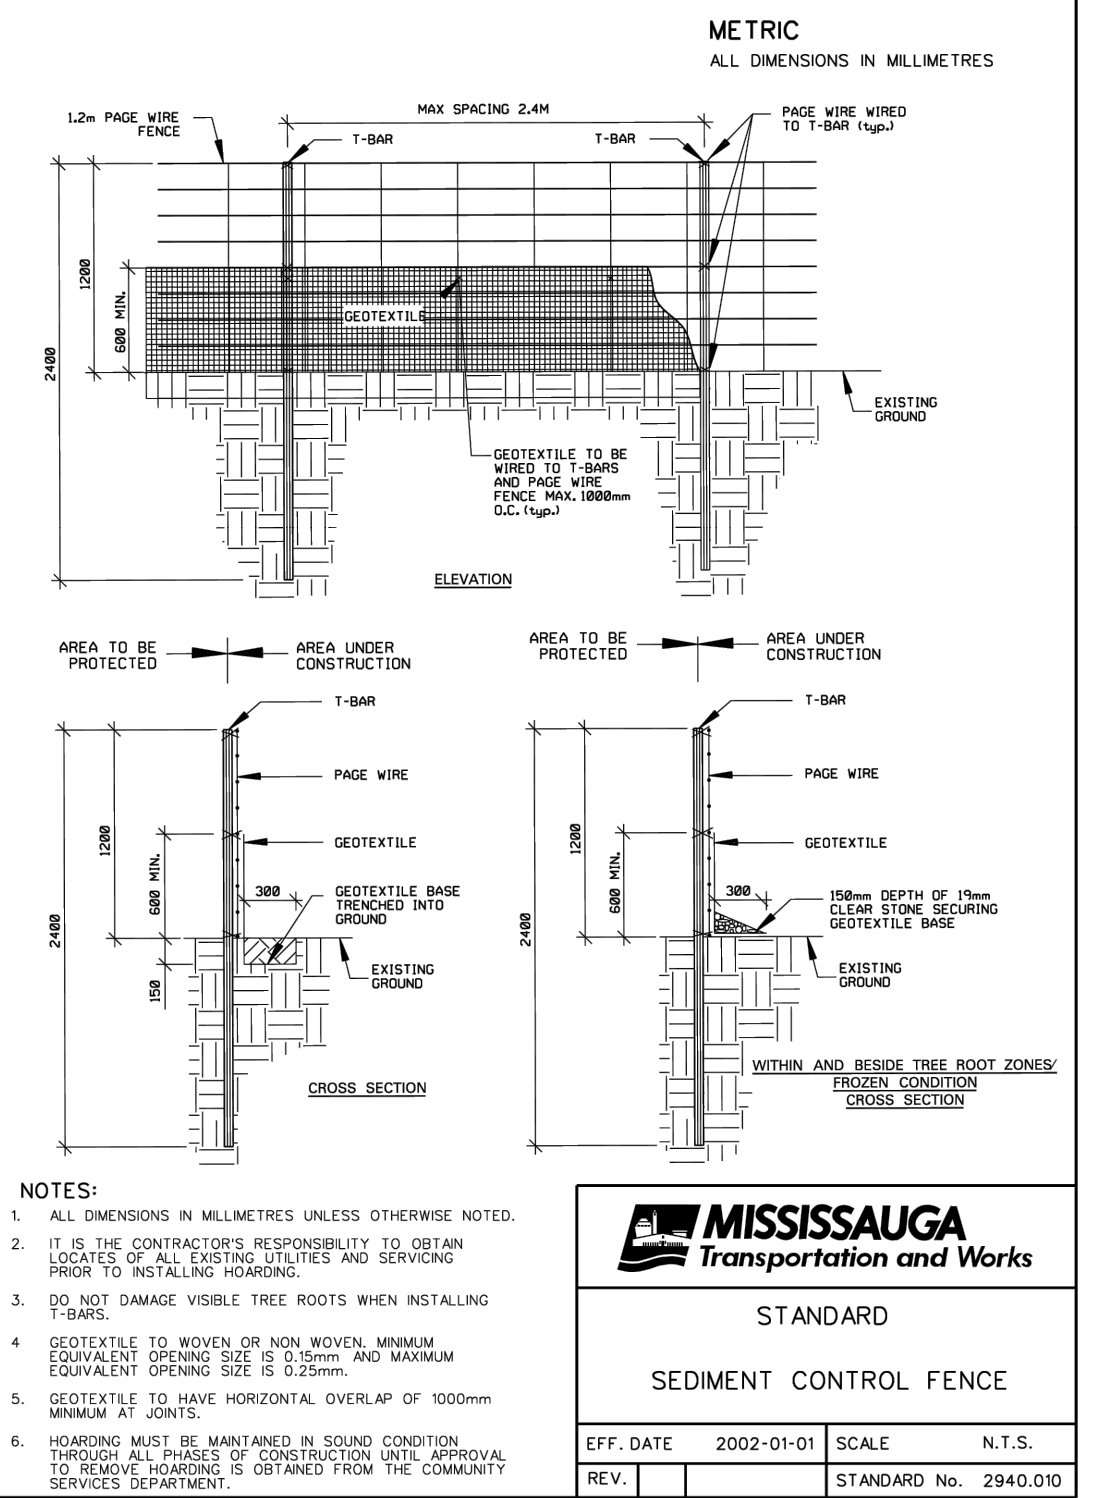


- NOTES:**
1. ALL DIMENSIONS IN MILLIMETRES UNLESS OTHERWISE NOTED.
 2. IT IS THE CONTRACTOR'S RESPONSIBILITY TO OBTAIN LOCATES OF ALL EXISTING UTILITIES AND SERVICES PRIOR TO INSTALLING HOARDING.
 3. DO NOT DAMAGE VISIBLE TREE ROOTS WHEN INSTALLING FENCE.
 4. GEOTEXTILE TO WOVEN OR NON WOVEN, MINIMUM EQUIVALENT OPENING SIZE IS 0.25mm AND MAXIMUM EQUIVALENT OPENING SIZE IS 0.25mm.
 5. GEOTEXTILE TO HAVE HORIZONTAL OVERLAP OF 100mm MINIMUM AT JOINTS.
 6. HOARDING MUST BE MAINTAINED IN SOUND CONDITION THROUGH ALL PHASES OF CONSTRUCTION WITH APPROVAL TO REMOVE HOARDING IS OBTAINED FROM THE COMMUNITY SERVICES DEPARTMENT.

MISSISSAUGA
Transportation and Works

STANDARD
SEDIMENT CONTROL FENCE

EFF. DATE 2002-01-01 SCALE N.T.S.
REV. STANDARD No. 2940.010

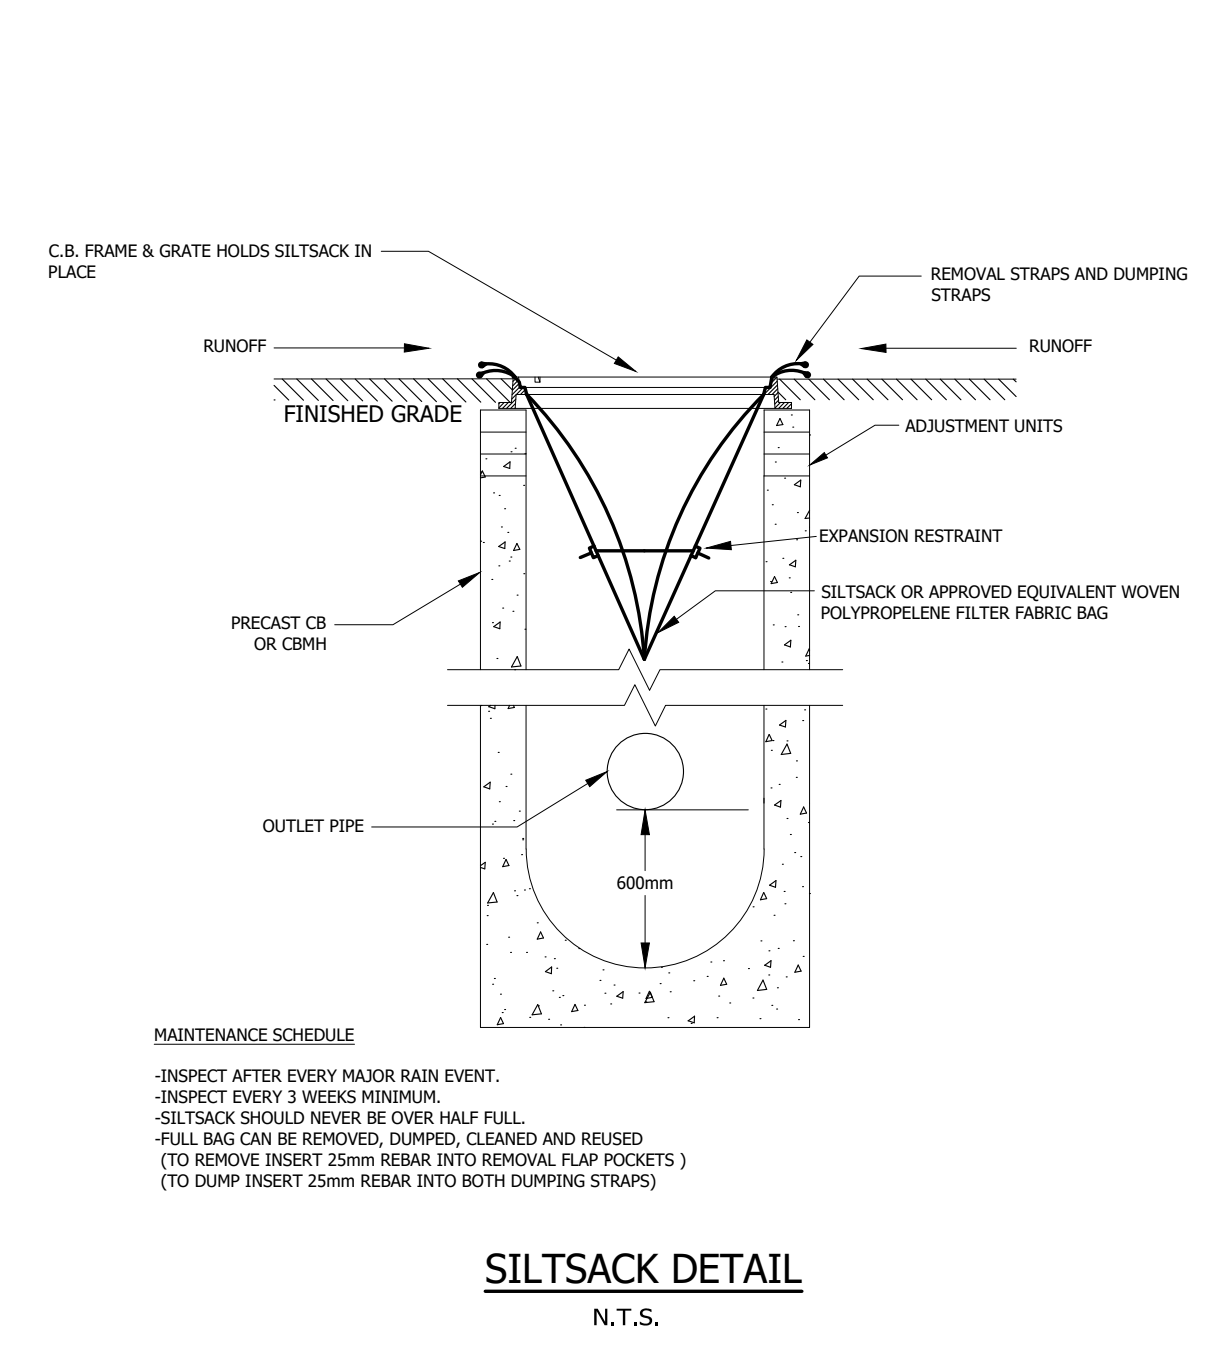

- MAINTENANCE SCHEDULE**
- INSPECT AFTER EVERY MAJOR RAIN EVENT.
 - INSPECT EVERY 3 WEEKS MINIMUM.
 - SILTSACK SHOULD NEVER BE OVER HALF FULL.
 - FULL BAG CAN BE REMOVED, DUMPED, CLEANED AND REUSED (TO REMOVE INSERT 25mm REBAR INTO REMOVAL FLAP POCKETS) (TO DUMP INSERT 25mm REBAR INTO BOTH DUMPING STRAPS)

SILTSACK DETAIL
N.T.S.

PLOT DATE: April 23, 2026 8:38:51 AM

1	ISSUED FOR ZONING	REVISIONS	APR. 10, 2026	R.B.T.M.
No.			DATE	BY

URBANTECH® Consulting
A Division of Leighton-Zeck Ltd.
2030 Bristol Circle, Suite 105
Oakville, ON, L6H 0H2
TEL. 905.829.8818 • urbantech.com

2233 & 2235 HURONTARIO LTD.

Region of Peel
working with you

MISSISSAUGA

EROSION & SEDIMENT CONTROL DETAILS

REGION FILE No. C-XXXXXX	CITY FILE No. XXX-XX-X
SCALE: N.T.S.	PROJECT No. 24-326
DRAWN BY: R.B.	CHECKED BY: R.M./R.B.T.M. PLAN No. C502
DATE: MARCH, 2026	SHEET OF C-XXXXXX

FILE: C:\GIS\SRM\BAC\ALCOCKS\URBANTECH\24-326 2233 HURONTARIO ST\PROJECT FILES\1000 - EROSION\500-ESC-DETAILS.DWG