

GRADIENTWIND

ENGINEERS & SCIENTISTS

PEDESTRIAN LEVEL WIND STUDY

12, 26 Park Street Road East
Mississauga, Ontario

REPORT: GW26-064-WTPLW



July 29, 2026

PREPARED FOR

Canahahns Company Limited

77 Bloor Street West
Toronto, Ontario
M5S 1M2

PREPARED BY

Cristiano Kondo, MEng., P.Eng., Wind Engineer
Angelina Gomes, P.Eng., Wind Engineer
Nick Petersen, P.Eng., Senior Wind Engineer

EXECUTIVE SUMMARY

This report describes a wind tunnel pedestrian level wind study undertaken to assess wind conditions for a proposed residential development located at 12, 26 Park Street East in Mississauga, Ontario. Two configurations were studied: (i) *existing scenario*, including all approved, surrounding developments and without the proposed development, and (ii) *proposed scenario* with the proposed development in place. The study involves wind tunnel measurements of pedestrian wind speeds using a physical scale model, combined with meteorological data integration, to assess pedestrian comfort at key areas within and surrounding the study site. Grade-level areas investigated include sidewalks, walkways, landscaped spaces, laneways, parking areas, outdoor amenity areas, and building access points. Wind comfort is also evaluated over the Level 7 outdoor amenity terrace. The results and recommendations derived from these considerations are summarized in the following paragraphs and detailed in the subsequent report.

Our work is based on industry standard wind tunnel testing and data analysis procedures, architectural drawings provided by Kohn Partnership Architects Inc. in May 2026, surrounding street layouts, as well as existing and approved future building massing information obtained from the City of Mississauga, and recent site imagery.

A complete summary of the predicted wind conditions is provided in Section 5 of this report and is also illustrated in Figures 2A through 4B, as well as Tables A1-A2 and B1-B3 in the appendices. Based on wind tunnel test results, meteorological data analysis, and experience with similar developments in Mississauga, we conclude that the future wind conditions over all grade-level pedestrian wind-sensitive areas within and surrounding the study site will generally be acceptable for the intended uses on a seasonal basis. To ensure the Level 7 outdoor amenity terrace will be comfortable for sitting or more sedentary activities throughout the warmer months, mitigation is recommended as described in Section 5.2.

Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no areas over the study site were found to experience conditions that could be considered unsafe.



TABLE OF CONTENTS

1. INTRODUCTION	1
2. TERMS OF REFERENCE	1
3. OBJECTIVES	2
4. METHODOLOGY.....	2
4.1 Wind Tunnel Context Modelling	2
4.2 Wind Speed Measurements.....	3
4.3 Meteorological Data Analysis – Billy Bishop Toronto City Airport.....	4
4.4 Pedestrian Comfort and Safety Guidelines	6
5. RESULTS AND DISCUSSION.....	8
5.1 Pedestrian Comfort Suitability – <i>Existing Scenario</i>	8
5.2 Pedestrian Comfort Suitability – <i>Proposed Scenario</i>	9
6. CONCLUSIONS AND RECOMMENDATIONS	10

MODEL PHOTOGRAPHS

FIGURES

APPENDICES

Appendix A – Pedestrian Comfort Suitability (Existing Scenario)

Appendix B – Pedestrian Comfort Suitability (Proposed Scenario)

Appendix C – Wind Tunnel Simulation of the Natural Wind

Appendix D – Pedestrian Level Wind Measurement Methodology



1. INTRODUCTION


This report describes a wind tunnel pedestrian level wind (PLW) study undertaken to assess wind conditions for a proposed residential development located at 12, 26 Park Street East in Mississauga, Ontario. Two configurations were studied: (i) *existing scenario*, including all approved, surrounding developments and without the proposed development, and (ii) *proposed scenario* with the proposed development in place. The study was performed in accordance with industry standard wind tunnel testing techniques, architectural drawings provided by Kohn Partnership Architects Inc. in May 2026, surrounding street layouts and existing and approved future building massing information, as well as recent site imagery.

2. TERMS OF REFERENCE

The focus of this wind tunnel pedestrian wind study is the proposed residential development located at 12, 26 Park Street East in Mississauga, Ontario. The study site is situated at the centre of the northwest side of a nearly trapezoidal parcel of land bounded by Queen Street East to the northeast, Park Street East to the southeast, Staveback Road to the southwest, and a railway corridor to the northwest.

The proposed residential development comprises a rectangular 26-storey tower rising from a six-storey podium. Two levels of below-grade parking are accessible via a laneway along the southeast side of the building and connecting to Park Street East. The ground floor consists of a residential lobby at the centre of the southeast side fronting the laneway, a loading area accessed from the southeast side in the east corner, parking spaces in the southern portion, and building support services elsewhere. Levels 2-4 are reserved for parking and partially cantilever over grade below. At Level 4, the floorplate steps back from all elevations and rises uniformly to Level 7, where it further steps back to the typical tower floorplate, accommodating indoor and outdoor amenities. Above, the tower rises to the full height, capped by a mechanical penthouse.

Regarding wind exposures, the near-field surroundings (defined as an area falling within a 200-metre (m) radius of the subject site) include a mix of open green spaces with low- and mid-rise buildings in all directions, and the northwest quadrant characterized primarily by open green spaces beyond the railway corridor. Notable nearby buildings include a seven-storey residential building directly east, a 13-storey



building directly northeast, and 5-, 11-, and 13-storey buildings directly south of the site. The railway corridor is located approximately 42 metres northwest of the subject site. The far-field surroundings (defined as the area beyond the near-field and within a 2-kilometre (km) radius) include the open exposure of Lake Ontario from the northeast clockwise southwest, and low-rise massing with isolated mid- and high-rise buildings in the remaining compass azimuth directions.

Grade-level areas investigated include sidewalks, walkways, laneways, landscaped spaces, parking areas, outdoor amenity areas, and building access points. Wind comfort is also evaluated over the Level 7 outdoor amenity terrace. Figures 1A and 1B illustrate the *existing* and *proposed* study sites and surrounding context, respectively, and Photographs 1 through 6 depict the wind tunnel model used to conduct the study.

3. OBJECTIVES

The principal objectives of this study are to (i) determine pedestrian level wind comfort and safety conditions at key areas within and surrounding the development site; (ii) identify areas where wind conditions may interfere with the intended uses of outdoor spaces; (iii) recommend suitable mitigation measures, where required; and (iv) evaluate the influence of the proposed development on the existing wind conditions.


4. METHODOLOGY

The approach followed to quantify pedestrian wind conditions over the site is based on wind tunnel measurements of wind speeds at selected locations on a reduced-scale physical model, meteorological analysis of the Mississauga area wind climate, and synthesis of wind tunnel data with industry-accepted guidelines¹. The following sections describe the analysis procedures, including a discussion of the pedestrian comfort and safety guidelines.

4.1 Wind Tunnel Context Modelling

A detailed PLW study is performed to determine the influence of local winds at the pedestrian level for a proposed development. The physical model of the proposed development and relevant surroundings,

¹ City of Mississauga Urban Design Terms of Reference, Wind Comfort and Safety Studies, July 2024



illustrated in Photographs 1 through 6 following the main text, was constructed at a scale of 1:400. The wind tunnel model includes all existing buildings and approved future developments within a full-scale diameter of approximately 840 metres. The general concept and approach to wind tunnel modelling is to provide building and topographic detail in the immediate vicinity of the study site on the surrounding model, and to rely on a length of wind tunnel upwind of the model to develop wind properties consistent with known turbulent intensity profiles that represent the surrounding terrain.

An industry standard practice is to omit trees, vegetation, and other existing and planned landscape elements from the wind tunnel model due to the difficulty of providing an accurate seasonal representation of vegetation. The omission of trees and other landscaping elements produces slightly more conservative wind speed values.

4.2 Wind Speed Measurements

The PLW study was performed by testing a total of 73 sensor locations on the scale model in Gradient Wind's wind tunnel, with 66 sensors located at grade and the remaining seven sensors over the Level 7 outdoor amenity terrace. Wind speed measurements were performed for each of the 73 sensors for 36 wind directions at 10° intervals. Figures 1A and 1B illustrate the *existing* and *proposed* study sites and surrounding context, respectively, while sensor locations used to investigate wind conditions are illustrated in Figures 2A through 4B.

Mean and peak wind speed values for each location and wind direction were calculated from real-time pressure measurements, recorded at a sample rate of 500 samples per second, and taken over a 60-second time period. This period at model-scale corresponds approximately to one hour in full-scale, which matches the time frame of full-scale meteorological observations. Measured mean and gust wind speeds at grade were referenced to the wind speed measured near the ceiling of the wind tunnel to generate mean and peak wind speed ratios. Ceiling height in the wind tunnel represents the depth of the boundary layer of wind flowing over the earth's surface, referred to as the gradient height. Within this boundary layer, mean wind speed increases up to the gradient height and remains constant thereafter. Appendices C and D provide greater detail of the theory behind wind speed measurements. Wind tunnel measurements for this project, conducted in Gradient Wind's wind tunnel facility, meet or exceed



guidelines found in the National Building Code of Canada 2015 and of 'Wind Tunnel Studies of Buildings and Structures', ASCE Manual 7 Reports on Engineering Practice No 67.


4.3 Meteorological Data Analysis – Billy Bishop Toronto City Airport

A statistical model for winds in Mississauga was developed from approximately 35-years of hourly meteorological wind data recorded at Toronto Island Billy Bishop Airport and obtained from Environment and Climate Change Canada. Wind speed and direction data were divided into two distinct seasons, as stipulated in the noted City of Mississauga Urban Design Terms of Reference. More specifically, the summer season is defined as May through October, while the winter season is defined as November through April, inclusive.

The statistical model of the Mississauga area wind climate, which indicates the directional character of local winds on a seasonal basis, is illustrated on the following page. The plots illustrate seasonal distribution of measured wind speeds and directions in kilometers per hour (km/h). Probabilities of occurrence of different wind speeds are represented as stacked polar bars in sixteen azimuth divisions. The radial direction represents the percentage of time for various wind speed ranges per wind direction during the measurement period. The preferred wind speeds and directions can be identified by the longer length of the bars. For Mississauga (south of the Queen Elizabeth Way, or QEW), the most common winds concerning pedestrian comfort during the winter season occur for westerly wind directions, followed by those from the east. The most common winds during the summer season occur for easterly wind directions. The directional preference and relative magnitude of the wind speed varies somewhat from season to season. Also, by convention in microclimate studies, wind direction refers to the wind origin (e.g., a north wind blows from north to south).



SEASONAL DISTRIBUTION OF WINDS FOR VARIOUS PROBABILITIES BILLY BISHOP AIRPORT, TORONTO, ONTARIO

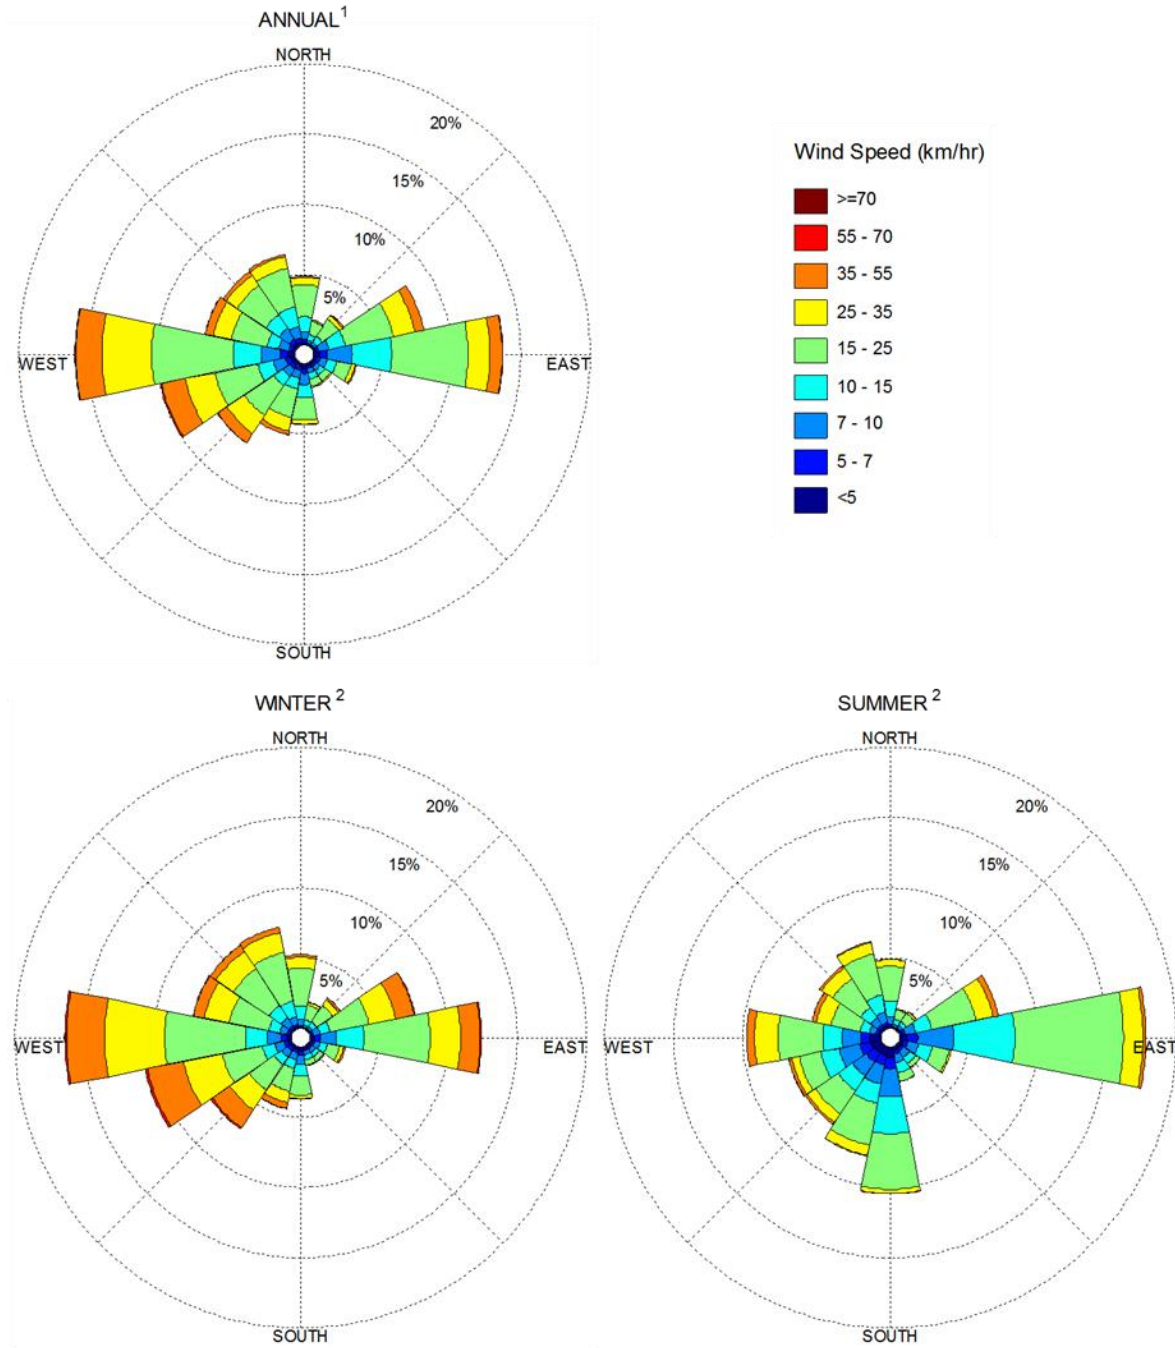

Notes:

1. Radial distances indicate percentage of time of wind events.
2. Wind speeds are mean hourly in km/h, measured at 10 m above the ground.



4.4 Pedestrian Comfort and Safety Guidelines

Pedestrian comfort and safety guidelines are based on the mechanical effects of wind without consideration of other meteorological conditions (i.e. temperature, relative humidity). The comfort guidelines assume that pedestrians are appropriately dressed for a specified outdoor activity during any given season. Since both mean and gust wind speeds affect pedestrian comfort, their combined effect is defined in the City of Mississauga Urban Design Terms of Reference¹. More specifically, the criteria are defined as a Gust Equivalent Mean (GEM) wind speed, which is the greater of the mean wind speed or the gust wind speed divided by 1.85. The wind speed ranges are selected based on 'The Beaufort Scale' (presented on the following page), which describes the effects of forces produced by varying wind speed levels on objects.

Four pedestrian comfort classes and corresponding GEM wind speed ranges are used to assess pedestrian comfort, which include: (i) Sitting; (ii) Standing; (iii) Walking; and (iv) Uncomfortable. More specifically, the comfort classes, wind speed ranges, and limiting criteria are summarized as follows:

- (i) **Sitting** – GEM wind speeds below 10 km/h occurring more than 80% of the time would be considered acceptable for sedentary activities, including sitting.
- (ii) **Standing** – GEM wind speeds below 15 km/h (i.e. 10-15 km/h) occurring more than 80% of the time are acceptable for activities such as standing, strolling or more vigorous activities.
- (iii) **Walking** – GEM wind speeds below 20 km/h (i.e. 15-20 km/h) occurring more than 80% of the time are acceptable for walking or more vigorous activities.
- (iv) **Uncomfortable** – Uncomfortable conditions are characterized by predicted values that fall below the 80% criterion for walking. Brisk walking and exercise, such as jogging, would be acceptable for moderate excesses of this criterion.

Gust wind speeds greater than 90 km/h, occurring more than 0.1% of the time on an annual basis, are classified as dangerous. From calculations of stability, it can be shown that gust wind speeds of 90 km/h would be the approximate threshold wind speed that would cause a vulnerable member of the population to fall.



Experience and research on people's perception of mechanical wind effects has shown that if the wind speed levels are exceeded for more than 20% of the time, the activity level would be judged to be uncomfortable by most people. For instance, if GEM wind speeds of 10 km/h were exceeded for more than 20% of the time, most pedestrians would judge that location to be too windy for sitting or more sedentary activities. Similarly, if GEM wind speeds of 20 km/h at a location were exceeded for more than 20% of the time, walking or less vigorous activities would be considered uncomfortable. As most of these criteria are based on subjective reactions of a population to wind forces, their application is partly based on experience and judgment.

Once the pedestrian wind speed predictions have been established at tested locations, the assessment of pedestrian comfort involves determining the suitability of the predicted wind conditions for their associated spaces. This step involves comparing the predicted comfort class to the desired comfort class, which is dictated by the location type represented by the sensor (i.e. a sidewalk, building entrance, amenity space, or other). An overview of common pedestrian location types and their desired comfort classes are summarized below.

DESIRED PEDESTRIAN COMFORT CLASSES FOR VARIOUS LOCATION TYPES

Location Types	Desired Comfort Classes
Primary Building Entrance	Standing
Secondary Building Access Point	Walking
Public Sidewalks / Pedestrian Walkways	Walking
Outdoor Amenity Spaces	Sitting / Standing
Cafés / Patios / Benches / Gardens	Sitting / Standing
Plazas	Standing / Walking
Transit Stops	Standing
Public Parks	Sitting / Walking
Garage / Service Entrances	Walking
Vehicular Drop-Off Zones	Walking
Laneways / Loading Zones	Walking



5. RESULTS AND DISCUSSION

Tables A1 and A2 in Appendix A provide a summary of seasonal comfort predictions for each sensor location under the *existing* massing scenario. Similarly, Tables B1-B3 in Appendix B provide the seasonal comfort predictions for under the *proposed* massing scenario. The tables indicate the 80% non-exceedance GEM wind speeds and corresponding comfort classifications as defined in Section 4.4. In other words, a wind speed threshold of 19.1 for the summer season indicates that 80% of the measured data falls at or below 19.1 km/h during the summer months and conditions are therefore suitable for walking, as the 80% threshold value falls within the exceedance range of 15-20 km/h for walking. The tables include the predicted threshold values for each sensor location during each season, accompanied by the corresponding predicted comfort class (i.e., sitting, standing, walking, etc.).

The most significant findings of the PLW study are summarized in Sections 5.1 and 5.2. To assist with understanding and interpretation, predicted conditions for the proposed development are also illustrated in colour-coded format in Figures 2A through 4B. Conditions suitable for sitting are represented by the colour blue, while standing is represented by green, and walking by yellow. Conditions considered uncomfortable for walking are represented by the colour orange. For locations where the wind safety criterion is exceeded, the sensor is highlighted in red.

5.1 Pedestrian Comfort Suitability – *Existing Scenario*

Based on the analysis of the measured data, consideration of local climate data, and the suitability descriptors provided in Tables A1 and A2 in Appendix A and illustrated in Figures 2A and 2B, this section summarizes the significant findings of the PLW study with respect to the *existing scenario*, as follows:

1. Most public sidewalks, walkways, laneways, landscaped spaces, and parking areas within and surrounding the proposed development currently experience wind conditions suitable for walking or better throughout the year. An exception is an isolated sidewalk area along Elizabeth Street North (Sensor 18), which becomes uncomfortable for walking during the winter months.
2. The existing outdoor amenity pool area to the southwest of the site (Sensor 36) currently experiences wind conditions comfortable for sitting during the summer months and standing during the winter months.



3. Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no areas over the study site were found to experience wind conditions that are considered unsafe.

5.2 Pedestrian Comfort Suitability – *Proposed Scenario*

Based on the analysis of the measured data, consideration of local climate data, and the suitability descriptors provided in Tables B1-B3 in Appendix B and illustrated in Figures 3A through 4B, this section summarizes the significant findings of the PLW study with respect to the *proposed scenario*, as follows:

1. Most public sidewalks, walkways, laneways, landscaped spaces, and parking areas within and surrounding the proposed development will experience wind conditions suitable for walking or better throughout the year, which is acceptable for the intended uses of spaces. Exceptions include isolated sidewalk areas along Elizabeth Street North (Sensors 17 & 18) and landscaped areas to the south, southwest, and northeast of the study building (Sensors 35, 37, and 52, respectively), which will exceed the walking criterion during the winter months. The uncomfortable conditions along Elizabeth Street North are largely pre-existing and not significantly exacerbated by the introduction of the proposed development. The greenspace surrounding the Elizabeth Towers development to the east (Sensors 51-53) generally experiences an improvement in overall wind comfort with a slight exacerbation at Sensor 52 during the winter months. Notably, all exceedances of the walking criterion are marginal (< 1.8 km/h; see Appendix B), restricted to the winter months, and wind speeds remain safe as defined in Section 4.4. Additionally, existing mature plantings to the northwest and east, which were not included in the wind tunnel testing, are expected to further buffer prominent wind flows and improve wind comfort at these locations. Overall, the noted uncomfortable conditions are generally expected to be eliminated, which is acceptable.
2. All primary and secondary building access points (including exits, loading areas, vehicle entrances, etc.) throughout the proposed development will be comfortable for standing or better throughout the year, which is acceptable for the intended use.
3. The proposed grade-level outdoor amenity area to the southeast (Sensor 44) will be suitable for sitting during the summer months and standing during the winter months, which is appropriate.




4. The existing outdoor amenity pool area to the southwest of the site (Sensor 36) will experience walking conditions during the summer months and uncomfortable for walking conditions during the winter months. Notably, the existing tall deciduous plantings and coniferous hedges surrounding the area not included in the wind tunnel testing are expected to buffer salient winds and improve comfort to generally suitable for sitting or standing throughout the year. If calmer conditions are desired, the introduction of windscreens along the northwest and/or northeast perimeters may be considered.
4. The Level 7 outdoor amenity terrace (Sensors 67-73) will experience standing conditions during the summer months. To achieve calmer wind conditions for sitting or more sedentary activities throughout the warmer months, it is recommended to raise the perimeter guard to at least 2.0 metres above the walking surface and install vertical wind barriers directly north and south (relative to Project North) of the seating areas, and/or provide canopies, trellises, or pergola structures overhead seating areas. Barriers may take the form of dense coniferous plantings, raised planters, high-solidity wind screens, or a combination thereof, and should measure at least 1.8-metres-tall. The exact composition and configuration of these mitigations can be coordinated with the design team as the landscape plan develops.
5. Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no areas over the study site were found to experience wind conditions that are considered unsafe.

6. CONCLUSIONS AND RECOMMENDATIONS

This report summarizes the methodology, results, and recommendations related to a pedestrian level wind study for a proposed residential development located at 12, 26 Park Street East in Mississauga, Ontario. The study was performed in accordance with industry standard wind tunnel testing and data analysis procedures.

A complete summary of the predicted wind conditions is provided in Section 5 of this report and is also illustrated in Figures 2A through 4B, as well as Tables A1-A2 and B1-B3 in the appendices. Based on wind tunnel test results, meteorological data analysis, and experience with similar developments in Mississauga, we conclude that the future wind conditions over all grade-level pedestrian wind-sensitive



areas within and surrounding the study site will generally be acceptable for the intended uses on a seasonal basis. To ensure the Level 7 outdoor amenity terrace will be comfortable for sitting or more sedentary activities throughout the warmer months, mitigation is recommended as described in Section 5.2.

Within the context of typical weather patterns, which exclude anomalous localized storm events such as tornadoes and downbursts, no areas over the study site were found to experience conditions that could be considered unsafe.

This concludes our pedestrian level wind study and report. Please advise the undersigned of any questions or comments.

Sincerely,

Gradient Wind Engineering Inc.



Cristiano Kondo, MEng., P.Eng.,
Wind Engineer





Angelina Gomes, P.Eng.,
Wind Engineer




Nick Petersen, P.Eng.,
Senior Wind Engineer

GW26-064-WTPLW



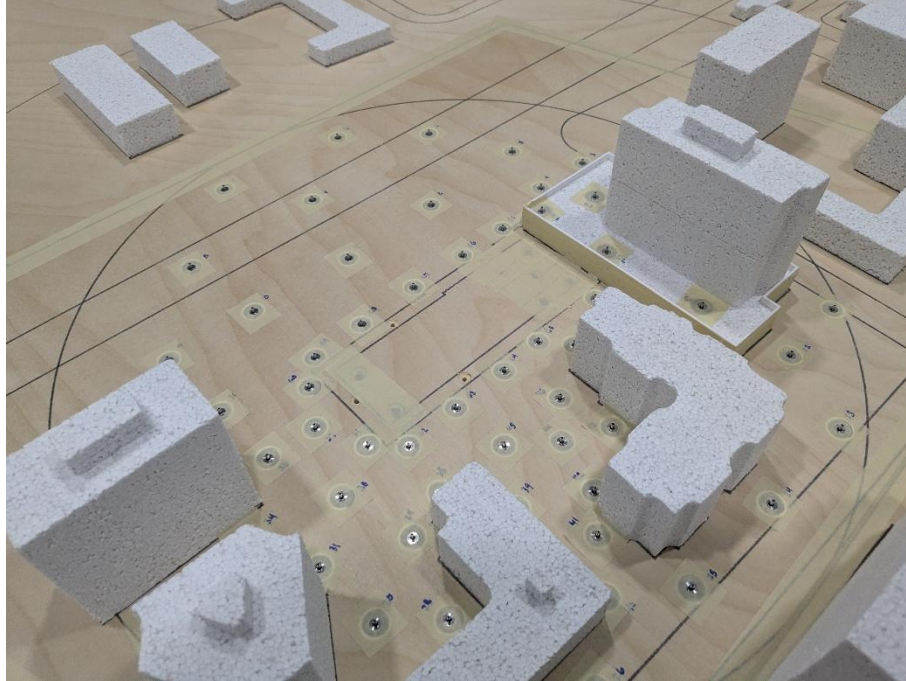

PHOTOGRAPH 1: CLOSE-UP VIEW OF EXISTING CONTEXT MODEL LOOKING NORTH

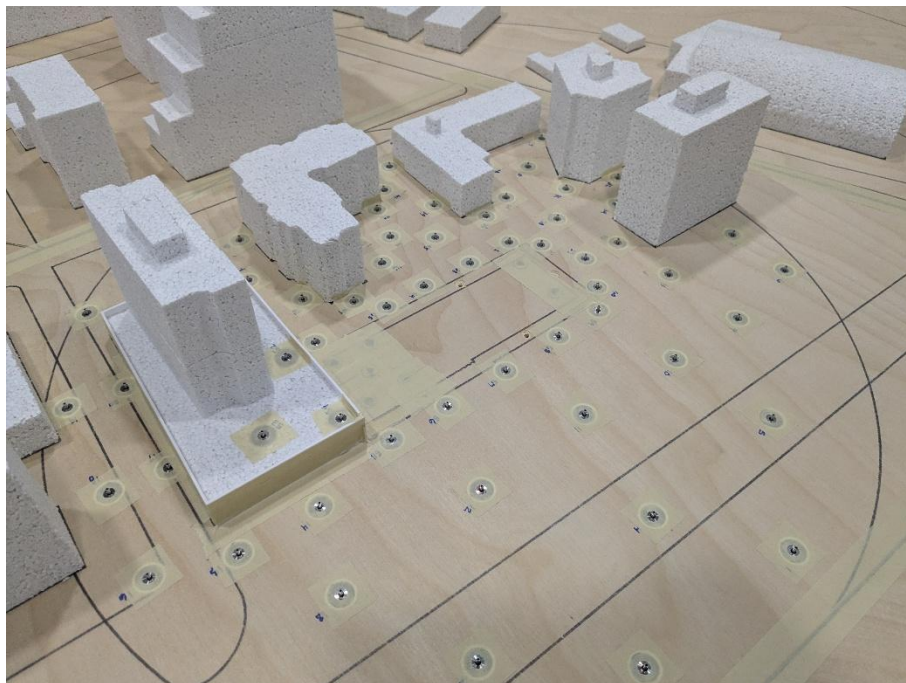

PHOTOGRAPH 2: CLOSE-UP VIEW OF EXISTING CONTEXT MODEL LOOKING SOUTH



PHOTOGRAPH 3: PROPOSED STUDY MODEL INSIDE THE GWE WIND TUNNEL LOOKING DOWNWIND



PHOTOGRAPH 4: PROPOSED STUDY MODEL INSIDE THE GWE WIND TUNNEL LOOKING UPWIND







PHOTOGRAPH 5: CLOSE-UP VIEW OF PROPOSED STUDY MODEL LOOKING NORTH




PHOTOGRAPH 6: CLOSE-UP VIEW OF PROPOSED STUDY MODEL LOOKING SOUTH



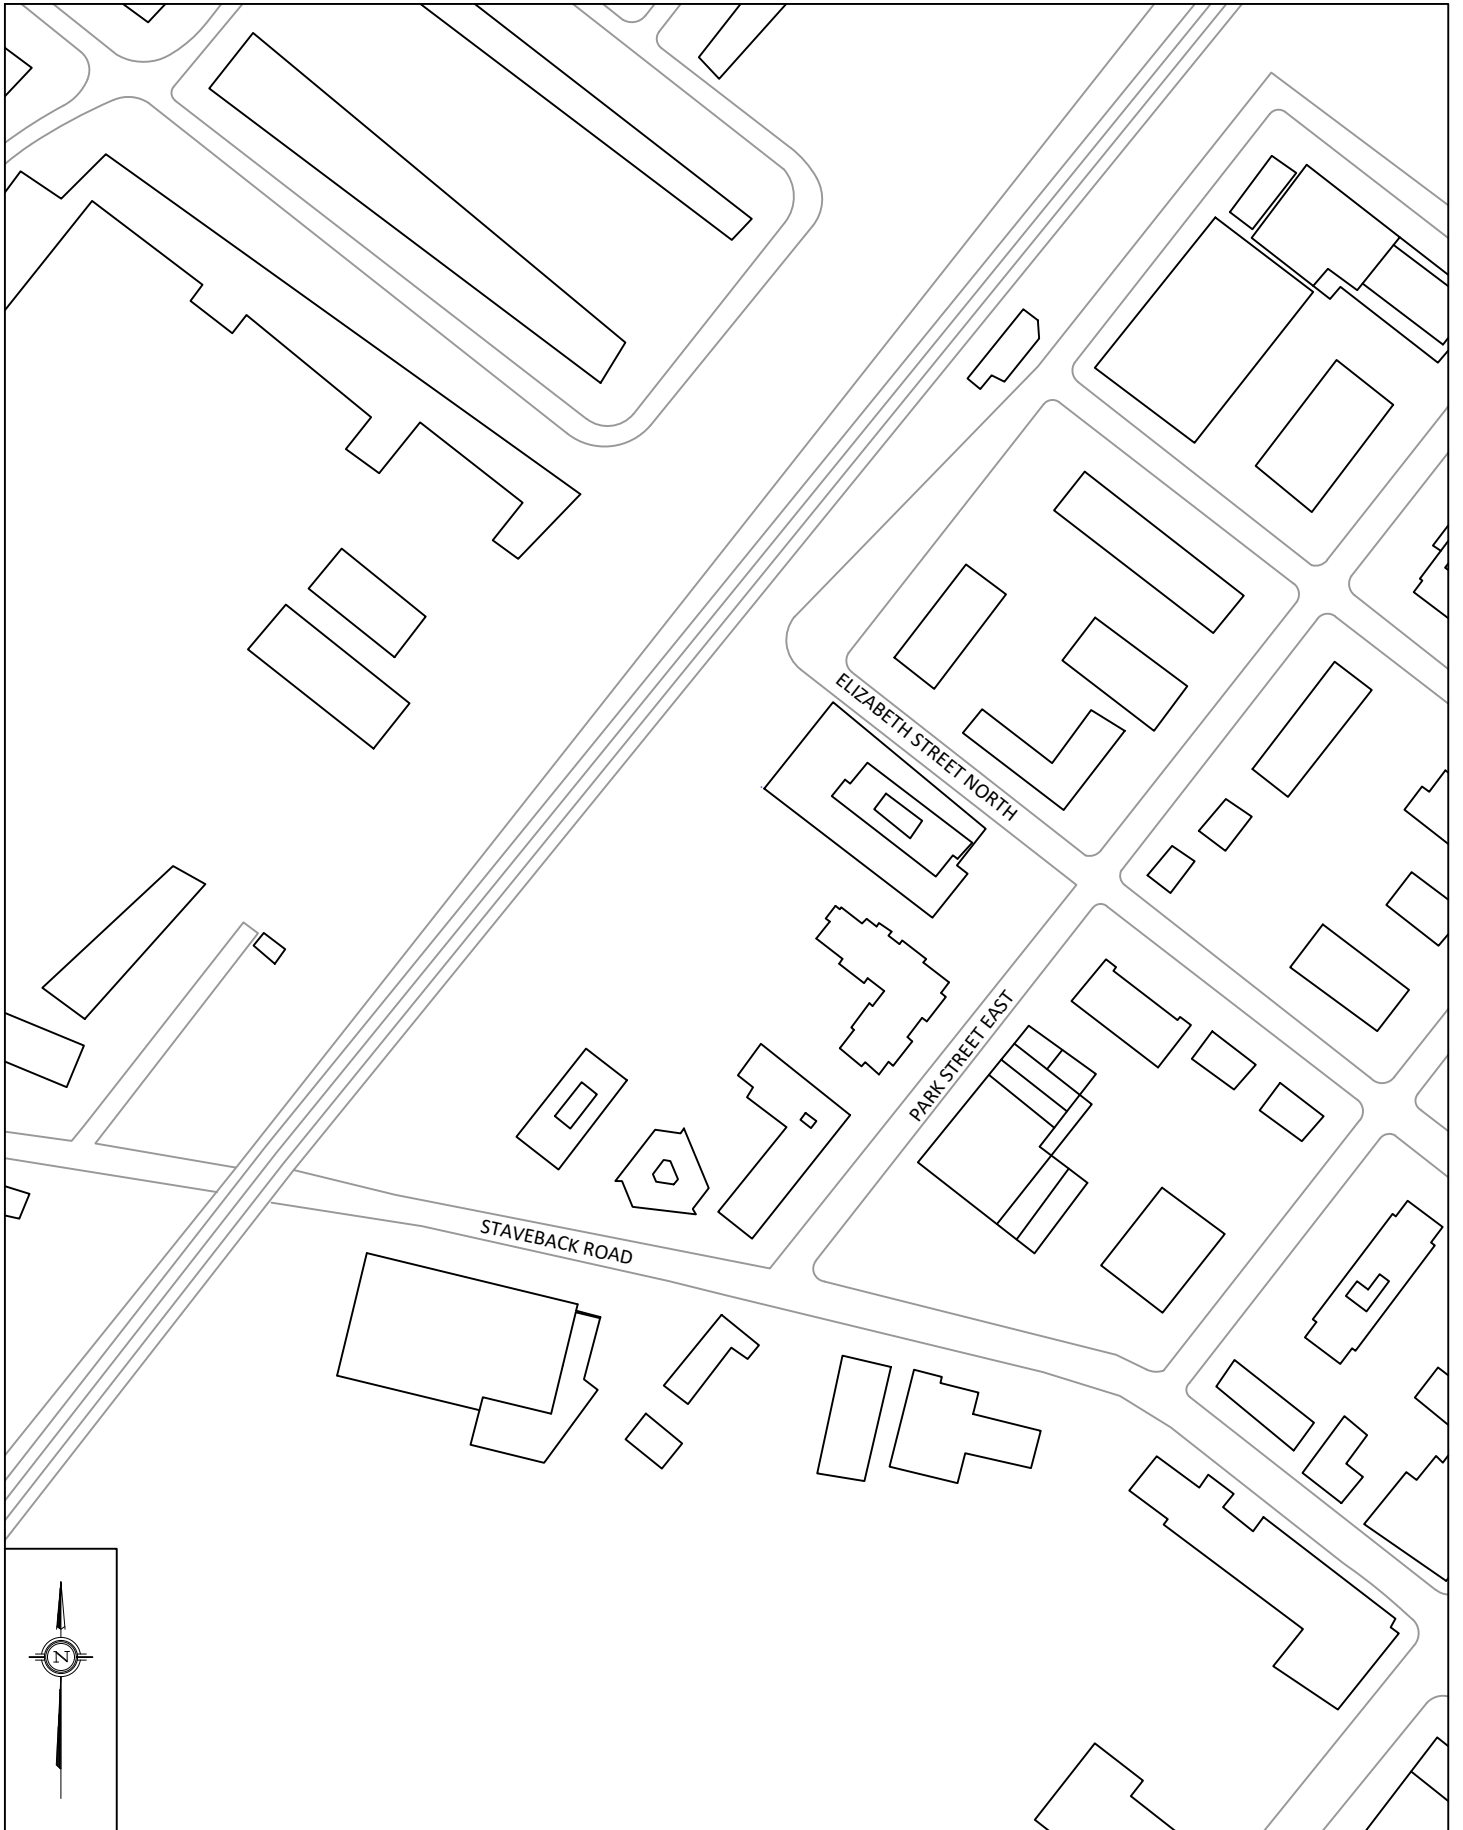


PROJECT	12 & 26 PARK STREET EAST, MISSISSAUGA, ON PEDESTRIAN LEVEL WIND STUDY	
SCALE	1:2500 (APPROX.)	DRAWING NO. GW26-064-PLW-1A
DATE	JUNE 1, 2026	DRAWN BY K.A.


DESCRIPTION	FIGURE 1A: EXISTING SCENARIO AND SURROUNDING CONTEXT
-------------	--

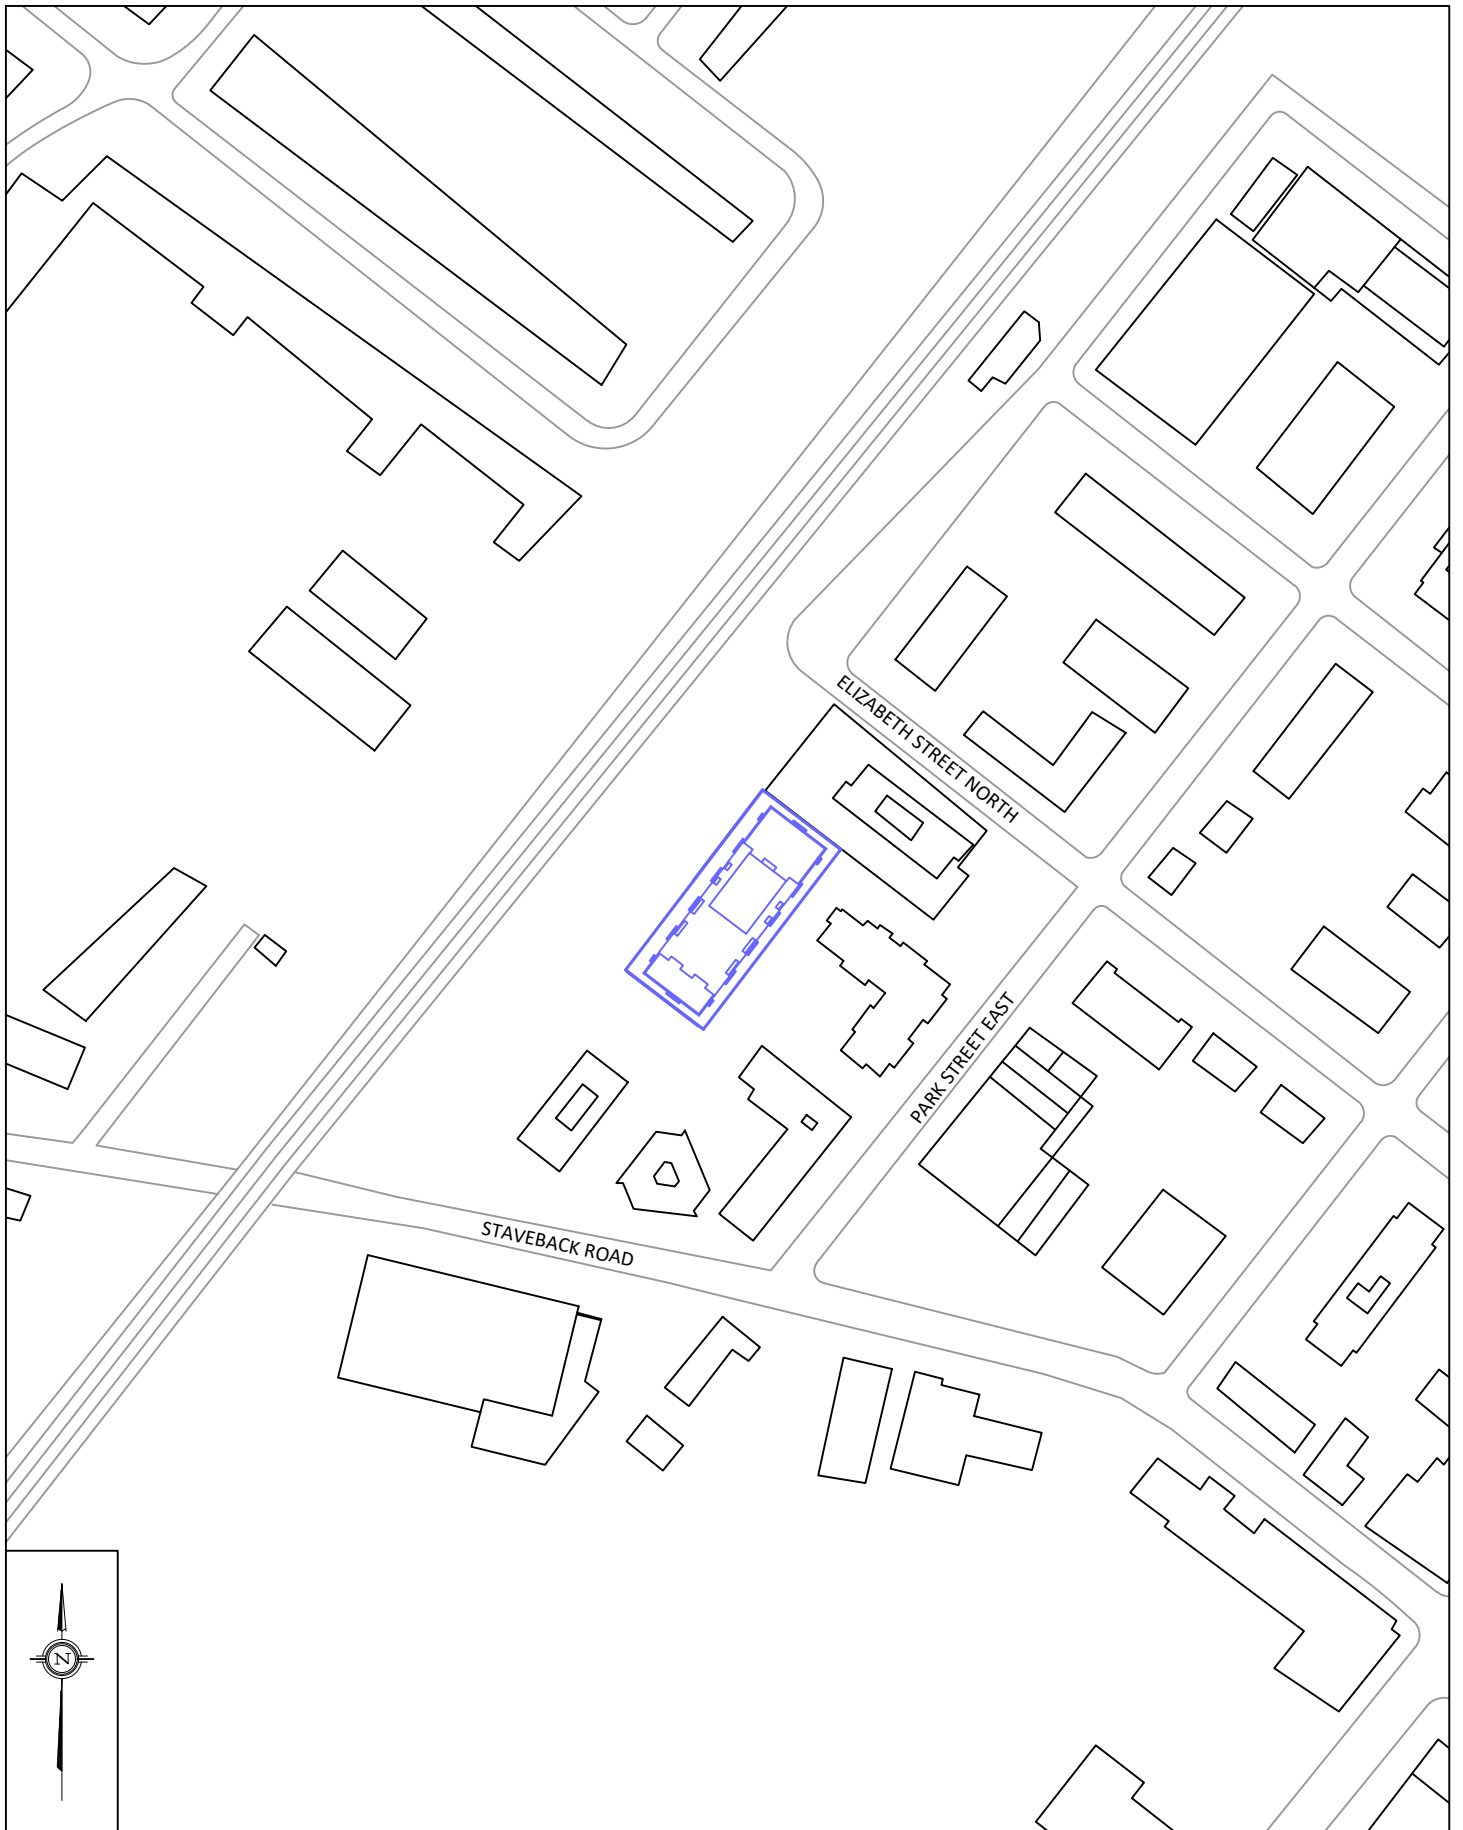



PROJECT	12 & 26 PARK STREET EAST, MISSISSAUGA, ON PEDESTRIAN LEVEL WIND STUDY	
SCALE	1:2500 (APPROX.)	DRAWING NO. GW26-064-PLW-1B
DATE	JUNE 1, 2026	DRAWN BY K.A.



DESCRIPTION	FIGURE 1B: FUTURE SCENARIO AND SURROUNDING CONTEXT
-------------	--

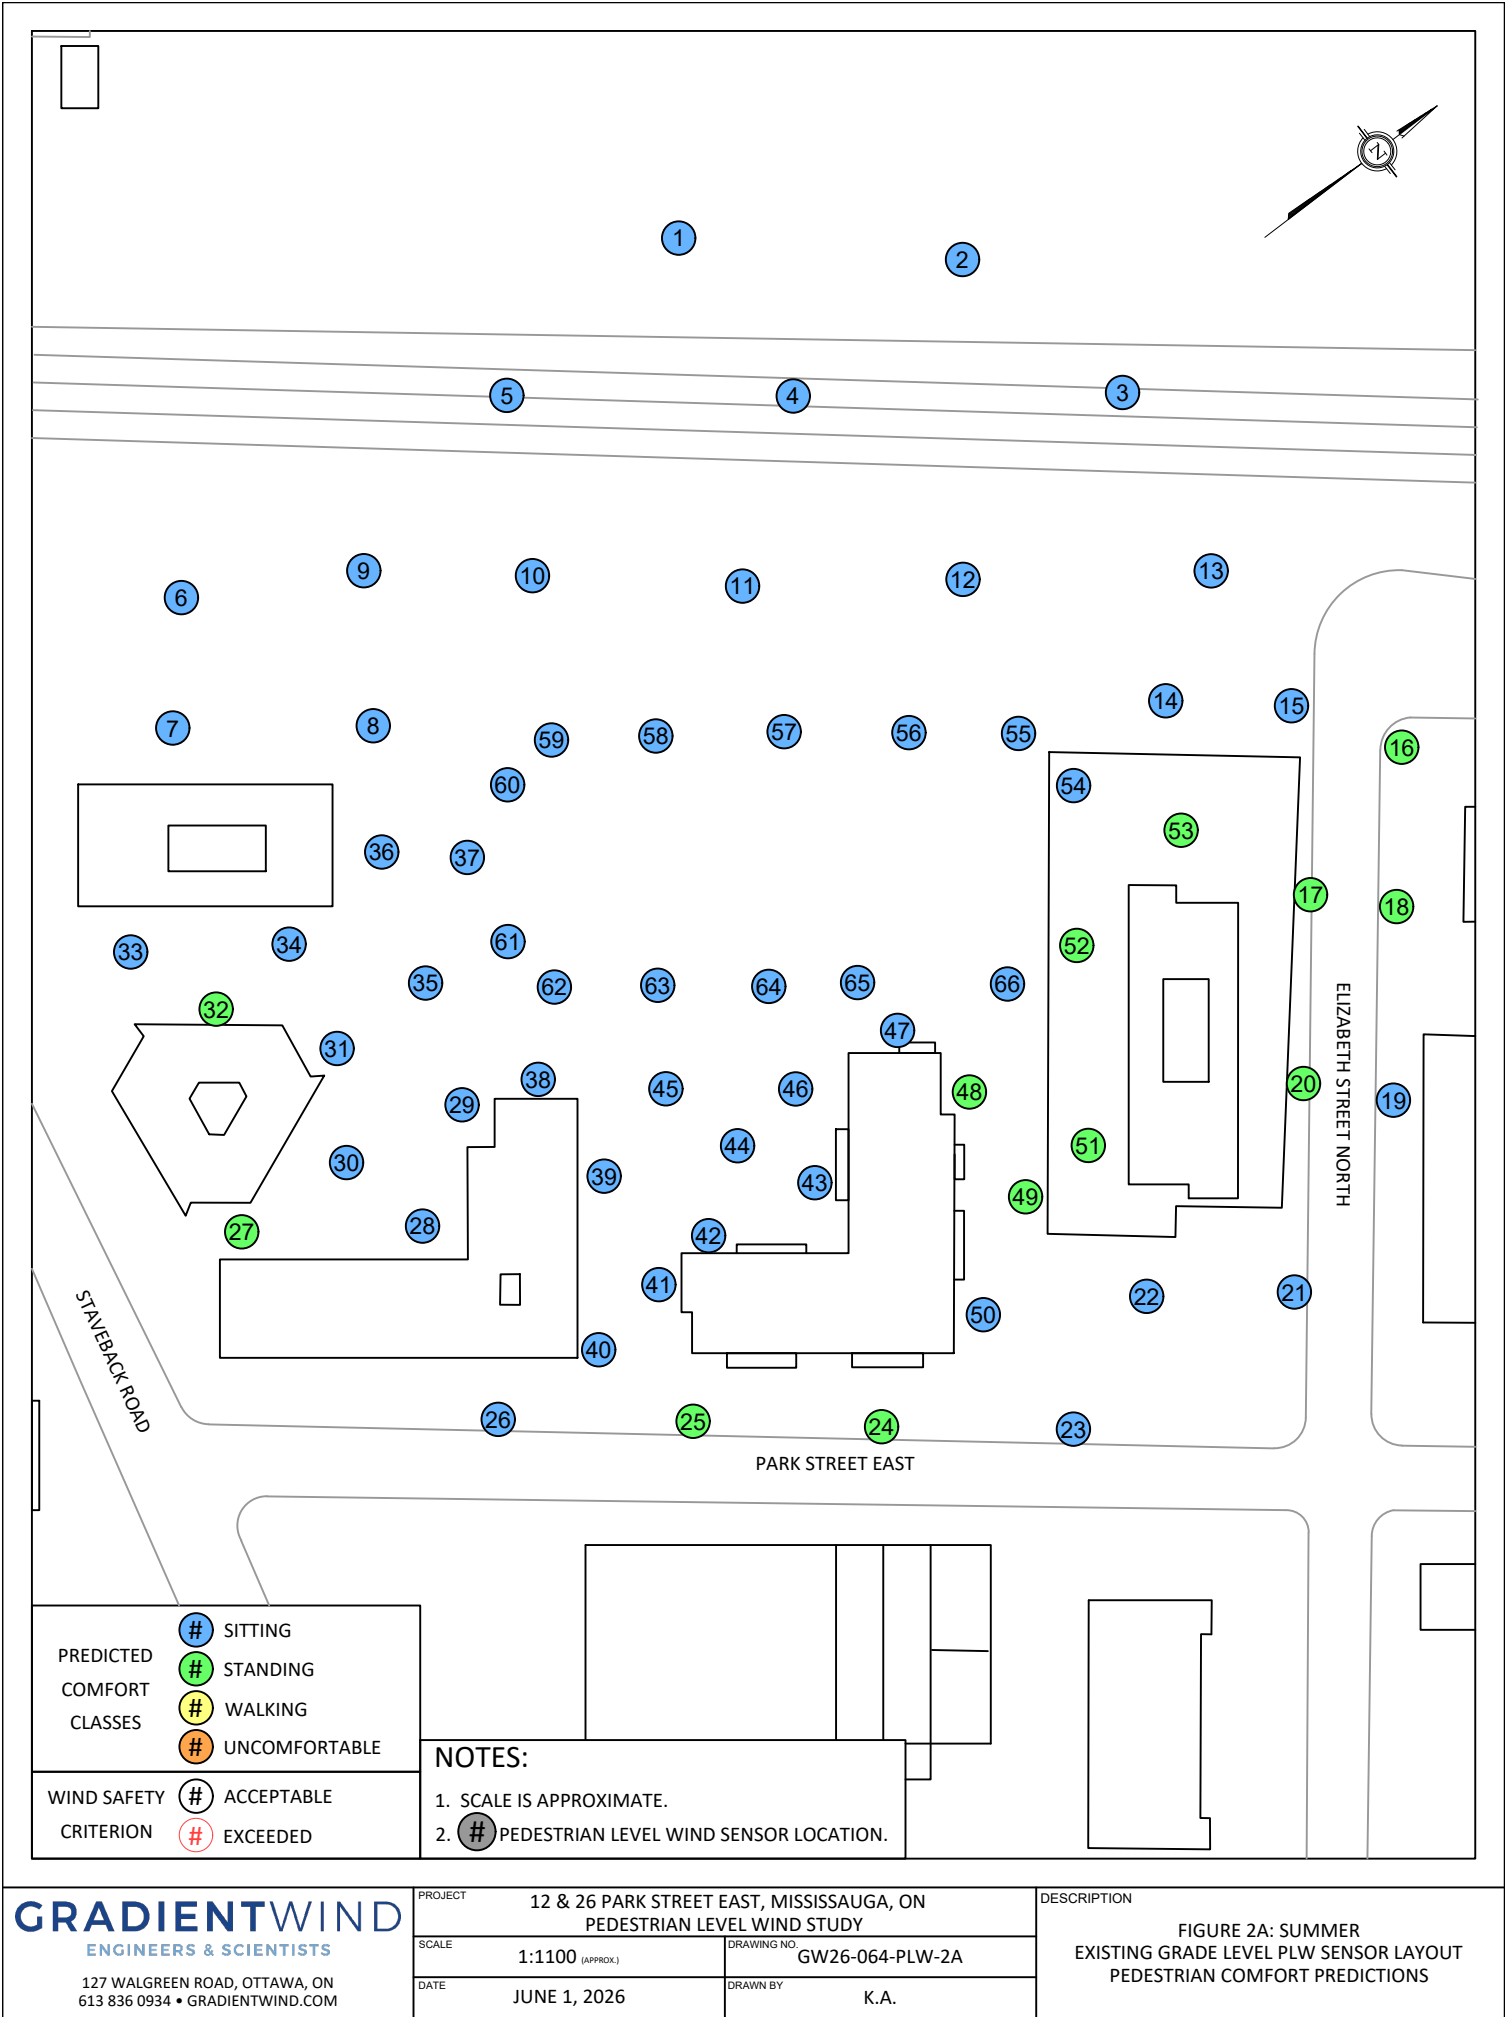

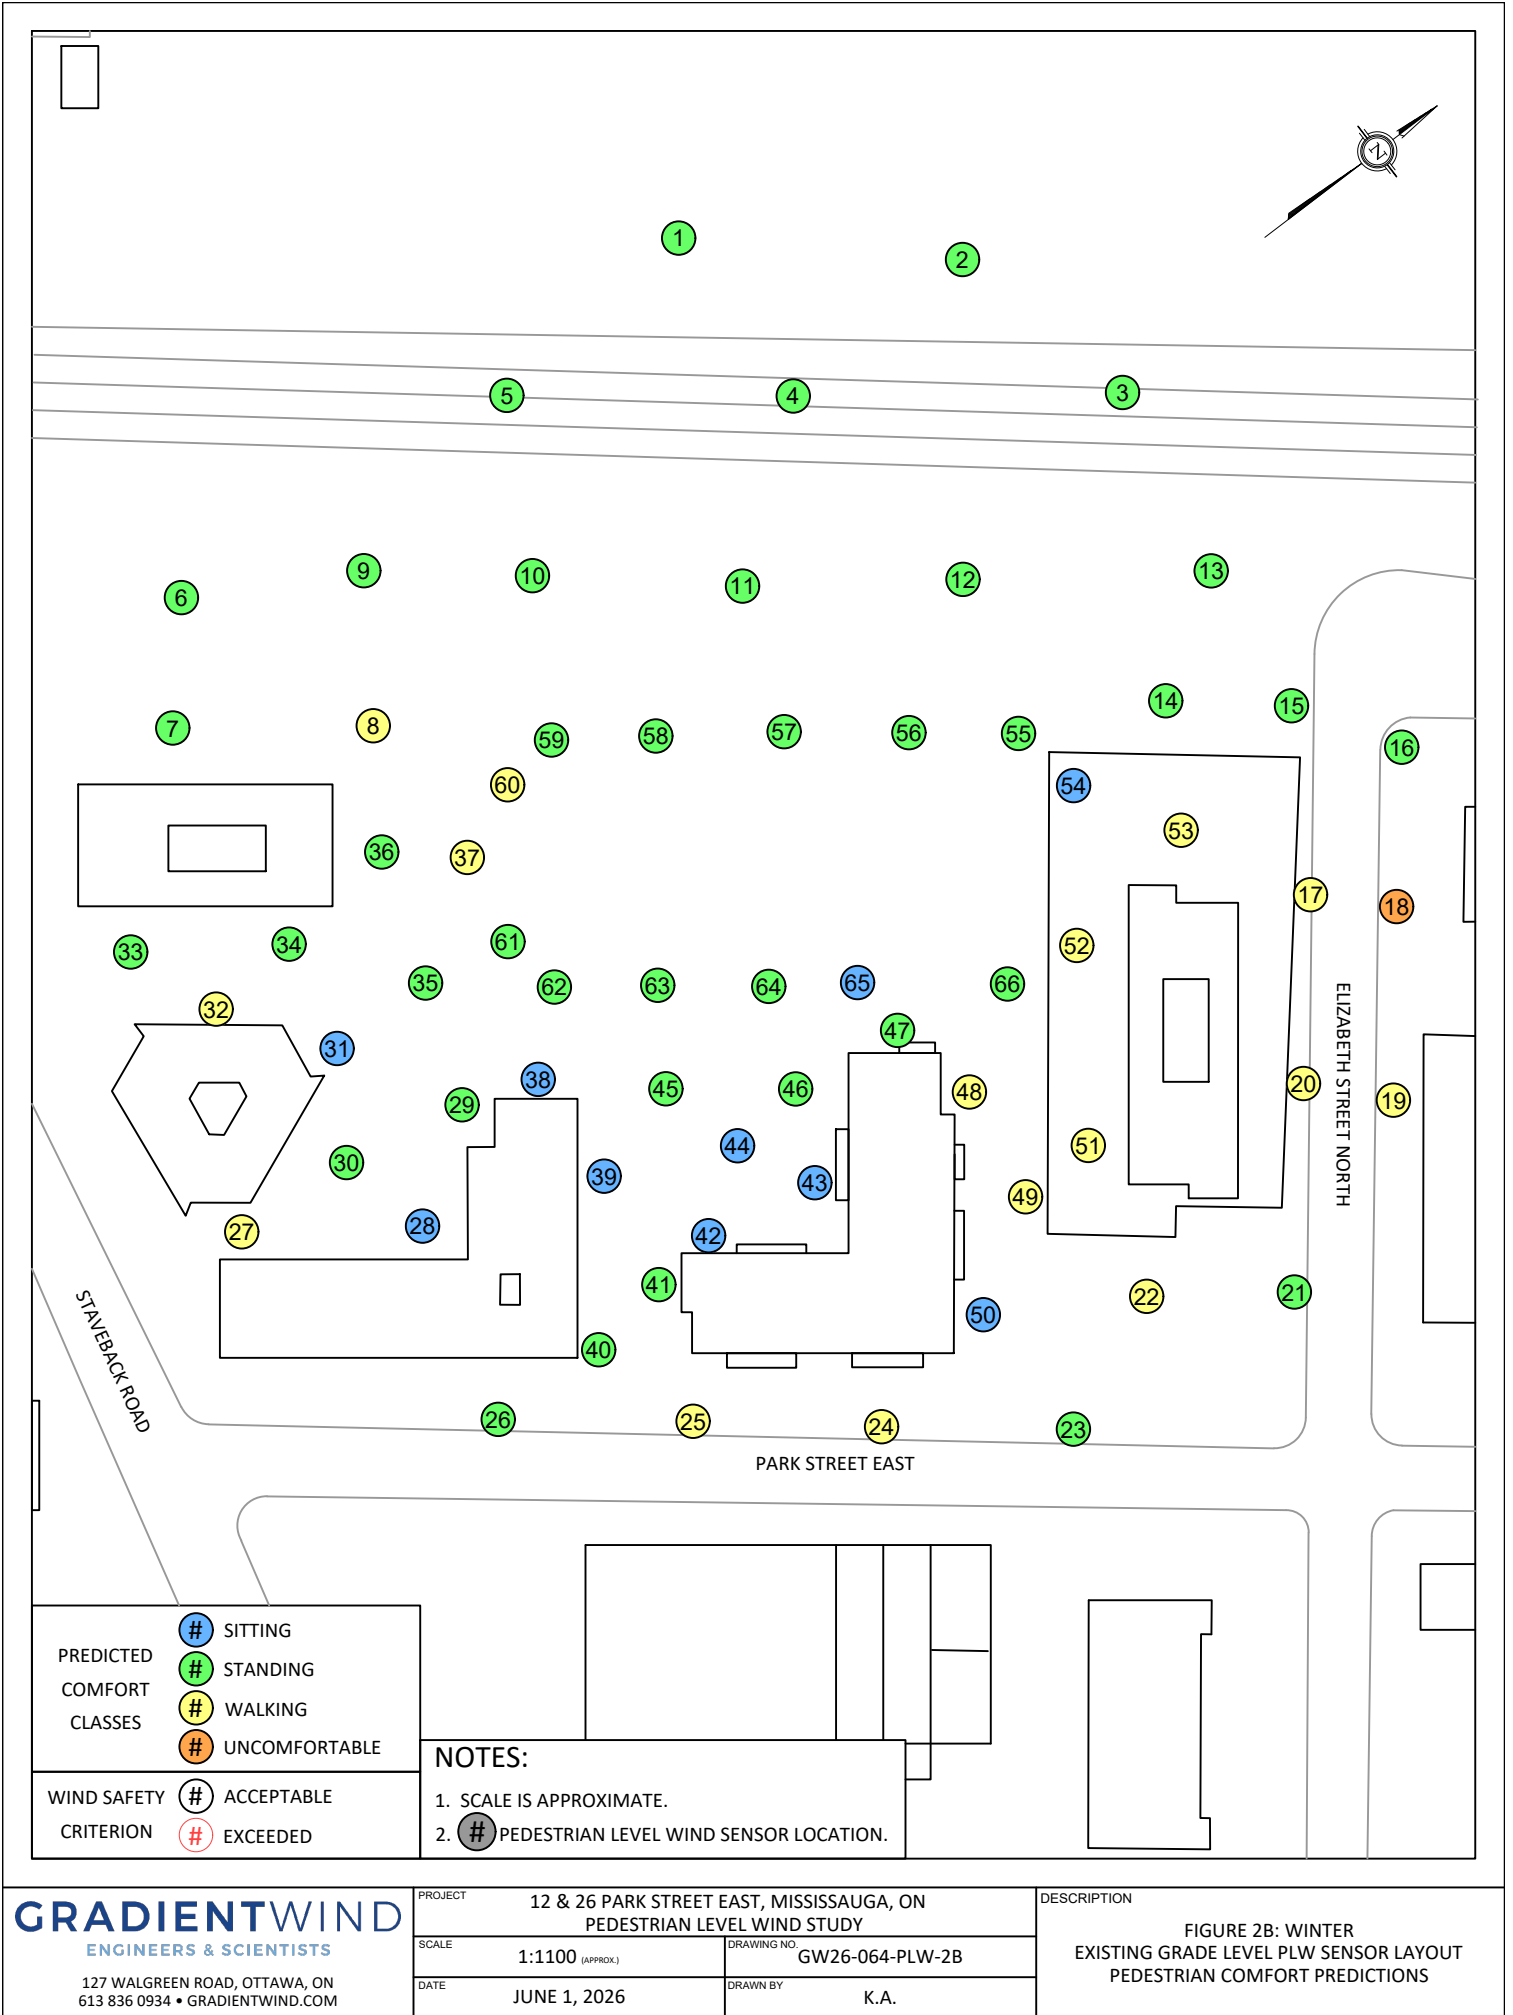

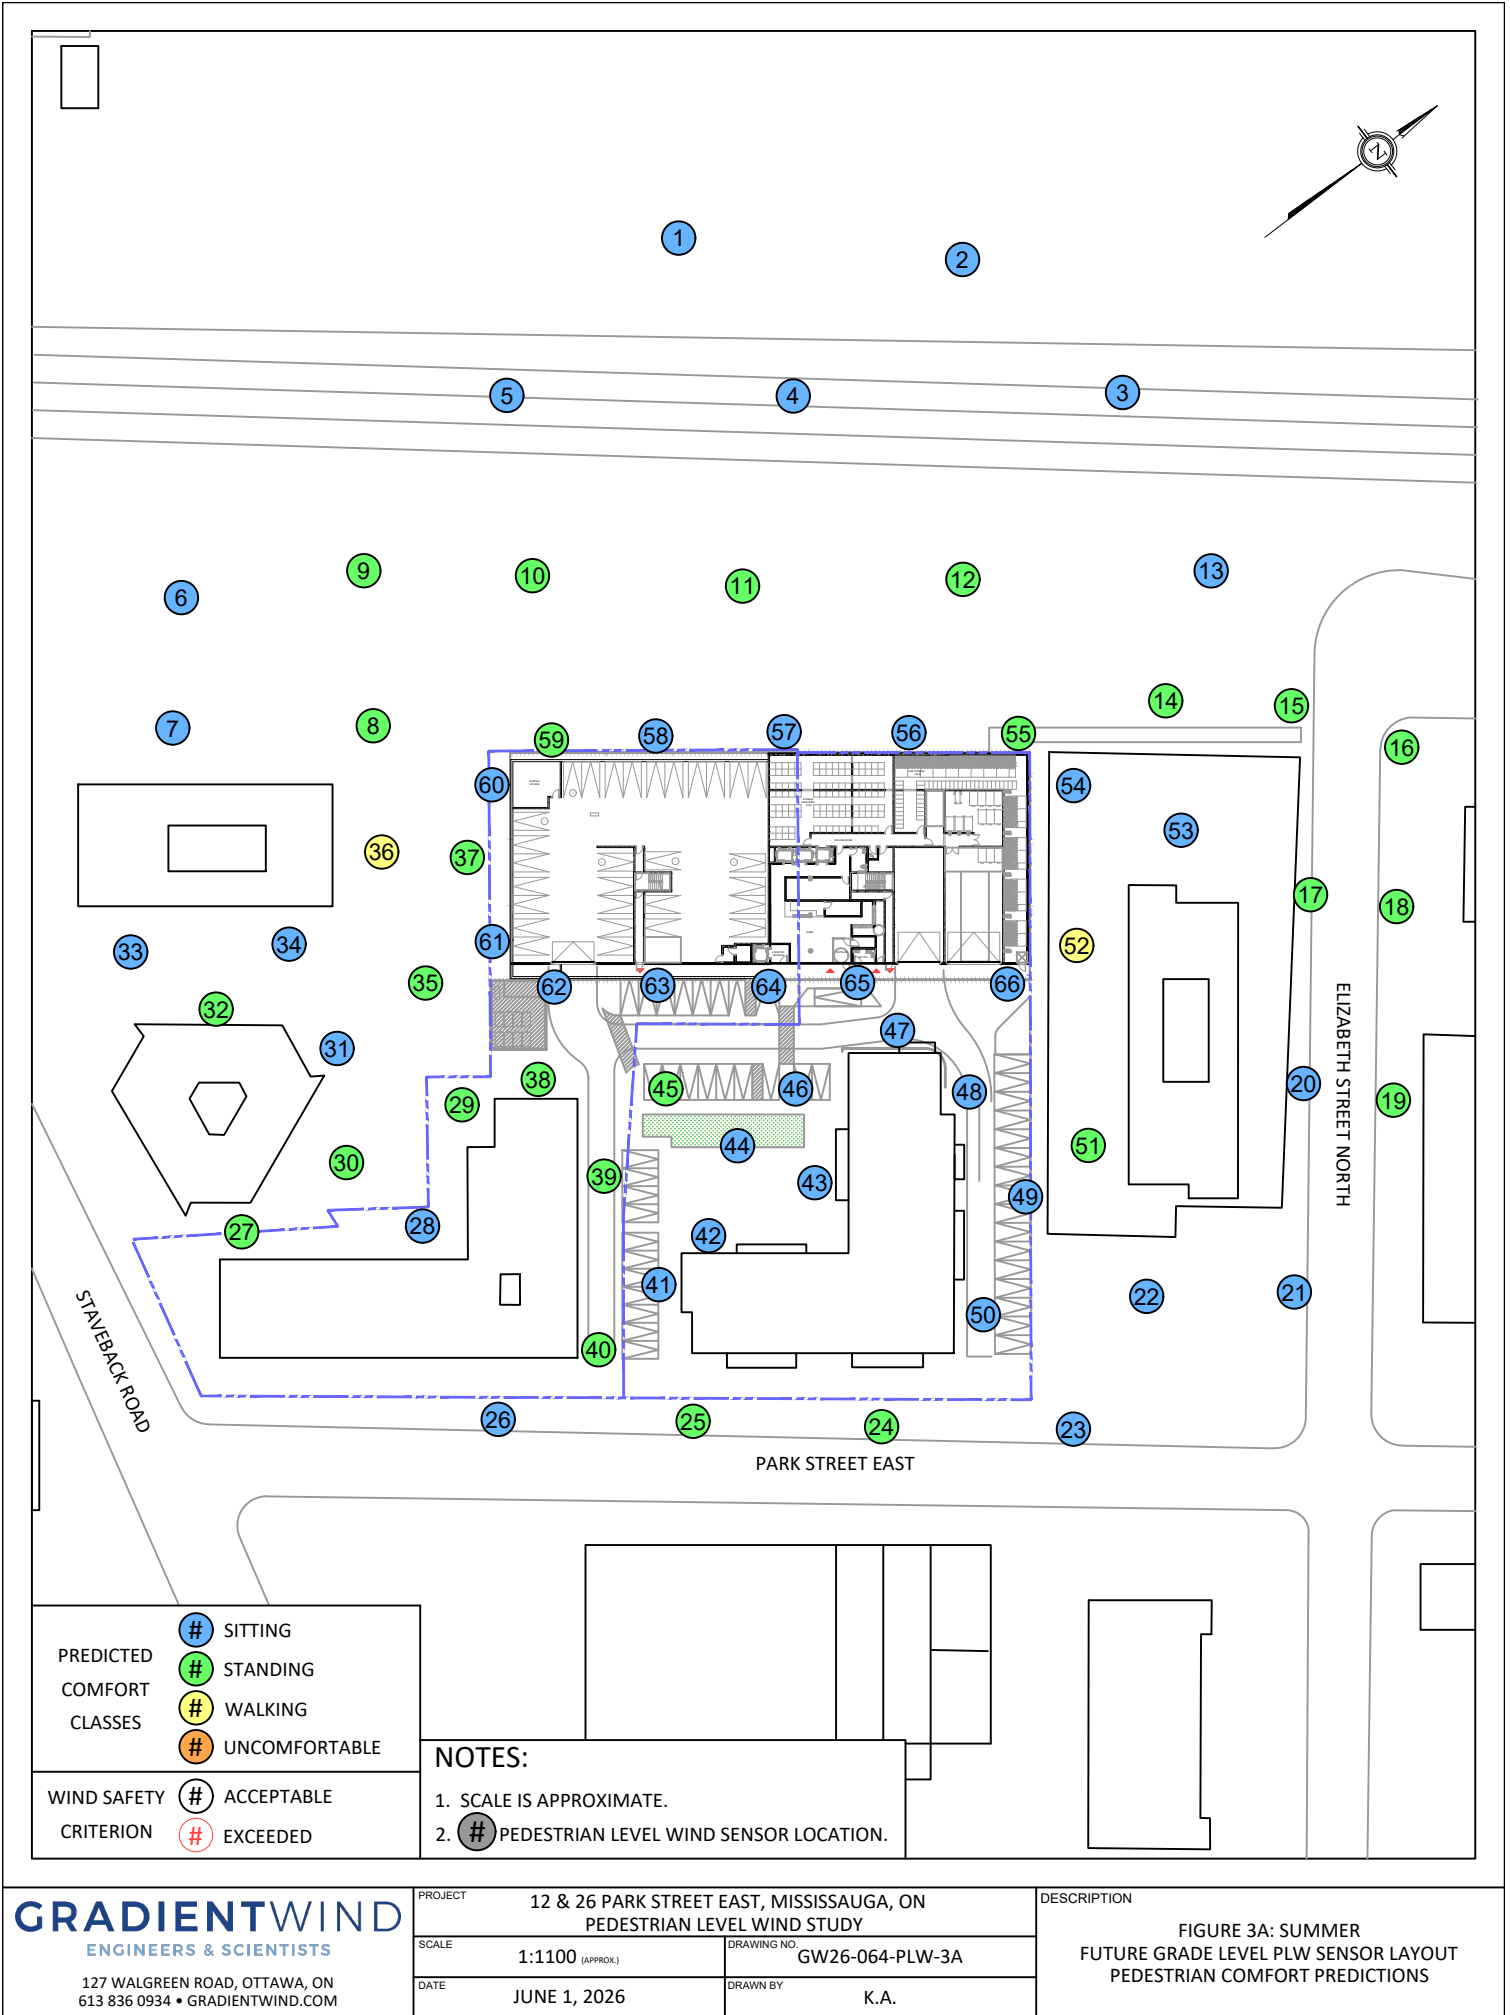

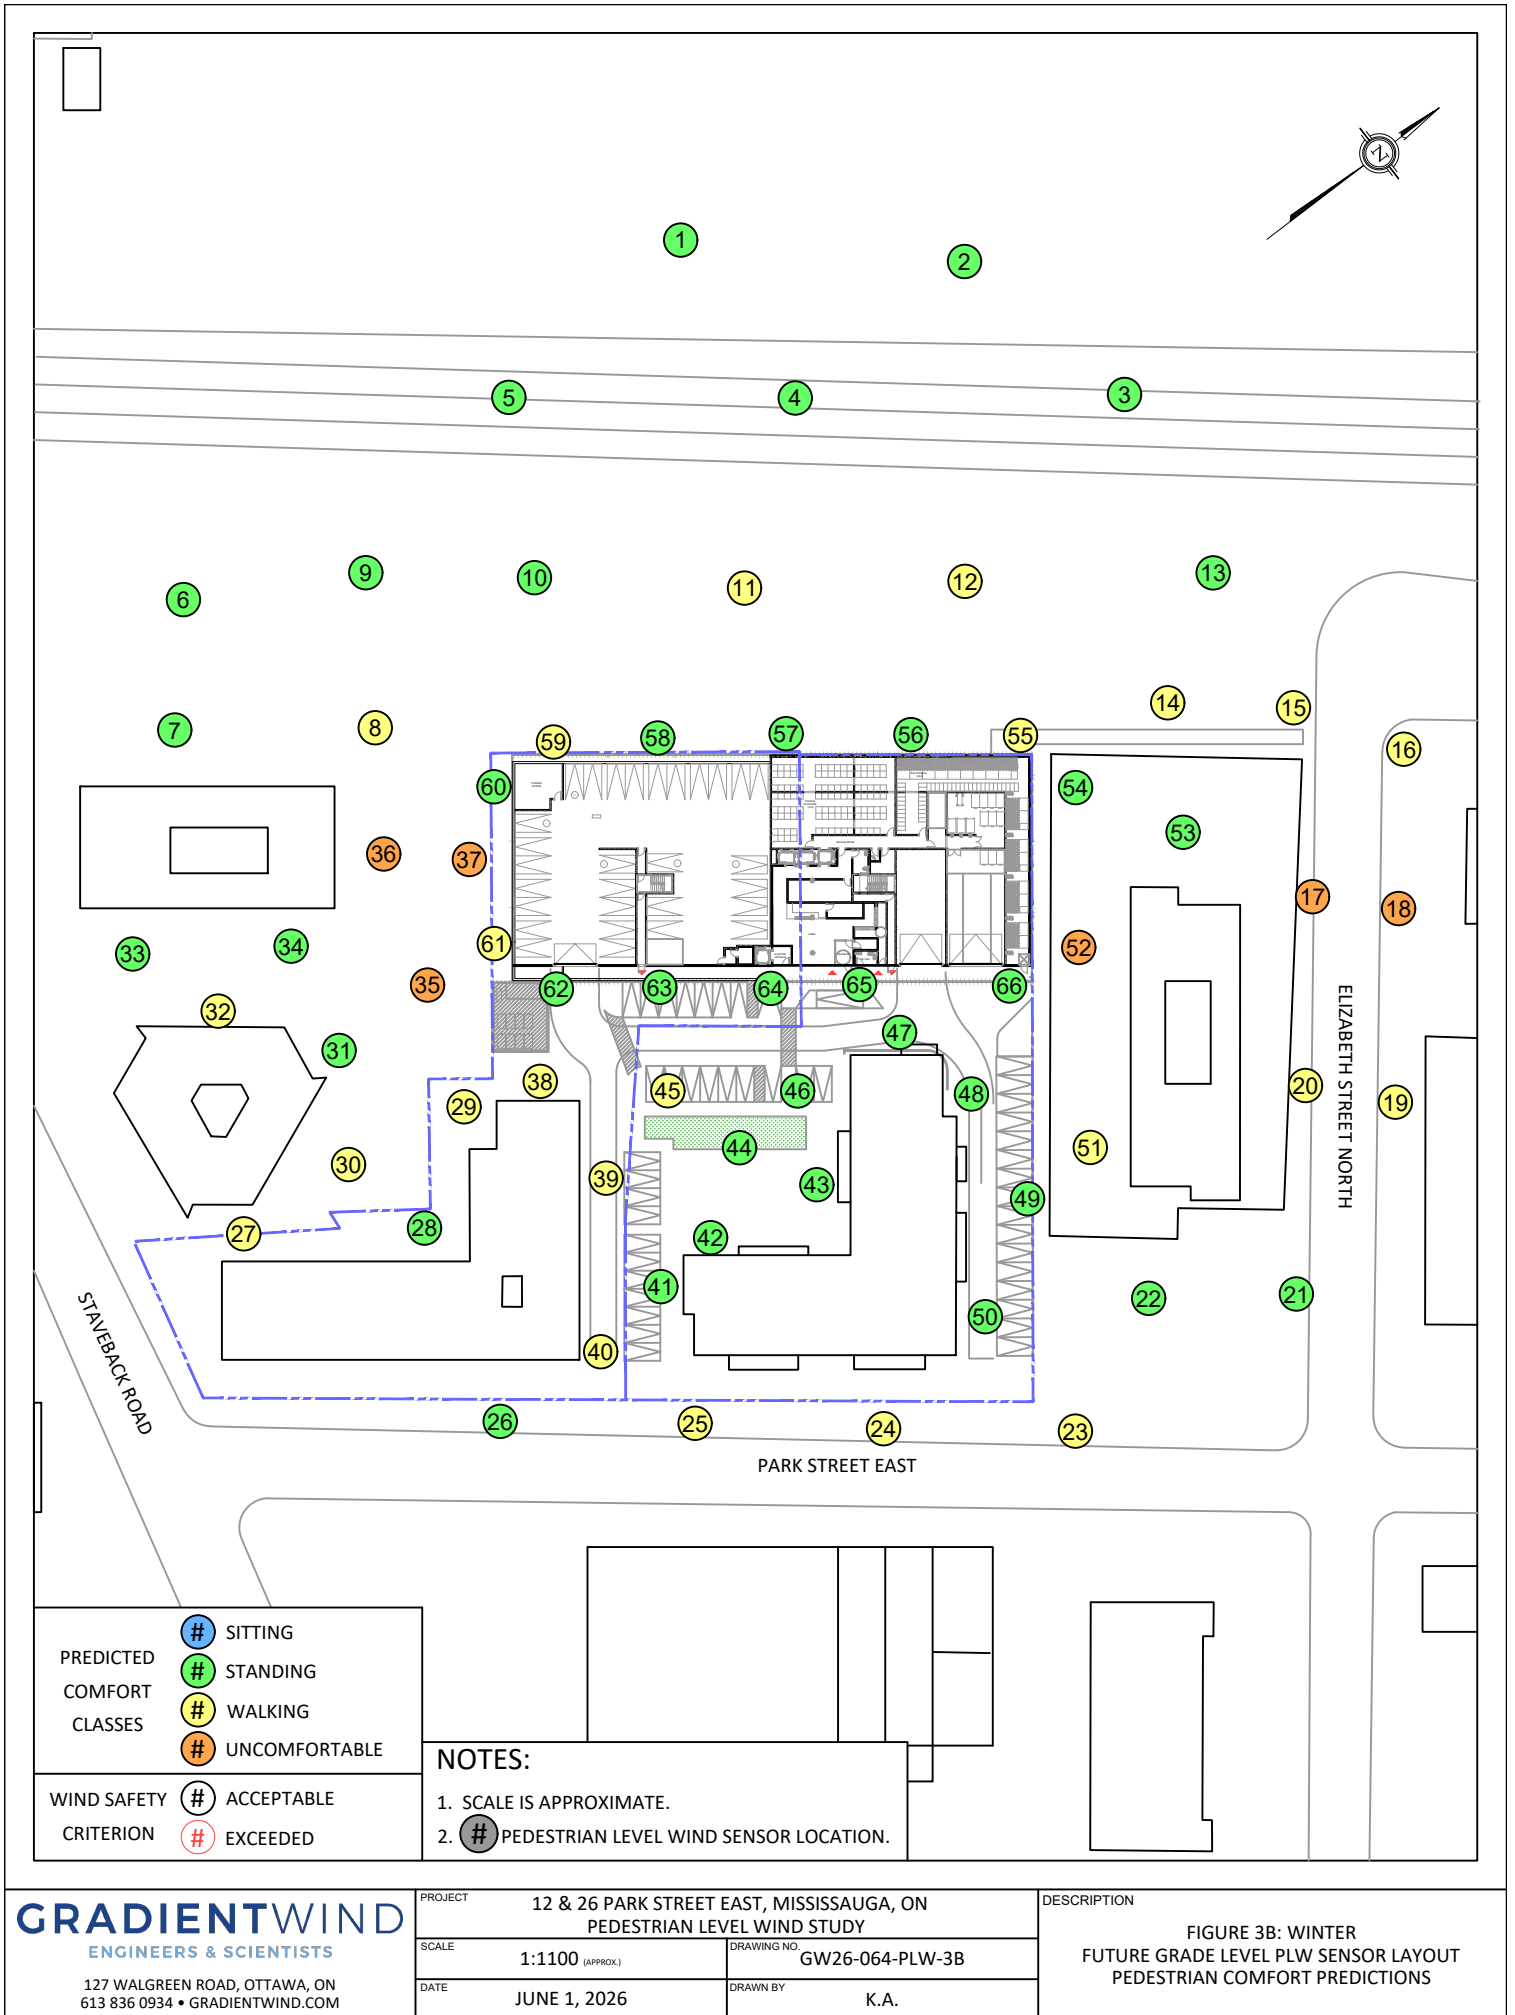

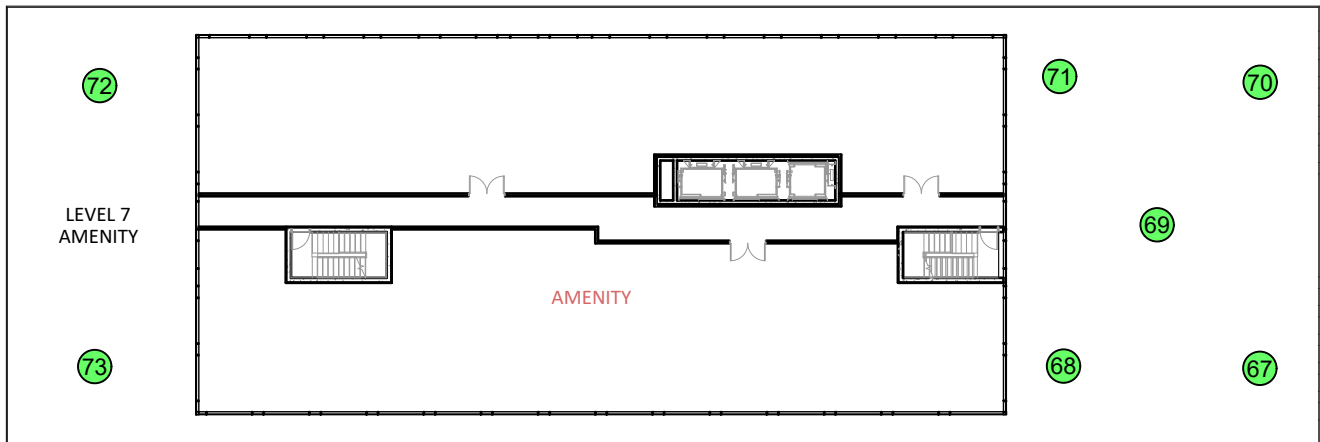



PREDICTED COMFORT CLASSES		SITTING
		STANDING
		WALKING
		UNCOMFORTABLE
WIND SAFETY CRITERION		ACCEPTABLE
		EXCEEDED

NOTES:

1. SCALE IS APPROXIMATE.
2. PEDESTRIAN LEVEL WIND SENSOR LOCATION.

GRADIENTWIND ENGINEERS & SCIENTISTS 127 WALGREEN ROAD, OTTAWA, ON 613 836 0934 • GRADIENTWIND.COM	PROJECT 12 & 26 PARK STREET EAST, MISSISSAUGA, ON PEDESTRIAN LEVEL WIND STUDY		DESCRIPTION FIGURE 4A: SUMMER FUTURE TERRACE PLW SENSOR LAYOUT PEDESTRIAN COMFORT PREDICTIONS
	SCALE 1:400 (APPROX.)	DRAWING NO. GW26-064-PLW-4A	
	DATE JUNE 1, 2026	DRAWN BY K.A.	

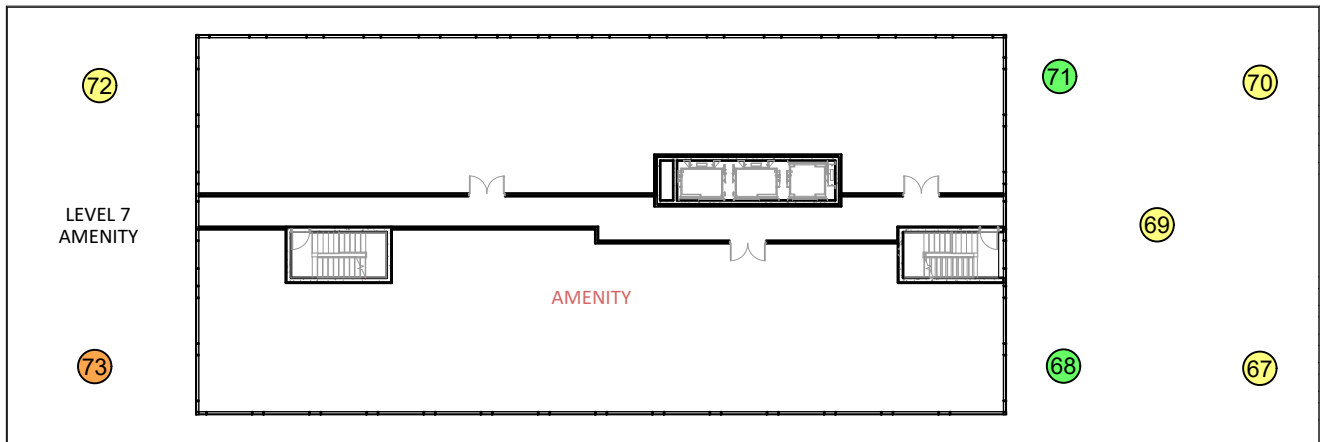

PREDICTED COMFORT CLASSES		SITTING
		STANDING
		WALKING
		UNCOMFORTABLE
WIND SAFETY CRITERION		ACCEPTABLE
		EXCEEDED

NOTES:

1. SCALE IS APPROXIMATE.
2. PEDESTRIAN LEVEL WIND SENSOR LOCATION.

GRADIENTWIND

ENGINEERS & SCIENTISTS




APPENDIX A

PEDESTRIAN COMFORT SUITABILITY, TABLES A1-A2 (EXISTING SCENARIO)

Guidelines	
Pedestrian Comfort	20% exceedance wind speed 0-10 km/h = Sitting, 10-15 km/h = Standing, 15-20 km/h = Walking, >20 km/h = Uncomfortable
Pedestrian Safety	0.1% exceedance wind speed 0-90 km/h = Safe

TABLE A1: SUMMARY OF PEDESTRIAN COMFORT (EXISTING SCENARIO)

Sensor	Pedestrian Comfort				Pedestrian Safety	
	Summer		Winter		Annual	
	Wind Speed	Comfort Class	Wind Speed	Comfort Class	Wind Speed	Safety Class
1	8.5	Sitting	11.8	Standing	40.5	Safe
2	9.3	Sitting	12.0	Standing	39.7	Safe
3	9.6	Sitting	13.1	Standing	41.3	Safe
4	8.7	Sitting	12.2	Standing	41.6	Safe
5	8.8	Sitting	12.8	Standing	41.0	Safe
6	8.9	Sitting	11.4	Standing	39.2	Safe
7	9.6	Sitting	13.6	Standing	47.2	Safe
8	9.6	Sitting	16.5	Walking	56.4	Safe
9	9.4	Sitting	13.3	Standing	40.5	Safe
10	8.8	Sitting	13.6	Standing	43.6	Safe
11	8.9	Sitting	13.1	Standing	40.3	Safe
12	9.4	Sitting	13.3	Standing	42.6	Safe
13	9.1	Sitting	12.5	Standing	42.2	Safe
14	8.2	Sitting	11.6	Standing	46.9	Safe
15	9.9	Sitting	14.3	Standing	53.3	Safe
16	10.6	Standing	14.4	Standing	53.8	Safe
17	12.3	Standing	19.3	Walking	57.1	Safe
18	13.8	Standing	20.9	Uncomfortable	64.2	Safe
19	9.1	Sitting	16.1	Walking	60.1	Safe
20	10.1	Standing	15.1	Walking	52.1	Safe
21	8.6	Sitting	11.7	Standing	41.5	Safe
22	9.7	Sitting	16.4	Walking	58.8	Safe
23	9.3	Sitting	15.0	Standing	57.4	Safe
24	11.8	Standing	17.3	Walking	55.7	Safe
25	13.7	Standing	17.9	Walking	59.5	Safe
26	10.0	Sitting	14.0	Standing	52.9	Safe
27	13.1	Standing	18.0	Walking	58.4	Safe
28	6.4	Sitting	9.4	Sitting	34.9	Safe
29	9.9	Sitting	15.0	Standing	55.6	Safe
30	8.4	Sitting	11.5	Standing	45.1	Safe
31	7.0	Sitting	9.7	Sitting	37.8	Safe
32	11.0	Standing	17.4	Walking	64.2	Safe
33	9.1	Sitting	11.9	Standing	53.4	Safe
34	9.1	Sitting	11.4	Standing	50.6	Safe
35	9.9	Sitting	13.8	Standing	48.8	Safe



Guidelines	
Pedestrian Comfort	20% exceedance wind speed 0-10 km/h = Sitting, 10-15 km/h = Standing, 15-20 km/h = Walking, >20 km/h = Uncomfortable
Pedestrian Safety	0.1% exceedance wind speed 0-90 km/h = Safe


TABLE A2: SUMMARY OF PEDESTRIAN COMFORT (EXISTING SCENARIO)

Sensor	Pedestrian Comfort				Pedestrian Safety	
	Summer		Winter		Annual	
	Wind Speed	Comfort Class	Wind Speed	Comfort Class	Wind Speed	Safety Class
36	9.2	Sitting	13.8	Standing	67.3	Safe
37	9.5	Sitting	16.6	Walking	64.3	Safe
38	6.5	Sitting	9.1	Sitting	34.2	Safe
39	6.6	Sitting	9.8	Sitting	35.7	Safe
40	9.1	Sitting	12.5	Standing	45.7	Safe
41	8.7	Sitting	10.9	Standing	43.4	Safe
42	6.1	Sitting	9.3	Sitting	35.7	Safe
43	6.1	Sitting	8.7	Sitting	32.2	Safe
44	6.8	Sitting	9.8	Sitting	37.0	Safe
45	8.2	Sitting	11.3	Standing	39.5	Safe
46	6.7	Sitting	10.1	Standing	40.4	Safe
47	7.2	Sitting	11.3	Standing	41.9	Safe
48	10.4	Standing	16.4	Walking	56.2	Safe
49	11.1	Standing	18.0	Walking	57.1	Safe
50	6.1	Sitting	8.2	Sitting	30.7	Safe
51	11.4	Standing	19.4	Walking	64.1	Safe
52	10.8	Standing	17.6	Walking	64.4	Safe
53	11.0	Standing	15.7	Walking	52.9	Safe
54	7.0	Sitting	9.0	Sitting	36.4	Safe
55	9.9	Sitting	14.2	Standing	48.6	Safe
56	8.3	Sitting	11.9	Standing	37.9	Safe
57	8.4	Sitting	12.7	Standing	40.8	Safe
58	8.6	Sitting	13.6	Standing	43.7	Safe
59	8.8	Sitting	14.8	Standing	48.7	Safe
60	9.0	Sitting	16.2	Walking	57.7	Safe
61	9.3	Sitting	13.2	Standing	54.7	Safe
62	8.4	Sitting	12.3	Standing	49.0	Safe
63	7.3	Sitting	10.9	Standing	43.7	Safe
64	8.7	Sitting	12.5	Standing	39.3	Safe
65	6.7	Sitting	9.9	Sitting	34.5	Safe
66	9.3	Sitting	13.2	Standing	41.7	Safe



GRADIENTWIND

ENGINEERS & SCIENTISTS

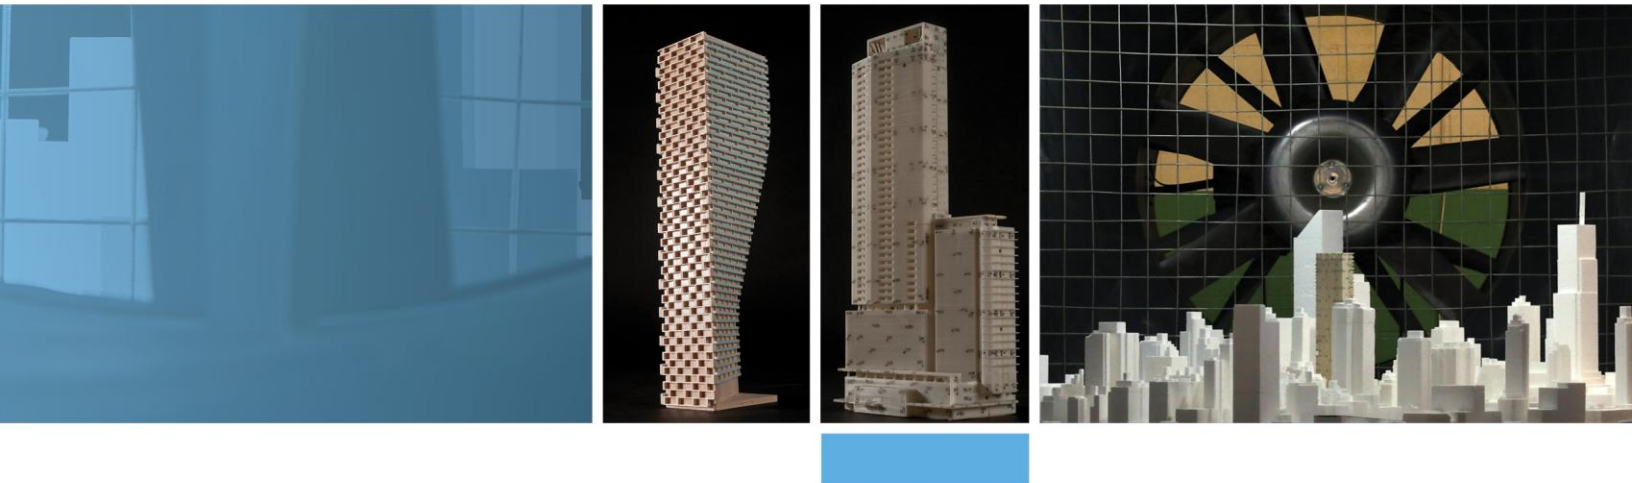


APPENDIX B

PEDESTRIAN COMFORT SUITABILITY, TABLES B1-B3 (PROPOSED SCENARIO)

Guidelines	
Pedestrian Comfort	20% exceedance wind speed 0-10 km/h = Sitting, 10-15 km/h = Standing, 15-20 km/h = Walking, >20 km/h = Uncomfortable
Pedestrian Safety	0.1% exceedance wind speed 0-90 km/h = Safe

TABLE B1: SUMMARY OF PEDESTRIAN COMFORT (PROPOSED SCENARIO)


Sensor	Pedestrian Comfort				Pedestrian Safety	
	Summer		Winter		Annual	
	Wind Speed	Comfort Class	Wind Speed	Comfort Class	Wind Speed	Safety Class
1	9.0	Sitting	12.3	Standing	42.0	Safe
2	9.1	Sitting	11.8	Standing	41.7	Safe
3	9.5	Sitting	13.4	Standing	44.3	Safe
4	9.4	Sitting	12.9	Standing	45.0	Safe
5	9.3	Sitting	12.3	Standing	45.2	Safe
6	9.4	Sitting	11.8	Standing	41.8	Safe
7	9.4	Sitting	13.4	Standing	47.8	Safe
8	13.0	Standing	17.7	Walking	58.4	Safe
9	11.4	Standing	14.3	Standing	62.4	Safe
10	10.6	Standing	13.7	Standing	55.8	Safe
11	11.7	Standing	15.5	Walking	53.7	Safe
12	11.0	Standing	16.0	Walking	51.8	Safe
13	9.9	Sitting	14.9	Standing	49.4	Safe
14	11.2	Standing	18.5	Walking	65.0	Safe
15	12.2	Standing	18.7	Walking	61.4	Safe
16	11.0	Standing	15.8	Walking	54.2	Safe
17	12.9	Standing	20.1	Uncomfortable	66.9	Safe
18	14.7	Standing	21.5	Uncomfortable	65.5	Safe
19	10.1	Standing	17.9	Walking	68.7	Safe
20	9.9	Sitting	15.5	Walking	52.9	Safe
21	9.3	Sitting	13.5	Standing	51.5	Safe
22	8.6	Sitting	12.3	Standing	44.9	Safe
23	9.4	Sitting	16.6	Walking	71.6	Safe
24	11.8	Standing	18.1	Walking	62.6	Safe
25	14.1	Standing	19.0	Walking	61.8	Safe
26	8.8	Sitting	12.5	Standing	49.3	Safe
27	13.8	Standing	19.1	Walking	68.4	Safe
28	7.2	Sitting	11.1	Standing	44.7	Safe
29	11.5	Standing	15.9	Walking	54.2	Safe
30	11.5	Standing	15.7	Walking	61.7	Safe
31	9.3	Sitting	12.6	Standing	49.5	Safe
32	11.1	Standing	16.9	Walking	62.2	Safe
33	9.5	Sitting	12.4	Standing	54.6	Safe
34	8.9	Sitting	10.9	Standing	44.9	Safe
35	14.5	Standing	21.0	Uncomfortable	67.9	Safe



Guidelines	
Pedestrian Comfort	20% exceedance wind speed 0-10 km/h = Sitting, 10-15 km/h = Standing, 15-20 km/h = Walking, >20 km/h = Uncomfortable
Pedestrian Safety	0.1% exceedance wind speed 0-90 km/h = Safe

TABLE B2: SUMMARY OF PEDESTRIAN COMFORT (PROPOSED SCENARIO)

Sensor	Pedestrian Comfort				Pedestrian Safety	
	Summer		Winter		Annual	
	Wind Speed	Comfort Class	Wind Speed	Comfort Class	Wind Speed	Safety Class
36	15.6	Walking	22.8	Uncomfortable	77.0	Safe
37	14.6	Standing	21.7	Uncomfortable	71.6	Safe
38	13.0	Standing	19.0	Walking	56.6	Safe
39	11.8	Standing	16.0	Walking	56.4	Safe
40	10.7	Standing	15.7	Walking	53.2	Safe
41	8.5	Sitting	12.2	Standing	45.0	Safe
42	6.4	Sitting	9.2	Sitting	34.9	Safe
43	7.6	Sitting	10.7	Standing	41.0	Safe
44	9.3	Sitting	13.4	Standing	53.3	Safe
45	12.9	Standing	19.9	Walking	67.8	Safe
46	8.5	Sitting	13.1	Standing	48.5	Safe
47	8.4	Sitting	11.7	Standing	40.2	Safe
48	7.4	Sitting	10.0	Sitting	35.5	Safe
49	8.7	Sitting	10.7	Standing	38.4	Safe
50	6.2	Sitting	8.7	Sitting	30.5	Safe
51	12.4	Standing	18.3	Walking	63.4	Safe
52	16.5	Walking	21.5	Uncomfortable	68.2	Safe
53	9.4	Sitting	13.2	Standing	46.8	Safe
54	8.1	Sitting	10.1	Standing	37.0	Safe
55	11.9	Standing	17.8	Walking	53.8	Safe
56	8.6	Sitting	13.7	Standing	49.2	Safe
57	8.3	Sitting	11.8	Standing	40.8	Safe
58	7.8	Sitting	11.1	Standing	40.4	Safe
59	10.4	Standing	15.6	Walking	58.9	Safe
60	9.6	Sitting	12.5	Standing	46.4	Safe
61	9.5	Sitting	18.0	Walking	64.6	Safe
62	9.6	Sitting	12.2	Standing	50.4	Safe
63	7.8	Sitting	11.2	Standing	42.0	Safe
64	9.3	Sitting	13.3	Standing	43.6	Safe
65	8.9	Sitting	13.2	Standing	48.1	Safe
66	6.0	Sitting	8.9	Sitting	33.4	Safe
67	13.3	Standing	17.8	Walking	62.3	Safe
68	11.7	Standing	13.9	Standing	71.4	Safe
69	12.0	Standing	15.4	Walking	70.9	Safe
70	12.0	Standing	19.9	Walking	71.5	Safe




Guidelines	
Pedestrian Comfort	20% exceedance wind speed 0-10 km/h = Sitting, 10-15 km/h = Standing, 15-20 km/h = Walking, >20 km/h = Uncomfortable
Pedestrian Safety	0.1% exceedance wind speed 0-90 km/h = Safe

TABLE B3: SUMMARY OF PEDESTRIAN COMFORT (PROPOSED SCENARIO)

Sensor	Pedestrian Comfort				Pedestrian Safety	
	Summer		Winter		Annual	
	Wind Speed	Comfort Class	Wind Speed	Comfort Class	Wind Speed	Safety Class
71	11.0	Standing	14.8	Standing	71.3	Safe
72	11.8	Standing	18.9	Walking	85.4	Safe
73	13.4	Standing	20.5	Uncomfortable	72.5	Safe

GRADIENTWIND

ENGINEERS & SCIENTISTS

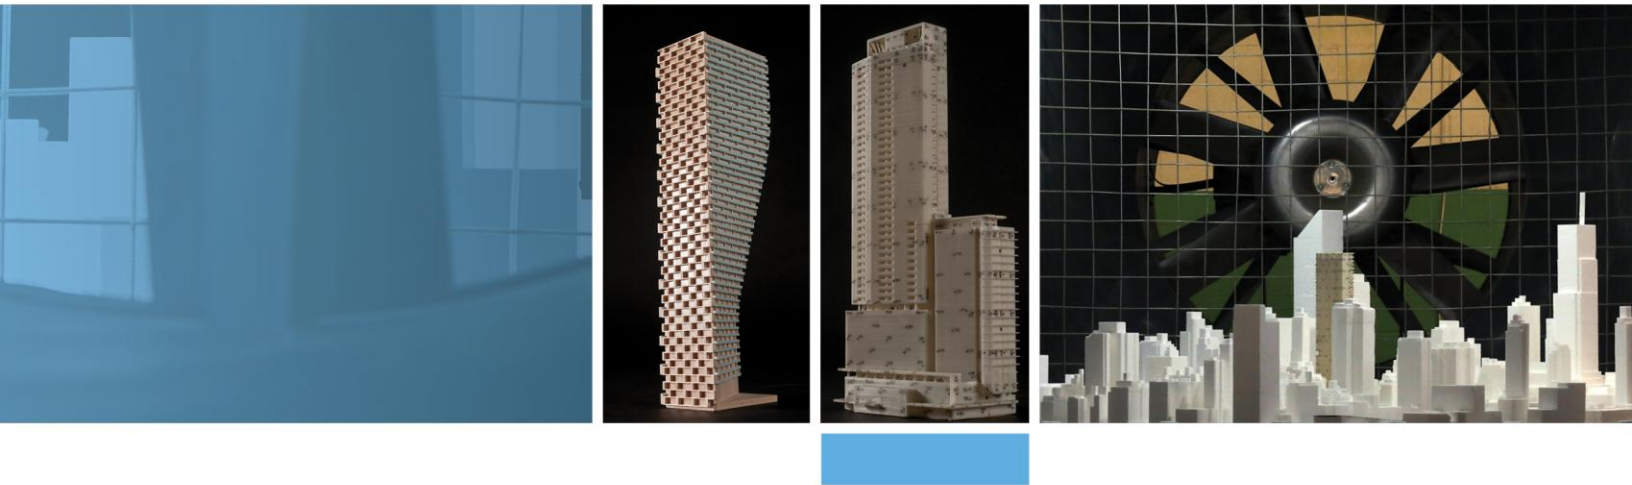

APPENDIX C

WIND TUNNEL SIMULATION OF THE NATURAL WIND

WIND TUNNEL SIMULATION OF THE NATURAL WIND

Wind flowing over the surface of the earth develops a boundary layer due to the drag produced by surface features such as vegetation and man-made structures. Within this boundary layer, the mean wind speed varies from zero at the surface to the gradient wind speed at the top of the layer. The height of the top of the boundary layer is referred to as the gradient height, above which the velocity remains more-or-less constant for a given synoptic weather system. The mean wind speed is taken to be the average value over one hour. Superimposed on the mean wind speed are fluctuating (or turbulent) components in the longitudinal (i.e. along wind), vertical and lateral directions. Although turbulence varies according to the roughness of the surface, the turbulence level generally increases from nearly zero (smooth flow) at gradient height to maximum values near the ground. While for a calm ocean the maximum could be 20%, the maximum for a very rough surface such as the center of a city could be 100%, or equal to the local mean wind speed. The height of the boundary layer varies in time and over different terrain roughness within the range of 400 metres (m) to 600 m.

Simulating real wind behaviour in a wind tunnel requires simulating the variation of mean wind speed with height, simulating the turbulence intensity, and matching the typical length scales of turbulence. It is the ratio between wind tunnel turbulence length scales and turbulence scales in the atmosphere that determines the geometric scales that models can assume in a wind tunnel. Hence, when a 1:200 scale model is quoted, this implies that the turbulence scales in the wind tunnel and the atmosphere have the same ratios. Some flexibility in this requirement has been shown to produce reasonable wind tunnel predictions compared to full scale. In model scale the mean and turbulence characteristics of the wind are obtained with the use of spires at one end of the tunnel and roughness elements along the floor of the tunnel. The fan is located at the model end and wind is pulled over the spires, roughness elements and model. It has been found that, to a good approximation, the mean wind profile can be represented by a power law relation, shown below, giving height above ground versus wind speed.

$$U = U_g \left(\frac{Z}{Z_g} \right)^\alpha$$

Where; U = mean wind speed, U_g = gradient wind speed, Z = height above ground, Z_g = depth of the boundary layer (gradient height) and α is the power law exponent.

Figure B1 on the following page plots three velocity profiles for open country, and suburban and urban exposures.


The exponent α varies according to the type of upwind terrain; α ranges from 0.14 for open country to 0.33 for an urban exposure. Figure C2 illustrates the theoretical variation of turbulence for open country, suburban and urban exposures.

The integral length scale of turbulence can be thought of as an average size of gust in the atmosphere. Although it varies with height and ground roughness, it has been found to generally be in the range of 100 m to 200 m in the upper half of the boundary layer. Thus, for a 1:300 scale, the model value should be between 1/3 and 2/3 of a metre. Integral length scales are derived from power spectra, which describe the energy content of wind as a function of frequency. There are several ways of determining integral length scales of turbulence. One way is by comparison of a measured power spectrum in model scale to a non-dimensional theoretical spectrum such as the Davenport spectrum of longitudinal turbulence. Using the Davenport spectrum, which agrees well with full-scale spectra, one can estimate the integral scale by plotting the theoretical spectrum with varying L until it matches as closely as possible the measured spectrum:

$$f \times S(f) = \frac{\frac{4(Lf)^2}{U_{10}^2}}{\left[1 + \frac{4(Lf)^2}{U_{10}^2}\right]^{\frac{4}{3}}}$$

Where, f is frequency, $S(f)$ is the spectrum value at frequency f , U_{10} is the wind speed 10 m above ground level, and L is the characteristic length of turbulence.

Once the wind simulation is correct, the model, constructed to a suitable scale, is installed at the center of the working section of the wind tunnel. Different wind directions are represented by rotating the model to align with the wind tunnel center-line axis.

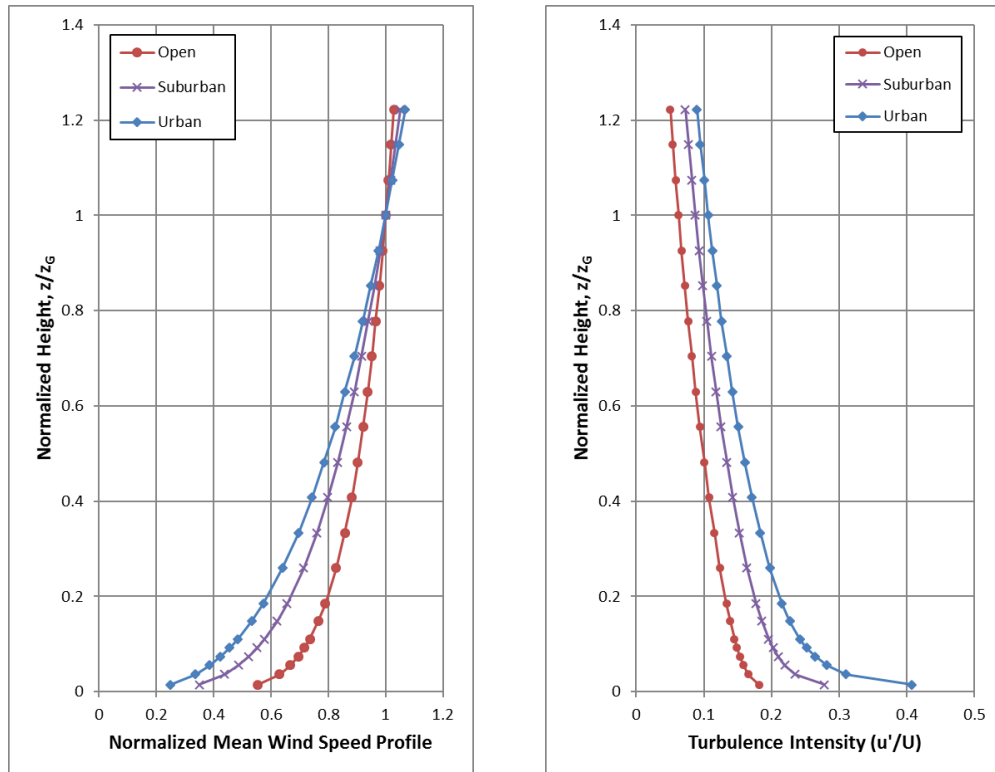


**FIGURE C1 (LEFT): MEAN WIND SPEED PROFILES;
 FIGURE C2 (RIGHT): TURBULENCE INTENSITY PROFILES**

REFERENCES

1. Teunissen, H.W., 'Characteristics of The Mean Wind And Turbulence In The Planetary Boundary Layer', Institute For Aerospace Studies, University Of Toronto, UTIAS # 32, Oct. 1970
2. Flay, R.G., Stevenson, D.C., 'Integral Length Scales in an Atmospheric Boundary Layer Near The Ground', 9th Australian Fluid Mechanics Conference, Auckland, Dec. 1966
3. ESDU, 'Characteristics of Atmospheric Turbulence Near the Ground', 74030
4. Bradley, E.F., Coppin, P.A., Katen, P.C., '*Turbulent Wind Structure Above Very Rugged Terrain*', 9th Australian Fluid Mechanics Conference, Auckland, Dec. 1966

GRADIENTWIND

ENGINEERS & SCIENTISTS

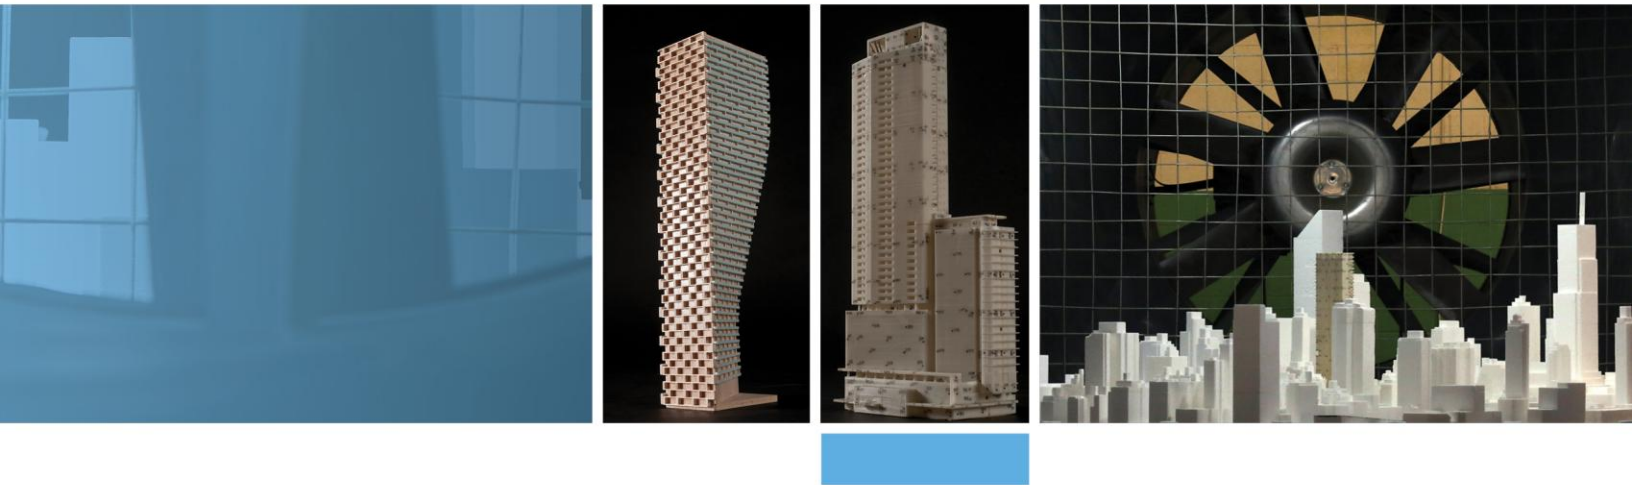

APPENDIX D

PEDESTRIAN LEVEL WIND MEASUREMENT METHODOLOGY

PEDESTRIAN LEVEL WIND MEASUREMENT METHODOLOGY

Pedestrian level wind studies are performed in a wind tunnel on a physical model of the study buildings at a suitable scale. Instantaneous wind speed measurements are recorded at a model height corresponding to 1.5 m full scale using either a hot wire anemometer or a pressure-based transducer. Measurements are performed at any number of locations on the model and usually for 36 wind directions. For each wind direction, the roughness of the upwind terrain is matched in the wind tunnel to generate the correct mean and turbulent wind profiles approaching the model.

The hot wire anemometer is an instrument consisting of a thin metallic wire conducting an electric current. It is an omni-directional device equally sensitive to wind approaching from any direction in the horizontal plane. By compensating for the cooling effect of wind flowing over the wire, the associated electronics produce an analog voltage signal that can be calibrated against velocity of the air stream. For all measurements, the wire is oriented vertically so as to be sensitive to wind approaching from all directions in a horizontal plane.

The pressure sensor is a small cylindrical device that measures instantaneous pressure differences over a small area. The sensor is connected via tubing to a transducer that translates the pressure to a voltage signal that is recorded by computer. With appropriately designed tubing, the sensor is sensitive to a suitable range of fluctuating velocities.

For a given wind direction and location on the model, a time history of the wind speed is recorded for a period of time equal to one hour in full-scale. The analog signal produced by the hot wire or pressure sensor is digitized at a rate of 400 samples per second. A sample recording for several seconds is illustrated in Figure D1. This data is analyzed to extract the mean, root-mean-square (rms) and the peak of the signal. The peak value, or gust wind speed, is formed by averaging a number of peaks obtained from sub-intervals of the sampling period. The mean and gust speeds are then normalized by the wind tunnel gradient wind speed, which is the speed at the top of the model boundary layer, to obtain mean and gust ratios. At each location, the measurements are repeated for 36 wind directions to produce normalized polar plots, which will be provided upon request.

In order to determine the duration of various wind speeds at full scale for a given measurement location the gust ratios are combined with a statistical (mathematical) model of the wind climate for the project site. This mathematical model is based on hourly wind data obtained from one or more meteorological stations (usually airports) close to the project location. The probability model used to represent the data is the Weibull distribution expressed as:

$$P(> U_g) = A_\theta \cdot \exp \left[\left(-\frac{U_g}{C_\theta} \right)^{K_\theta} \right]$$

Where,

$P(> U_g)$ is the probability, fraction of time, that the gradient wind speed U_g is exceeded; θ is the wind direction measured clockwise from true north, A , C , K are the Weibull coefficients, (Units: A - dimensionless, C - wind speed units [km/h] for instance, K - dimensionless). A_θ is the fraction of time wind blows from a 10° sector centered on θ .

Analysis of the hourly wind data recorded for a length of time, on the order of 10 to 30 years, yields the A_θ , C_θ and K_θ values. The probability of exceeding a chosen wind speed level, say 20 km/h, at sensor N is given by the following expression:

$$P_N(> 20) = \sum_\theta P \left[\frac{(> 20)}{\left(\frac{U_N}{U_g} \right)} \right]$$

$$P_N(> 20) = \sum_\theta P \{ > 20 / (U_N / U_g) \}$$

Where, U_N / U_g is the gust velocity ratios, where the summation is taken over all 36 wind directions at 10° intervals.

If there are significant seasonal variations in the weather data, as determined by inspection of the C_θ and K_θ values, then the analysis is performed separately for two or more times corresponding to the groupings of seasonal wind data. Wind speed levels of interest for predicting pedestrian comfort are based on the comfort guidelines chosen to represent various pedestrian activity levels as discussed in the main text.

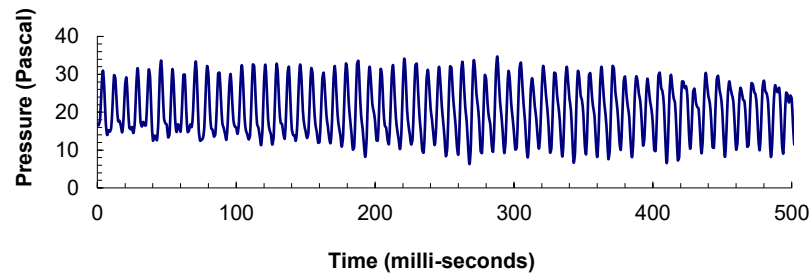


FIGURE D1: TIME VERSUS VELOCITY TRACE FOR A TYPICAL WIND SENSOR

REFERENCES

1. Davenport, A.G., '*The Dependence of Wind Loading on Meteorological Parameters*', Proc. of Int. Res. Seminar, Wind Effects on Buildings & Structures, NRC, Ottawa, 1967, University of Toronto Press.
2. Wu, S., Bose, N., '*An Extended Power Law Model for the Calibration of Hot-wire/Hot-film Constant Temperature Probes*', Int. J. of Heat Mass Transfer, Vol.17, No.3, pp.437-442, Pergamon Press.